


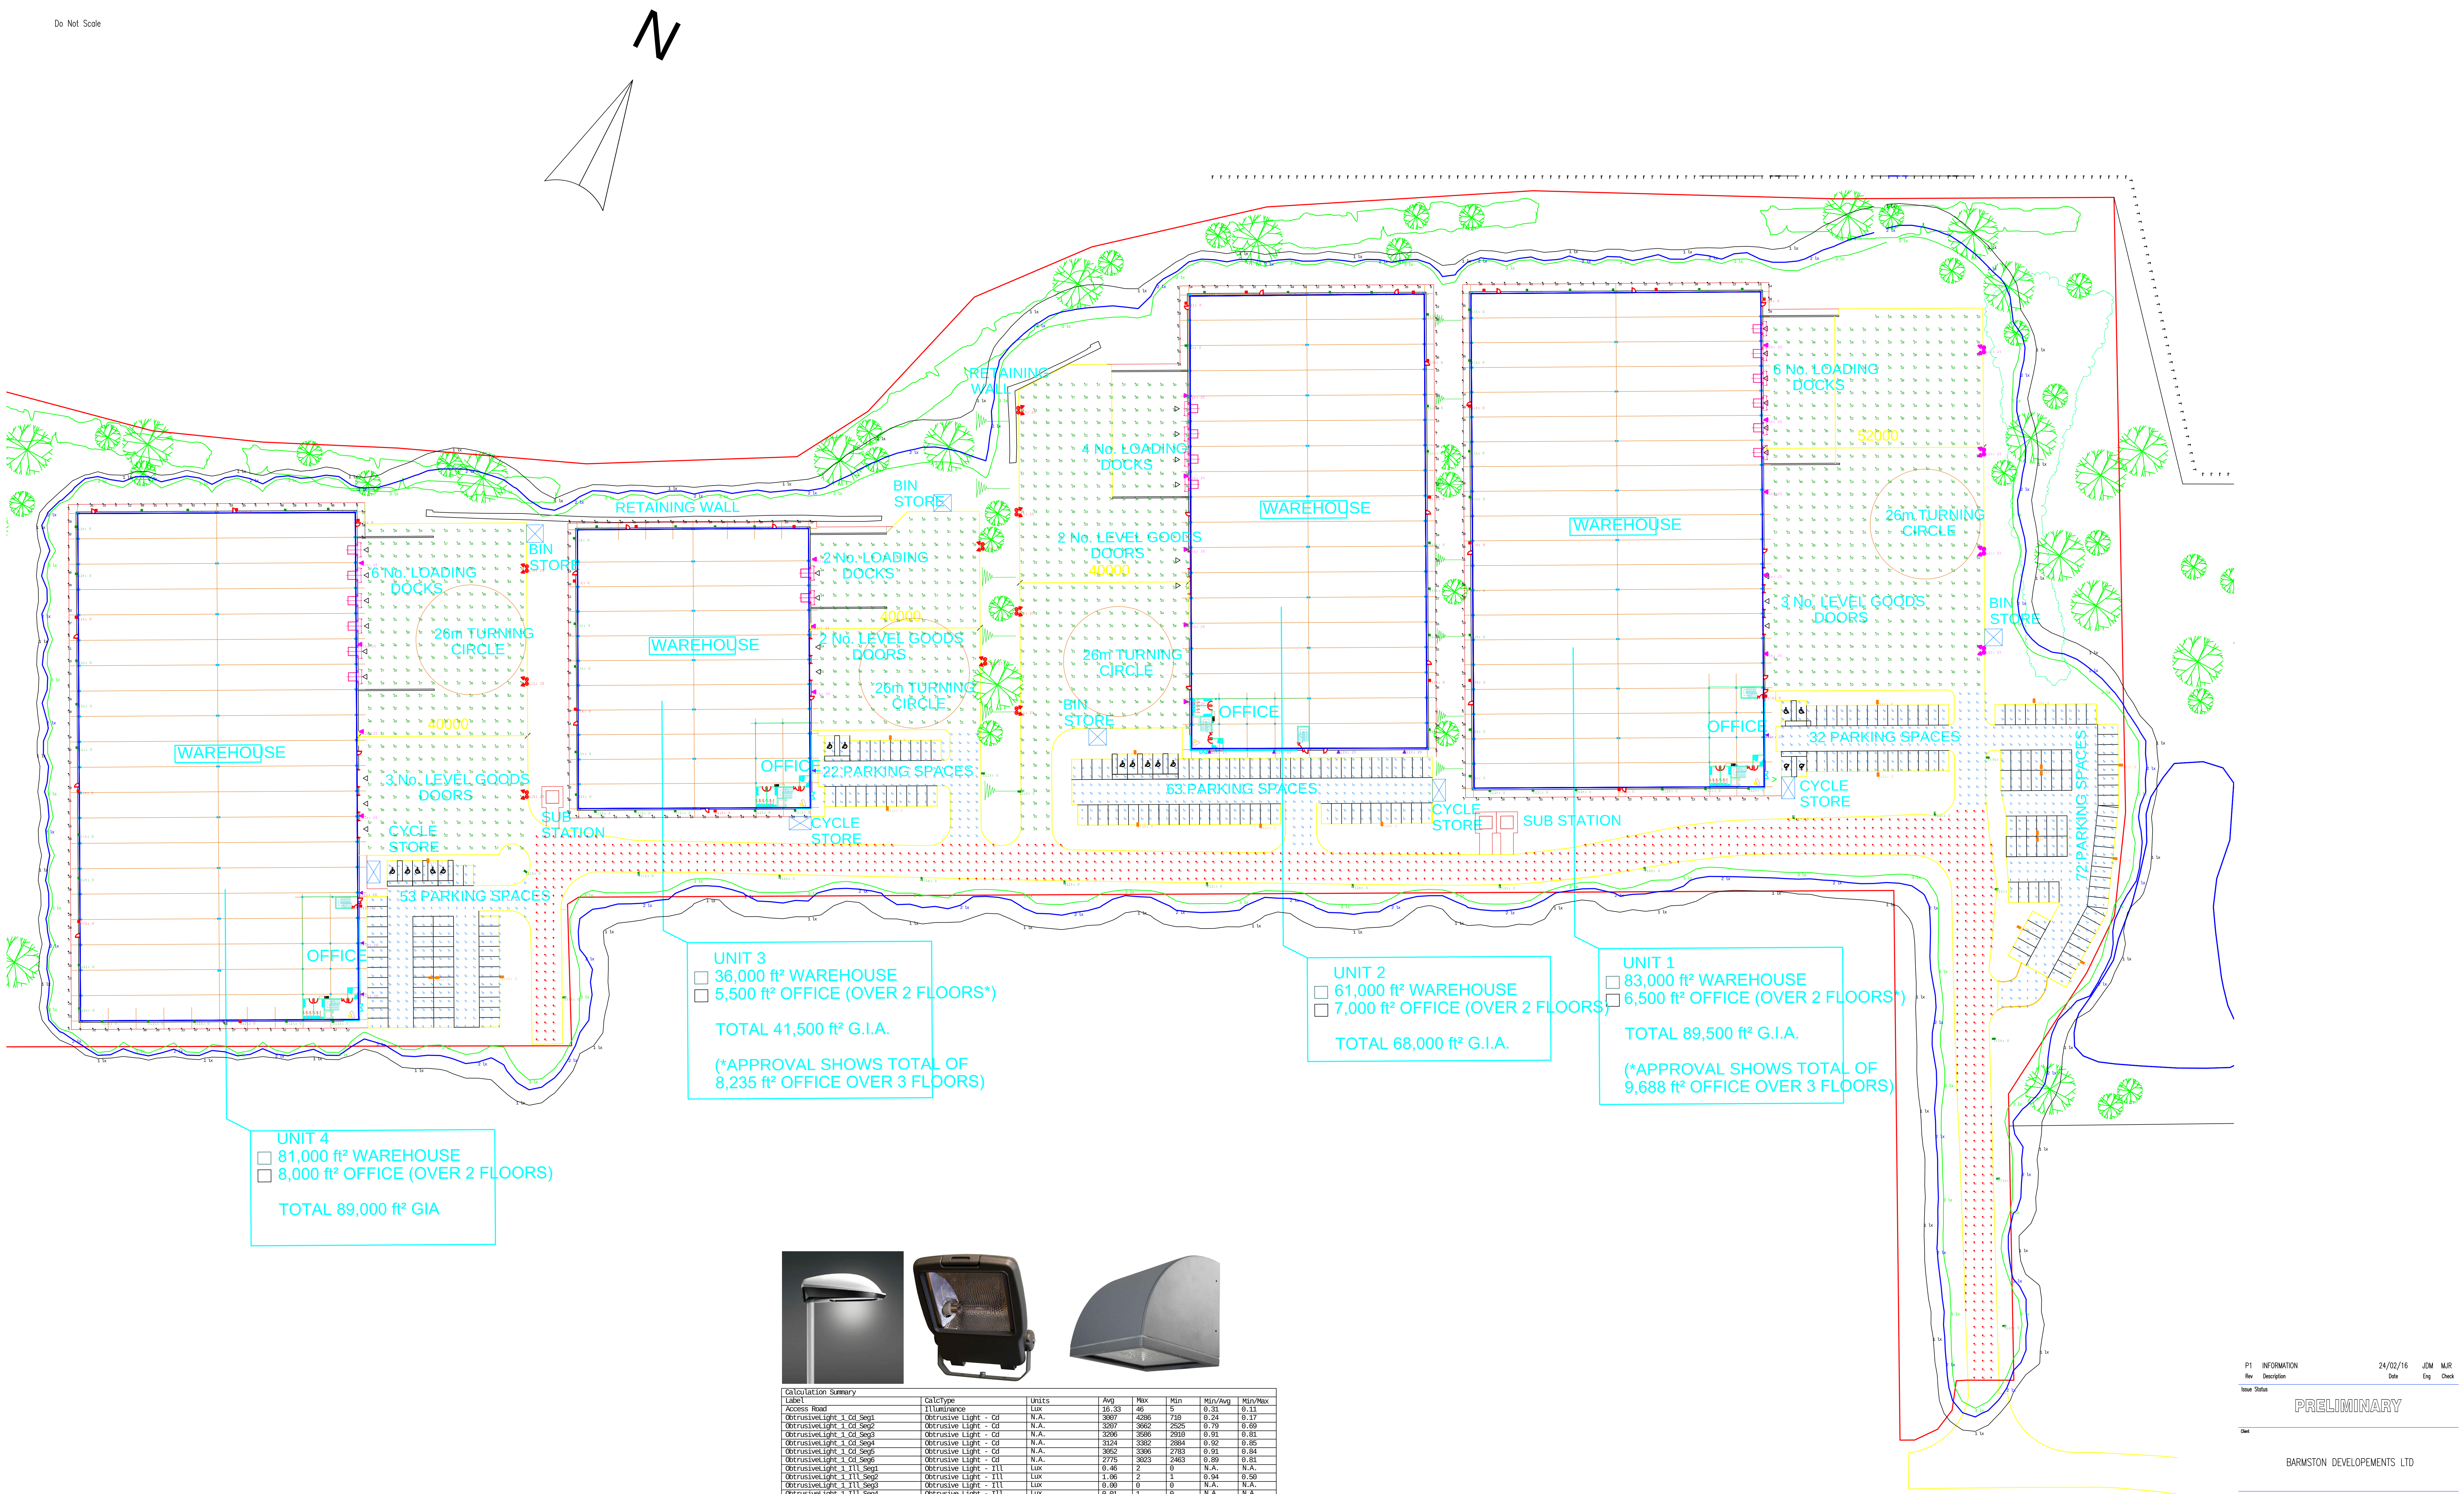

Calculation Summary									
Label	Qty	CalcType	Units	Avg	Max	Min	Min/Avg	Min/Max	
Access Road	1	Illuminance	Lux	16.33	46	5	0.31	0.11	
ObtrusiveLight - 1 Cd Seq1	1	Obtrusive Light - Cd	N.A.	3067	4286	716	0.24	0.17	
ObtrusiveLight - 1 Cd Seq2	1	Obtrusive Light - Cd	N.A.	3067	3662	2525	0.79	0.69	
ObtrusiveLight - 1 Cd Seq3	1	Obtrusive Light - Cd	N.A.	3066	3662	2510	0.91	0.81	
ObtrusiveLight - 1 Cd Seq4	1	Obtrusive Light - Cd	N.A.	3124	3382	2884	0.92	0.85	
ObtrusiveLight - 1 Cd Seq5	1	Obtrusive Light - Cd	N.A.	3652	3386	2783	0.91	0.84	
ObtrusiveLight - 1 Cd Seq6	1	Obtrusive Light - Cd	N.A.	2775	3823	2463	0.88	0.81	
ObtrusiveLight - 1 TL Seq1	1	Obtrusive Light - TL	Lux	0.46	2	0	N.A.	N.A.	
ObtrusiveLight - 1 TL Seq2	1	Obtrusive Light - TL	Lux	1.06	2	1	0.54	0.50	
ObtrusiveLight - 1 TL Seq3	1	Obtrusive Light - TL	Lux	0.00	0	0	N.A.	N.A.	
ObtrusiveLight - 1 TL Seq4	1	Obtrusive Light - TL	Lux	0.01	1	0	N.A.	N.A.	
ObtrusiveLight - 1 TL Seq5	1	Obtrusive Light - TL	Lux	0.42	1	0	N.A.	N.A.	
ObtrusiveLight - 1 TL Seq6	1	Obtrusive Light - TL	Lux	0.00	0	0	N.A.	N.A.	
Unit 1 Car Park	1	Illuminance	Lux	21.78	59	6	0.28	0.10	
Unit 1 Perimeter	1	Illuminance	Lux	21.95	58	6	0.27	0.10	
Unit 1 Service Yard	1	Illuminance	Lux	34.50	71	14	0.41	0.20	
Unit 2 Car Park	1	Illuminance	Lux	21.13	58	7	0.33	0.12	
Unit 2 Perimeter	1	Illuminance	Lux	22.17	51	6	0.27	0.12	
Unit 2 Service Yard	1	Illuminance	Lux	33.75	76	14	0.41	0.18	
Unit 3 Car Park	1	Illuminance	Lux	24.41	64	9	0.37	0.16	
Unit 3 Perimeter	1	Illuminance	Lux	25.61	58	7	0.27	0.12	
Unit 3 Service Yard	1	Illuminance	Lux	32.88	78	14	0.43	0.18	
Unit 4 Car Park	1	Illuminance	Lux	21.75	56	6	0.28	0.11	
Unit 4 Perimeter	1	Illuminance	Lux	26.22	56	5	0.25	0.09	
Unit 4 Service Yard	1	Illuminance	Lux	39.34	77	12	0.40	0.16	

Luminaire Schedule				
Symbol	Qty	Label	Arrangement	Description
1	1	A	SINGLE	150w CDO-TT Kios 1 Road lantern (P8 lamp position) column mounted at 6m
34	1	A Spill	SINGLE	150w CDO-TT Kios 1 Road lantern with Spill Shield (P8 lamp position) column mounted at 6m
32	1	B	SINGLE	100w CDO-TT Kios 1 Road lantern (P1 lamp position) column mounted at 6m
7	1	B Spill	SINGLE	100w CDO-TT Kios 1 Road lantern with Spill Shield (P8 lamp position) column mounted at 6m
3	1	B2	BACK-2-2	2 x 70w CDO-TT Kios 1 Road lantern (P8 lamp position) column mounted at 6m
37	1	OW	SINGLE	250w CDO-T Aludra Floodlight column mounted at 6m
10	1	OW	TWIN 20 DEGREE	2 x 150w CDO-T Aludra Floodlight column mounted at 6m
9	1	OW	SINGLE	70w CDO-T Aludra Floodlight column mounted at 6m
4	1	P2	TWIN 20 DEGREE	2 x 250w CDO-T Aludra Floodlight column mounted at 10m
63	1	OW	SINGLE	40w PL Quarto bulkhead light mounted at 3.5m
27	1	OW	SINGLE	40w PL Quarto emergency bulkhead light mounted at 3.5m

P1	INFORMATION	24/02/16	JDM	MJR
Rev	Description	Date	Eng	Check
Issue Status				

PRELIMINARY

BARMSTON DEVELOPMENTS LTD

MRB
Unit 1 Waterside
Old Botton Road
Wetherby
LS22 5AB
Tel: 01937 585082
email: office@mrb.uk.net

Project
GLADMAN PARK
TANKERSLEY

Drawn
NUL
Date
FEB.16
Scale
1:500@A0

Job No
W631
Day No
EX001
Rev
P1