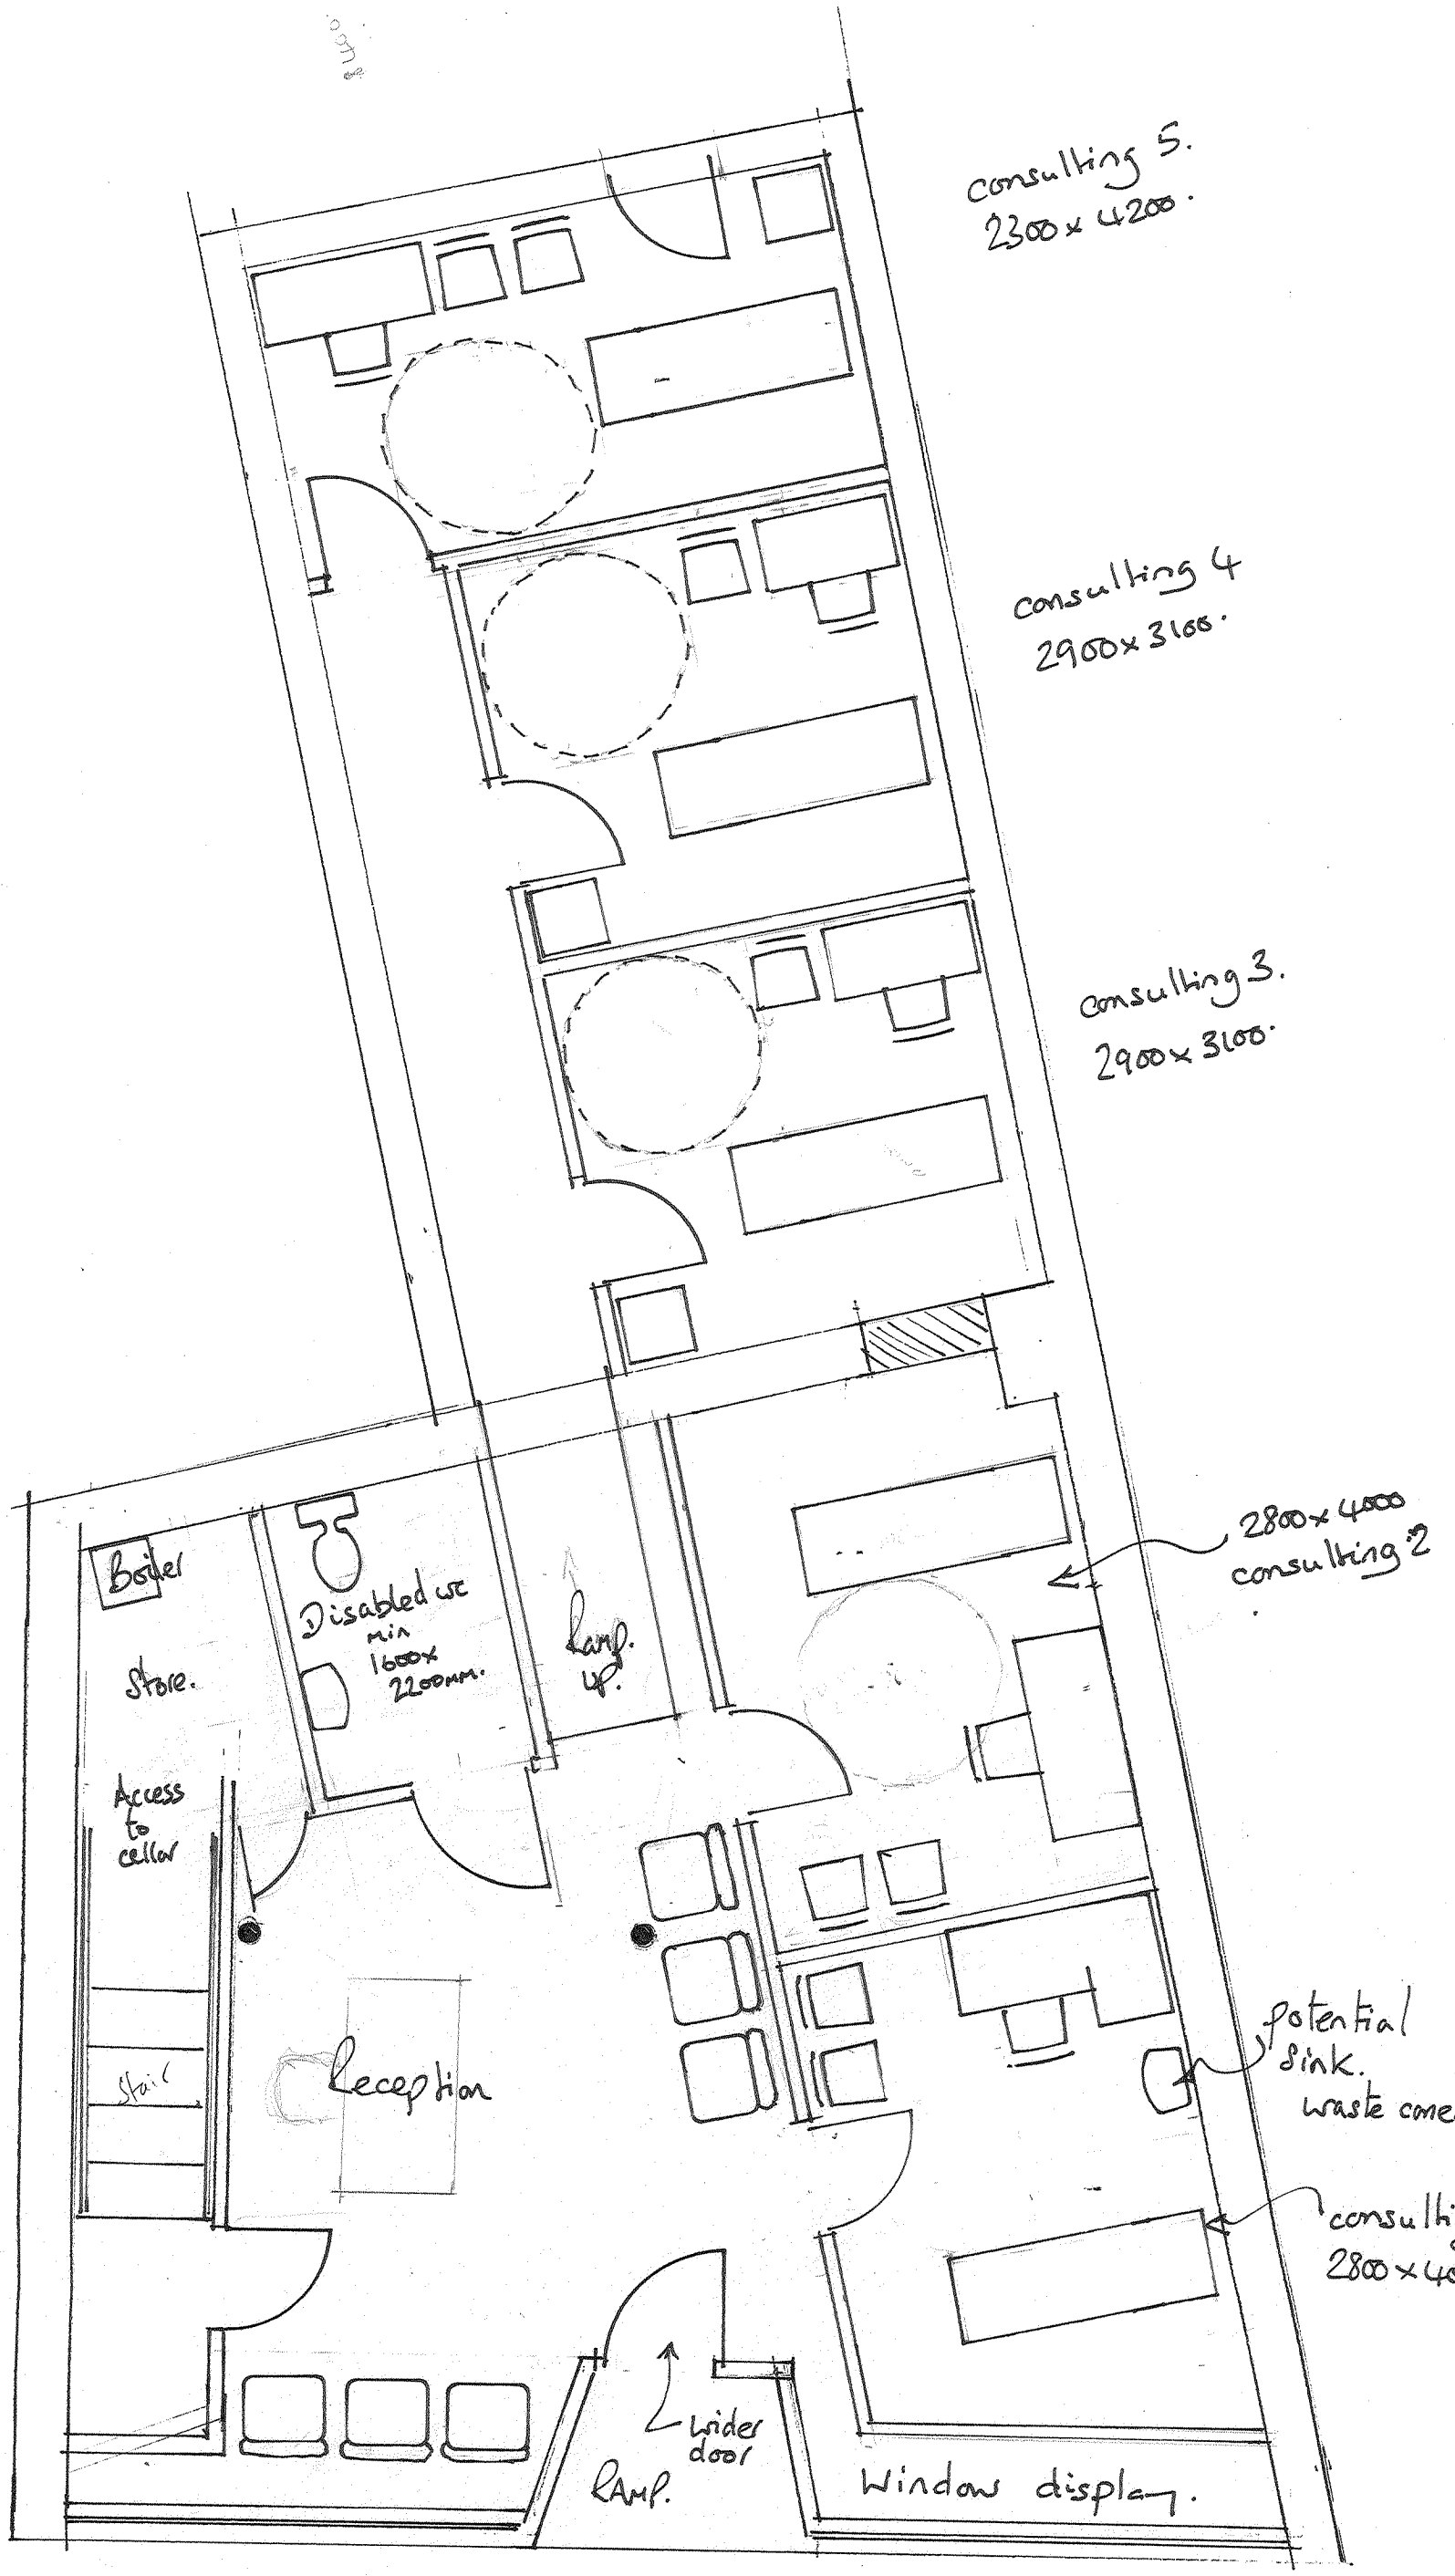


OPTION 1 - GROUND FLOOR

single entry + fire exit at front should be compliant as travel distance to furthest room less than 18m max.