
© COPYRIGHT D
do not scale

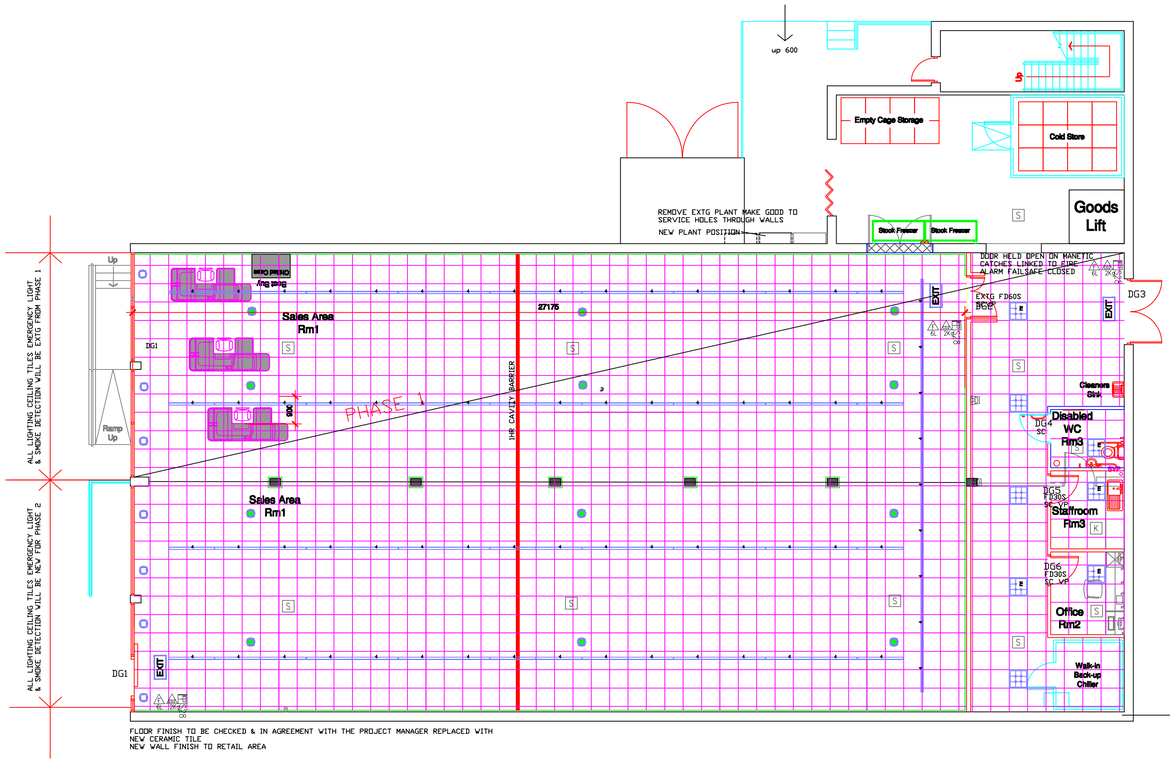

INVERTED CEILING & FIRE PLAN


Note: Existing staff facilities to be retained and utilised until new are constructed in adjacent unit as part of store extension.

CHECK WITH PROJECT MANAGER IS A NEW HAND DRYER REQUIRED IN THE EXTG WC

ALL MECHANICAL VENTILATION TO BE CHECKED CONFIRMED SLL IN WORKING ORDER AND FUNCTIONING CORRECTLY
IN DISCUSSION WITH PROJECT MANAGER WAL CLEANED DOWN MADE GOOD & RE-DECORATED COLOUR MAGNOLIA
ALL SMOKE ALARMS SMOKE DETECTORS TO BE UPGRADED


Note: Existing staff facilities to be retained and utilised until new are constructed in adjacent unit as part of store extension.

Surface Mount LED TRUNK 60w 6000lm	73
600x600 LED 40W 5000lm	3
AS ABOVE WITH EMERGENCY LIGHT	5
EMERGENCY EXIT LED SLAVE	1
6W LED DOWNLIGHTER	6
RECESSED LED DOWNLIGHTER 6W 500lm	4
13AMP DOUBLE SOCKETS	1

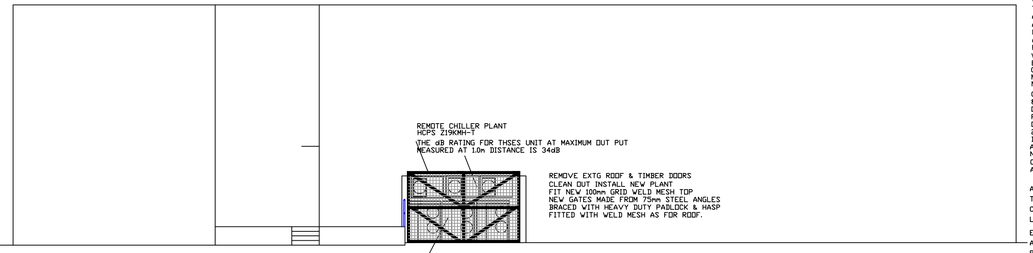

EAST ELEVATION AS PROPOSED

PUHZ.RP.140VHA2/YHA2
COMFORT COOLING PLANT
THE DECIBEL RATING FOR THESE UNITS IS 52dB
THIS IS AT MAXIMUM THE ONLY TIME THESE MACHINES REACH MAXIMUM IS AT MID-DAY ON THE HOTTEST DAYS OF THE YEAR
THE MEASUREMENTS ARE AT A DISTANCE OF 1.0m THE DISAPATION DECREASES BY 6dB AS YOU DOUBLE THE DISTANCE
SO AT 4.0m THE dB RATING AT MAXIMUM IS 40dB

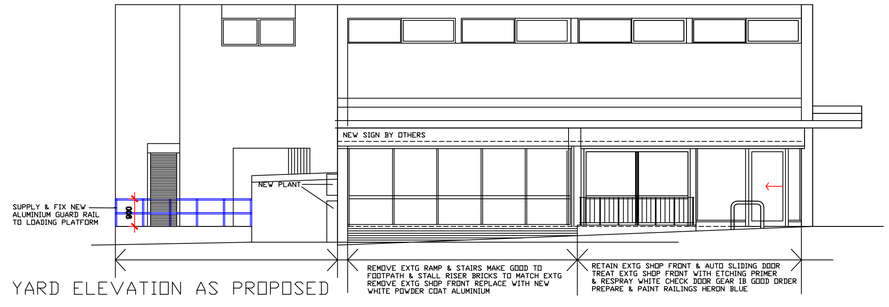

YARD ELEVATION AS PROPOSED

NORTH ELEVATION TO STREET AS PROPOSED

THERE ARE NO WORKS PROPOSED TO THE SOUTH & WEST ELEVATIONS

DOOR SCHEDULE IRONMONGERY SAA GOOD QUALITY	
DG1	EXTG ENTRANCE DOOR POSITION & SIZE RETAINED - FULL NEW WHITE POWDER COAT ALUMINIUM SHOP FRONTTO REPLACE THE EXTG RED SHOP FRONT
DG2	EXTG DOOR
DG3	EXTG FIRE ESCAPE DOOR
DG4, 5 & 6	NEW SOLID CORE DOORS & FRAMES PAINT FINISH GARDENIA WITH WHITE ARCHETRAVES DG4 FITTED WITH DISABLED BARS & IRONMONGERY DG6 DG5 LOCK

WALLS & AREAS TO BE DEMOLISHED INDICATED IN GREY LINE


REMOVE EXTG CONCRETE RAMP STAIRS & BRICK WALL WITH METAL HANDRAIL
MAKE GOOD TO FOOTPATH
REMOVE EXTG SHOP FRONT INCLUDING ENTRANCE DOOR & FRAME REBUILD STALL RISER IF NECESSARY IF IT LOOKS A MESS AFTER THE RAMP HAS BEEN REMOVED
BUILD IN NEW WHITE POWDER COAT ALUMINIUM SHOP FRONT

**NEW TILL BELL INSTALLATION TO BE PROVIDED WITH TRADITIONAL TYPE ALARM BELL LOCATED IN THE MAIN STOCK ROOM
ONE BELL LOCATED BENEATH EACH CHECKOUT BANK**


IN THE OFFICE AND THE STOCK ROOM WHERE THERE ICL CHECKOUTS ARE BEING INSTALLED AN ADDITIONAL BOXSET IS REQUIRED BELOW THE CENTRAL CHECKOUT BANK FOR TESTER

**NEW CAT6 CABLING TO BE INSTALLED BY ELECTICAL CONTRACTOR TO LINK CHECKOUT POSITIONS BACK TO OFFICE LOCATION IN ACCORDANCE WITH HERON SHOP INFRASTRUCTURE DIAGRAM.
8No DATA CABLES TO BE TERMINATED BELOW EACH CHECKOUT BASE IN RJ45 FACEPLATES WITH 6No RJ45 FACEPLATES MOUNTED WITHIN THE OFFICE & CLEARLY LABELLED SEE DIAGRAM - DATA INFRASTRUCTURE**

**ELECTRICAL SOCKET TO BE INSTALLED ABOVE CEILING TO SERVE CCTV MONITOR AT SHOP ENTRANCE
POSITION TO BE AGREED WITH CCTV CONTRACTOR AFTEC BY PROJECT MANAGER**

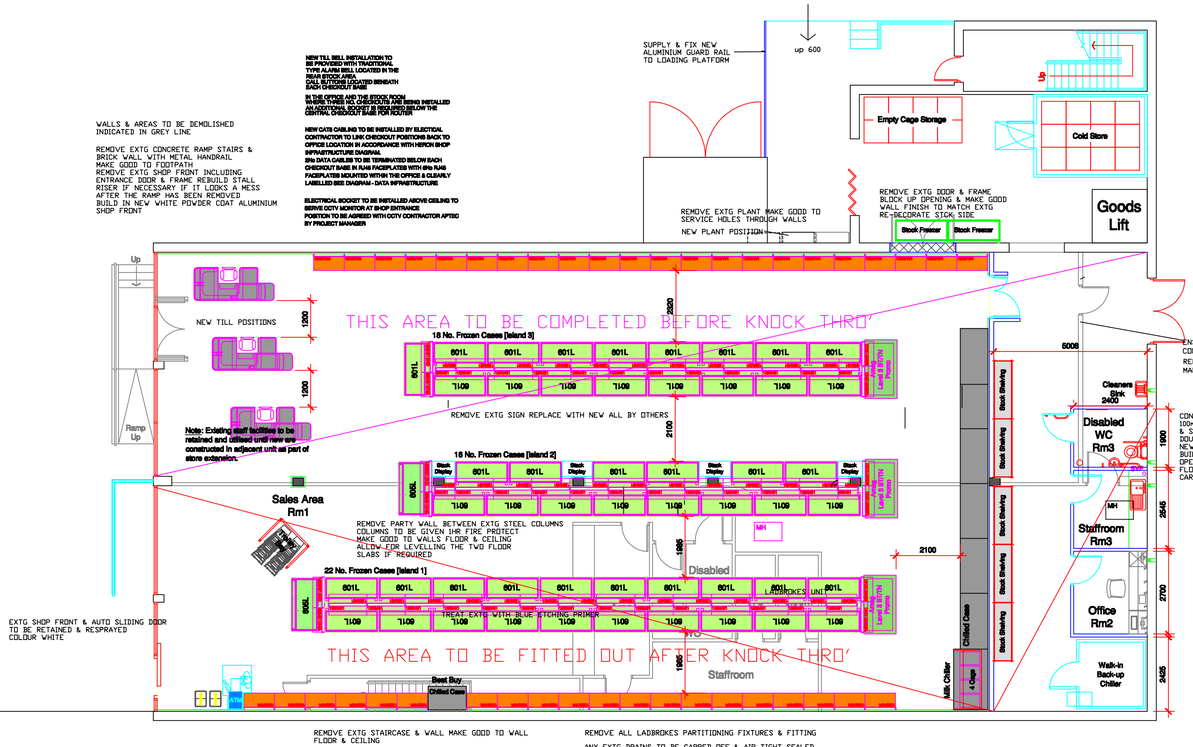

PROPOSED GROUND FLOOR PLAN

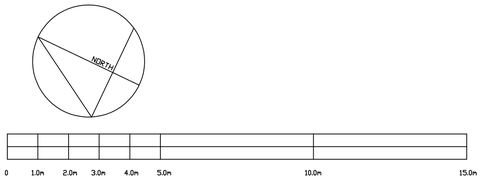

FIRE LEGEND
- ILLUMINATED FIRE EXIT SIGN
- LUMINAIRE, EMERGENCY SELF-CONTAINED.
- K HEAT DETECTOR
- S SMOKE DETECTOR
- S22 'FIRE EXIT' SIGN
- S26 DIRECTION ARROW, GREEN.
- S28 FIRE ALARM CALL POINT, MANUAL
- ALARM BELL
- S20 'FIRE ESCAPE KEEP CLEAR' SIGN
- S25 'PUSH BAR TO OPEN' SIGN
- 2Kg CARBON DIOXIDE FIRE EXTINGUISHER, 2Kg
- 6L WATER TYPE FIRE EXTINGUISHER, 6Ltrs.AFFF
- DRY POWDER FIRE EXTINGUISHER, 3Kg
- FIRE BLANKET

EMERGENCY LIGHTING, FIRE WARNING + FIGHTING SYSTEMS TO BE BY CLIENT
FIRE SIGNAGE BY CLIENT

EMERGENCY FIRE ALARM SOUNDERS
MUST BE AUDIBLE THROUGHOUT THE BUILDIN
VENTILATION TO OFFICE,STAFFROOM & WCS.
MECHANICAL EXTRACT AT 15 ltrs/sec
CONNECTED TO LIGHT SWITCH WITH 15min OV

FIRE DETECTION & ALARM SYSTEM TO BE IN
IN ACCORDANCE WITH BS 5839 Pt8
ESCAPE LIGHTING INSTALLED IN ACCORDANCE
Pt1
FIRE EXIT SIGNS TO BE INSTALLED IN ACCO
BS 5499 Pt1

STRIP OUT EXTG CLADDING CART AWAY
RECLAD MELAMINE FACED WALL LINING PANEL
TO MEET CLASS 1 SURFACE SPREAD OF FLAME
COLOURS ALT ABCT LAMINATE WALL BOARD
COLOUR REF 464 & 466

NEW SUSPENDED CEILING EACH TILE FULLY C
WHITE PAPER FINISH RAL 9016 (NCS S0300-N
TILES CLASS'D' HEIGHT TO SUSP CEILING @7
ALL LIGHTING TO HAVE FIRE SHROUDING TO
ANY SERVICE PASSING THRO THE CEILING MU
FULLY SEALED USING INTUMESCENT FOAM
ANY CLIPS REMOVED DURING FIT OUT MUST B
REPLACED A 1HR FIREPROOF SUSPENDED CEIL
WHERE POSSIBLE SUBCONTRACTOR TO USE
EXISTING SERVICE PIPE HOLES WHERE POSSI
CORE DRILLING NEW HOLES CONTRACTOR AND
MUST LIAISE WITH CENTRE MANAGEMENT OVER
NEW COMFORT COOLING COMPRESSORS

CABLE/PIPE ENTRY SHOULD BE FORMED BY CU
& POINTING WITH AN APPROVED NON SETTINC
ONCE THE PIPE & CABLE WORK HAS BEEN CO
PIPEWORK & CABLES SHALL BE SUPPORTED B
OR CLIPPED IN ACCORDANCE WITH MANUFACTU
25mm CONDENSATE PIPES TO BE FULLY INSUL
DISCHARGE VIA ANTI SPLASH SHOE TO NEARE
ALL PIPEWORK PASSING THRO WALLS &FLOORS
NEATLY SEALED AND FIRESTOPPED.
CLEAN DOWN EXTG WALLS
AND REPAINT OFF WHITE

ALL HEATING COOLING AND LIGHTING
TO BE IN ACCORDANCE WITH L2 AND A
COMPLETION CERTIFICATE ISSUED TO
LOCAL AUTHORITY.

ELECTRICAL INSTALLATION
ALL LIGHT SWITCHES AND SOCKETS ARE TO
POSITIONED BETWEEN 450 & 1200mm FROM FL
LEVEL

**LIGHTING TO COMPLY WITH L2 AND CERTIFIC
TO BE PROVIDED FOR THE BUILDING CONTROL**



1HR FIRE STUD WALL
CONSTRUCTION 100 OR 150mm 'C'
METAL STUD WITH TWO LAYERS
& SKIM FULLY FIRE SEALED

FLOOR FINISH
EXTG FLOOR FINISH RETAINED
FLOOR - LEVELLED USING LEVELLING COMPOU
PRIOR TO LAYING 300x300X12 SWEDECOR VITH
COLOUR ZOTTI BEIGE
~~PRIOR TO LAYING NEW VINYL TILES~~
~~VINYL TILES TO BE 600x600mm POLIFLOR PR~~
~~COLOUR ALABASTER REF 1600~~
~~NOTE ON SOME PROJECTS THE GROUND FLOOR~~
~~BE TIMBER FLOORS THESE ARE TO BE DECKE~~
~~USING 9mm PLY AND TILE USING SUITABLE~~

SEE SCOPE OF WORKS DOCUMENT FOR FLOOR WALL AND CEILING SPECIFICATIONS & SCOPE OF WORKS DOCUMENT

CONTRACTOR TO CARRY OUT FULL ASBESTOS REPORT CATAGORY 3

TIMBER BUMP RAILS SEE DETAIL SH


POWER REQUIREMENT
3 PHASE 80 KVA

TAKE OUT ALL SERVICES BACK TO SWITCHGEA
REMOVE ALL REDUNDANT CABLE FIXTURES
RE-WIRE THROUGHT

ALL GLAZING IN CRITICAL LOCATIONS TO BE
TO PART N OF THE BUILDING REGULATIONS
ALL FIRE DOORS TO HAVE INTUMESCENT STRIP
AND SMOKE SEALS
CIRCULATION SPACES TO HAVE CLASS'D' FINIS
ALL OTHER AREAS TO HAVE CLASS1 OR BETTE

COMPRESSOR SIZES
COMFORT COOLING 1258mmHx970Wx376D

WHERE EQUIPMENT IS MOUNTED ON FLAT ROOF
SHOULD BE MOUNTED ON PAVING SLABS ON
ISOLATOR PADS



TYPICAL MANIFESTATION
LOGO IN VINYL PANEL 200x200mm
POSITIONED NO LOWER THAN 1400mm
AND NO HIGHER THAN 1600mm
THE DOOR STYLES WHITE ACT AS
A CONTRAST TO THE WINDOW GLAZING
BARS WHICH ARE MUCH THINNER.
DRAINAGE:
ABOVE GROUND:
ALL SANITARY WARE TO BE VIA 76mm DEEP
TRAP, ALL PIPEWORK IN uPVC.
WHB'S - 32mm, SINK - 38mm
WC's VIA STUB STACKS WITH AIR ADMITTANC

CLIENT + HERON FOODS LTD
PROJECT + 7-9 KING STREET H
DRAWING + PLAN ELES SECTION AS PROPOSED
JOB NUMBER + 16-17 DRAWING NUMBER +
SCALE + 1-100 @ A1 REVISION +

DEREK MORRIS ARCHITECTS
THE STUDIO + MALT KILN ROAD + FENTON + LINCO
Telephone + 01427 718910 Email + info@derel