




IMPERMEABLE AREAS

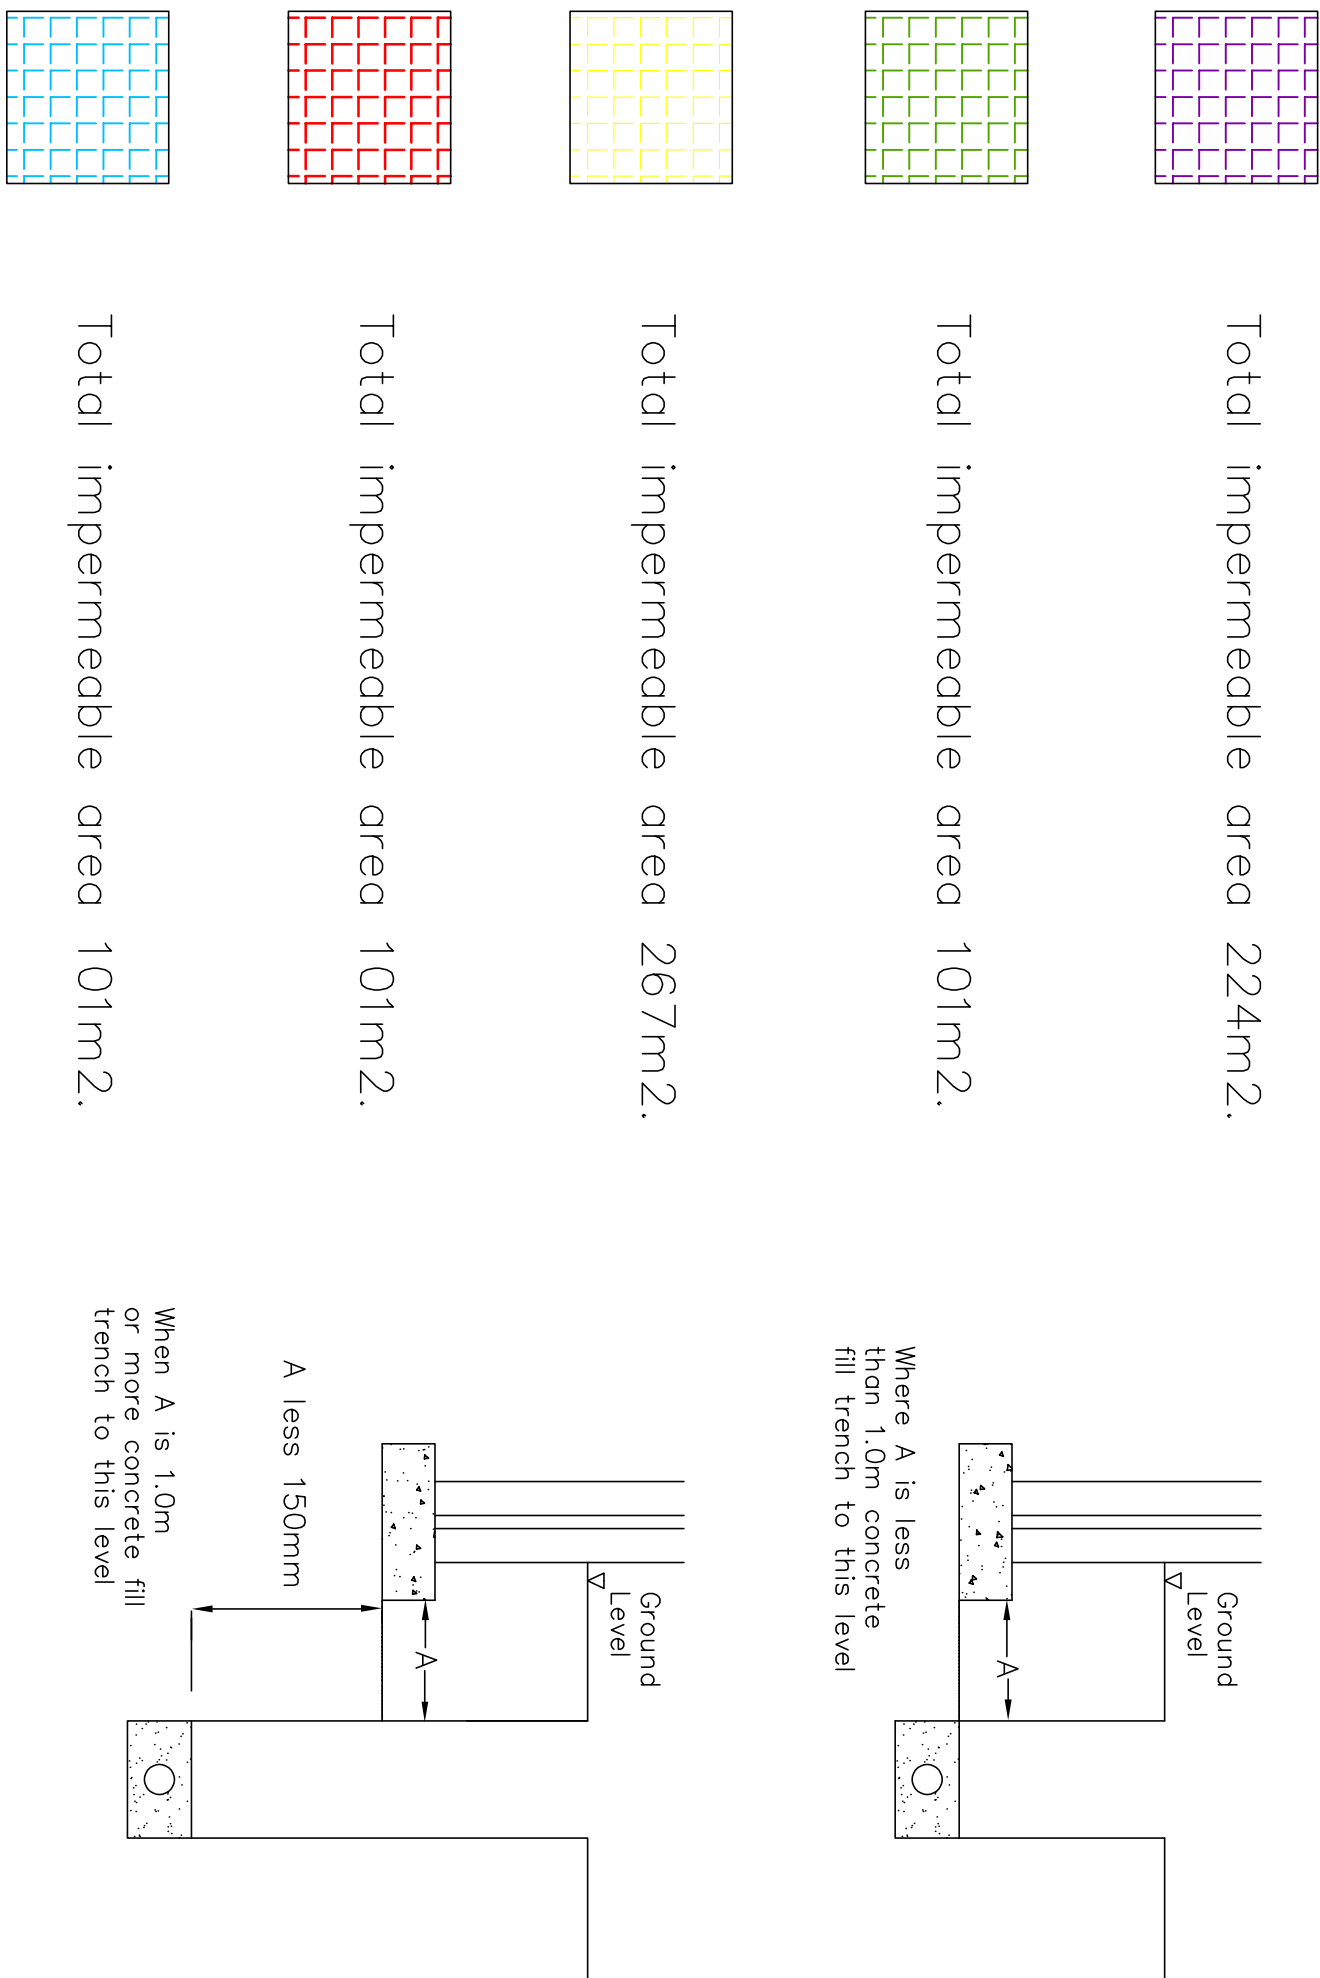

NOTES

All works to comply with Building Regulations Approved document Part H.

Drainage points shown are approximate and should be checked against the house type working drawings.

All existing drainage to be checked for line and level prior to commencement.

Invert levels shown indicate the invert level of the main channel within the chamber. Branches connect at +50mm. At changes of direction the main channel is to be used with bends outside the chamber. Branches not to be used for changes of direction.


Floor Levels/Invert Levels shown are indicative only

Sookaways are to be sited a minimum of 5m away from buildings

It is assumed that the strata is uniform with no signs of filled material/clay layers/ground water when the infiltration tests were carried out.



DRAINAGE DESIGN

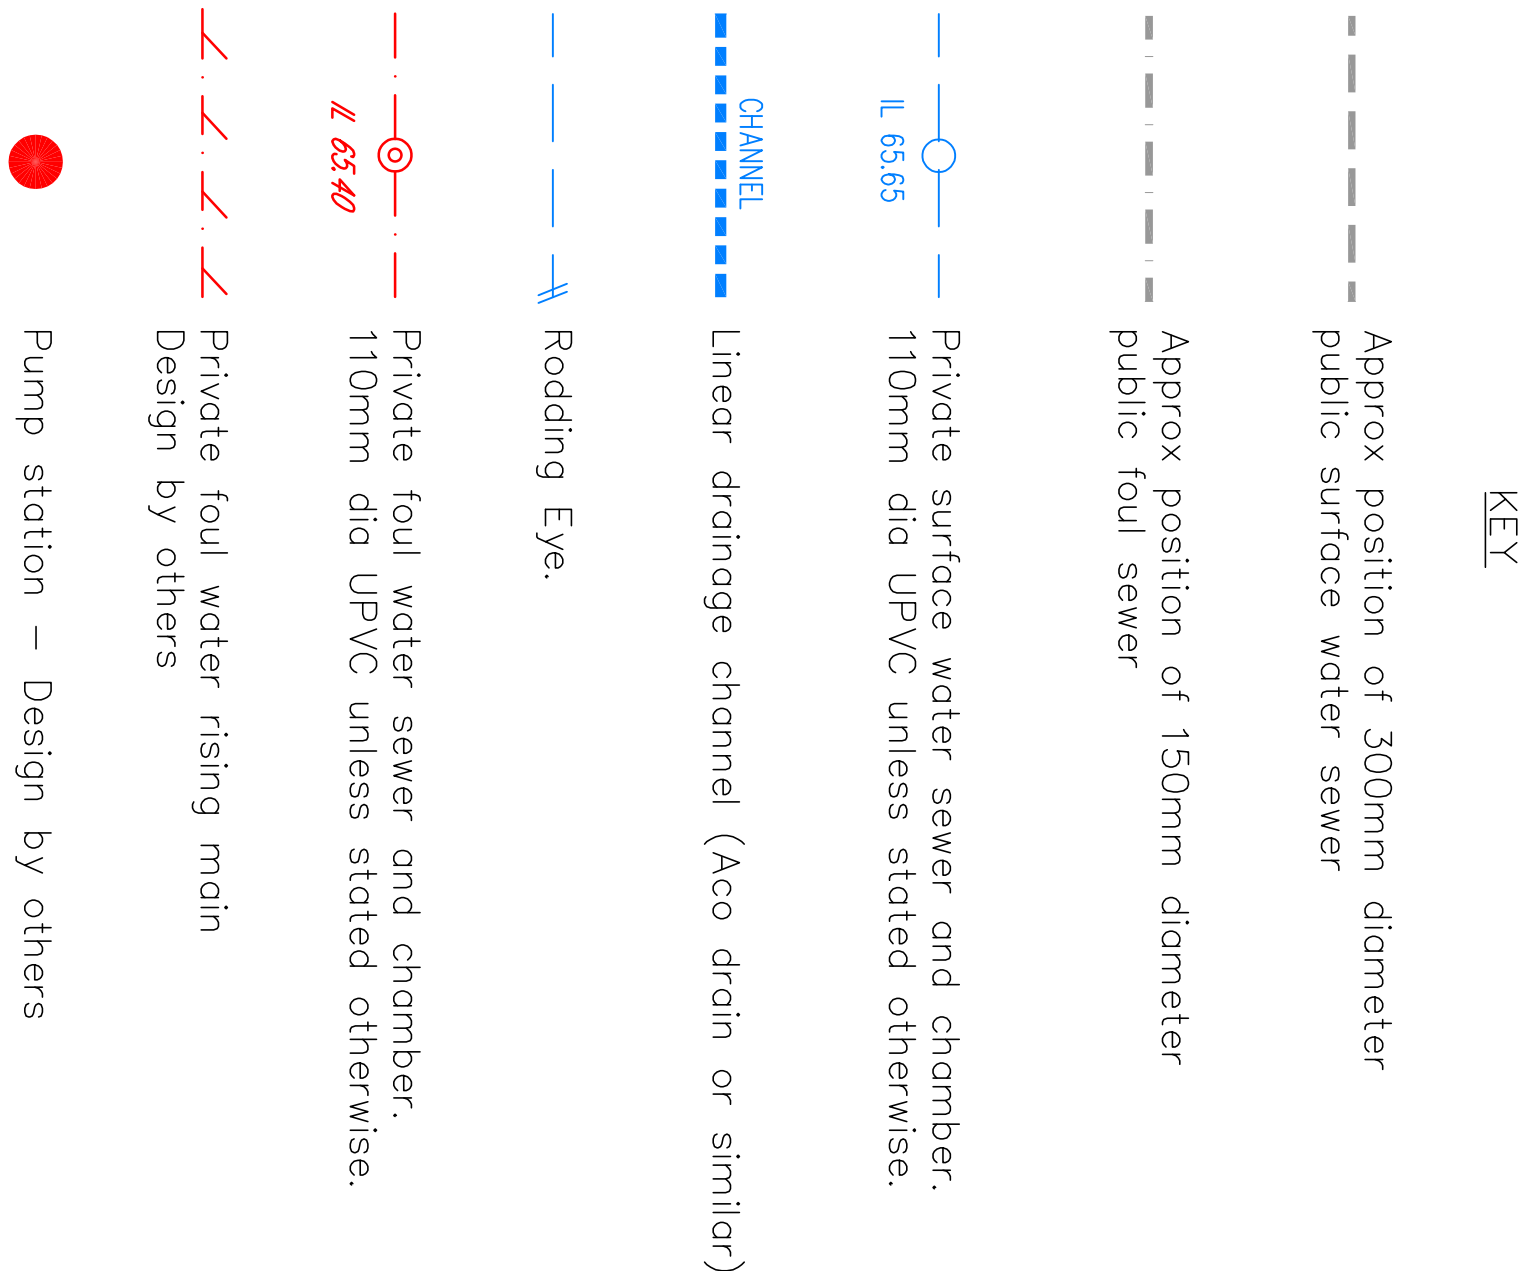

KEY

Preliminary

Rev	Details	Date	Drawn/Chk
Developments by Boutique			
Martin Croft Silkstone, Barnsley			
Drainage design			
Dwg No.: STE/21/05/01			
Date: 12-7-21			
Scale: 1:200			
Copyright © Shaun Tonge Engineering			

SHAUNTONGE ENGINEERING

11 Bloomfield Road, Wortwell, Barnsley, S73 0SA
Tel: 01728 758929, Mobile: 07528 278070, Email: shauntongeengineering@yahoo.co.uk