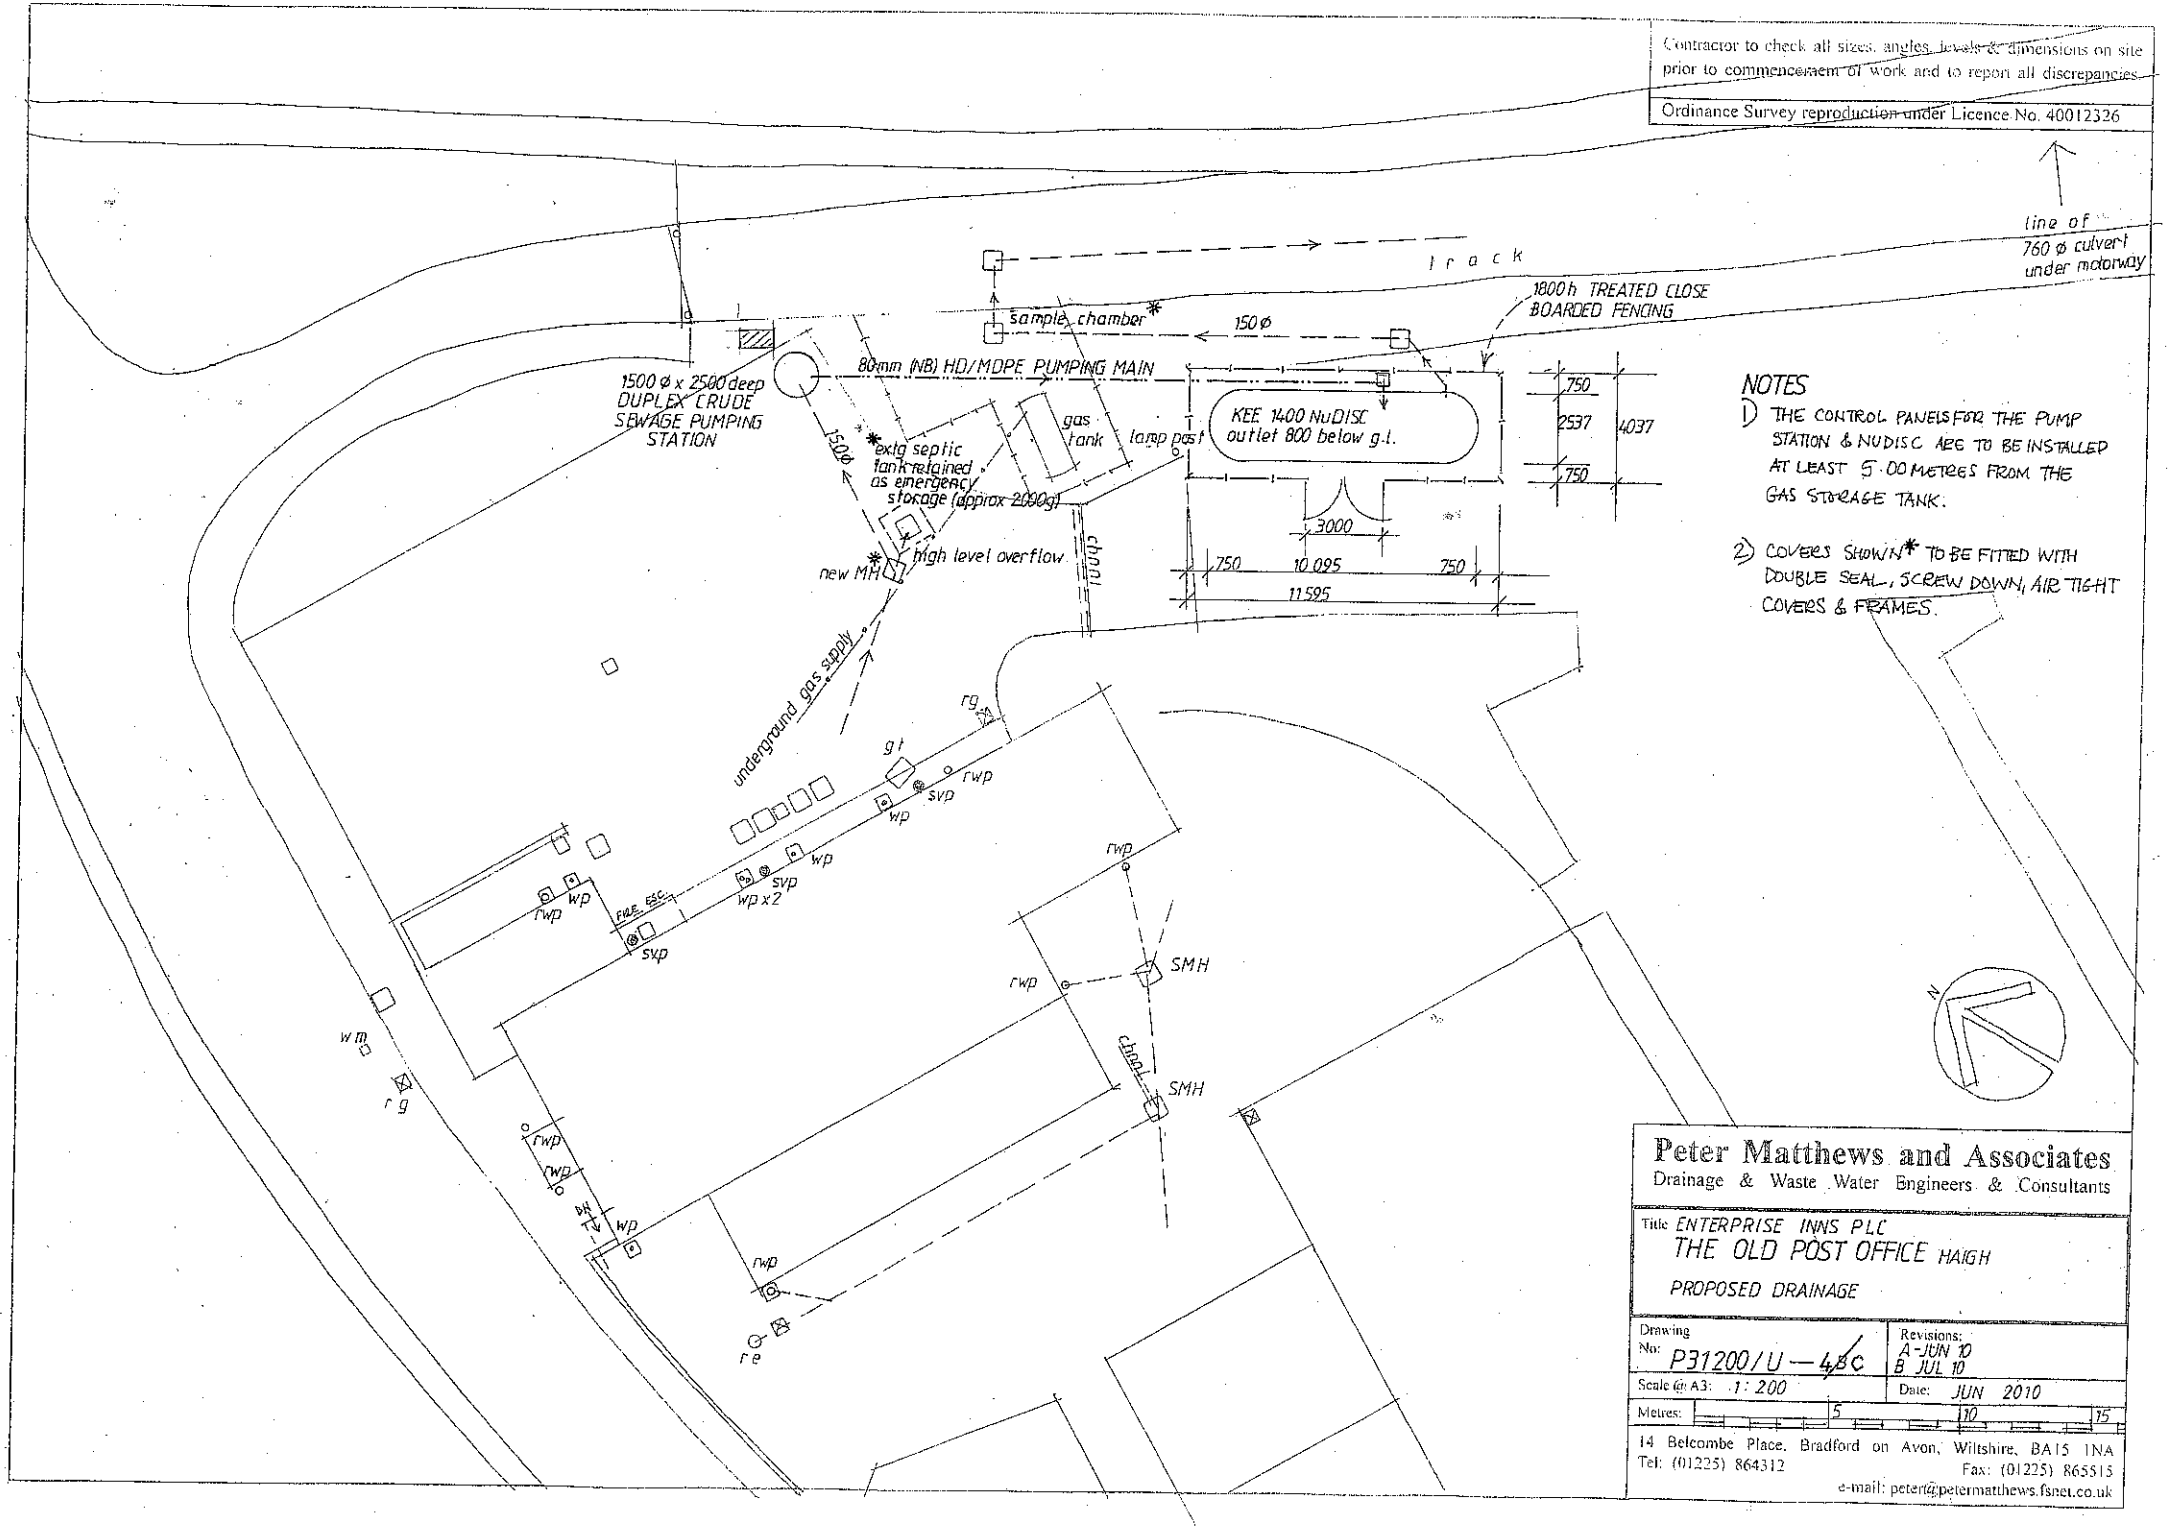

Contractor to check all sizes, angles, levels & dimensions on site prior to commencement of work and to report all discrepancies
Ordinance Survey reproduction under Licence No. 40012326
line of 760 ø culvert under motorway
track
1800h TREATED CLOSE BOARDED FENCING
sample chamber *
150ø
80mm (NB) HD/MDPE PUMPING MAIN
1500ø x 2500 deep DUPLEX CRUDE SEWAGE PUMPING STATION
150ø
extg septic tank retained as emergency storage (approx 2000g)
gas tank
lamp post
KEE 1400 NuDISC outlet 800 below g.l.
750
2537
4037
750
3000
750
10 095
750
11595
high level overflow
new MH *
culvert
underground gas supply
rg
gt
rwp
svp
wp
wp x2
fwg
bsc
wm
rg
rwp
SMH
SMH
culvert
rwp
rwp
bsc
wp
rwp
re
NOTES
1) THE CONTROL PANELS FOR THE PUMP STATION & NUDISC ARE TO BE INSTALLED AT LEAST 5.00 METRES FROM THE GAS STORAGE TANK.
2) COVERS SHOWN * TO BE FITTED WITH DOUBLE SEAL, SCREW DOWN, AIR TIGHT COVERS & FRAMES.
N
Peter Matthews and Associates
Drainage & Waste Water Engineers & Consultants
Title ENTERPRISE INNS PLC
THE OLD POST OFFICE HAIGH
PROPOSED DRAINAGE
Drawing No: P31200/U—48C
Revisions: A JUN 10 B JUL 10
Scale @ A3: 1:200
Date: JUN 2010
Metres: 5 10 15
14 Belcombe Place, Bradford on Avon, Wiltshire, BA15 1NA
Tel: (01225) 864312
Fax: (01225) 865515
e-mail: peter@petermatthews.fsnet.co.uk