


Depth from cover level to soffit of pipe 1.5 to 3m.


Depth from cover level to soffit of pipe 1.5 to 3m.

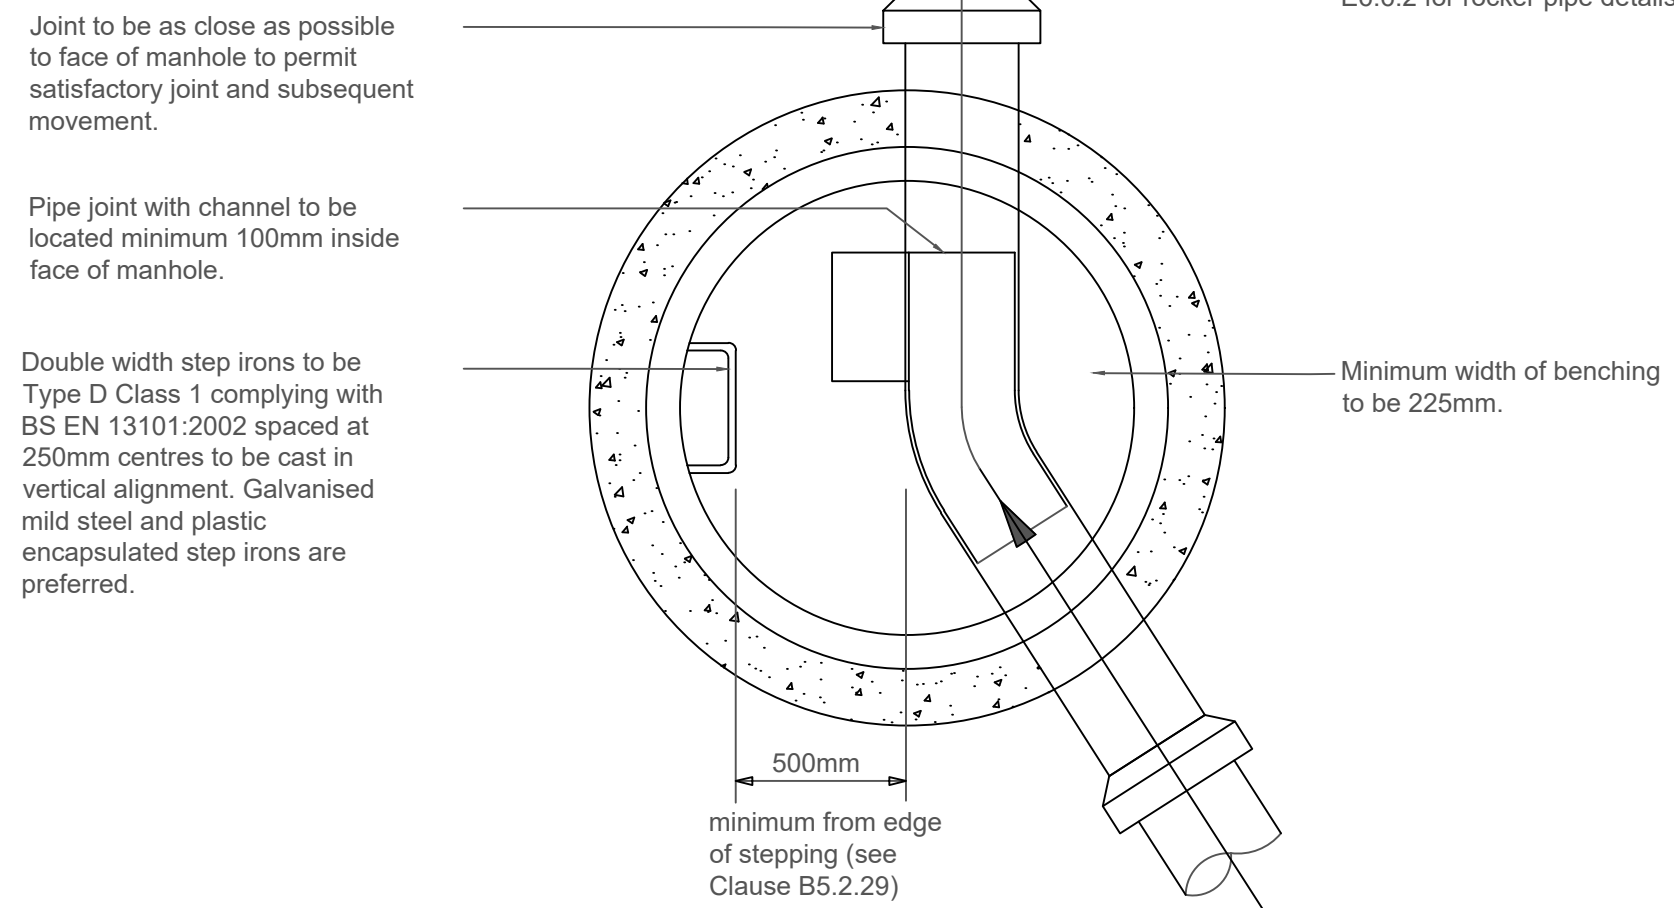


Min 150mm concrete above back drop
All in-situ concrete to be GEN 3

Nominal internal diameter in manhole (mm).	Nominal internal diameter of manhole (mm).
Upto 300	1200
375 - 450	1350
500 - 700	1500
750 - 900	1800
Greater than 900	Specific drawing required.

(1.2m - 2.0m maximum deep - Maximum lateral drain diameter 150mm)

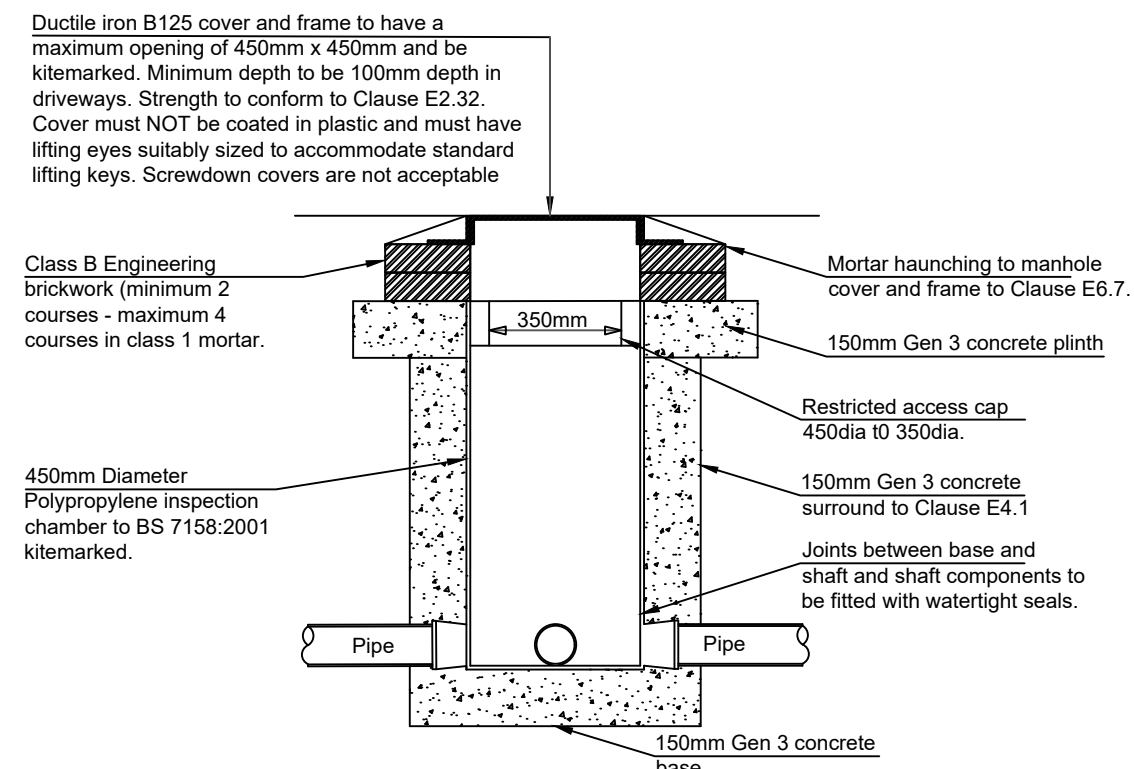


(1.2m - 2.0m maximum deep - Maximum lateral drain diameter 150mm)

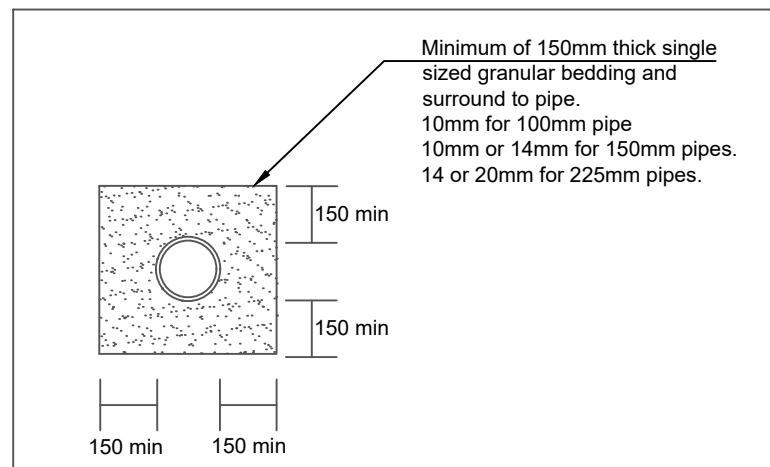

1. All adoptable sewer works and materials to be in accordance with Design and Construction Guidance for foul and surface water sewers offered for adoption under the code for adoption agreements for water and sewerage companies operating wholly or mainly in England'.
- The relevant British/European and Yorkshire Water's Standards/Requirements/Addendum to the Mechanical and Electrical Specification and kitemarked.
2. Manhole covers shall/must have a clear opening of 600mm and shall be Class D400 to BS EN124 with 150mm deep frames in highways.
3. Filled ground must be filled and consolidated under the supervision of and to the satisfaction of Yorkshire Water before any sewer works are carried out.
4. Yorkshire Water is **not** obliged to accept filter drain/land drainage run-off into the public sewer network or adoptable drainage system (directly or indirectly). An alternative method of disposal of the land drainage run-off with therefore be required and you will have to liaise with the Local Authority, Land Drainage Section with the regard to the disposal of the filter drain/land drain run-off.
5. Cover slabs must carry the BSI Kitemark or will be rejected by Yorkshire Water Inspector. Where the clear opening of the Kitemarked product is different to that of the cover and frame, a load bearing slab should be fitted above the cover slab to bring the size down to 600mm x 600mm for the Yorkshire Water specified cover size. Please refer to the Concrete Pipe Systems Association (CPSA), 'Technical Bulletin' issued autumn 2004 for kitemarked cover slab opening sizes. As an alternative 600mm x 600mm access cover slabs are now available (must must be kitemarked) and Yorkshire Water would accept without the requirement of the reducing piece.
6. Sulphate resisting cement (C20-DC2) and pre-cast concrete products must be used or a laboratory report provided proving that such precautions are not necessary.
7. The adoptable sewers should be located a minimum of 1m and manholes 0.5m from kerb faces and service margins.
8. Sewers must have 5 metres clearance from trees and hedges (please also refer to Figure 2.3 on page 33 in 'Sewers for Adoption' 6th Edition for restrictions on tree planting adjacent to sewers).
9. Sewers to be laid with Class 'S' Bedding (150mm granular bed and surround). Where depth of cover to top of sewer is less than 1.2m in highways and verges (or less than 900mm in none vehicular areas), then a concrete slab should be provided above the granular bed and surround.
10. Bedding and backfilling material to conform to the requirement of Water Industry Specification 4-08-02 (Table A2).
11. The chamber size of manholes with more than one connection in them may need to be increased an increment to accommodate the connections and bends.
- 12 Yorkshire water policy is not to accept Type 'c' brick manholes and 1050mm diameter rings. Instead it is preferred that you use a type 'B' manhole with 1200mm dia or 1500mm dia rings with the opening sit over the channel where depth of cover to pipe soffit is 1-1.5m.
13. Adoptable plastic sewer pipes to be BSI Kitemarked (certified to WIS 4-35-01 and BS/EN13476). Adoptable plastic sewer pipes to be laid in maximum 3m lengths unless there is a specific operational need to lay longer lengths. Plastic channel sections in manholes are not acceptable and Yorkshire Water would prefer clayware channels in manholes. We have found that plastic channels are difficult to set in concrete because they float and a satisfactory finish cannot be obtained on the benching.
14. The minimum crushing strength for clay pipes should be as follows: 100mm dia, 40KN/m, 150mm dia, 40KN/m, 225mm, 45KN/m and 300mm dia 72KN/m. The minimum crushing strength for concrete pipes should be - (Class 120 to EN 1916/BS5911-2 2002). Plastic pipes should conform to WIS 4-35-01 and BS EN13476.

SCALE = 1:20@A1

The logo for H&M Design is centered on the page. It features the letters 'H' and 'M' in a large, bold, sans-serif font. The 'H' is red, and the 'M' is dark grey. Below these letters, the word 'DESIGN' is written in a smaller, dark grey, sans-serif font. The entire logo is enclosed within a thin black rectangular border.

HM Design
10 The Green
York
YO26 5LR
07919 031289

Drawing Title
TYPICAL SEWER DETAILS

Drawn HM	Checked HM		
Drg.No. YH743/4B		Date 13/01/2021	