



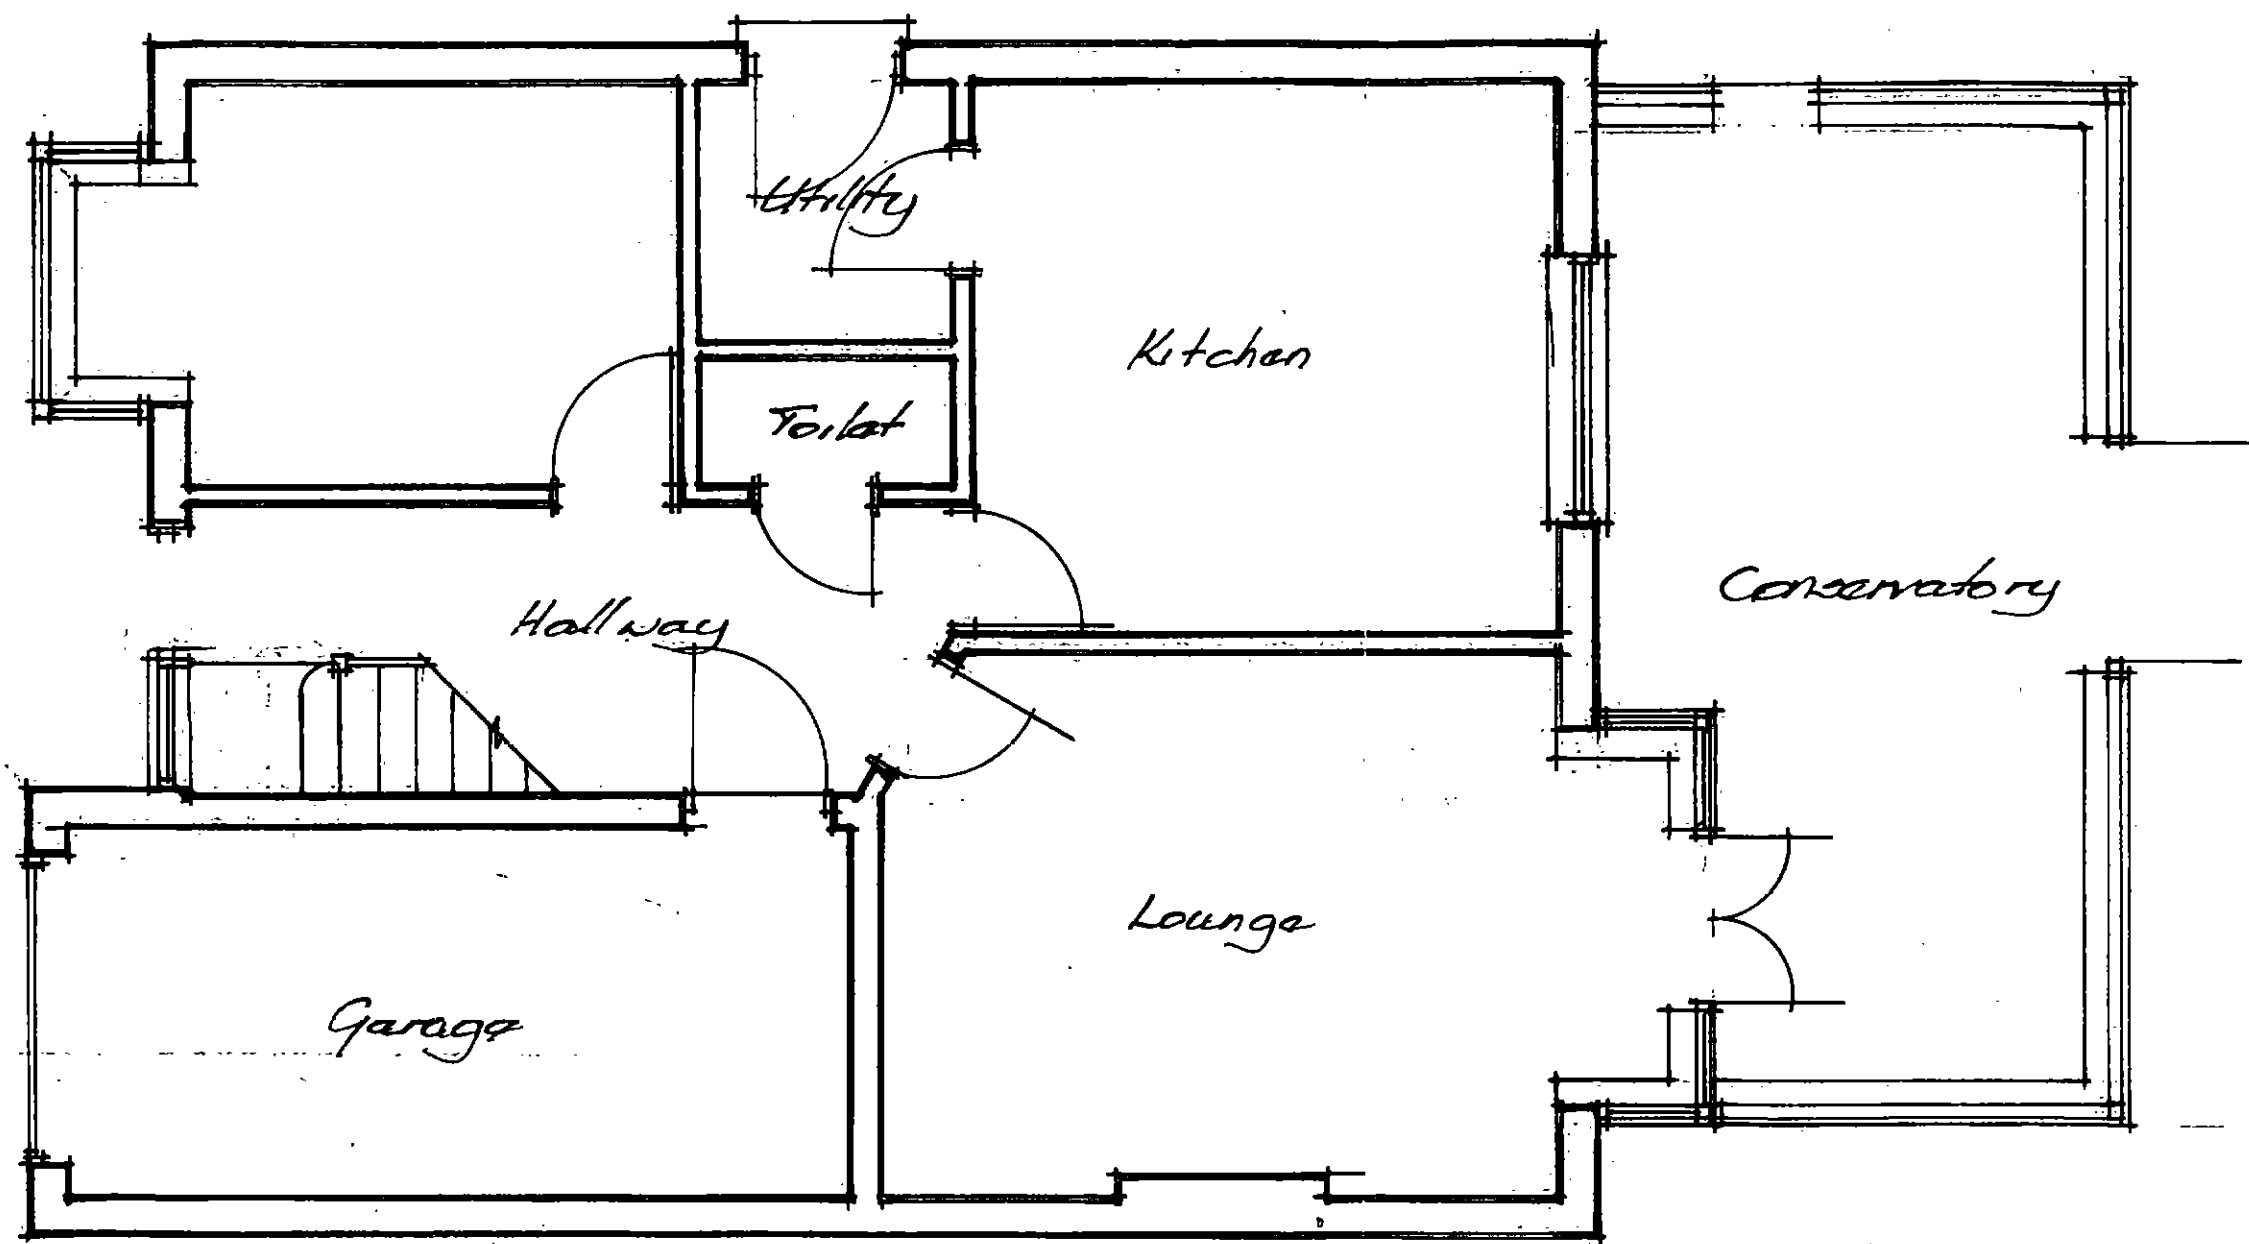


EXISTING GROUND FLOOR PLAN

PROPOSED SINGLE
STOREY EXTENSION
AT NO 9 NETHERFIELD
CROFT, SHAFTON
FOR
MR & MRS. HARRISON
SCALE 1:50.

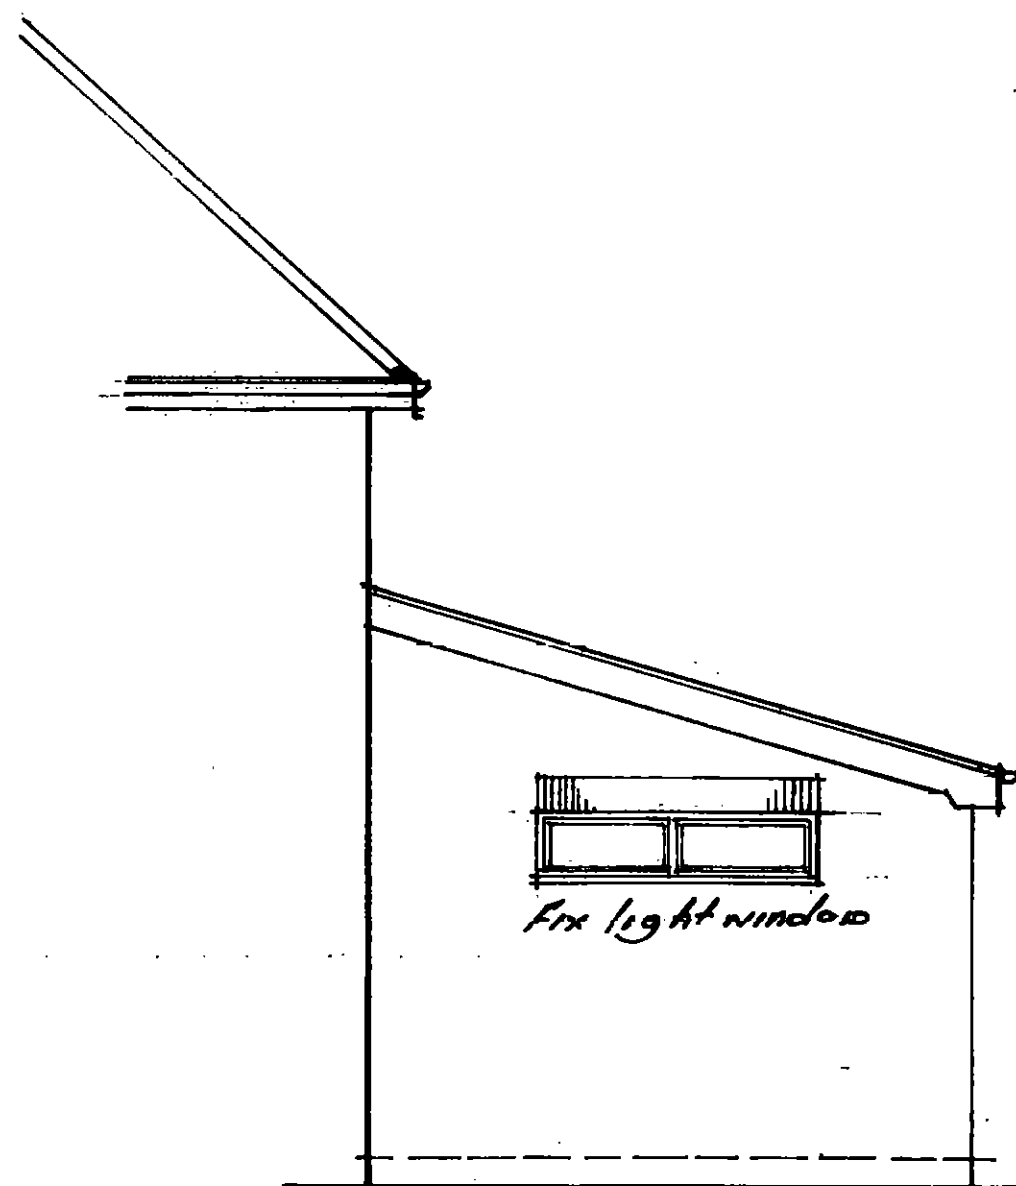

East Elevation

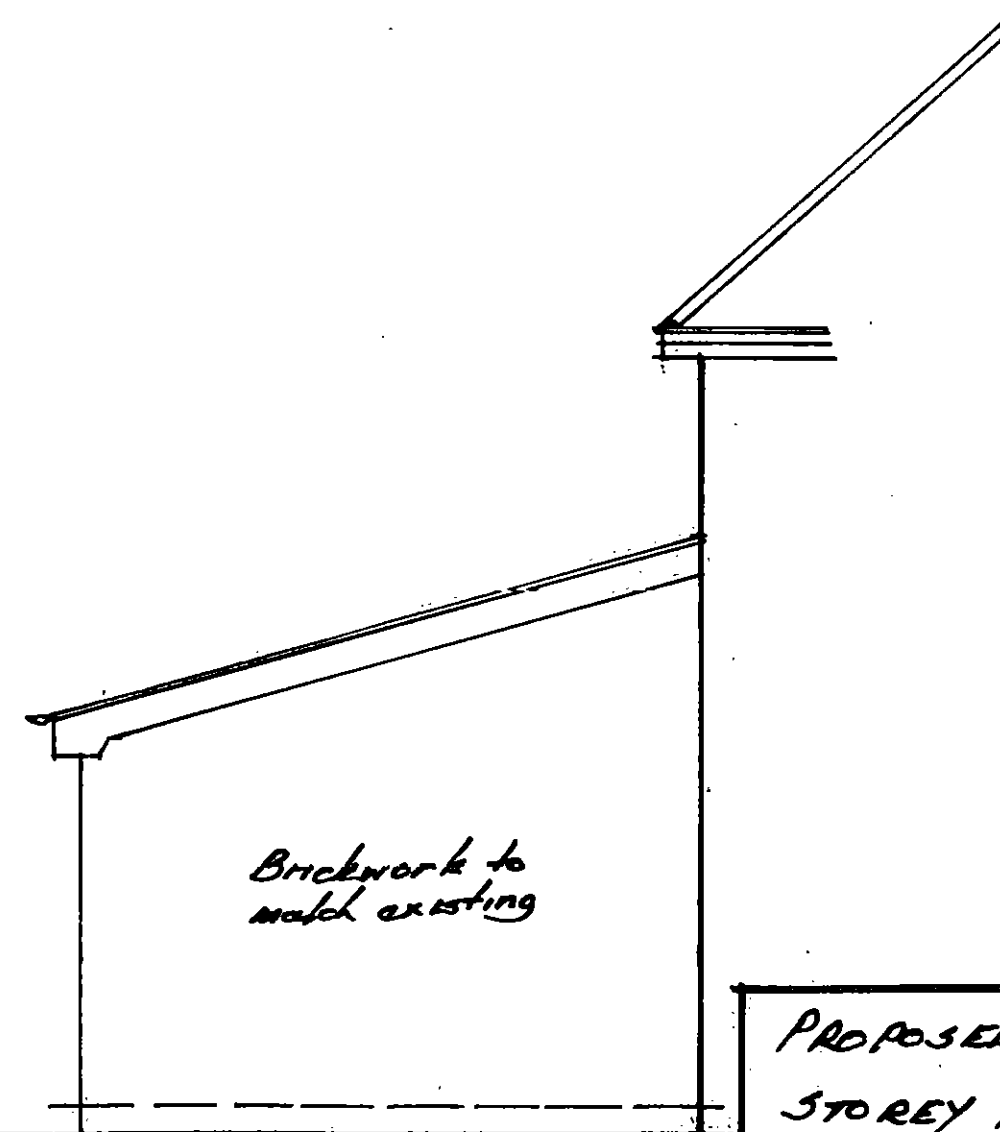


West Elevation.

Proposed Side Elevations

PROPOSED SINGLE
STOREY EXTENSION
AT NO 2 NETHERFIELD
CROFT SHAFTON
FOR
MR & MRS, HARRISON
SCALE 1:50


Roof Construction:- Concrete
 Pantiles to match existing on 38x
 25mm battens gauge to suit;
 fixed to 38x38mm counter-
 battens on breathable membrane
 fixed to 18mm marine grade
 plywood fixed to 4x125
 joists @ 400mm @s with
 125mm insulation between
 joists & under drawn with
 insulated plaster bed.

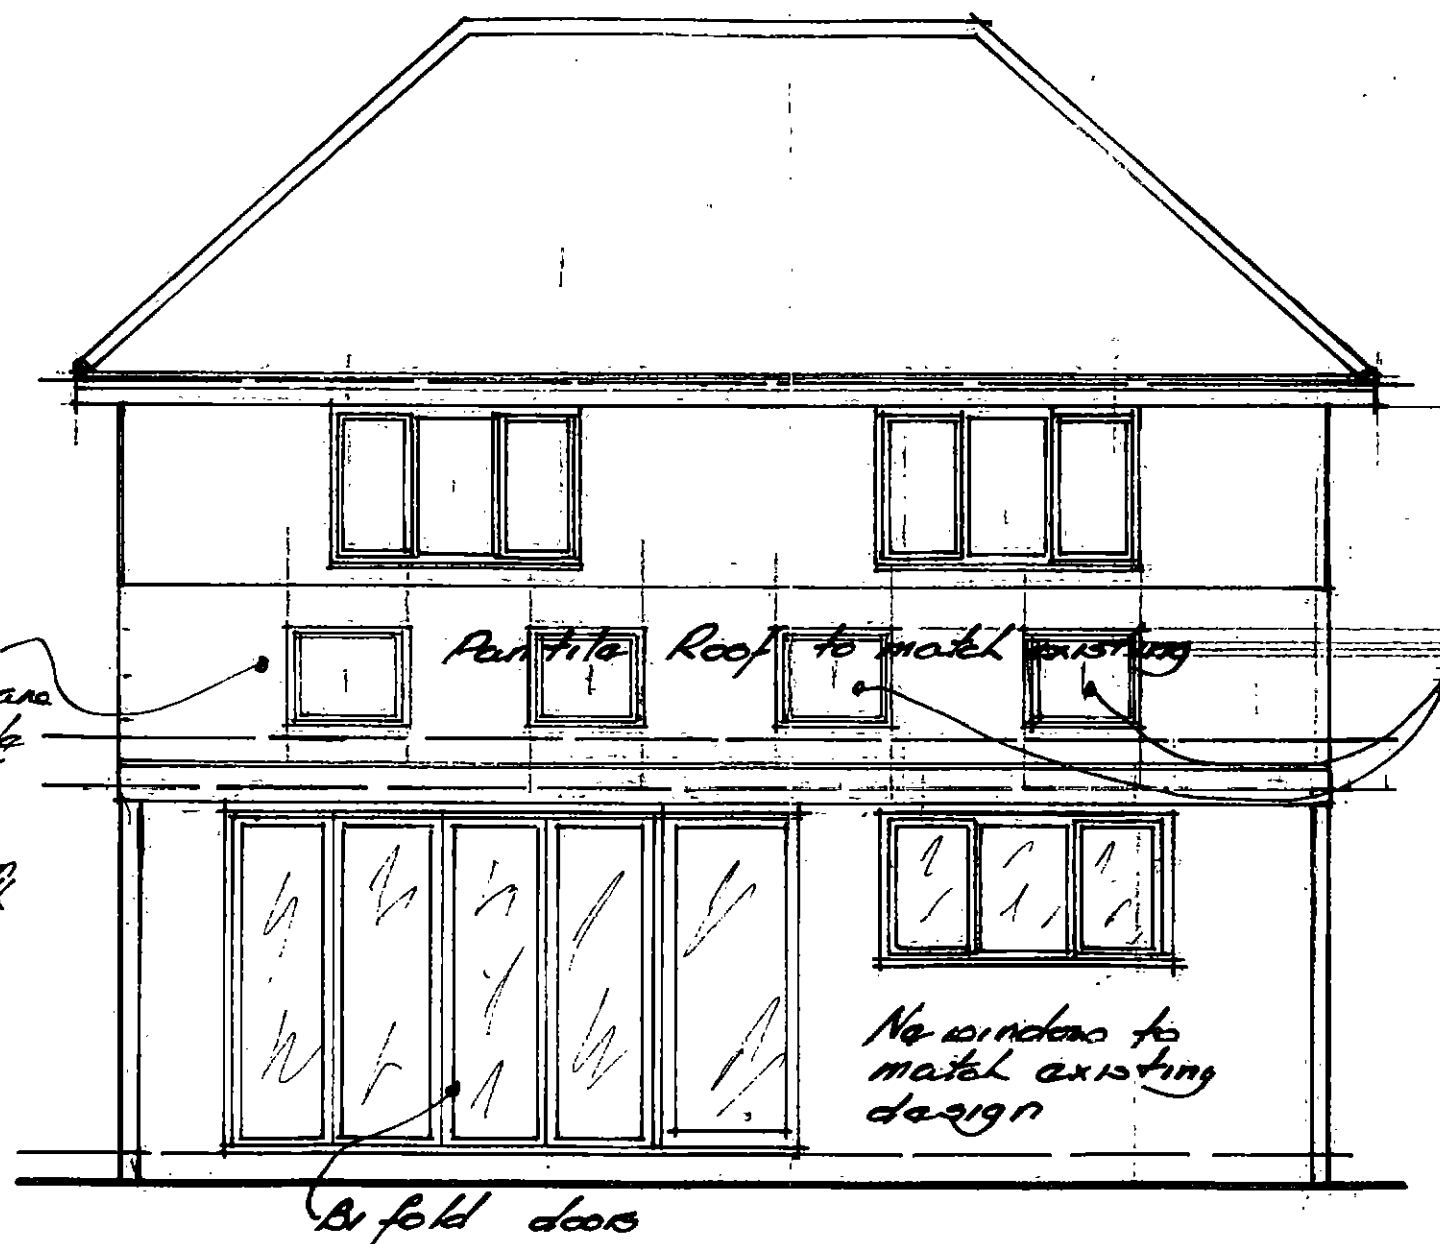

Proposed Rear Elevation.

PROPOSED SINGLE
 STOREY EXTENSION
 AT NO2 NETHERFIELD
 CROFT SHAFTON
 FOR
 MR & MRS, HARRISON
 SCALE 1:50

Foundations - Depth of foundations to be as reqd by BUILDING CONTROL OFFICER with min depth to extg; min 750x375 or to match extg; bonded to extg with 25mm reinforcing bars, epoxy bonded to extg & new.

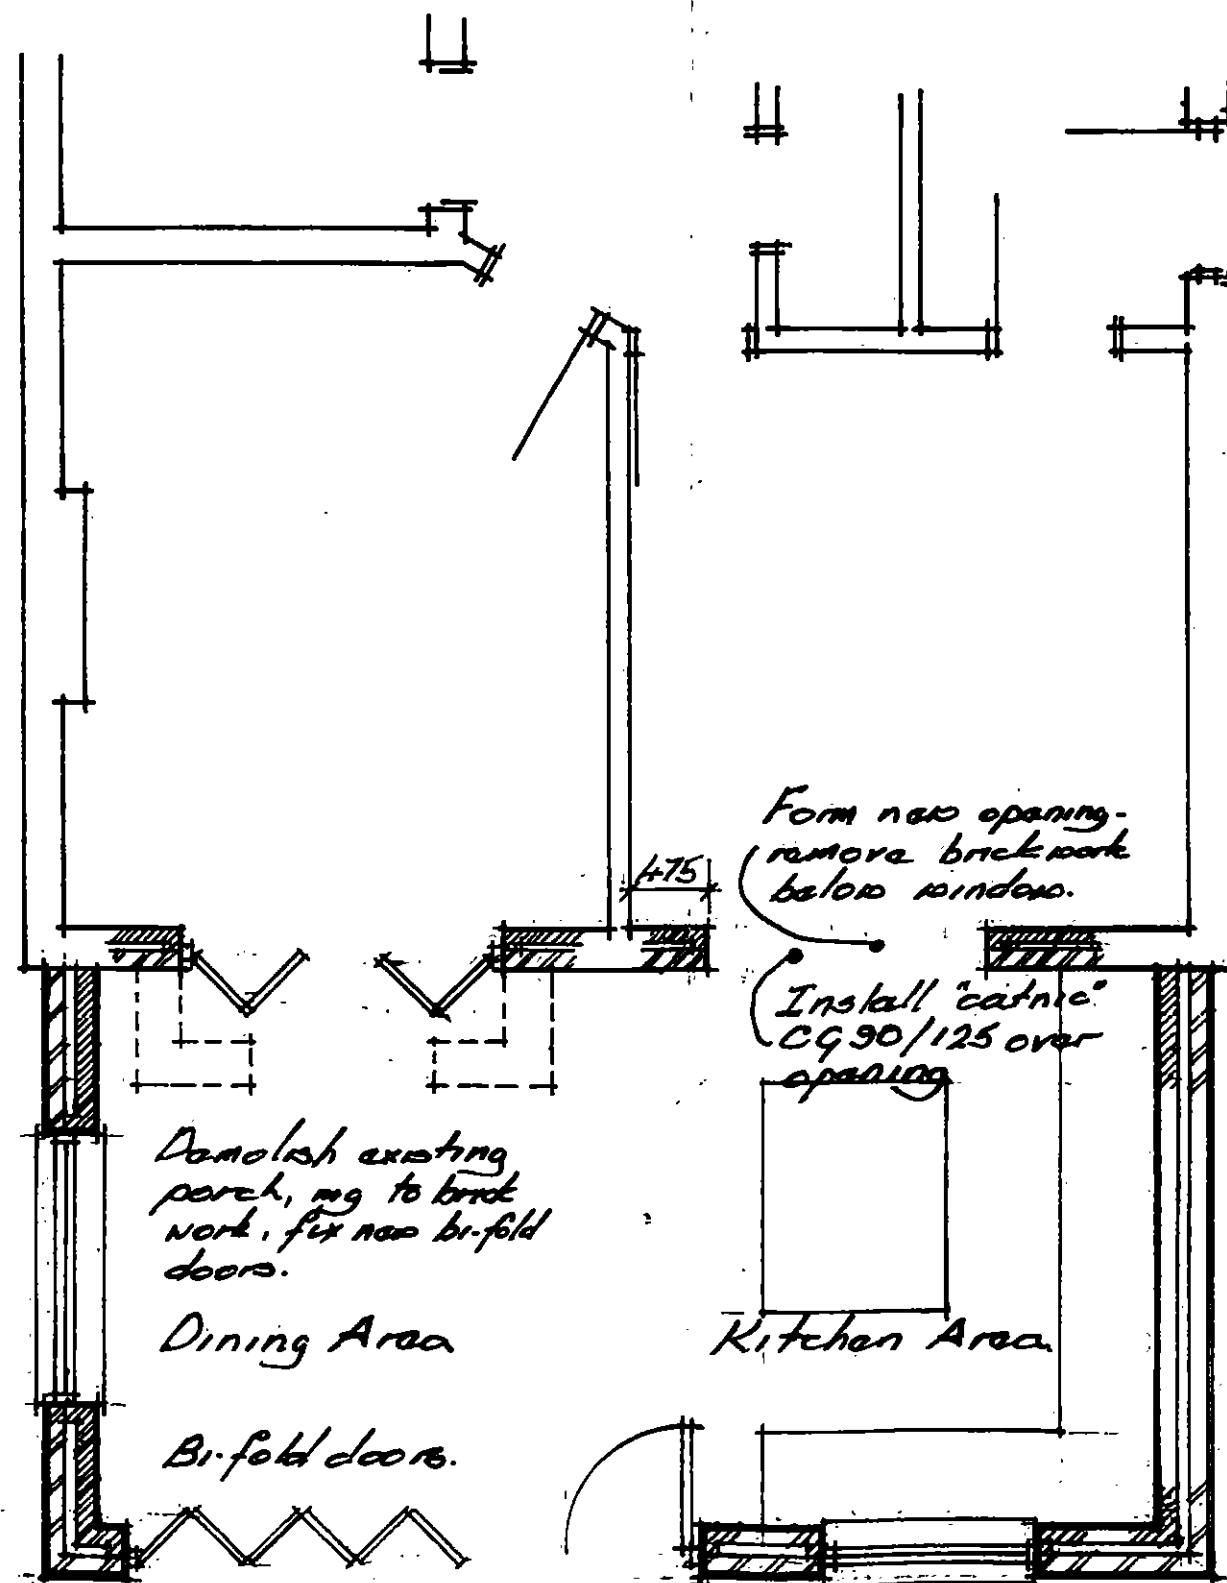


PROPOSED GROUND FLOOR LAYOUT.

Cavity Wall - Brickwork to match extg in size, texture, colour & bond 100mm cavity filled with 75mm Kingspan 'Kooltherm' K10B insulation bonded to 110 'Thermalite' insulation block, cavity closed @ reveals & cells with dpc's to BS 743; cold bridge prevented by 'Kooltherm' cavity closers at cells reveals & corners; brick work & blockwork bonded to extg wall using proprietary bonding strip fixed to extg brickwork internal leaf below dpc level & external leaf below ground level to be constructed of 7N/mm blockwork; cavity to be filled to 150mm below dpc.

Lintols - Catnic lintols with 150mm and bearing on 225x150x110 pad stones.

PROPOSED SINGLE
STOREY EXTENSION
AT NO 2, NETHERFIELD
CROFT SHAFTON
FOR
MR & MRS, HARRISON
SCALE 1:50

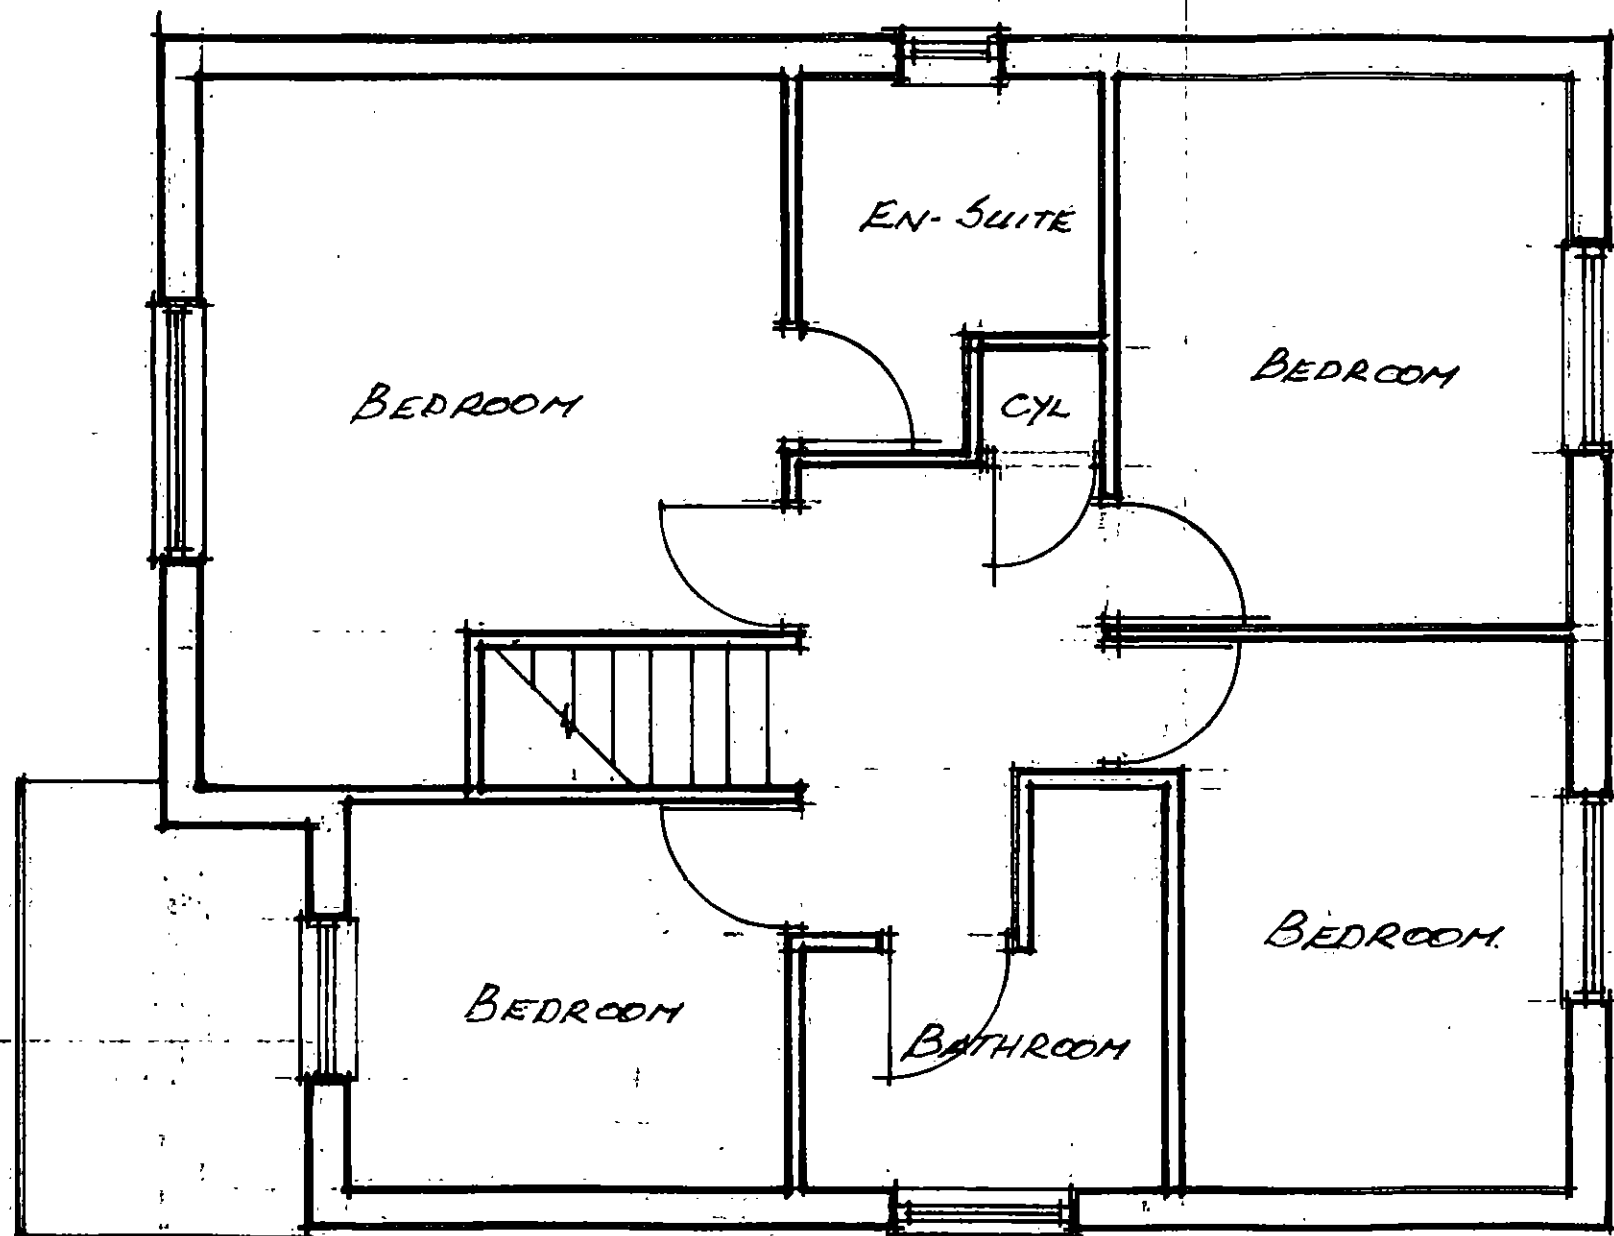

EXISTING FIRST FLOOR LAYOUT.

PROPOSED SINGLE
STOREY EXTENSION
AT NO. 9, NETHERFIELD
CROFT, SHAFTON
FOR
MR & MRS. HARRISON
SCALE 1:50