


HEATING & HOT WATER

Gas fired central heating system room-sealed fan assisted balance flue boiler located within the kitchen/utility or garage area with a SEDBUK rating of 90%. The balance flue to the boiler is to be located a minimum 300mm from any opening window and 2m above the external ground level (if less than 2m then terminal to be fitted with suitable wire cage). All pipework to be insulated in accordance with current regulations, and radiators to be fitted with thermostatically controlled valves and space heating control system to comply with the British Standard Code of Practice. Fire appliance in living room to be radiant convector gas fire wall mounted a minimum 250mm above finished floor level, discharging into proprietary gas flue block system by Dunbrik or similar approved installed in accordance with manufacturers instructions by a CORGI registered installer. Flue blocks to connect to a minimum 127mm internal diameter twin wall stainlesssteel flue in roof space taken up to ridge tile adaptor approved ridge vent. Provide permanent ventilation to living room for gas appliance with free area of 500mm² per KW input in excess of 5kW.

DISABLED ACCESS

To be a ramped approach to main side entrance a minimum 900mm wide with a gradient not steeper than 1 in 15 with 1.2m unobstructed landings at top and bottom and with 100mm raised curb to edge of ramp and top landing. Handrail to be fixed to the wall of the building 900mm above the line of the ramp and extend 300mm beyond the top and bottom. The main entrance is to have a minimum clear opening of 800mm i.e. 850mm door leaf & 1000mm door set with internal doors having a clear width of 750mm.

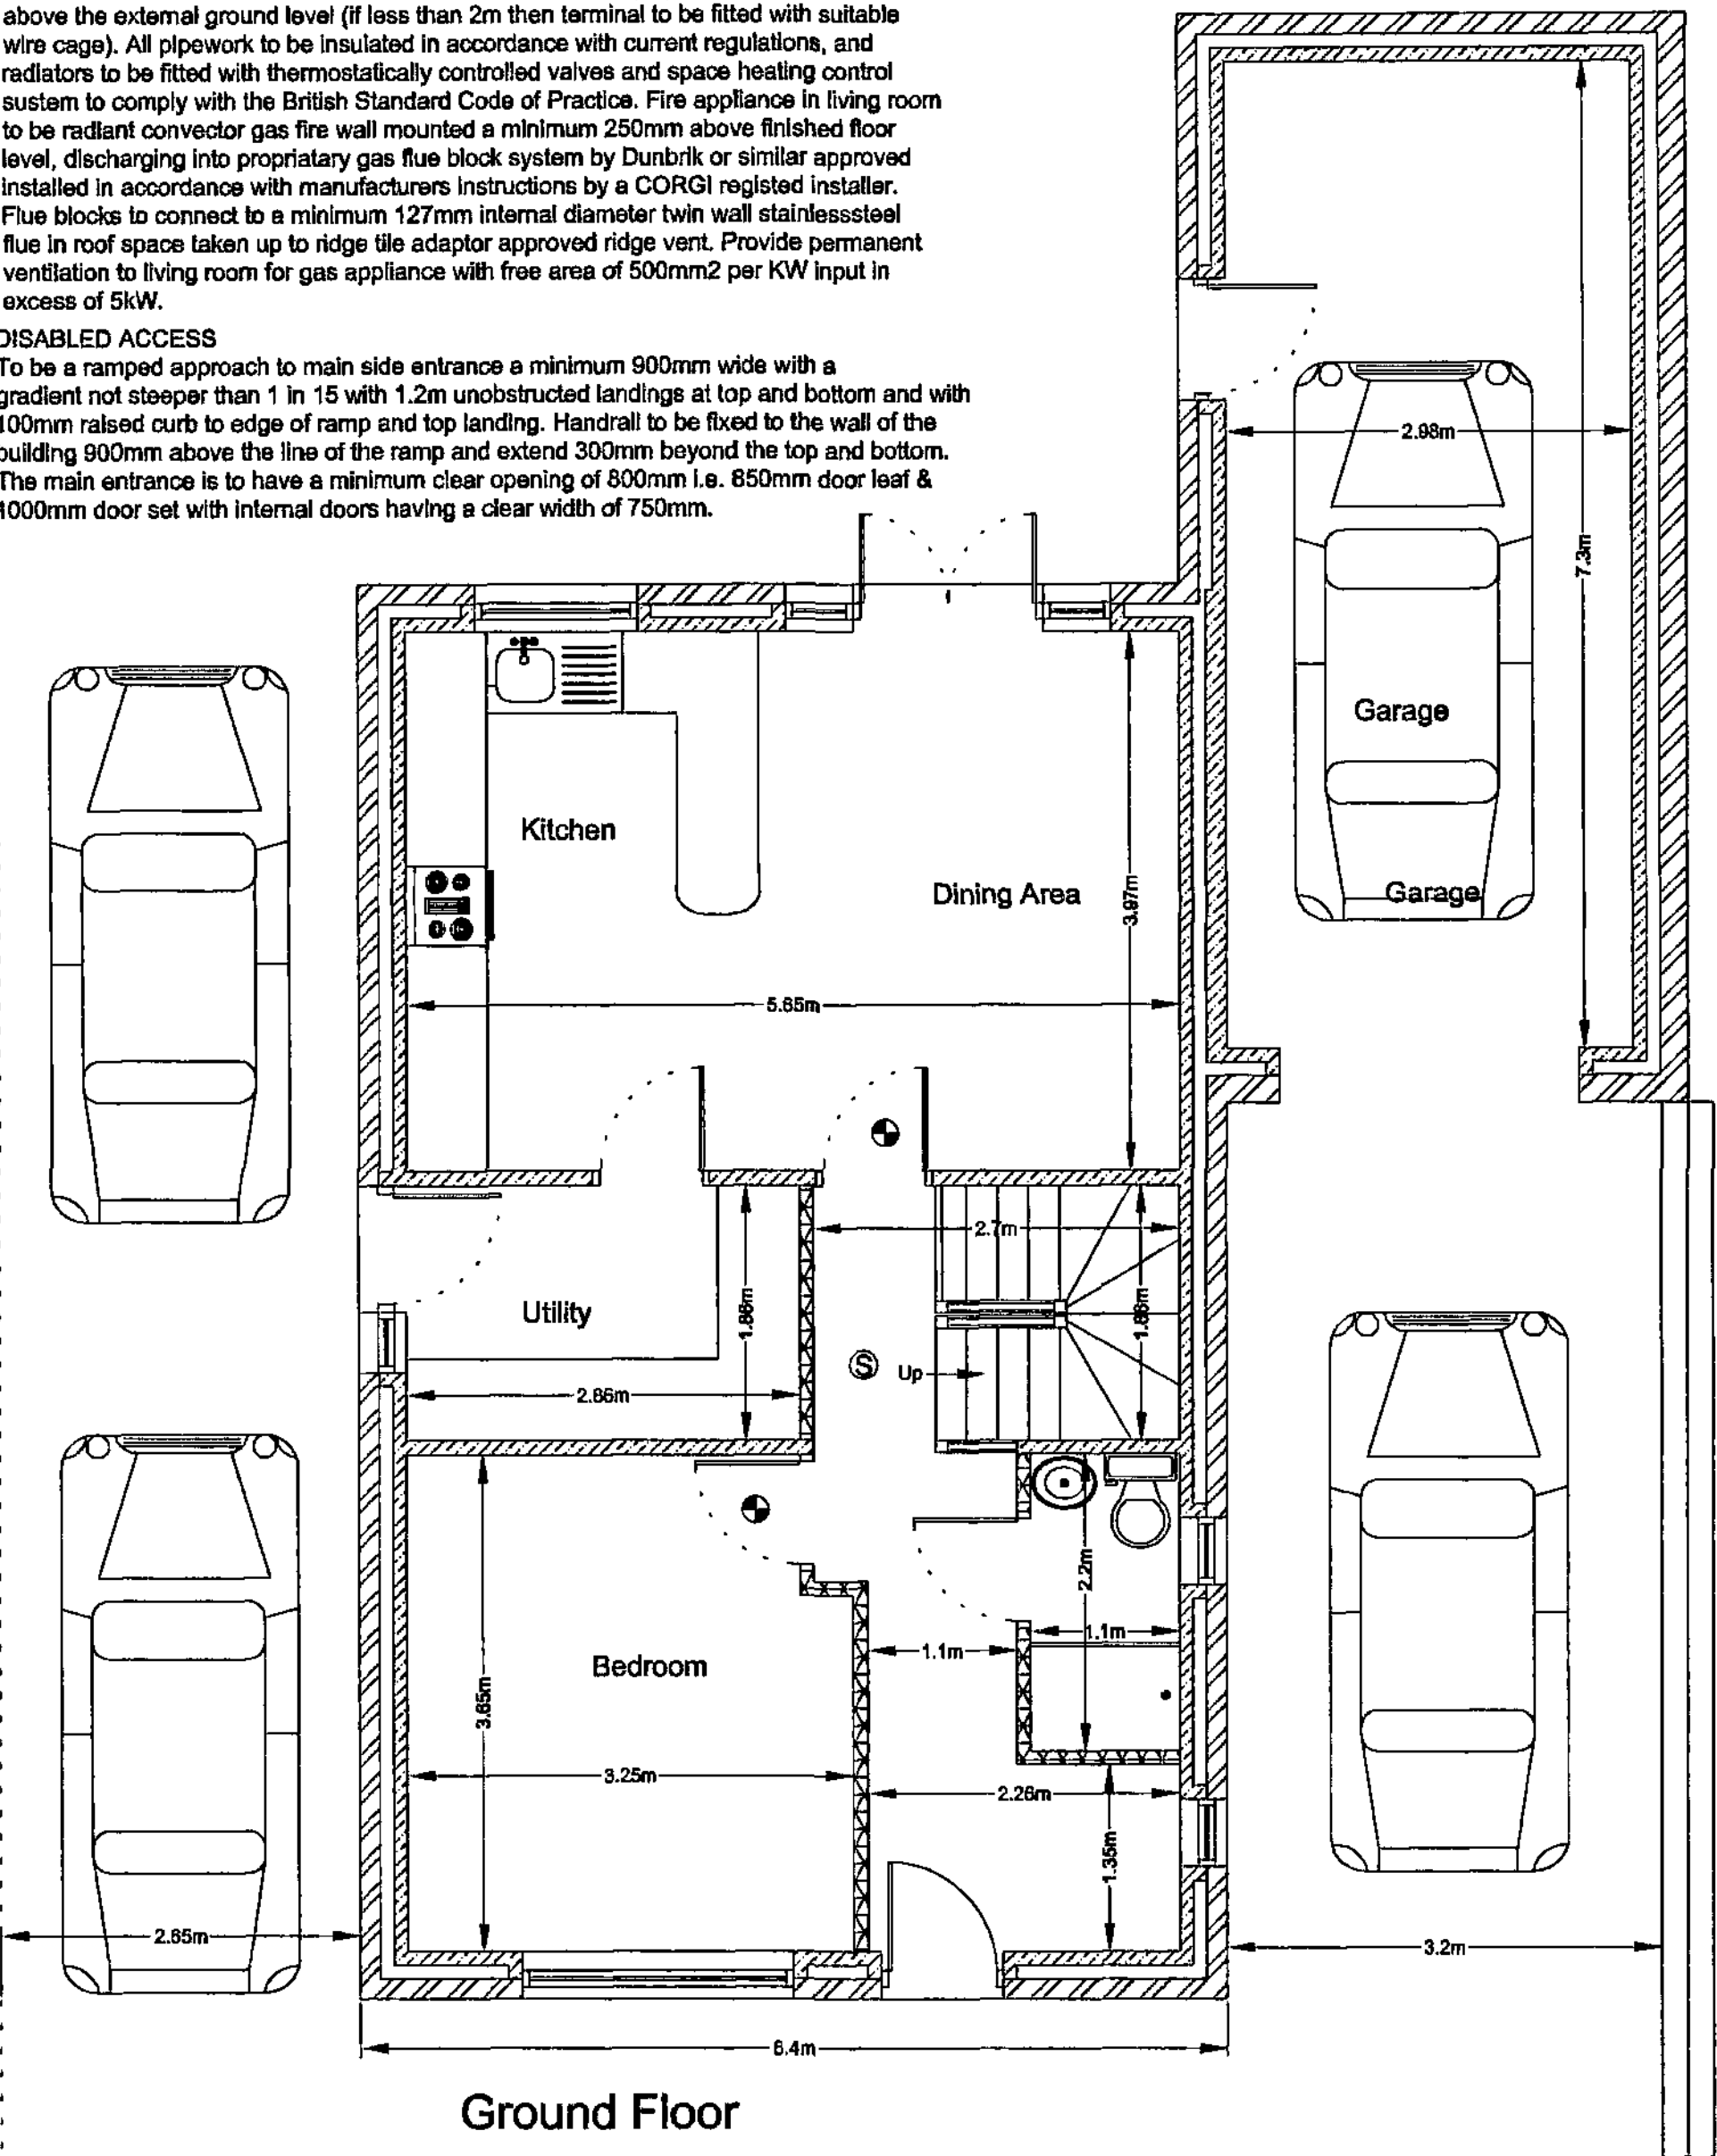


EXTERNAL WALLS

To be cavity wall construction with external leaf of natural stone 150mm sawn bed from Stancliffe Stone Co. quarry to all sides, 100mm cavity with 50mm Kingspan Kooltherm KB insulation wall batts fixed to the internal leaf of 100mm Thermalite shield blocks. Walls ties to be 5 number per metre square and 225mm vertical centres to reveals, stainless steel double triangle to BS 1243. The internal wall to be finished with 12.5mm plasterboard on dabs or 15mm two coat gypsum plaster. The dpc is to be 150mm above the adjacent finished ground level and linked with the existing, cavities closed with Thermabate or similar approved cavity closer.

FIRST FLOOR

The floor is to be 22mm floorboarding on 50mm x 195mm C16 timber joists at 400mm centres with herring bone strutting at mid-span and doubled up under any first floor walls. The floor is to be insulated with 100mm mineral fibre quilt minimum density of 10kg/m² laid between joists and under drawn with 12.5mm plasterboard and 5mm plaster skim. Where floor joists run parallel to wall 38mm x 5mm steel strap to be provided spanning a minimum of three joists with timber noggins between joists and bent down cavity a minimum of 450mm.

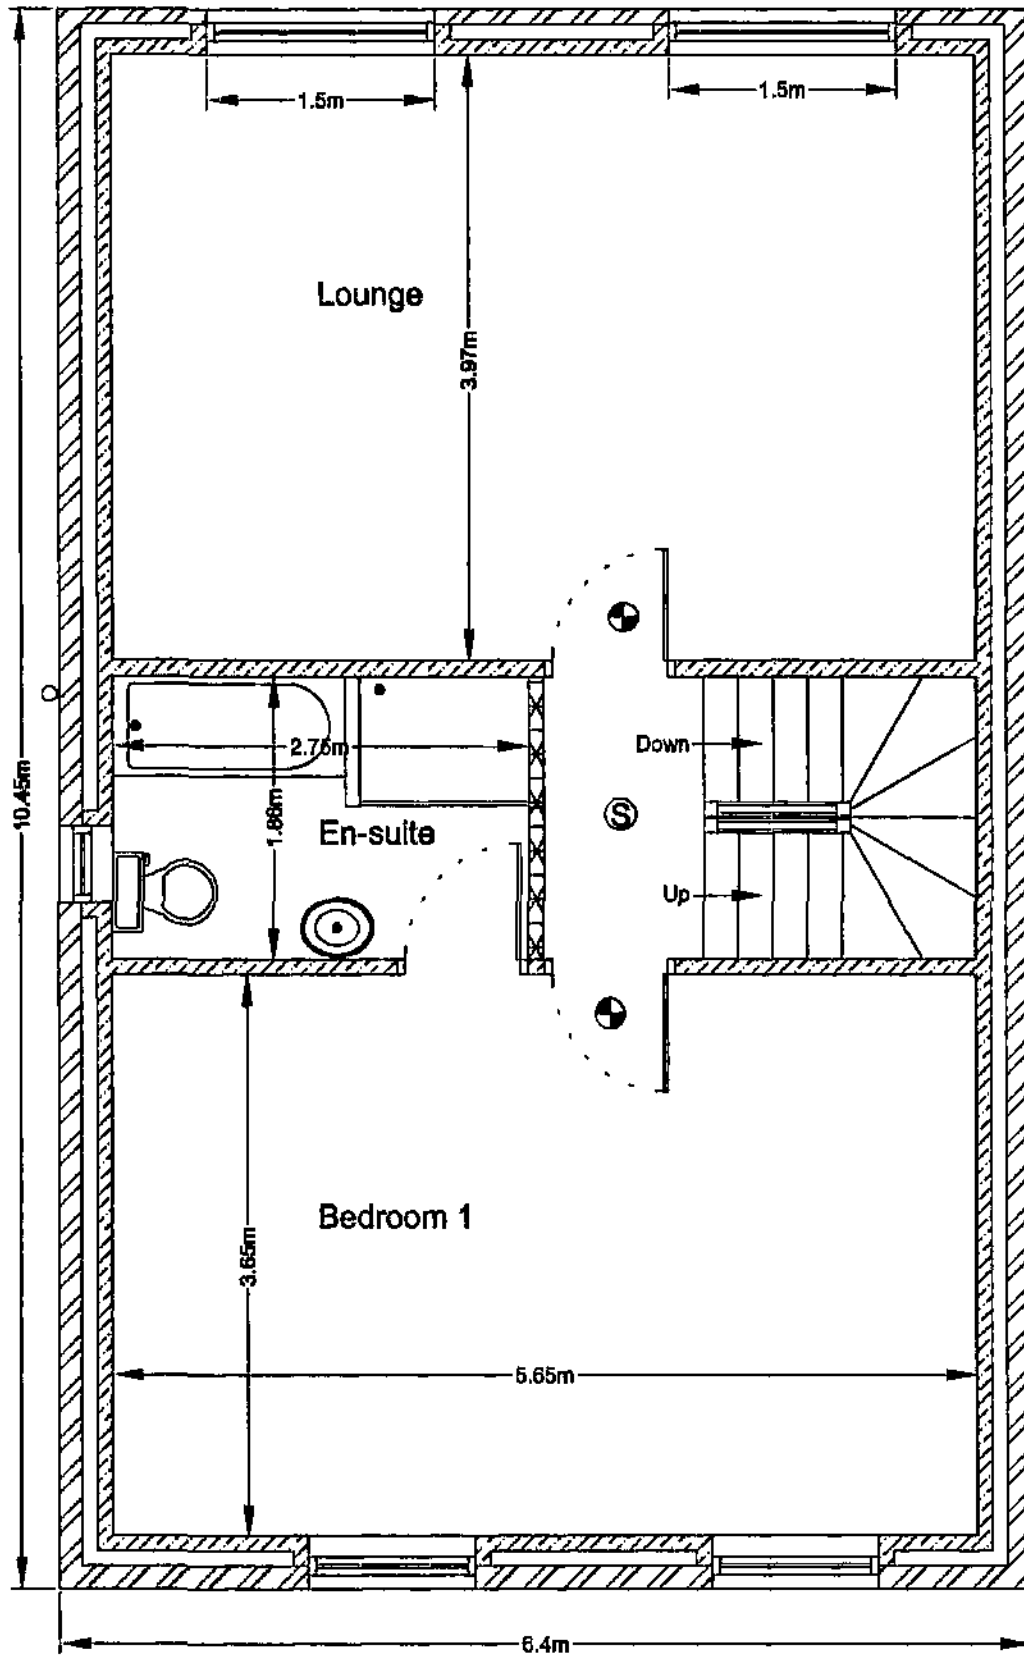


First Floor

WINDOWS & VENTILATION

The windows and doors are to be UPVC double glazed with 16mm air gap and a "soft" low-E coating and draught stripped with trickle ventilation of 8000mm² and opening lights minimum 5 % floor area of the room. Glazing to doors and side panels within 1500mm and windows within 800mm of the floor must laminated or toughened safety glass and marked according to BS 6206.

Mechanical ventilation provided to kitchen and bathrooms of 60L/sec and 15L/sec ducted to the external air. All first floor windows to habitable rooms to be provided with escape windows a minimum area 0.33m² with a minimum clear opening height and width of 450mm (ie. minimum clear opening of 450mm wide and 750mm high) with the opening window between 800mm and 1100mm above finished floor level.

Revised internal layout
to clients requirements
30/01/2008

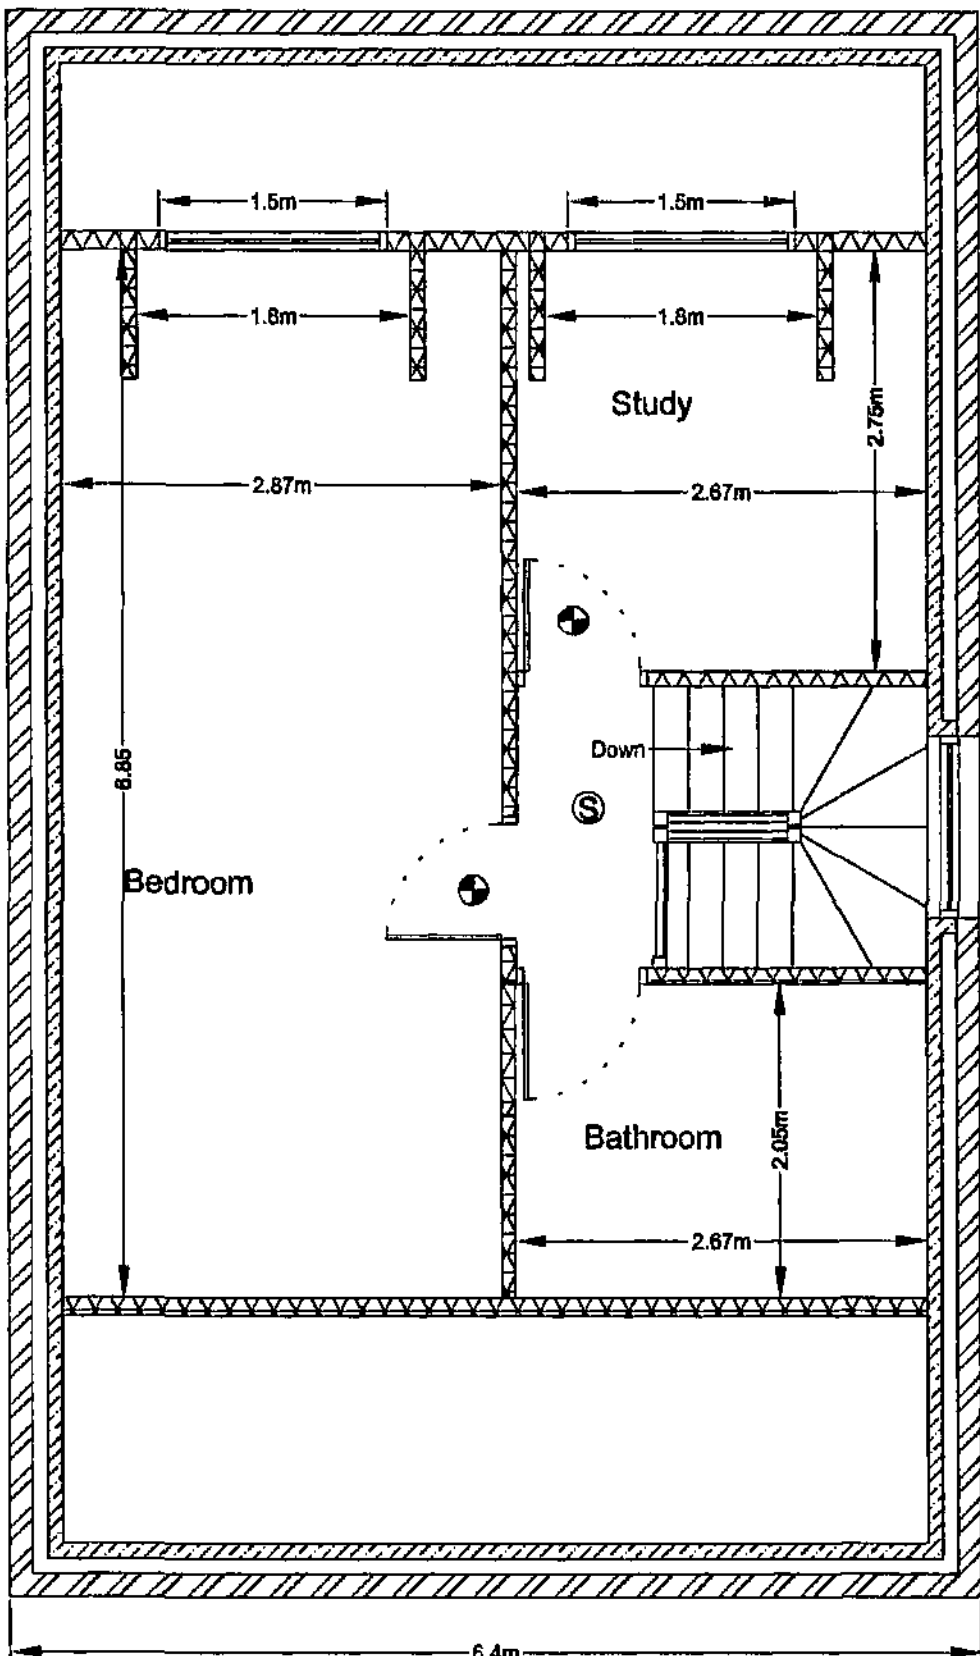

Second Floor

Drawing No. MRT/07/02

© Copyright I. J. Mawson

Address Adj 167 Manchester Road
Thurstone
Penistone
Floor Plans
Scale 1 : 50

Date January 2008

Willowbrook Design Services
Mr. I. J. Mawson M. B. Eng.
14 Willow Brook Close Darton Barnsley
Telephone 01226 - 380043

06 FEB 2008

Corporate Mail Room