


Street Lighting Arrangement



Denotes 6M galvanised steel column with 40 AriaLED lantern complete with electronic PEC

All materials to comply fully with current BMBC Street Lighting Specification.


It is the responsibility of the developer to advise their clients of the location of street lighting columns relative to their property and to programme column installation works commensurate with property occupation.

Column positions may be adjusted slightly to suit site conditions and services, but must not normally be erected within 500mm of defined driveway boundaries.

BMBC will not enter into third party discussion on column positions, any such discussion will be carried out between BMBC and the developer.

The street lighting columns and lanterns and their maintenance remain the responsibility of the developer until completion of the adoption process.

All lighting columns are to be provided with an unmetered single phase electricity supply via the REC cable network. It is expected that the developer will coordinate with the REC regarding the installation of any cable ducts they may require.

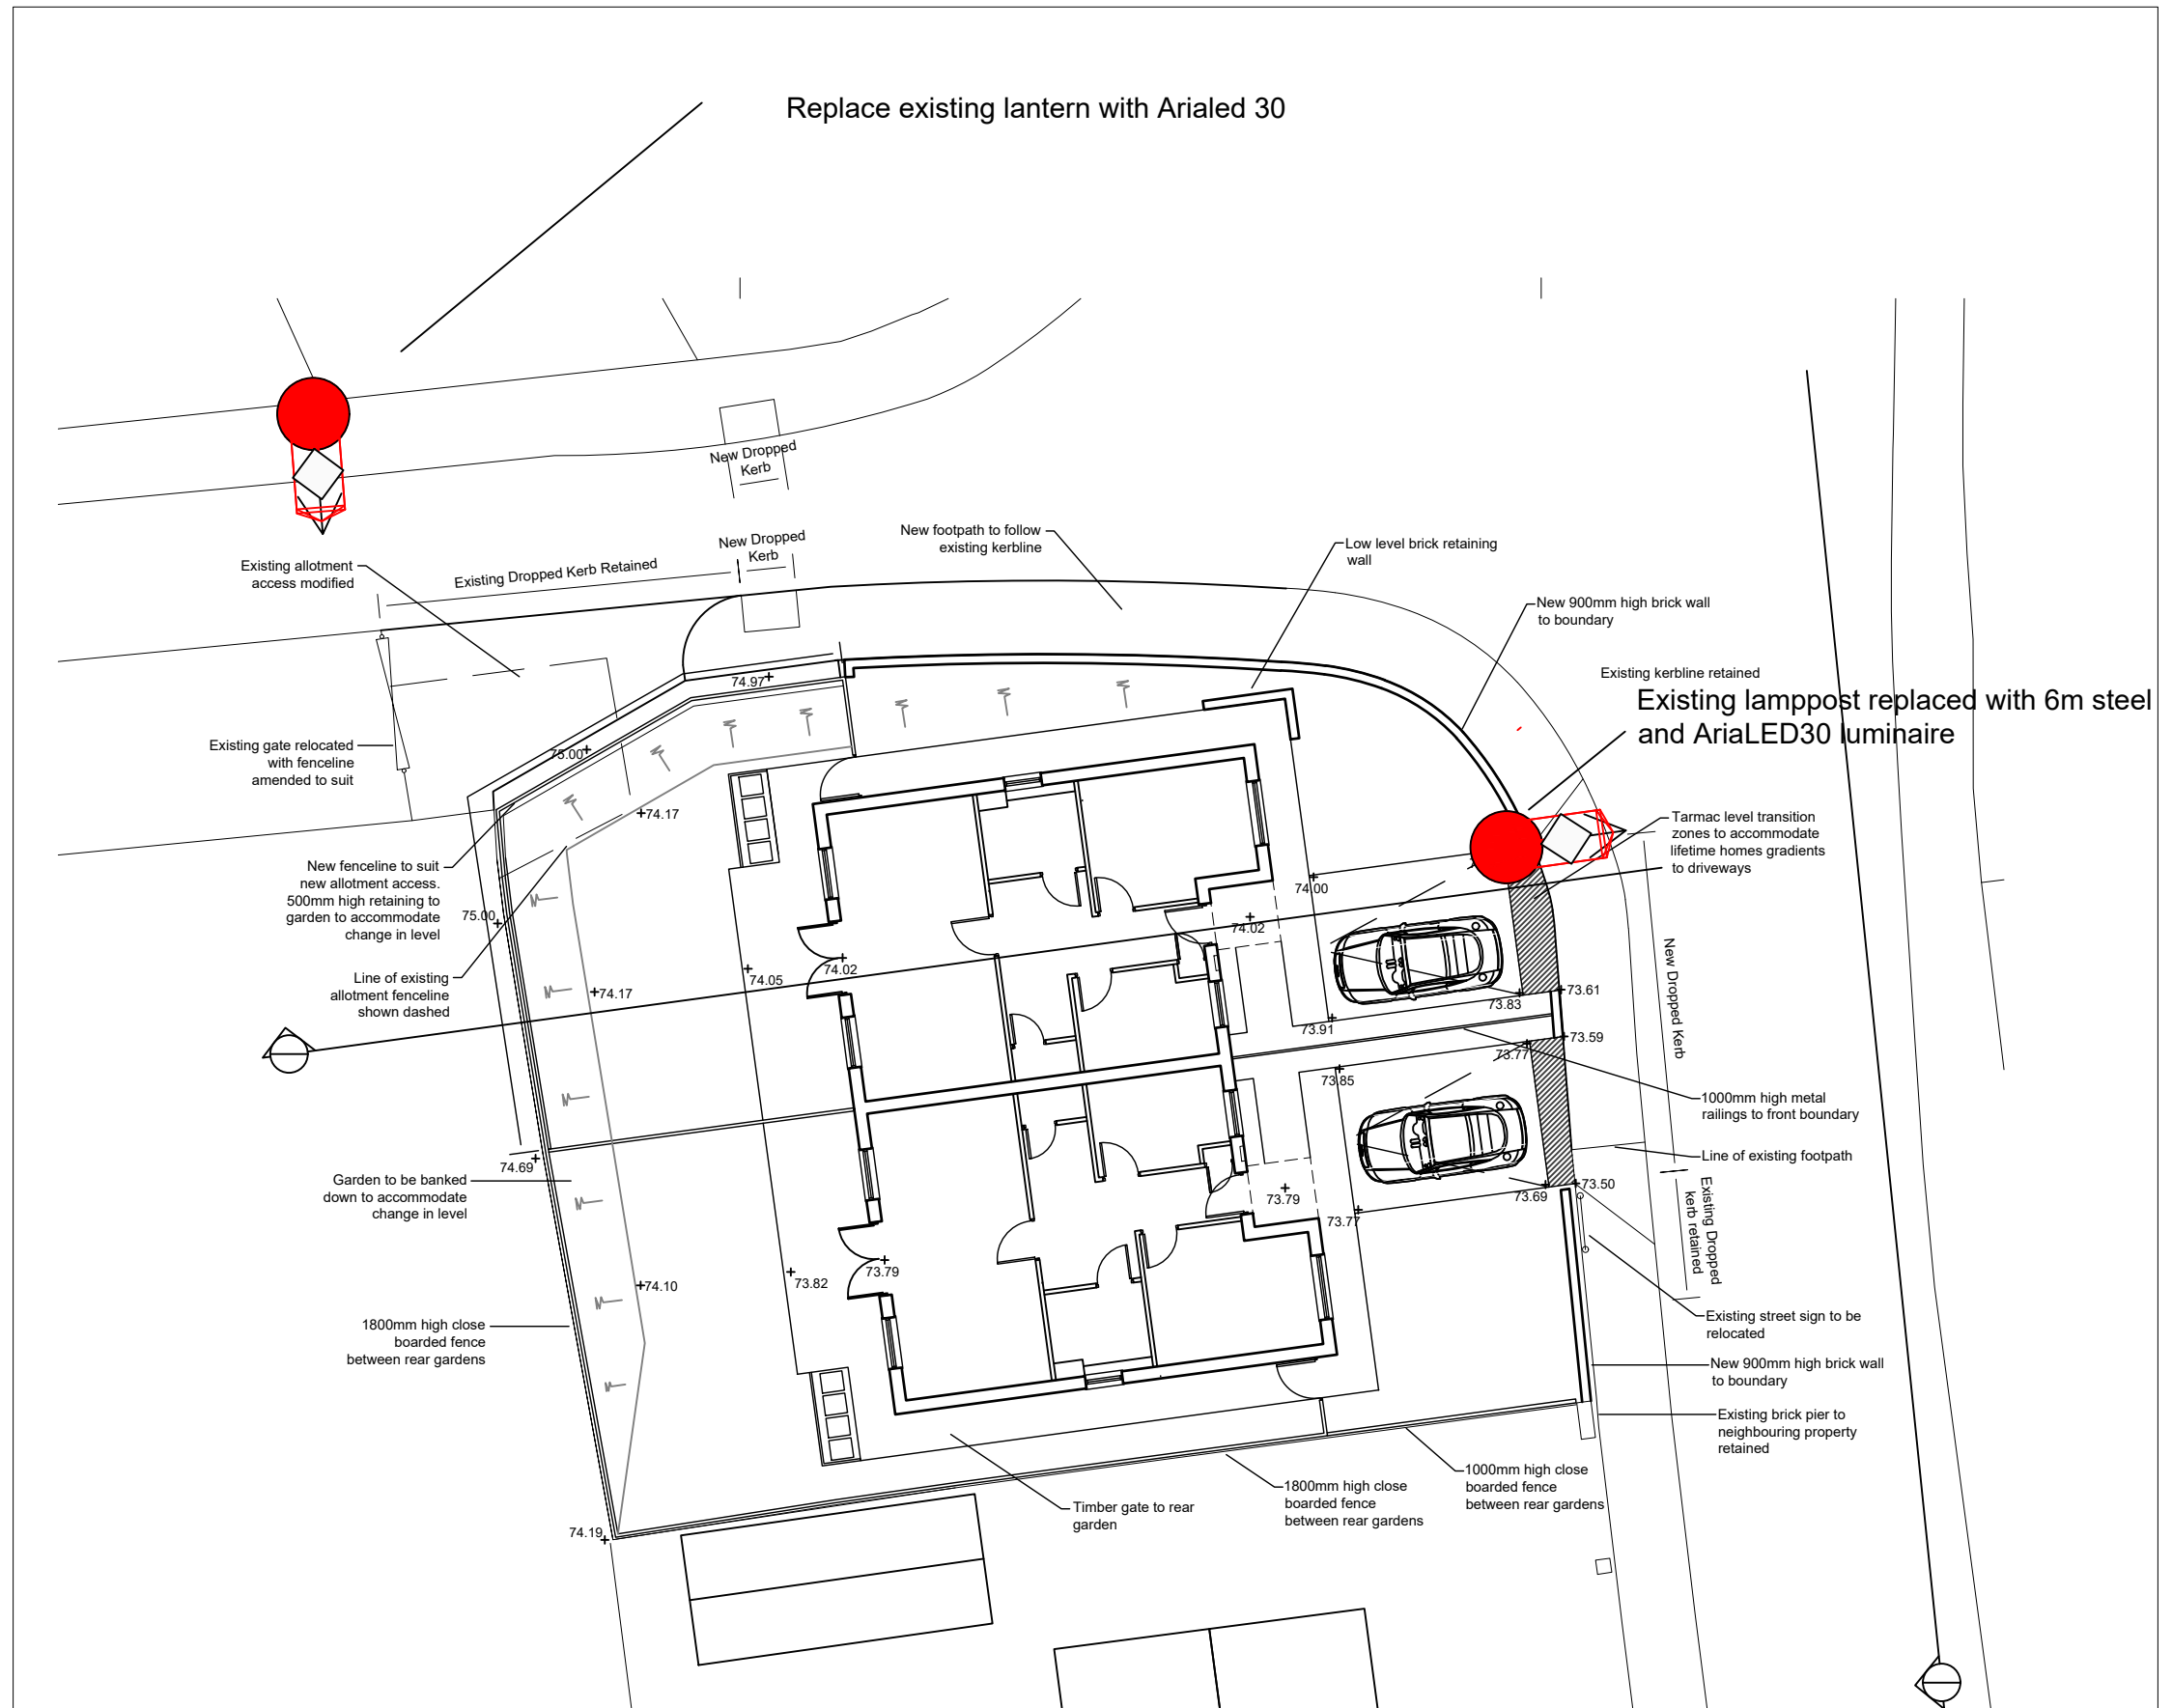

West End Avenue



West End Avenue Section 38 Street Lighting Design

Scale NTS	
Drawn SGA	Date 20/2/18
Checked	File West End

I.M. Wilson, BEng (Hons), CEng, MICE, DMS., Interim Head of Highways, Engineering and Transportation, Place Directorate, Westgate Plaza One, Westgate, Barnsley, S70 2DR Tel. (01226) 770770 Fax. (01226) 772222	
Drawing No.	1
West End Avenue	