
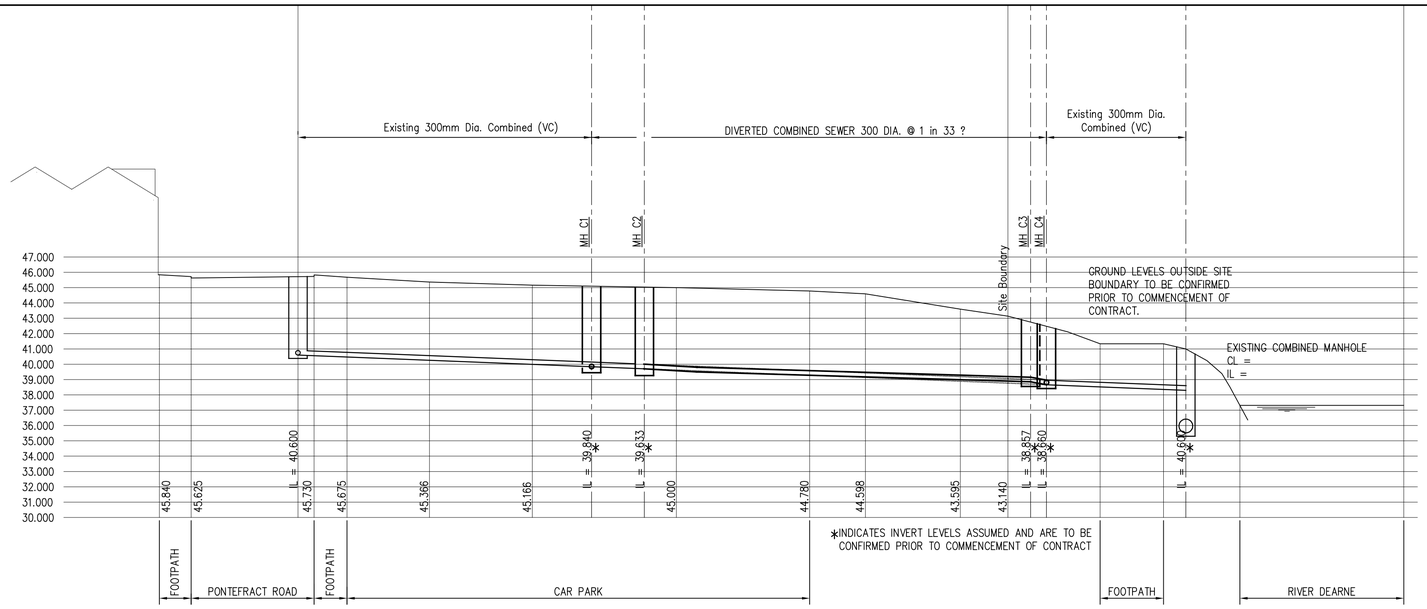


LONGITUDINAL SECTION (A – A)

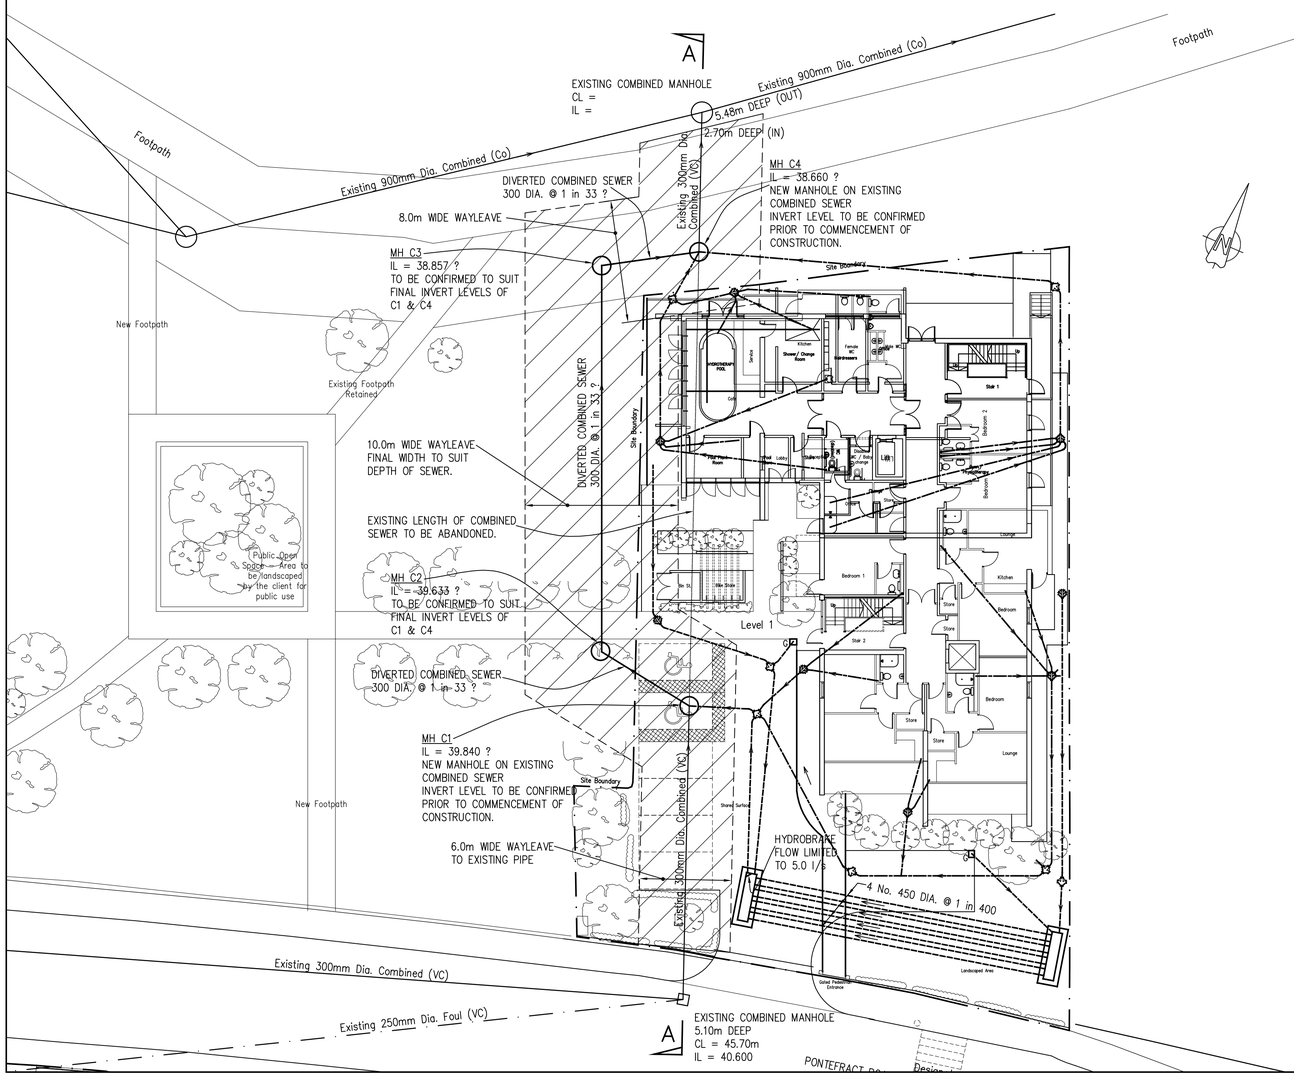

NOTES

1. ALL CLAYWARE PIPES TO BE TYPE D.V.C. EXTRA STRENGTH.
2. ALL CONCRETE PIPES TO BE CLASS H
3. ALL UPVC PIPES TO COMPLY WITH THE RELEVANT PROVISIONS OF BS4660 OR BS5481
4. PIPES WITH CONCRETE SURROUND TO HAVE 'KORKPAK OR SIMILAR' APPROVED COLLARS AT EACH JOINT
5. CONNECTIONS TO ROAD GULLIES TO BE 150mm DIA
6. ALL RWP'S TO BE CONNECTED TO BIG'S
7. ALL SEWERS TO BE LAID FROM THE LOWEST LEVEL UPWARDS.
8. LEVELS OF EXTG SEWERS TO BE CHECKED ON SITE PRIOR TO COMMENCEMENT OF CONTRACT.
9. BEDDING FACTOR FOR DVC PIPES TO BE 2.5 AND FOR CONCRETE PIPES 2.2 UNO
10. DEEP DRAINAGE ADJACENT TO DWELLINGS TO HAVE CONCRETE SURROUND IN ACCORDANCE WITH CLAUSE A11 OF APPROVED DOCUMENT H OF THE BUILDING REGULATIONS.
11. PIPES OF DIFFERING SIZE TO BE CONNECTED CROWN TO CROWN.
12. POSITIONS OF EXISTING SERVICES TO BE CHECKED BY CONTRACTOR PRIOR TO COMMENCEMENT OF CONSTRUCTION.

PRELIMINARY

Rev.	Drawn	Date	Description

Contract

PROPOSED CARE HOME
PONTEFRACT ROAD,
BARNSLEY.

Drawing Title

DRAINAGE LAYOUT
AND LONGITUDINAL
SECTION.

MOOREHEAD SUTTON & LAING
CONSULTING ENGINEERS
Middlesbrough 01642 240525
Manchester 0161 833 4883
London 0171 242 8220

Scales (A1) 1:200	Date JULY '11
Drawn GH	Checked
Contract No. 3957M	Drawing No. 101
REVISION	