A1




DRAIN PASSING UNDER FOUNDATION THROUGH MASS CONCRETE FILL




DRAIN PASSING UNDER FOUNDATION FILLERBOARD PROTECTION DETAIL

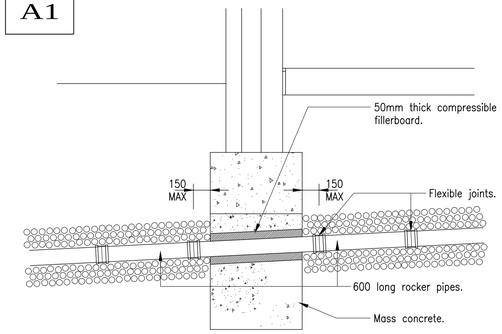


DRAIN PASSING THROUGH WALL BUILT IN DETAIL

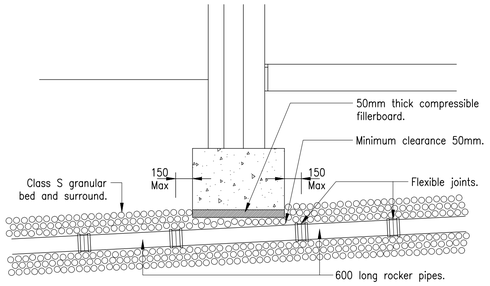


DRAIN PASSING THROUGH WALL NOT BUILT IN DETAIL

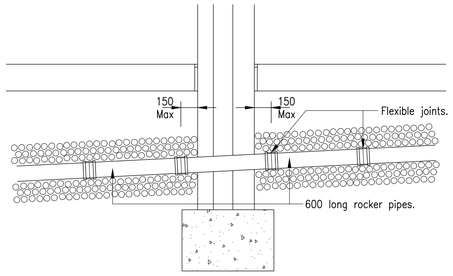


DRAIN TRENCH EDGE LESS THAN 1m. FROM FOOTING/FOUNDATION EDGE

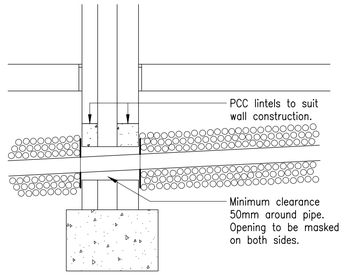


DRAIN TRENCH EDGE MORE THAN 1m. FROM FOOTING/FOUNDATION EDGE

## BEDDING DETAIL IN VICINITY OF FOOTINGS/FOUNDATIONS
## NOTE:– THIS IS A TYPICAL DETAIL TO BE CROSS REFERENCED WITH 3E STRUCTURAL DRAWINGS

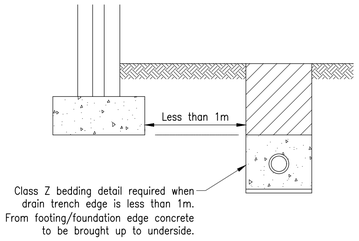


CLASS Q DETAIL
(where cover to pipe less than 1.2m)

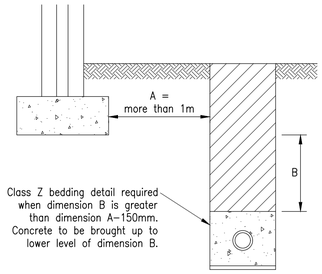


CLASS T DETAIL

(plastic pipes shall comply with WIS 4–35–01 and shall be kitemarked)
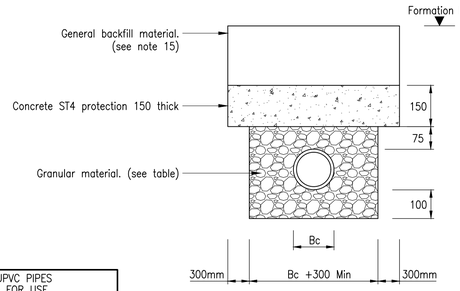
| THE FOLLOWING UPVC PIPES ARE ACCEPTABLE FOR USE | |
|---|---|
| UPONOR ULTRA DRAIN | 110 & 160 (O.D.) |
| HEPWORTH PLASTIDRAIN | 110 & 160 (O.D.) |
| WAVIN OSMA DRAIN | 110 & 160 (O.D.) |
| WAVIN OSMA ULTRA RIB | 150 & 225 (I.D.) |
| MARLEY SOLID WALL | 110 & 160 (O.D.) |
| MARLEY QUANTUM | 150 & 225 (I.D.) |
| POLYPIPE RIDGISEWER | 150 & 225 (I.D.) |
| POLYPIPE UNDERGROUND DRAIN | 110 & 160 (O.D.) |

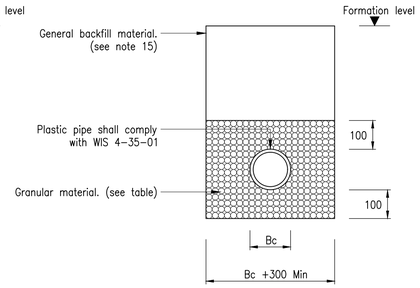


JOINTS FOR CONCRETE ENCASED PIPES

| NOMINAL PIPE DIA (mm) | SINGLE SIZED (mm) | GRADED (mm) |
|---|---|---|
| 100 | 10 | Not permitted |
| 110 to 150 | 10 or 14 | 14 to 5 graded |
| 160 to 300 | 10, 14 or 20 | Either 20 to 5 graded or 14 to 5 graded |
| 310 to 500 | 14 or 20 | Either 20 to 5 graded or 14 to 5 graded |
| Over 550 | 14, 20 or 40 | Either 40 to 5 graded or 20 to 5 graded or 14 to 5 graded |

GRANULAR BEDDING MATERIAL
Extract from Table A2 WIS 4–08–02
(all aggregates to table 4 of bs 882 :1983)

| MINIMUM RECOMMENDED TRENCH WIDTHS FOR PIPES IN POOR GROUND CONDITIONS | |
|---|---|
| NOM PIPE DIA (mm) | MIN TRENCH WIDTH (mm) |
| 150 | 450 |
| 225 | 525 |
| 300 And above | Two times nom. diameter |

## PLASTIC PIPE (u–PVC) TRENCH BEDDING DETAILS




TYPICAL ROAD GULLY DETAIL

(375 x 750mm not adopted)




RODDING ACCESS DETAIL

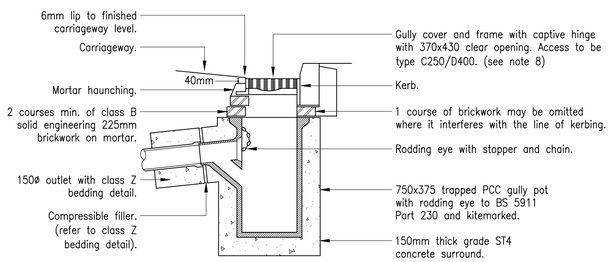(non–traficked areas)




CLASS S DETAIL (see notes 13 & 15)

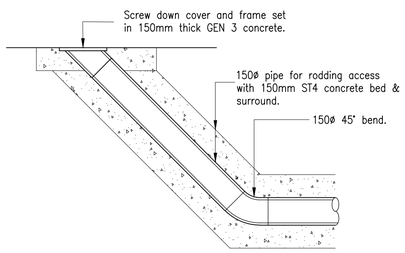


CLASS Z DETAIL (see notes 11, 13 & 15)

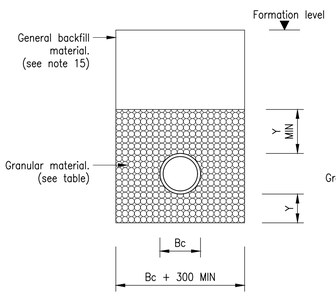


CLASS A DETAIL (see notes 11, 13 & 15)

| TRENCH WIDTHS | |
|---|---|
| PIPE I.D | OVERALL TRENCH WIDTH |
| 100 | 550 |
| 150 | 600 |
| 225 | 700 |
| 300 | 850 |
| 375 | 1050 |
| 450 | 1150 |
| 525 | 1200 |
| 600 | 1350 |
| 675 | 1450 |
| 750 | 1500 |
| 825 | 1600 |
| 900 | 1900 |
| 1050 | 2100 |
| 1200 | 2300 |
| 1350 | 2500 |
| 1500 | 2700 |
| 1800 | 3100 |
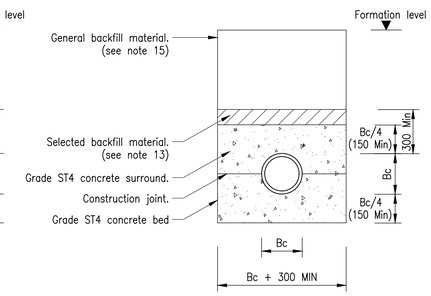
| NOMINAL PIPE DIA (mm) | SINGLE SIZED (mm) | GRADED (mm) |
|---|---|---|
| 150 | 10 or 14 | 14 to 5 |
| 200 to 300 | 10, 14 or 20 | 14 to 5 ot 20 TO 5 |
| 375 to 525 | 14 or 20 | 14 to 5 ot 20 to 5 |
| Greater than 525 | 14, 20 or 40 | 14 to 5, 20 to 5 or 40 to 5 |

GRANULAR BEDDING MATERIAL
(all aggregates to table 4 of BS 882 :1983)
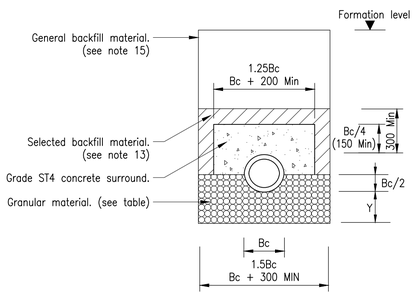
| NOMINAL PIPE DIA (mm) | THICKNESS OF COMPRESSIBLE FILLER (mm) |
|---|---|
| Less than 450 | 18 |
| 450 to 1200 | 36 |
| Greater than 1200 | 54 |

COMPRESSIBLE FILLER TABLE
(bitumen impregnated insulating board to BS 1142: Part 3)

Notes
A) Bc = outside diameter of pipe barrel.
B) Y = for uniform soils:
Sleeve jointed pipes, min. 50mm or 1/6Bc, whichever is the greater.
Socketed pipe, min. 100mm or 1/6Bc, whichever is the greater under barrels and not less than 50mm under sockets. For rock or mixed soils containing rock bands, boulders, stones or other irregular hard spots:
Sleeve jointed pipes, min. 150mm or 1/4Bc, whichever is the greater.
Socketed pipe, min. 200mm or 1/4Bc, whichever is the greater under barrels and not less than 150mm under sockets.

## RIGID PIPE TRENCH BEDDING DETAILS

DO NOT SCALE.

## NOTES –CONT....

12. Where two pipelines cross with less than 300mm cover, surround each pipe with a full concrete bed and surround (class Z detail) for not less than 1m centered on the crossing and extended as required to within 150mm of the nearest flexible joint.
13. Selected backfill material shall consist of uniform soil, free from stones larger than 40mm, clay lumps larger than 75mm, tree roots, contaminated material. Selected backfill material is to be placed in layers not exceeding 150mm thickness. Should the excavated material be unsuitable or weather conditions affect the materials stability, then a suitable hard granular material shall be used.
14. No mechanical compaction of fill material shall be permitted within 300mm above the barrel/crown of the pipe.
15. General backfill to drainage trenches in vehicular trafficked areas above the pipe bedding detail, shall be suitably selected material (in accordance with BS 8301 clause 5.7.6.1.) and be placed in layers not exceeding 225mm, each layer compacted to form a stable trench backfill, should the material be unsuitable or weather conditions affect the materials stability, then a hard granular material shall be used up to formation level.
16. All separators shall be in accordance with the environment agency document PPG3.
17. All below ground plastic/grp tanks shall be installed in accordance with the manufacturers instructions. They shall be provided with sufficient concrete surround to counter floatation and shall have a wall thickness adequate to resist the highest ground water level which could be encountered at their location.
18. All excavations in areas of high water tables and granular materials with high sand/silt contents shall be wrapped with a suitable geotechnical filter membrane to prevent migration of sands/silts. Full height clay stanks across trenches and/or at manhole locations at 25m intervals to restrict water movement along the excavation shall be provided.
19. Where utility/land drainage trenches etc cross over drainage trenches, the contractor shall construct an impermeable barrier to prevent groundwater infiltrating into the drainage trench.
20. Non–man entry access chambers shall comply with the relevant provisions of BS EN 752–3.


Only PDF/DWF Issues of this drawing are controlled. All other formats (eg. DWG AutoCAD FILES) are UN–controlled and are used at your own risk.

This drawing is copyright ©. It is sent to you in confidence and must not be copied, used or disclosed to any third parties without 3E permission. It remains the property of 3E and must be returned on request.


Contractors should refer to the residual risks contained in the CDM Pre Construction Information before carrying out any site operations and should not issue parts of this drawing without including the CDM notes and references. This information will include details of the SIGNIFICANT risks which 3E have considered beyond that which a competent contractor should be aware.

## NOTES –

1. This drawing is to be read in conjunction with all relevant 3E, architect and M&E consultants drawings and project specifications.
2. All building drainage works shall be carried out in accordance with the relevent parts of BS EN 752 'Drains and Sewer Systems Outside Buildings', the current building regulations and the local authority building control specifications and requirements.
3. All insitu and precast concrete products shall comply with class DS1 requirements for sulphate exposure in accordance with BRE Special Digest 1, Concrete in Aggresive Ground (2001) Part 1: Table 2.
4. All precast concrete products shall comply with the relevant provisions of BS 5911 and be Kitemarked. All precast concrete pipes shall be class 120 and comply with the requirements of note 3 above.
5. All vitrified clay pipes and fittings shall comply with the relevant provisions of BS EN295 and BS 65 respectively and be Kitemarked, all pipes shall be extra strength to BS 65 or equivalent BS EN295 pipe crushing strength and be of a sleeved system.
6. All u–PVC pipes and fittings shall comply with WIS 4–35–01 and shall be kitemarked.
7. Manhole covers and frames shall comply with the relevant provisions of BS EN214, have 600x600 clear openings unless otherwise specified and be of non–rocking design without cushion inserts and be Kitemarked. Load class D400 in trafficked areas and load class B125 in footways, landscaped and pedestrian areas. where required, covers shall be recessed to receive the architects specified finish.
8. Gully grates and frames shall comply with the relevant provisions of BS EN:124 and be of non–rocking design with captive hinge access and be Kitemarked. Load class D400 in industrial estate roads and areas carrying regular heavy traffic and load class C250 in estate roads and car parking areas. In all road locations, the grate shall be hinged on the side of the traffic direction (left hand opening).
9. All external rigid pipework shall be laid with a class S pipe bedding detail with 1.2m minimum cover to the pipe barrel under vehicular trafficked areas, 0.9m cover under fields and 0.6m cover under footways/gardens. Where cover is less than that stated, a class A pipe bedding detail shall be used on pipes 225dia and larger, for pipes less than 225dia use a class Z pipe bedding detail. Under buildings a class S pipe bedding detail shall be used. Where there is less than 300mm between the barrel of the pipe and the underside of the structural floor slab, the pipe shall be cast integral with the floor slab with 150mm minimum concrete surround with vertical reinforcement tied into the slab.
10. All u–PVC pipework shall be laid with a class T pipe bedding detail with 1.2m minimum cover to the pipe barrel under vehicular trafficked areas, 0.9m cover under fields and 0.6m cover under footways/gardens. Where cover is less than that stated a class Q pipe bedding detail shall be used.
11. Where concrete protection is required to pipework, the concrete shall be discontinued at each pipe joint over the full cross section of the concrete by means of a shaped compressible filler.

| Date | Revisions | Drawn | Rev. |
|---|---|---|---|
| 12.06.17 | INITIAL ISSUE | JM | P1 |


4 Calder Close
Calder Park
Wakefield
WF4 3BA
t 01924 240420
wakefield@3econsult.com

consulting engineers
www.3econsult.com

First Floor
Block C
Holland Park
Holland Drive
Newcastle upon Tyne
NE2 4LD
t 0191 230 2993
newcastle@3econsult.com


Client
Mr Starling

Project
Ashley Grange
Haigh Lane
Hoylandswaine

Title
Typical Drainage Details
Sheet 1

| Scale | Author | Checked | Date |
|---|---|---|---|
| 1:20 | JM | ST | June '17 |

Drawing Status
Preliminary

| Job Number | Originator | Zone | Level | Type | Role | Drawing No. | Rev |
|---|---|---|---|---|---|---|---|
| P17-089 | 3E | 00 | XX | DR | C | 1001 | P1 |