
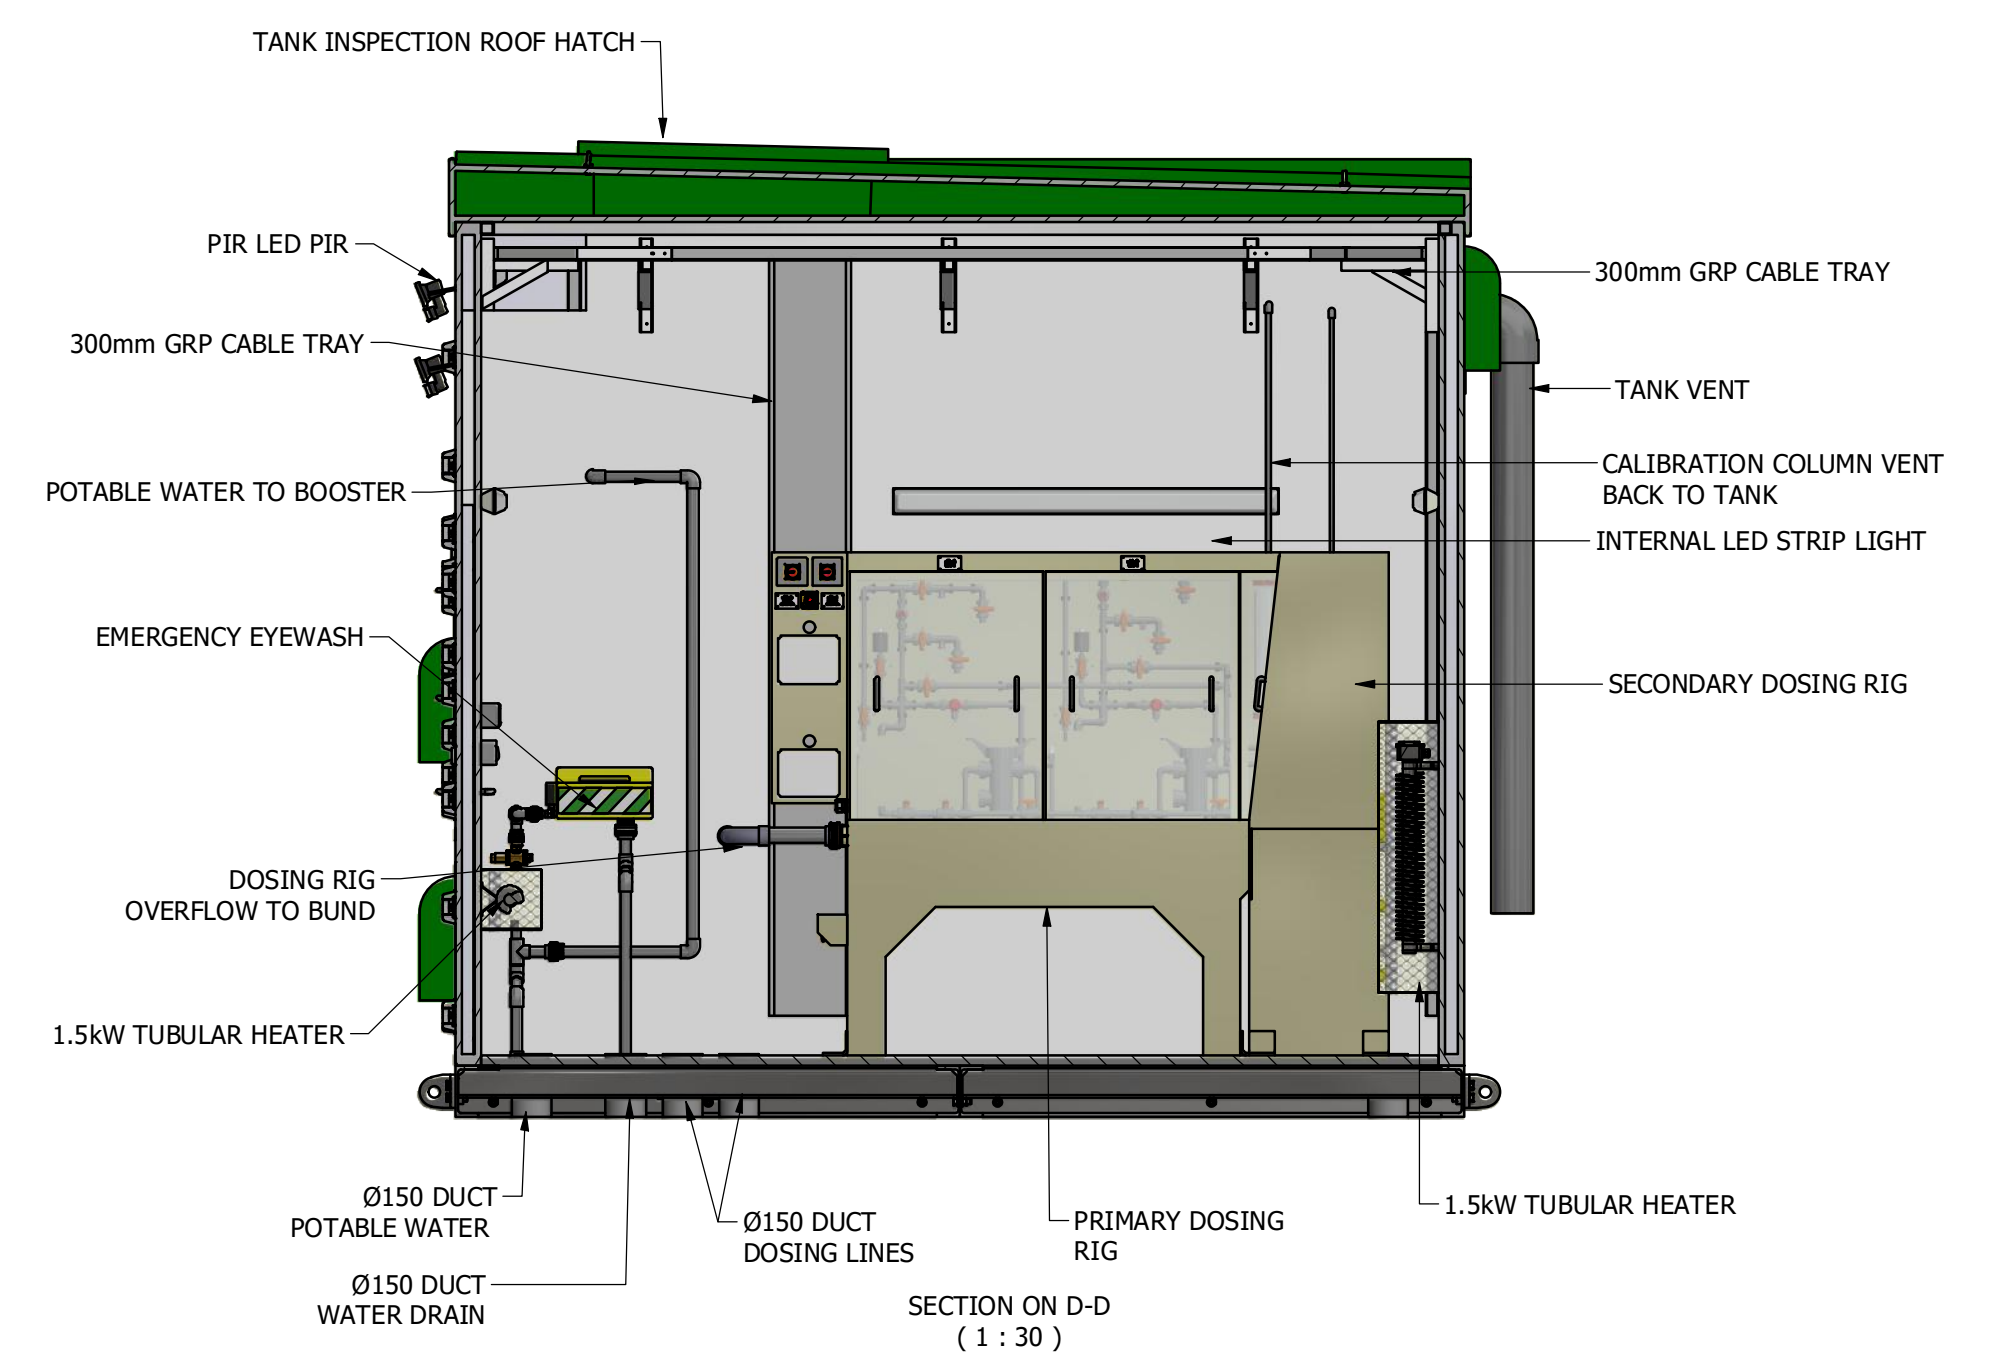
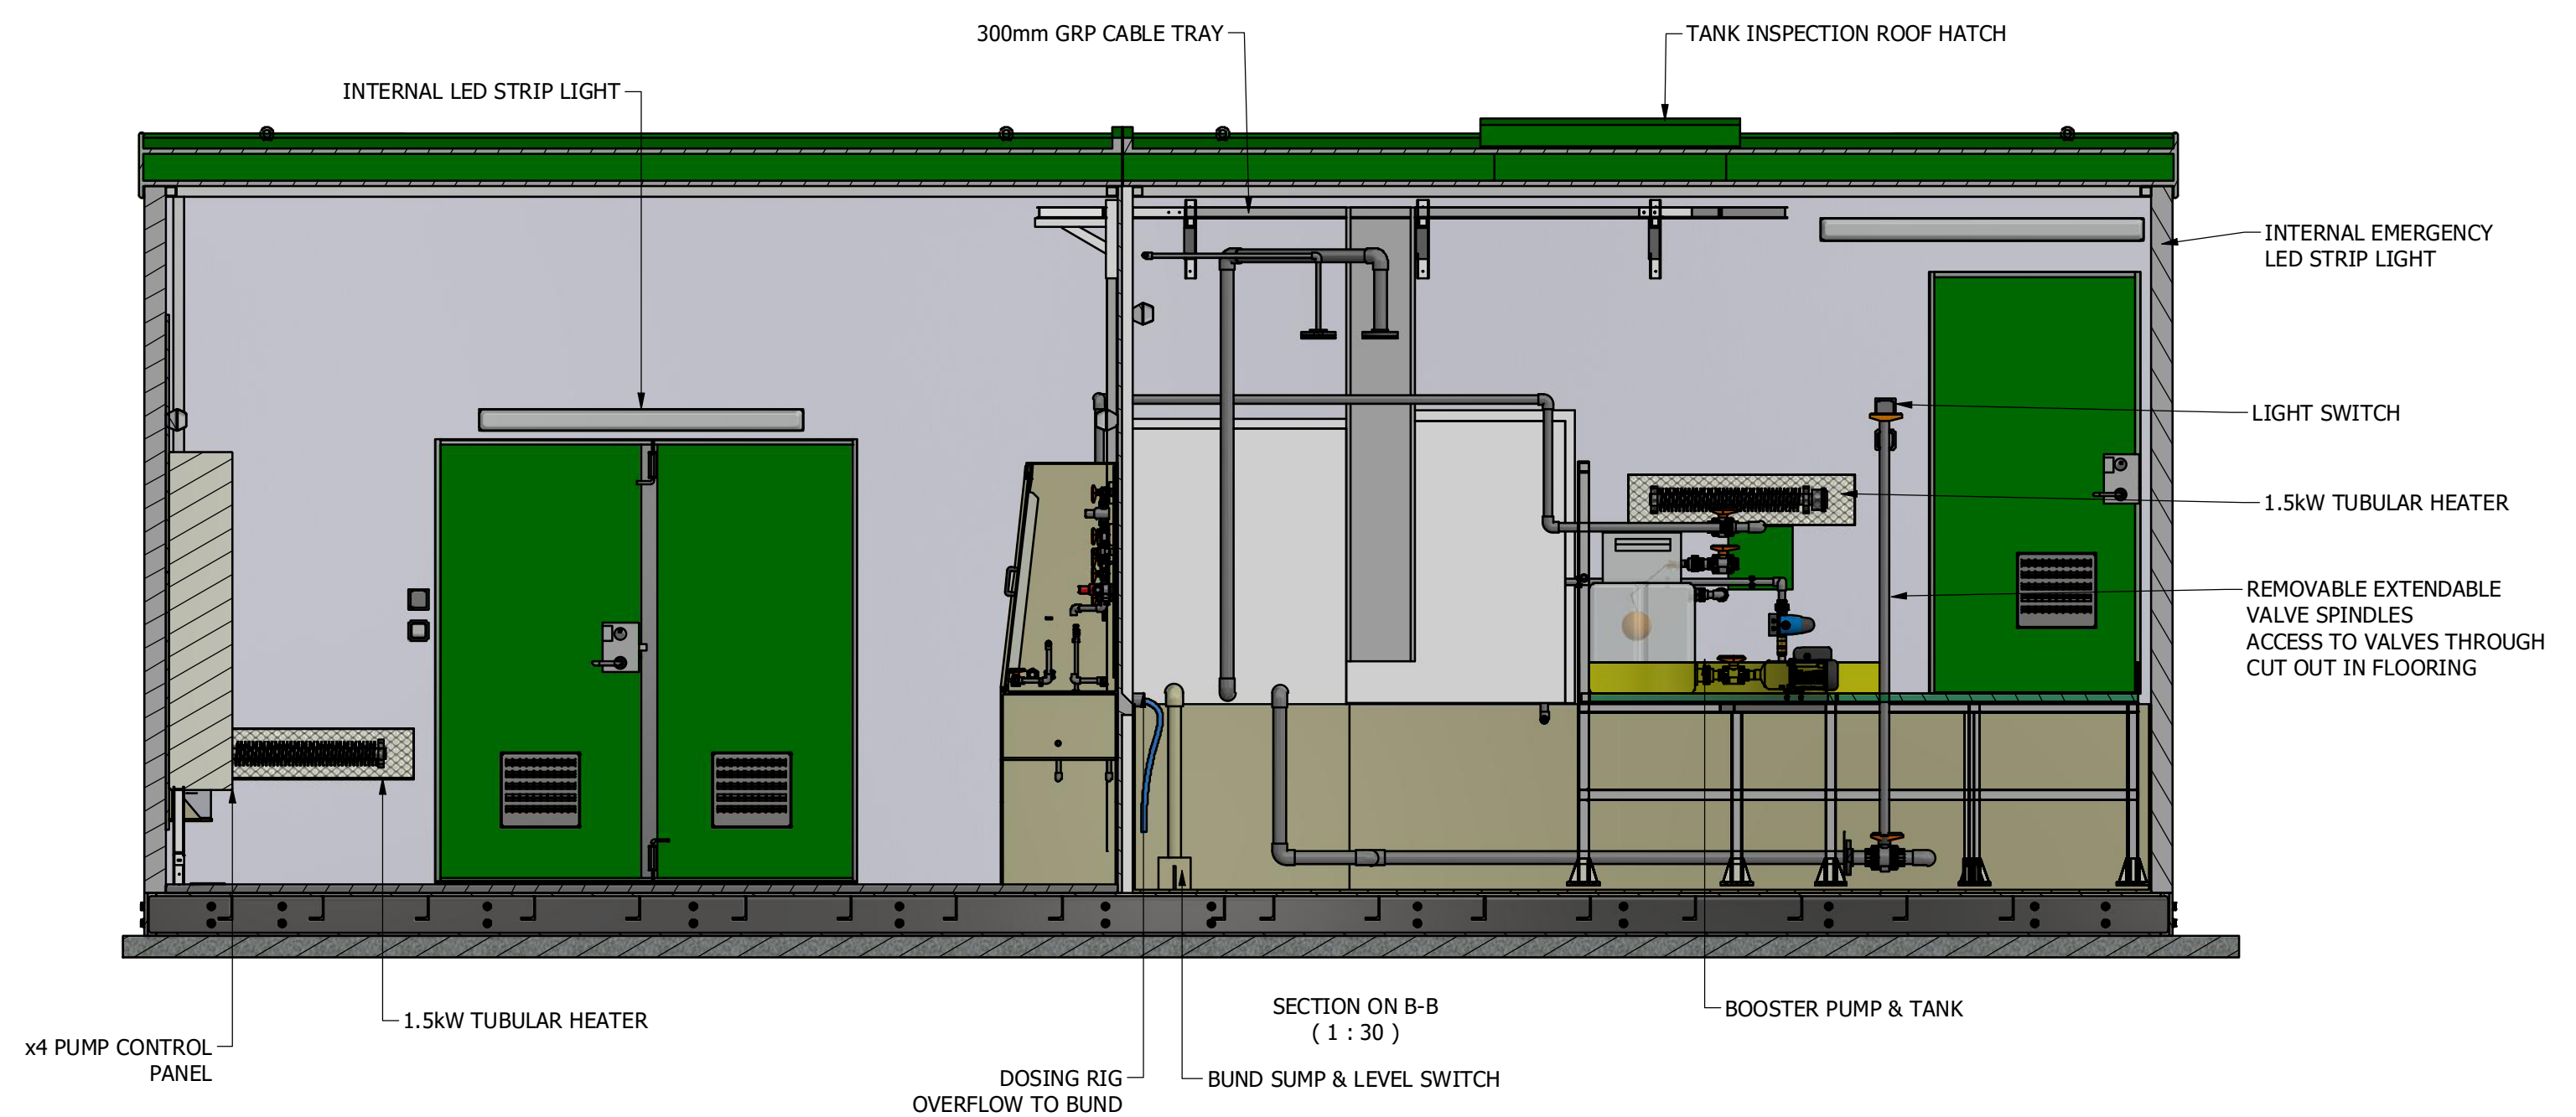
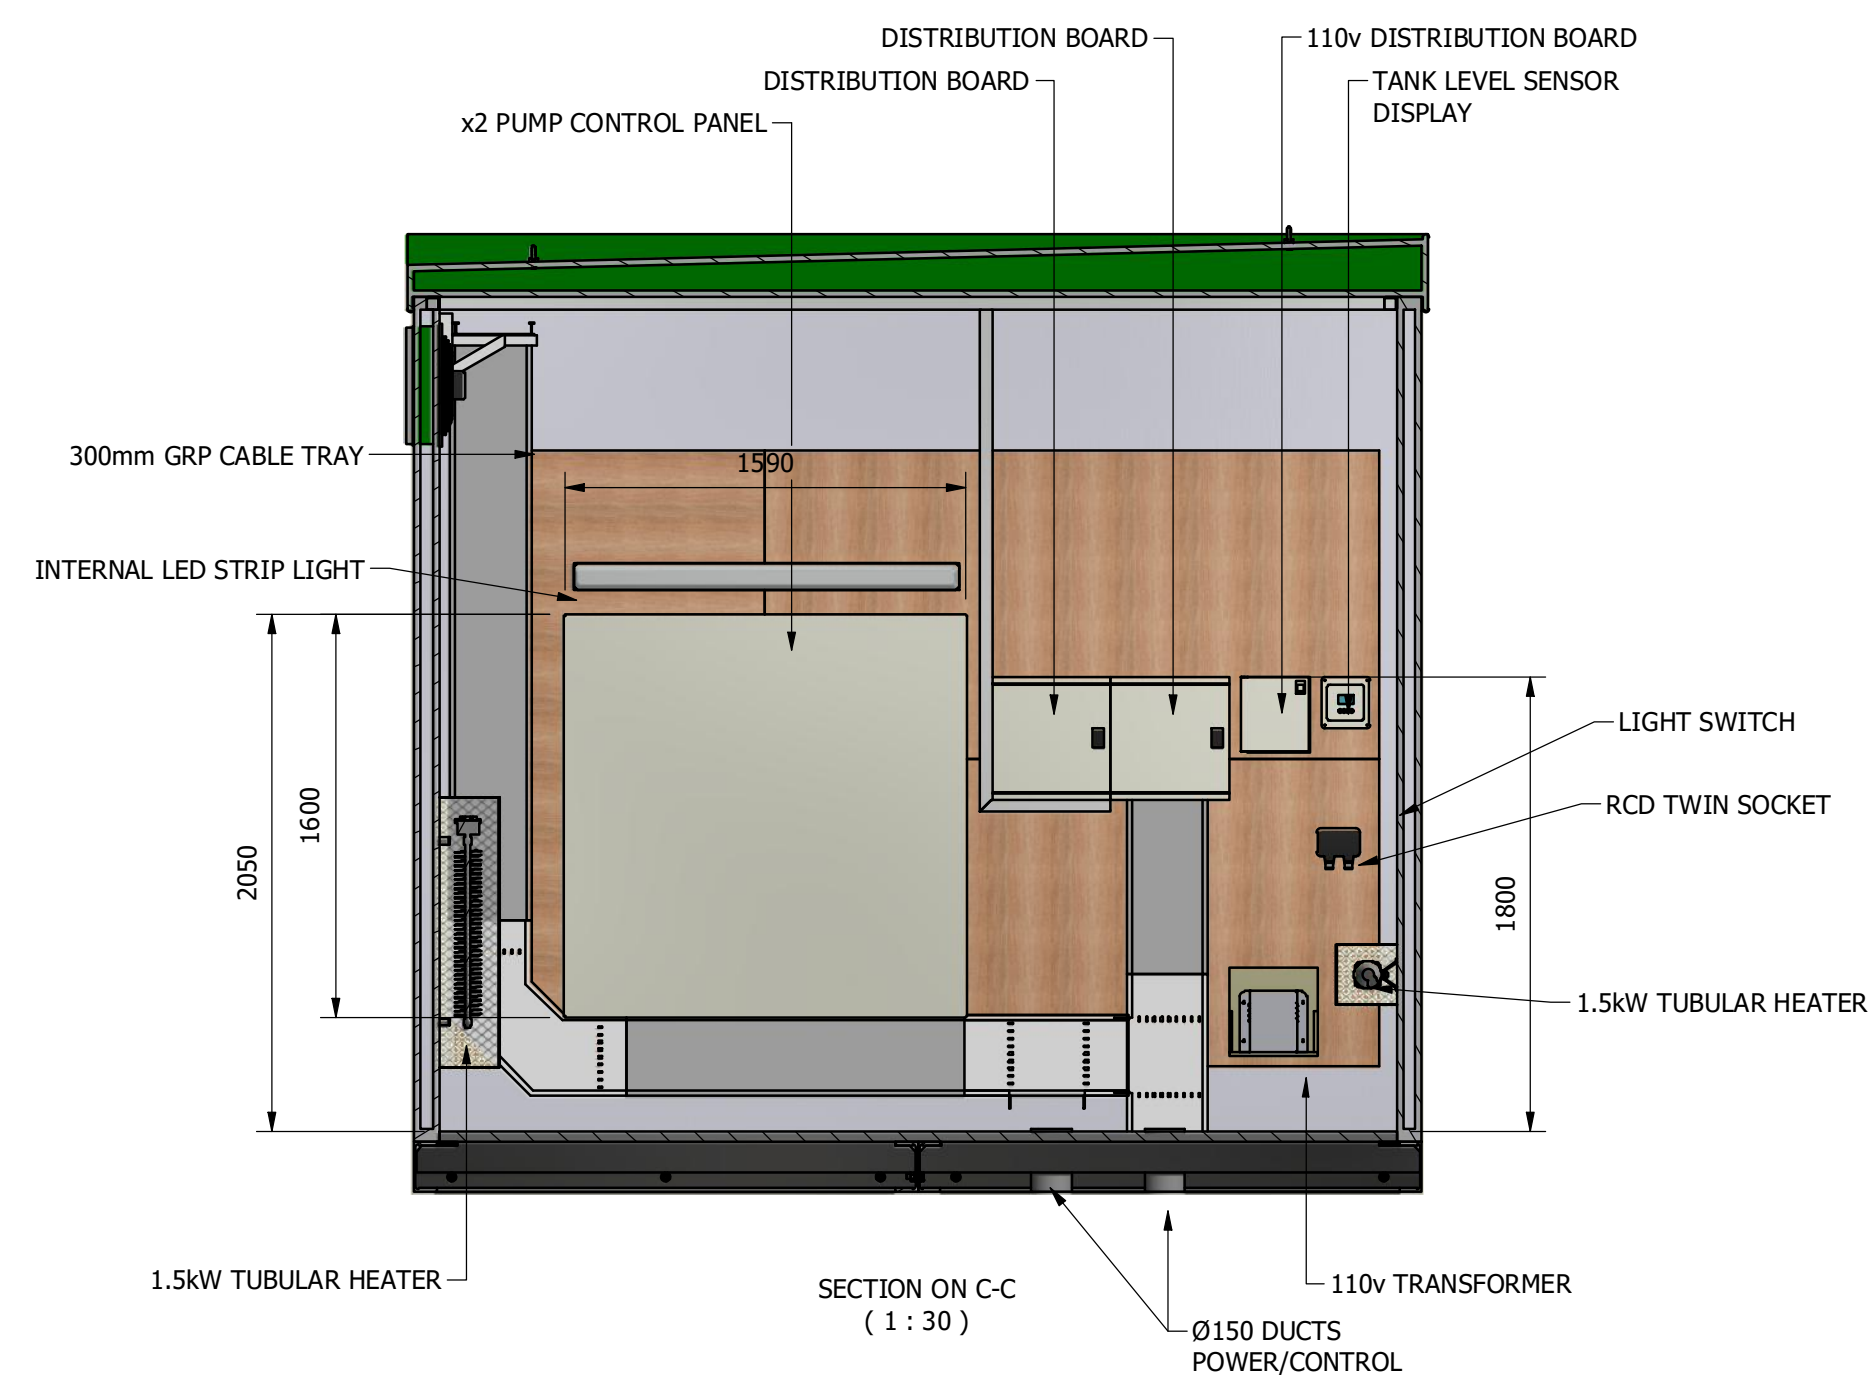
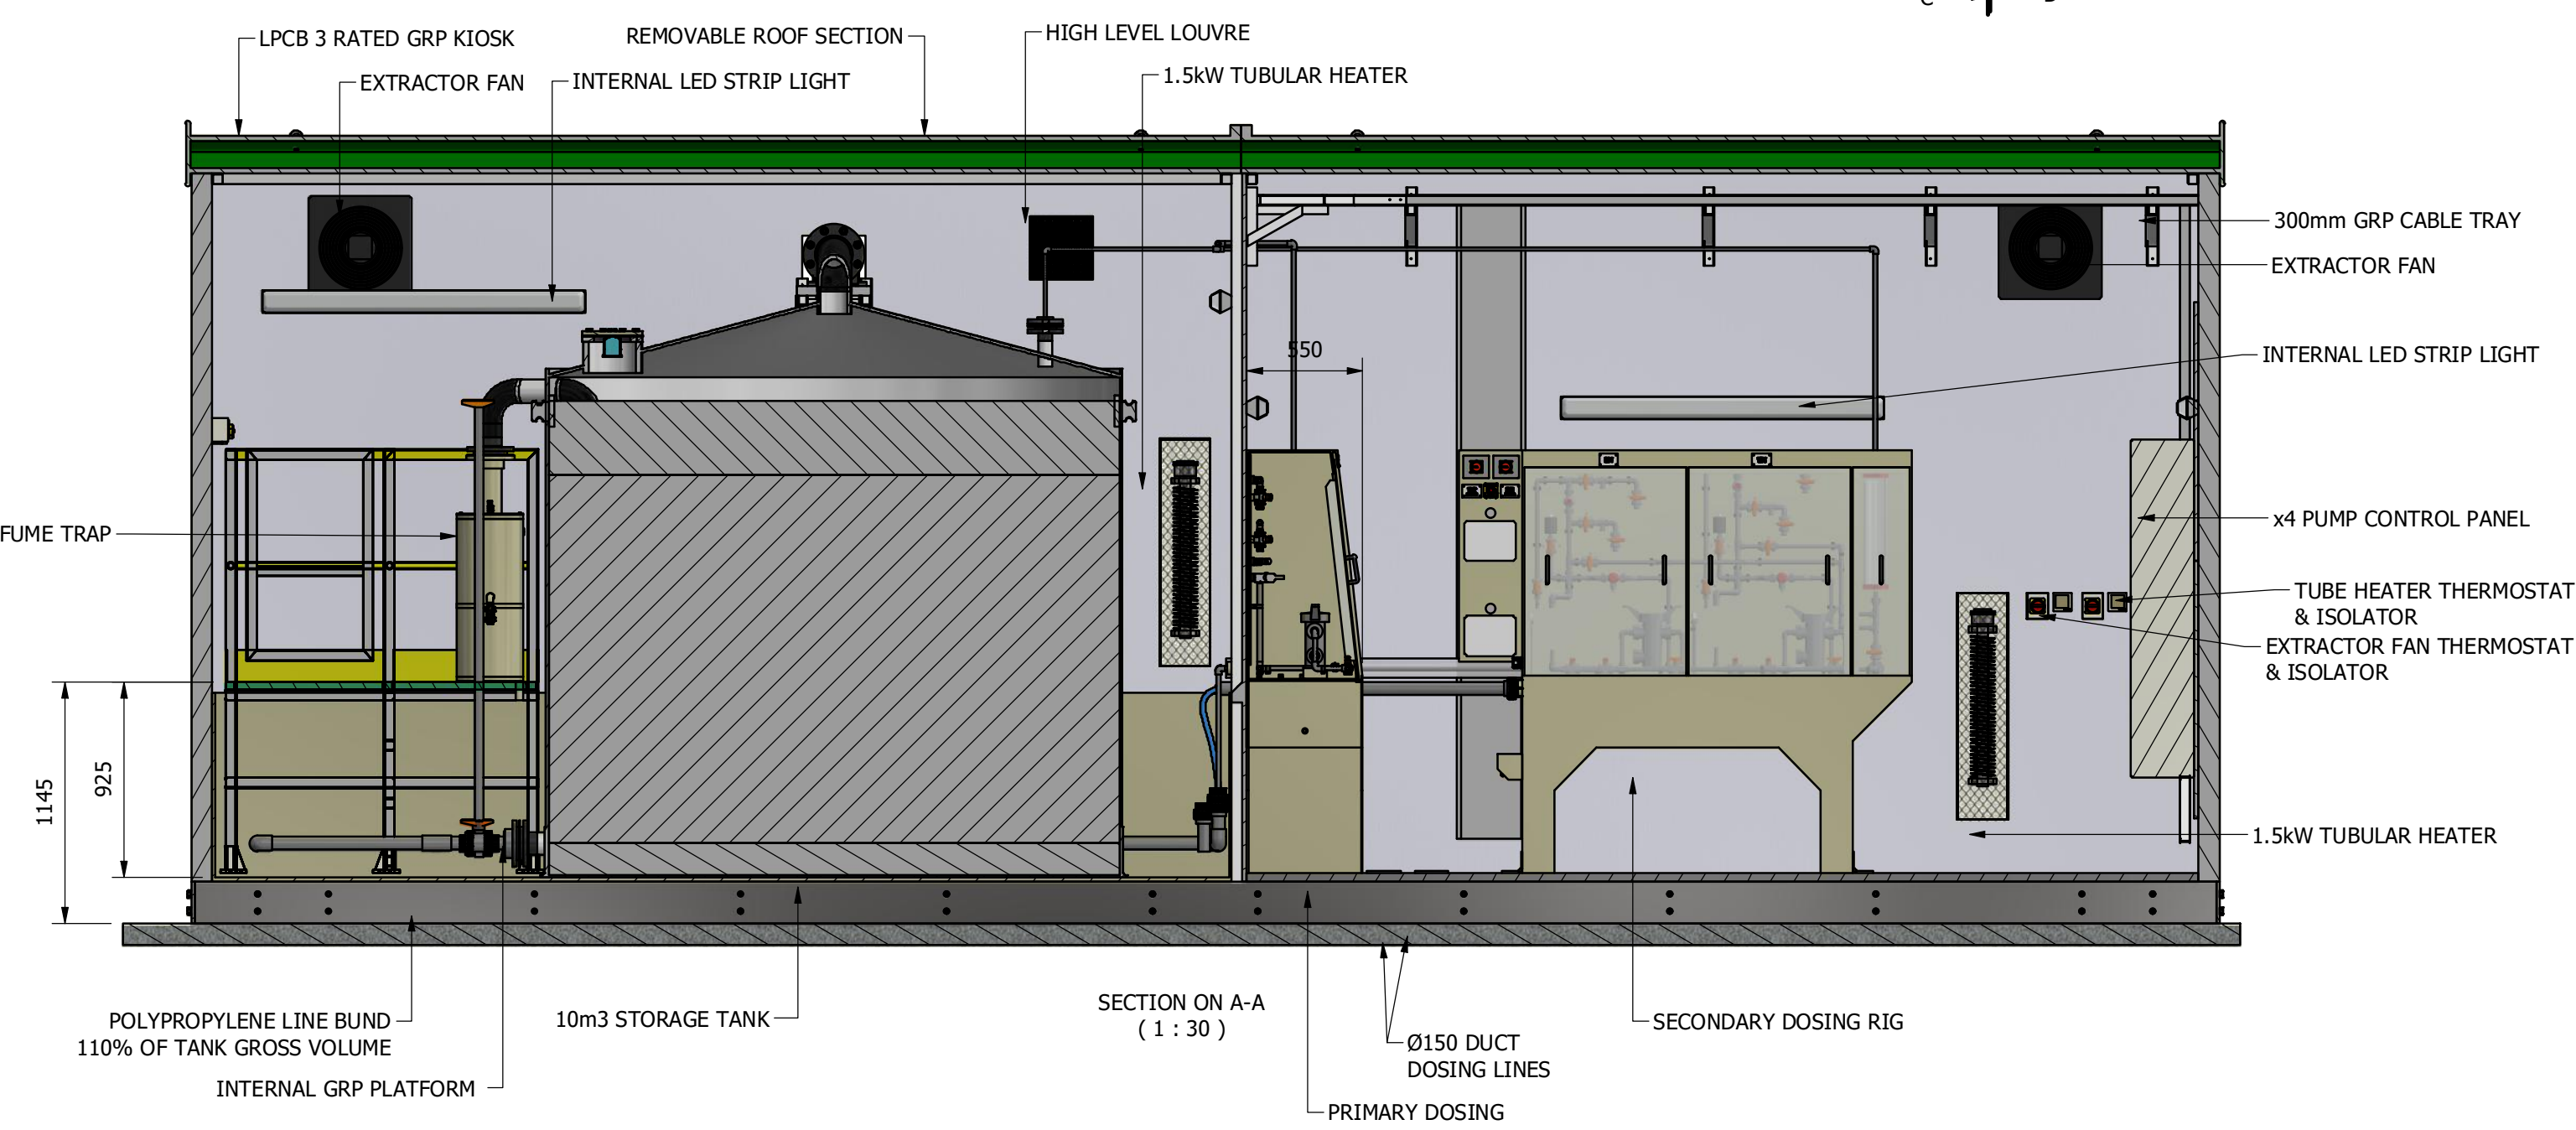
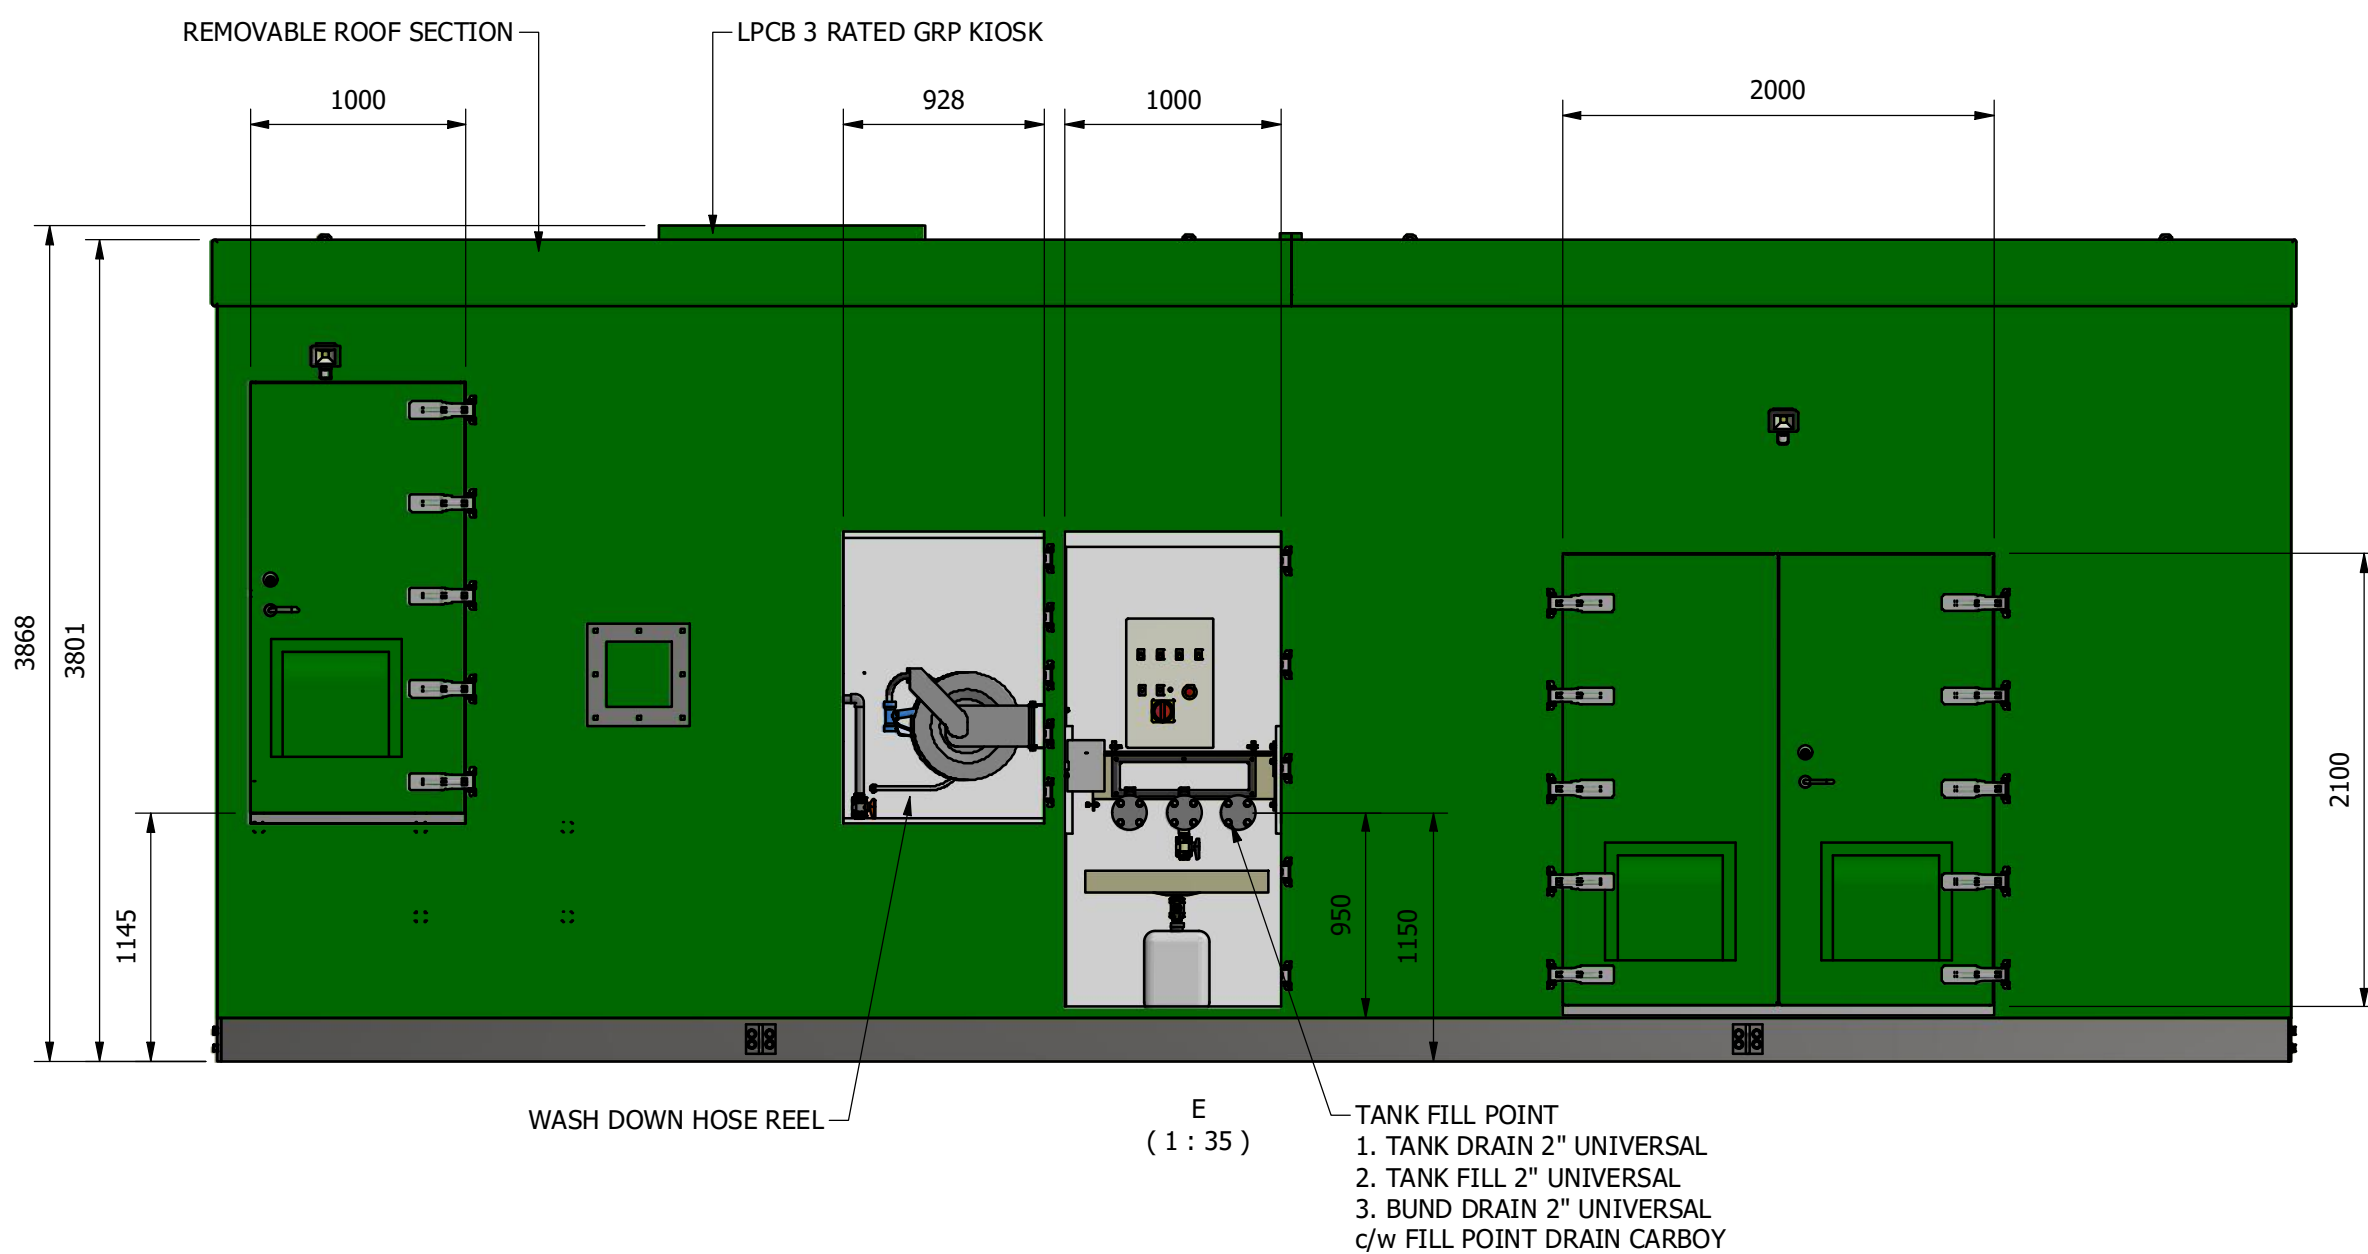


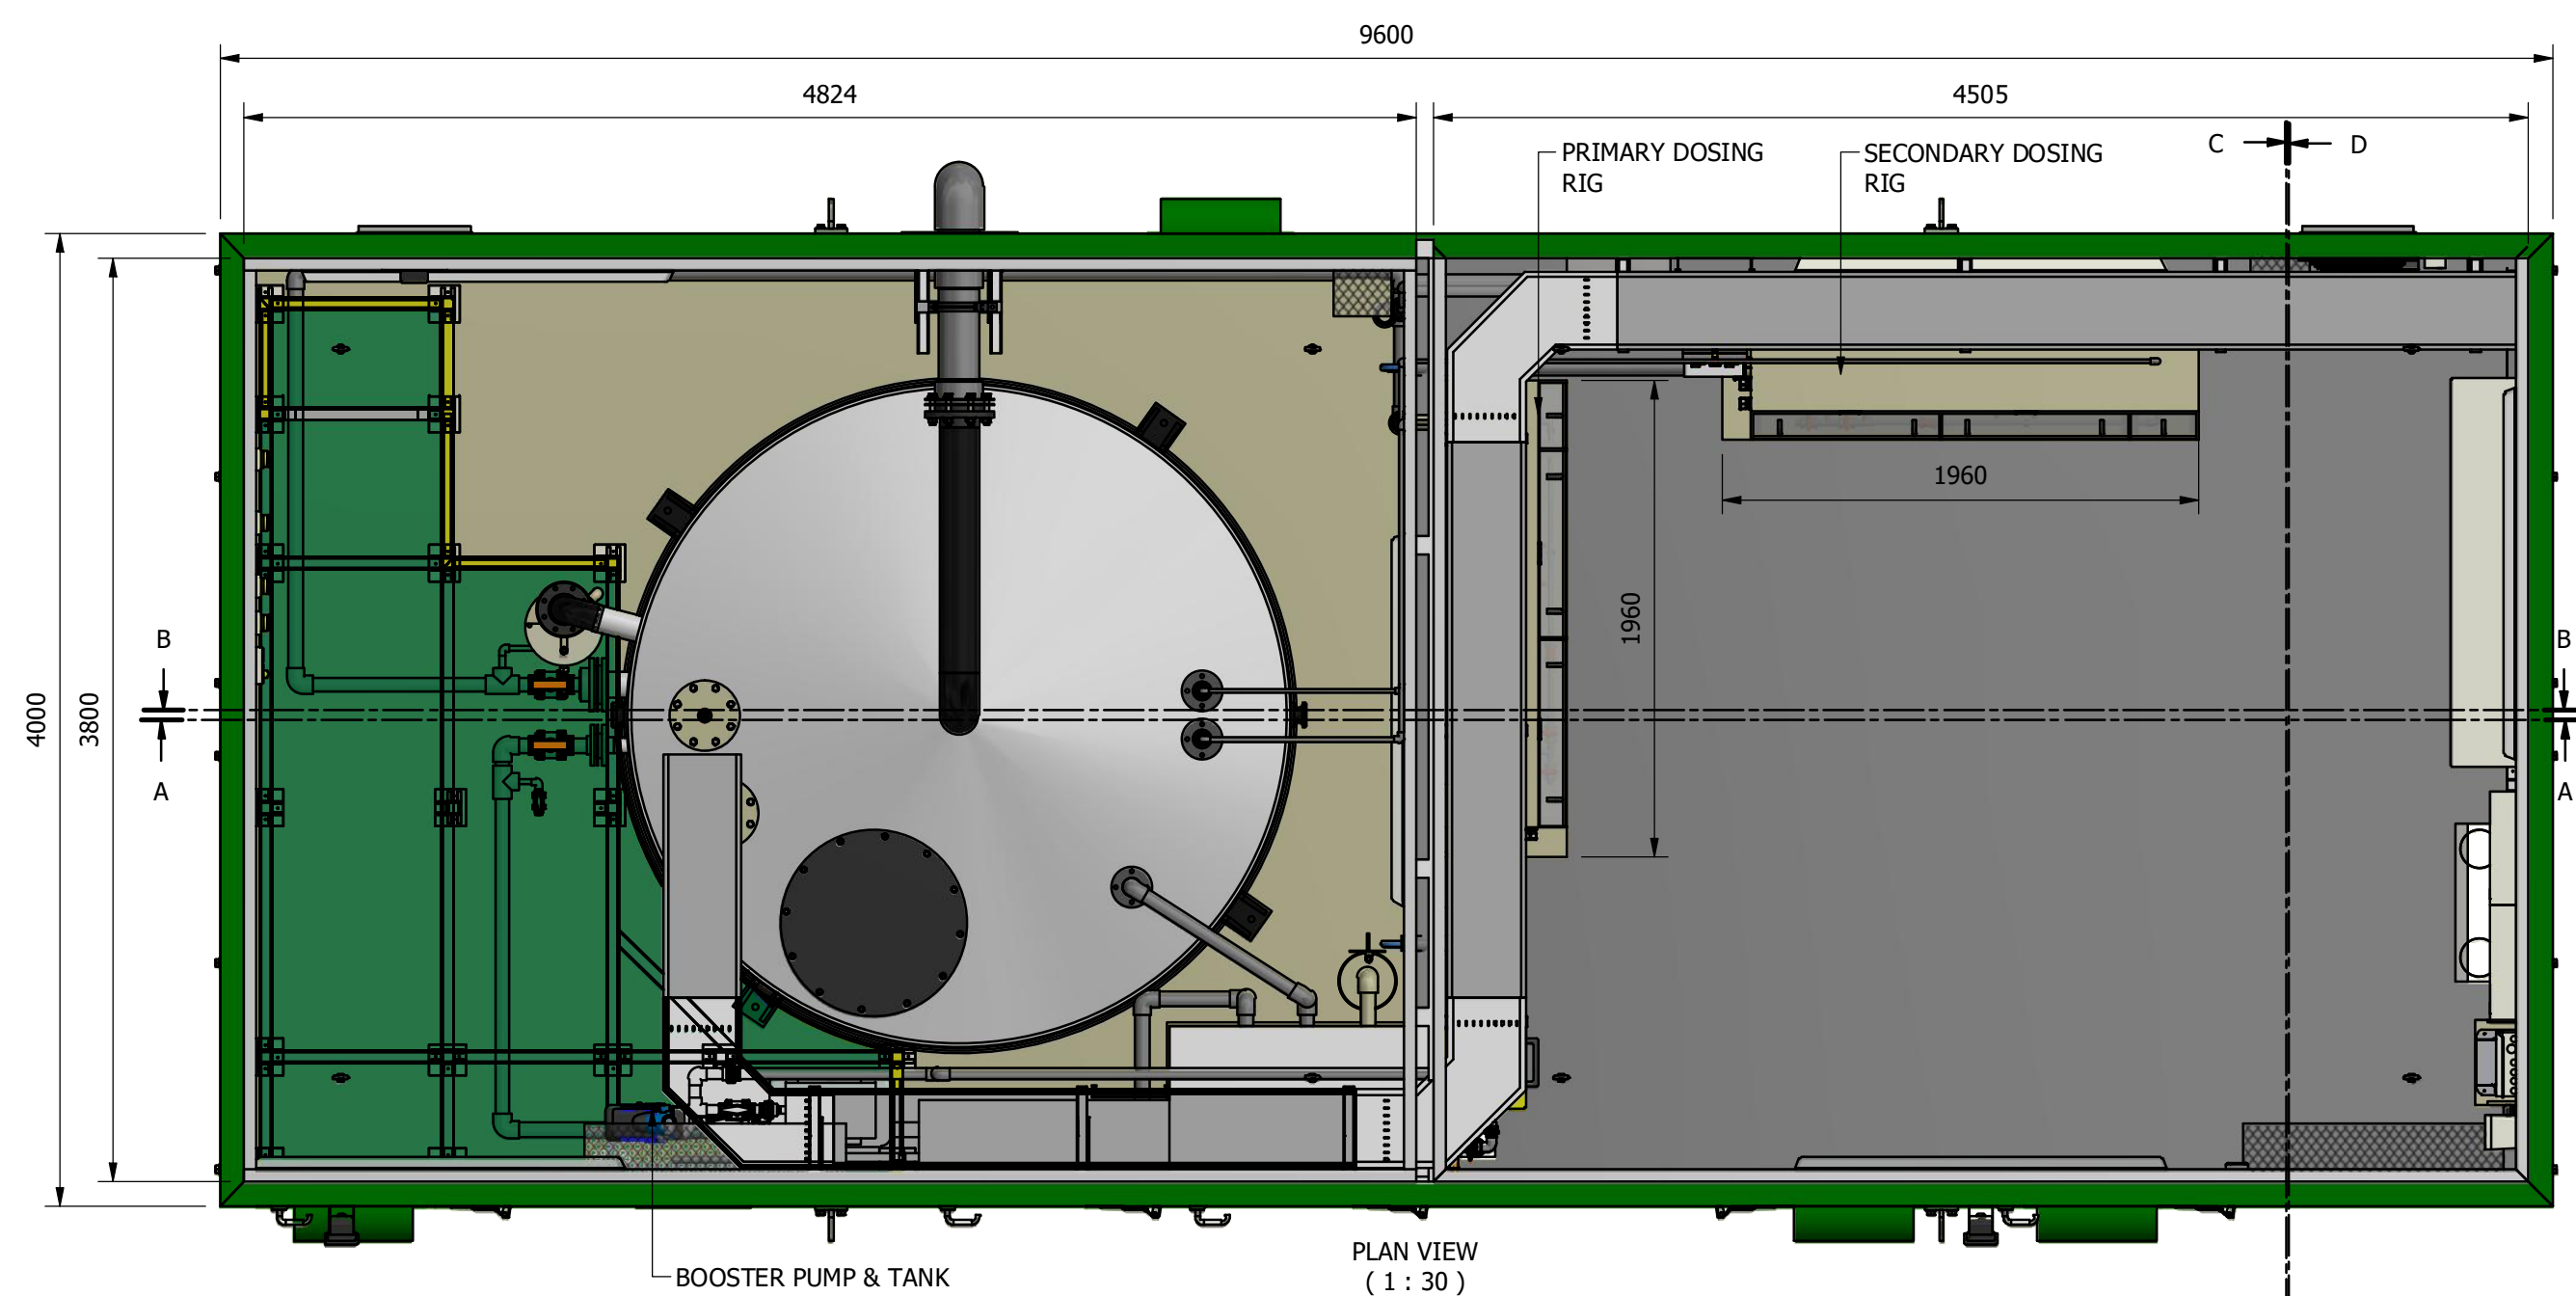

NOTES

- THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL RELEVANT DRAWINGS AND TOGETHER WITH THE SPECIFICATIONS.
- ALL DIMENSIONS ARE SHOWN IN MILLIMETRES (mm), UNLESS NOTED OTHERWISE.

LEGEND:

REFERENCE DRAWINGS:

PHCPR-YWS-WWT-COF-PI-P-0001
PRIMARY & SECONDARY COAGULANT DOSING
INTERNAL SINGLE TANK

NPS Northern Pump Suppliers Ltd
Upper Castle Street, Bradford
West Yorkshire, BD5 7RN.
Tel:- (+44) 01274 721314 Fax:- (+44) 01274 733321
E-Mail sales@npsgroup.co.uk
This drawing is copyright and must not be copied, disclosed or used for any purpose without written consent (C) 2021

Kemada PROJECT & CONTRACT SERVICES

YORKSHIRE WATER ALWAYS CONSIDERS

LIFE SAVING RULES

YorkshireWater

Yorkshire Water Services Ltd
Western House,
Western Way,
Halifax Road,
Bradford,
BD6 2SZ

Framework: AMP 7 Work Stream: -
YW Bath ID / Project Code: YW. Solution ID: -
Site: CHEESEBOTTOM WwTW
OS Grid Reference: - DAZ or DMA References: -
Drawing File: PRIMARY & SECONDARY COAGULANT DOSING SYSTEM (FERRIC) KIOSK GENERAL ARRANGEMENT
Original Design / OEM Reference: - Size: A1 Scale: AS SHOWN
Status Description: FOR APPROVAL Status: S4 Revision: P01
Drawing Number: CHE02-NPS-WWT- COF-GA-M-0001

QCE Approval