
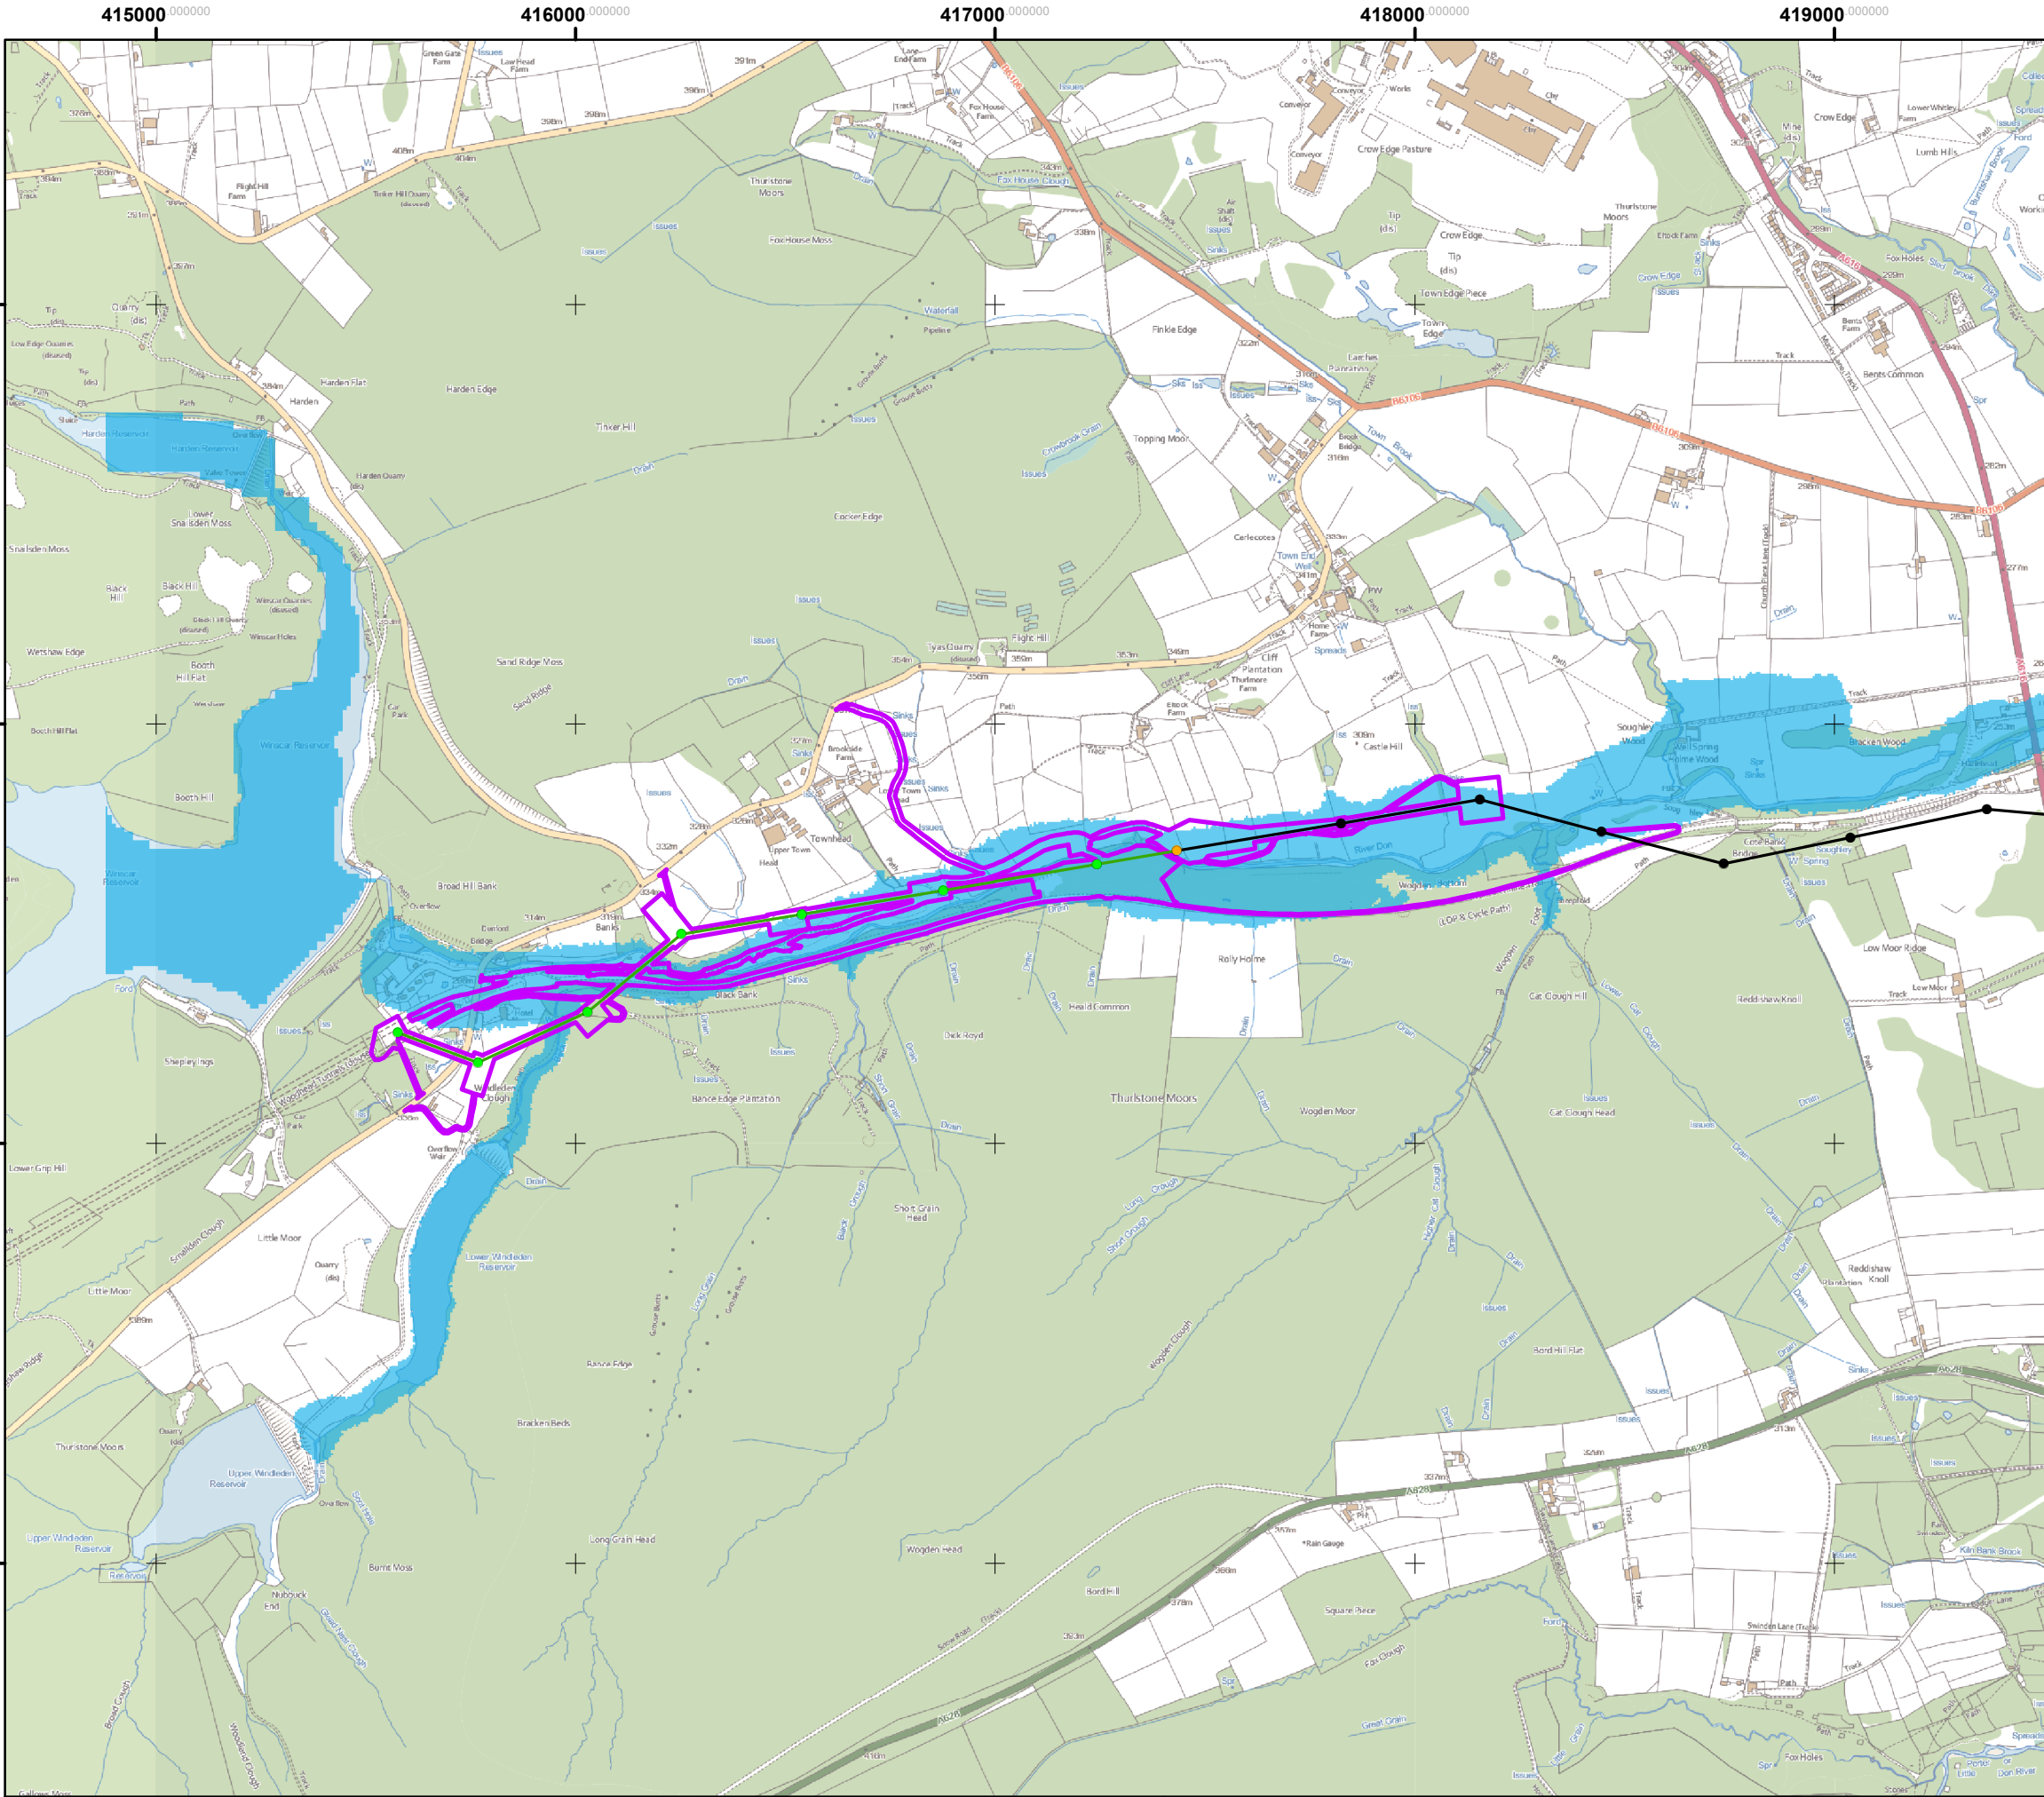


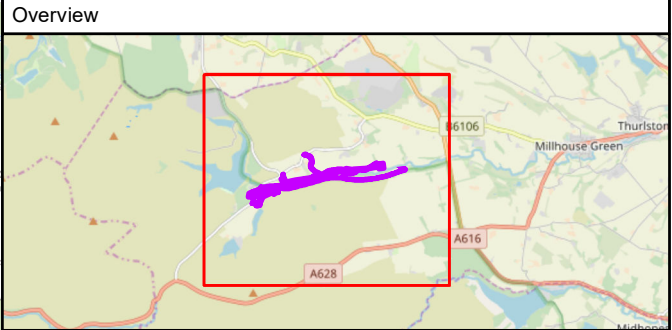

- Site Boundary**
- Existing Infrastructure**
- Existing pylon to remain
 - Existing pylon to be removed
 - Existing pylon to be replaced
 - Existing overhead line to be retained
 - Existing overhead line to be removed
- Risk of Flooding from Reservoirs**
- Environment Agency Flood Risk from Reservoirs

Source:
Tower and overhead line: National Grid, 2015.
Site Boundary: AECOM, 2015, edited Mott MacDonald May 2019.
Flood Risk from Reservoirs:
Contains information provided by the Environment Agency 2016. Copyright © and Database rights Environment Agency 2010. All rights reserved.

Reproduced from Ordnance Survey digital map data © Crown copyright 2015.
All rights reserved. Licence number National Grid Electricity - 100024241
Reproduced from Ordnance Survey digital map data © Crown copyright 2016.
All rights reserved. Licence number 0100031673

004	For information	GS	TN	KL	02/05/19
003	For information	GS	TN	KL	28/03/19
002	For information	GS	LA	KL	18/10/18
Rev	Description	Cre'd	Chk'd	App'd	Date

nationalgrid

Master Scheme No:	Sub-Scheme No:	Site:
Not Provided	Not Provided	Peak District


Scheme Name:
Visual Impact Provision - Peak District (East) Project

Document Title:
**Figure 9.8: Environment Agency
Risk of Flooding from Reservoirs**

Created by: GS	Date: 02/05/19	Checked by: LA	Date: 02/05/19	Approved by: KL	Date: 02/05/19
Development Eng: -	Document Type: -	Scale: 1:16,000	Format: A3	Sheet(s): 1 of 1	Rev: 001

National Grid Document Number:
PDD--LAY-012

FEED Document Number:
MMD-362981-C-GIS--XX-0012



Co-ordinate System:
British National Grid

