


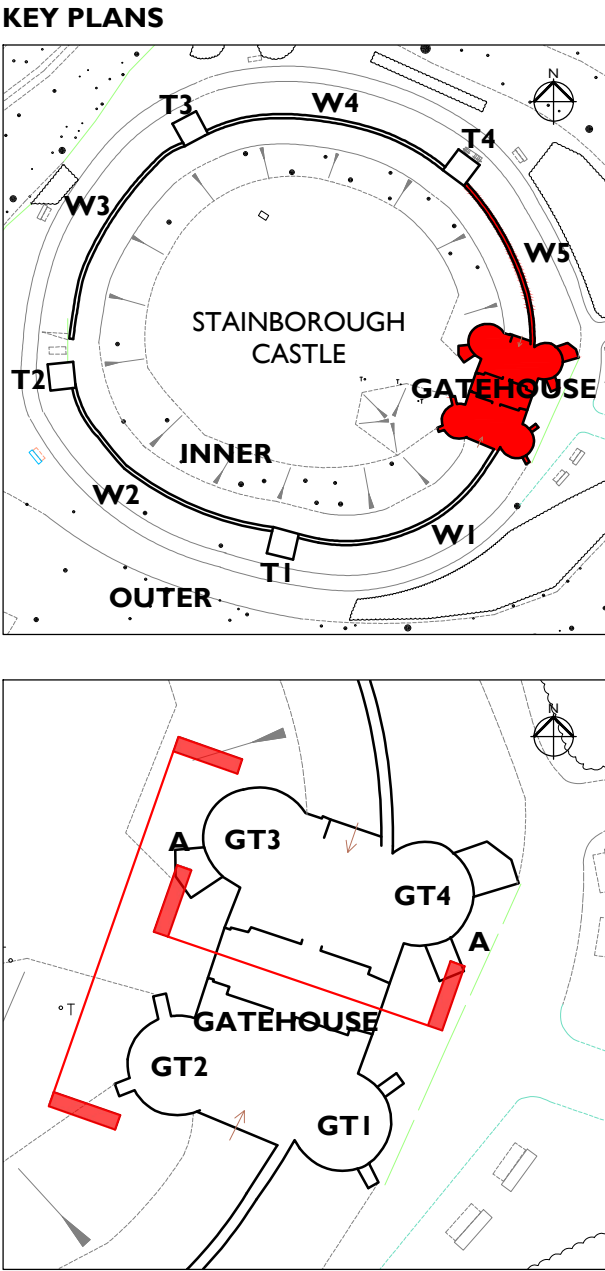


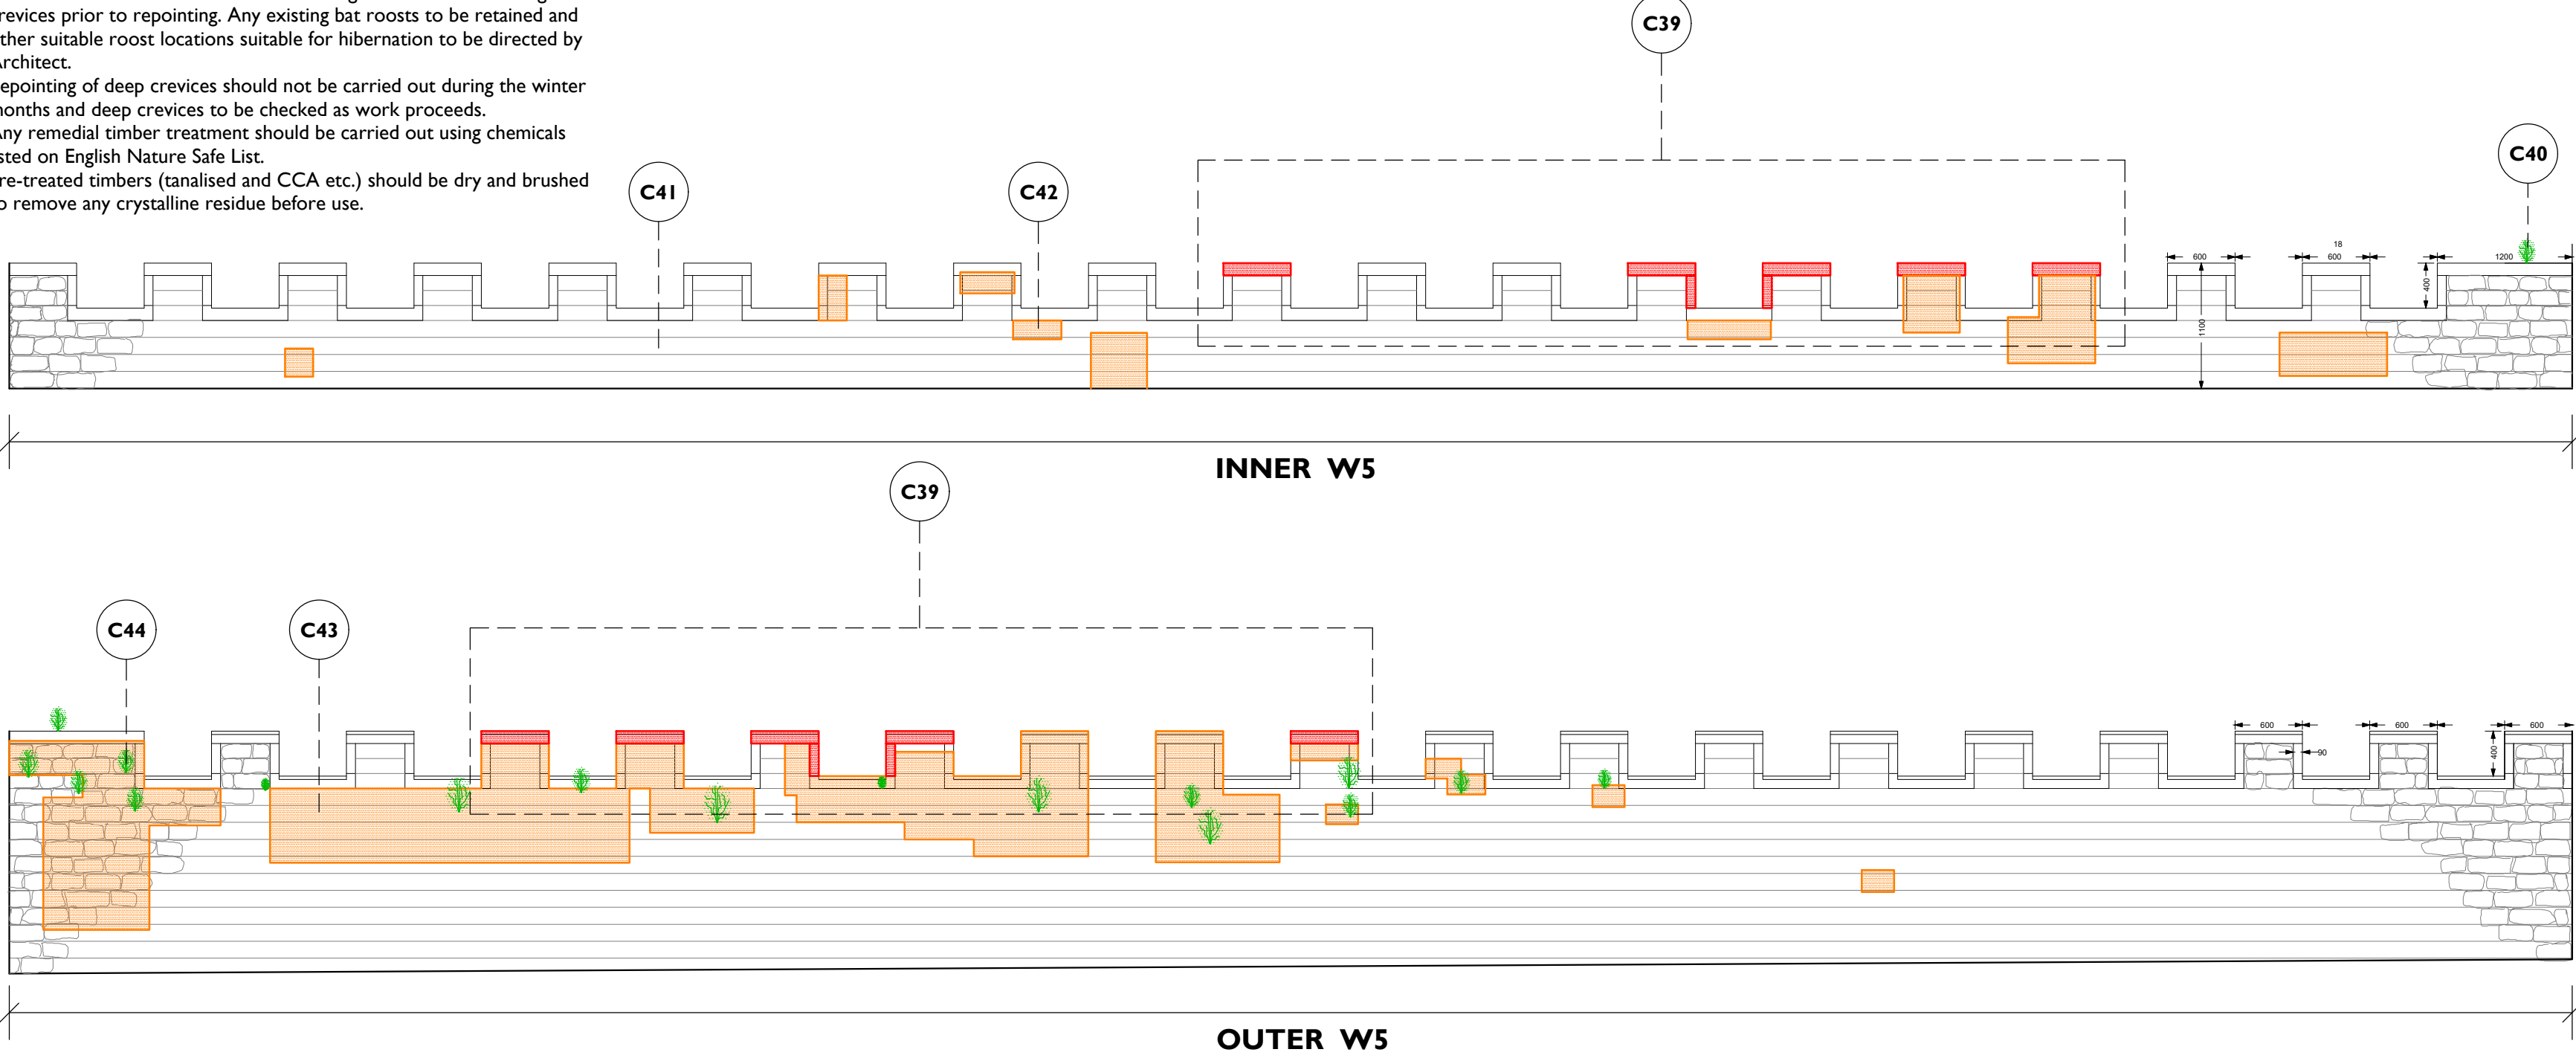

- BAT MITIGATION STRATEGY
1. Crevices in stonework to be checked for signs of bats and roosting crevices prior to repointing. Any existing bat roosts to be retained and other suitable roost locations suitable for hibernation to be directed by Architect.
 2. Repointing of deep crevices should not be carried out during the winter months and deep crevices to be checked as work proceeds.
 3. Any remedial timber treatment should be carried out using chemicals listed on English Nature Safe List.
 4. Pre-treated timbers (tanalised and CCA etc.) should be dry and brushed to remove any crystalline residue before use.

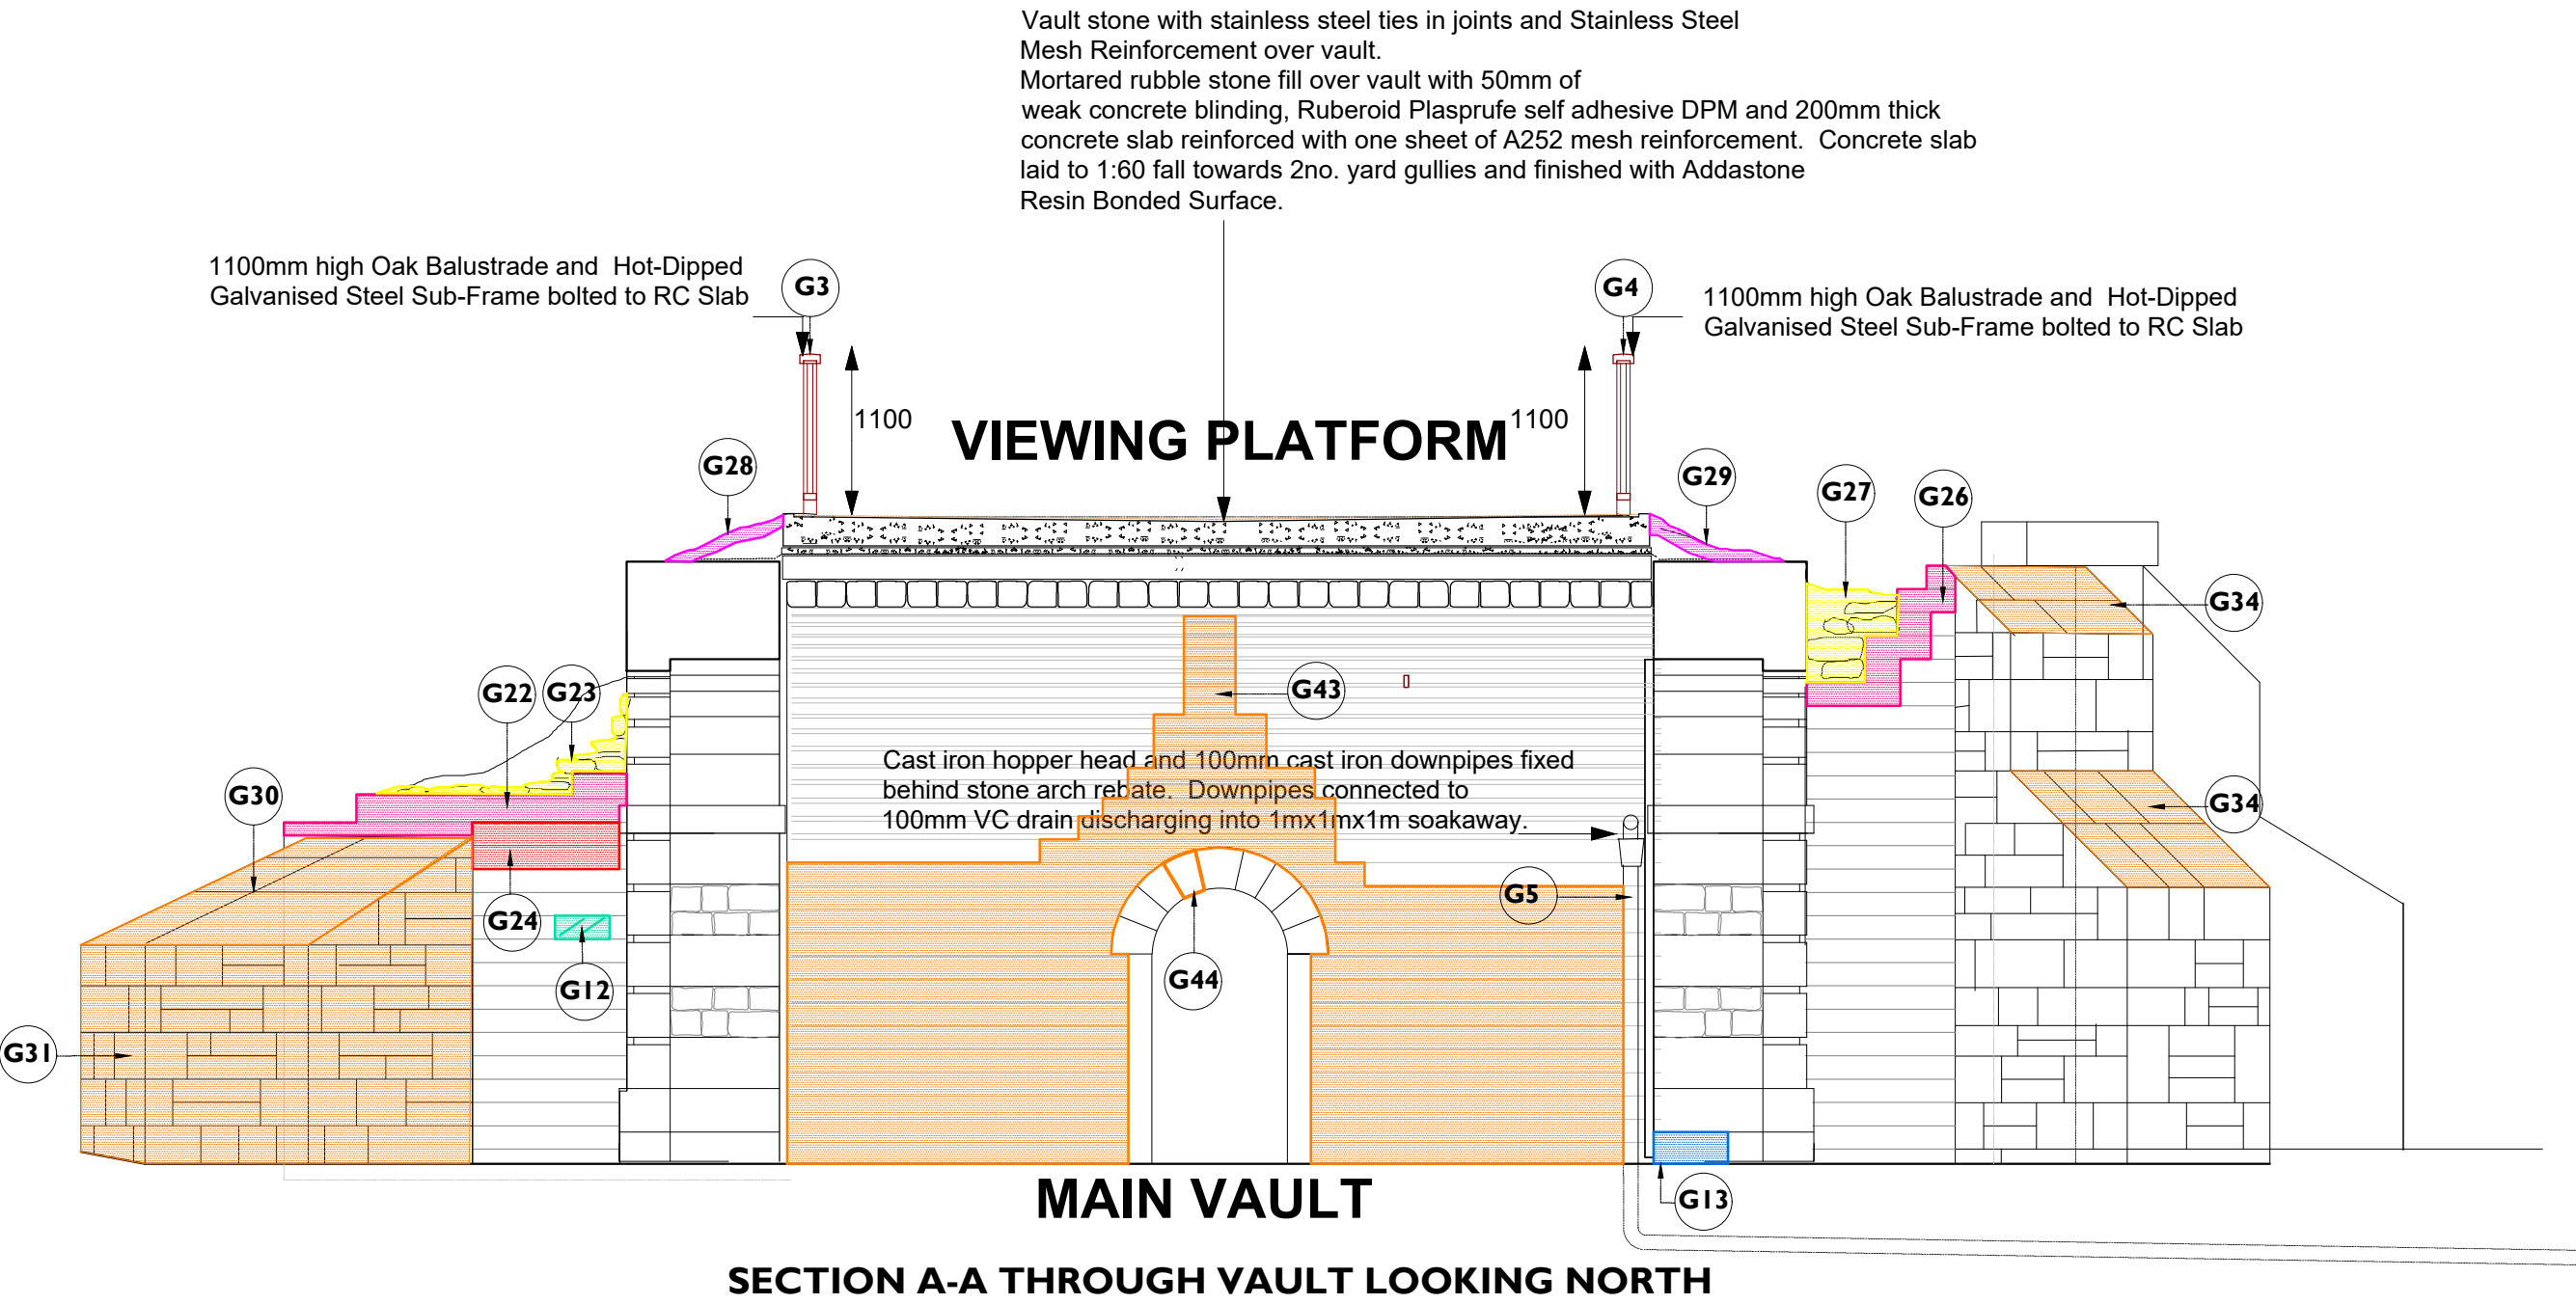


GATEHOUSE TOWER GT2

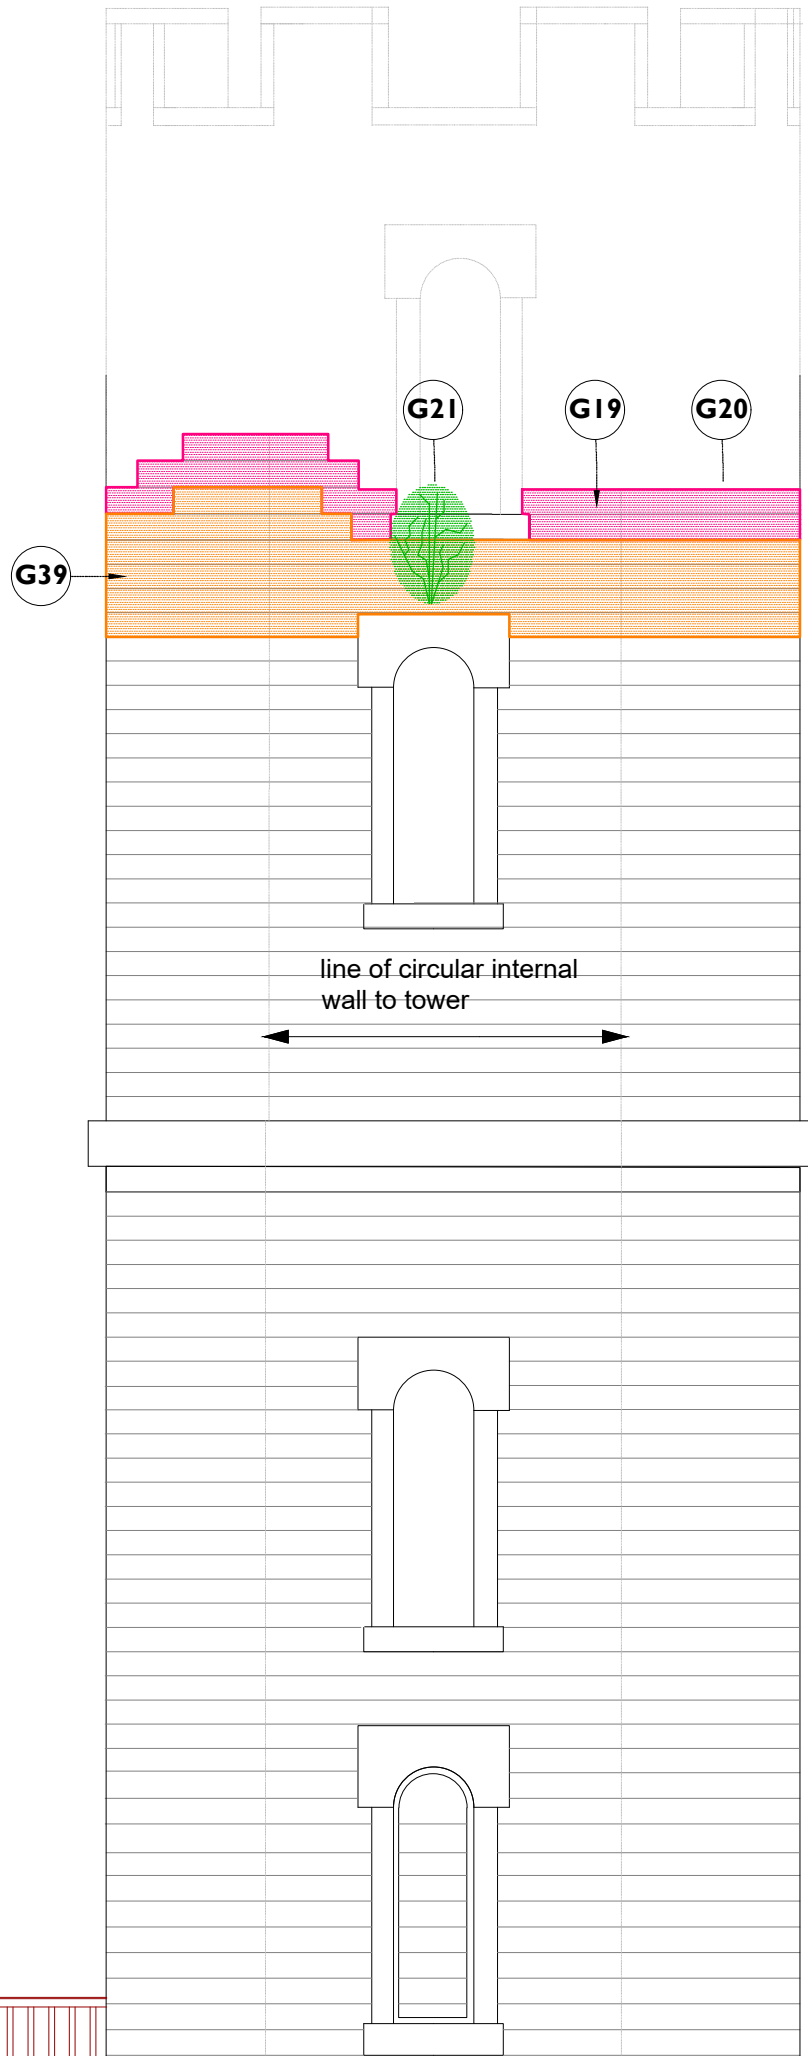

GATEHOUSE TOWER GT3

GATEHOUSE TOWER GT4

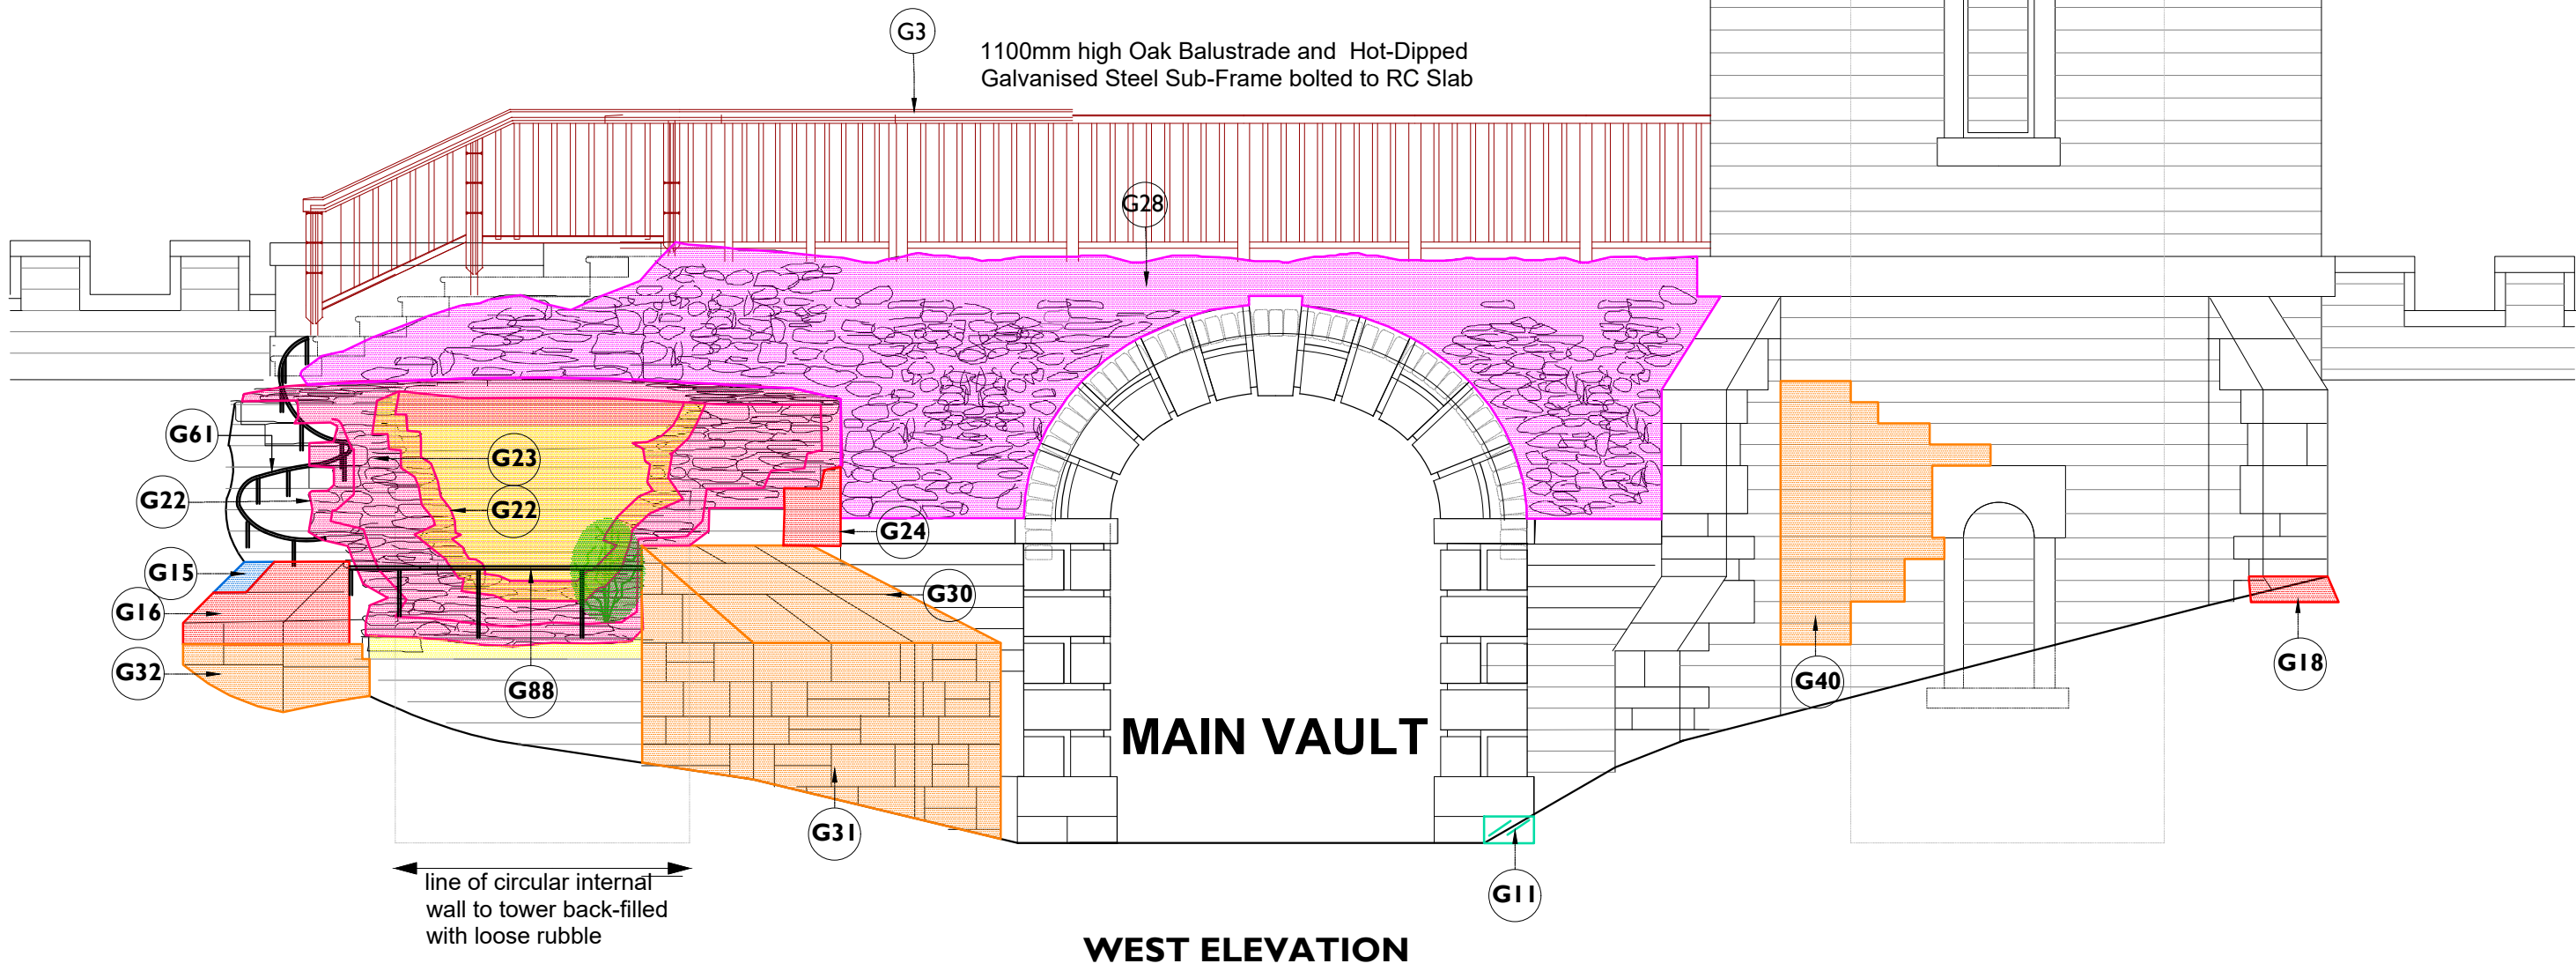

GATEHOUSE TOWER GT3

WEST ELEVATION

Notes:


Drawings are based on survey data and may not accurately represent what is physically present.

Do not scale from this drawing. All dimensions are to be verified on site before proceeding with the work.

All dimensions are in millimeters unless noted otherwise.

Purcell shall be notified in writing of any discrepancies.

- KEY**
- Re-bed existing stone
 - Replacement stone
 - Re-point square faced stone/rubble stone walling
 - Deep pointing/consolidation of rubble stone
 - Re-bed top 2no courses of square faced stone
 - Pinning to delaminated stone face
 - Render repair
 - Mortar packing to cavernously eroded stone
 - Remove woody shrubs

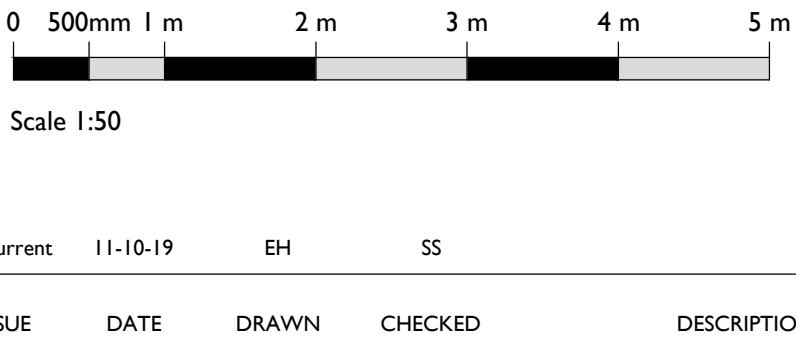

CLIENT National Trust

PROJECT Wentworth Castle and Stainborough Park 2019

240169-PUR-ZZ-00-DR-A-2004

DRAWING TITLE Curtain Wall 5 and Gatehouse

SIZE & SCALE A1L 1:50 @ A1

DRAWING STATUS S2 - For Information

JOB NUMBER 240169

DRAWING NO. 2004

REVISION P01

