
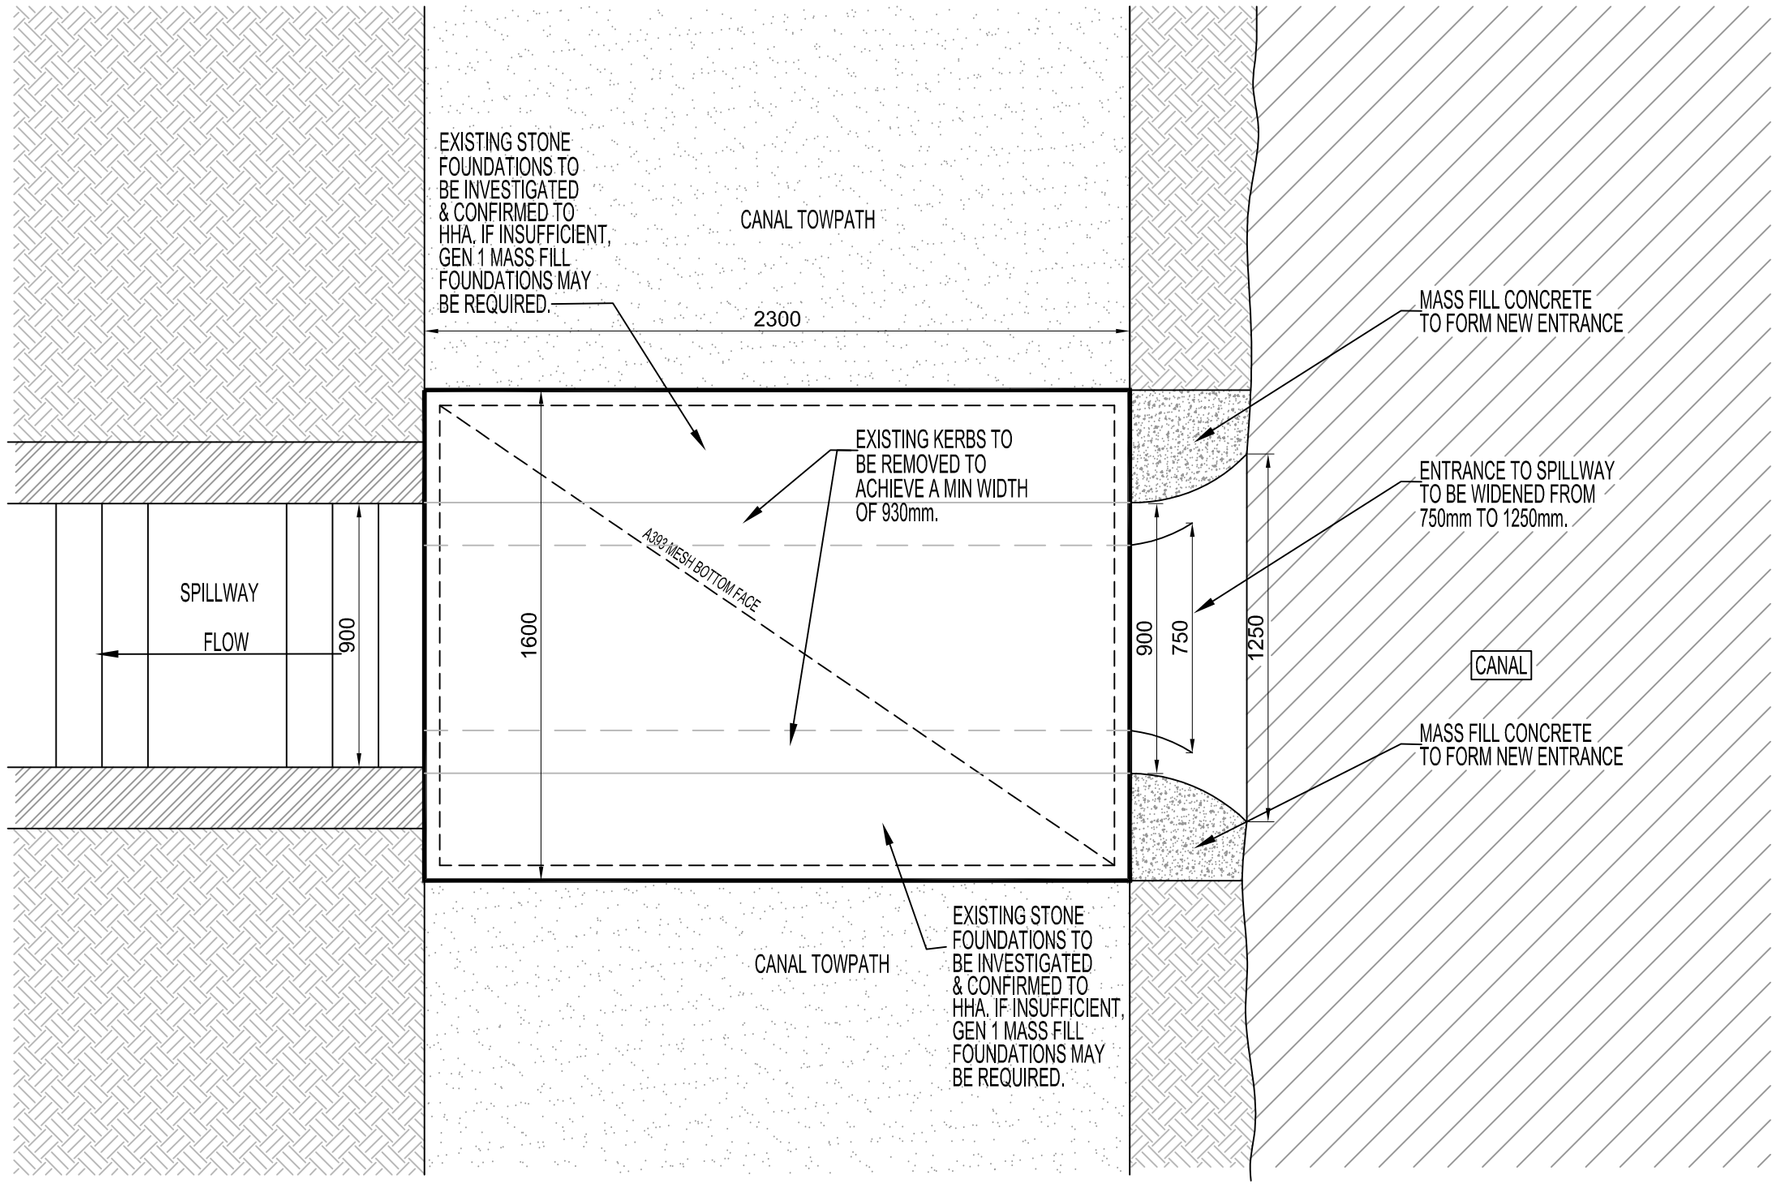



PLAN VIEW

1. ALL DIMENSIONS TO BE CHECKED PRIOR TO CONSTRUCTION.
2. THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS & ENGINEERS DRAWINGS.
3. CONCRETE GRADE RC35 IN ACCORDANCE WITH B.S.5328.
4. MIN COVER FOR REINFORCEMENT 50mm TO ALL FACES.
5. MIN LAPS 40 BAR DIAM FOR MAIN STEEL 300mm FOR MESH PANELS
6. ANY MESH IN TOP FACE TO BE ADEQUATELY SUPPORTED WITH STEEL CHAIRS OR COILED MESH PRIOR TO CONCRETE POUR
7. LOCAL SOFT SPOTS TO BE REPORTED TO HHA.
8. ALL REINFORCED CONCRETE TO BE ADEQUATELY VIBRATED.
9. EXCAVATION TO BE CLEAN AND DRY WHEN CONCRETE IS CAST.
10. BURIED CONCRETE TO BE IN ACCORDANCE WITH BRE SPECIAL DIGEST 1. FOR CONCRETE IN CONTACT WITH NATURAL INSITU SOILS, DS-1 AC-1 CAN BE USED.

NOTE:
EXISTING STONE FOUNDATIONS TO BE INVESTIGATED & CONFIRMED TO HHA. IF INSUFFICIENT, GEN 1 MASS FILL FOUNDATIONS MAY BE REQUIRED.

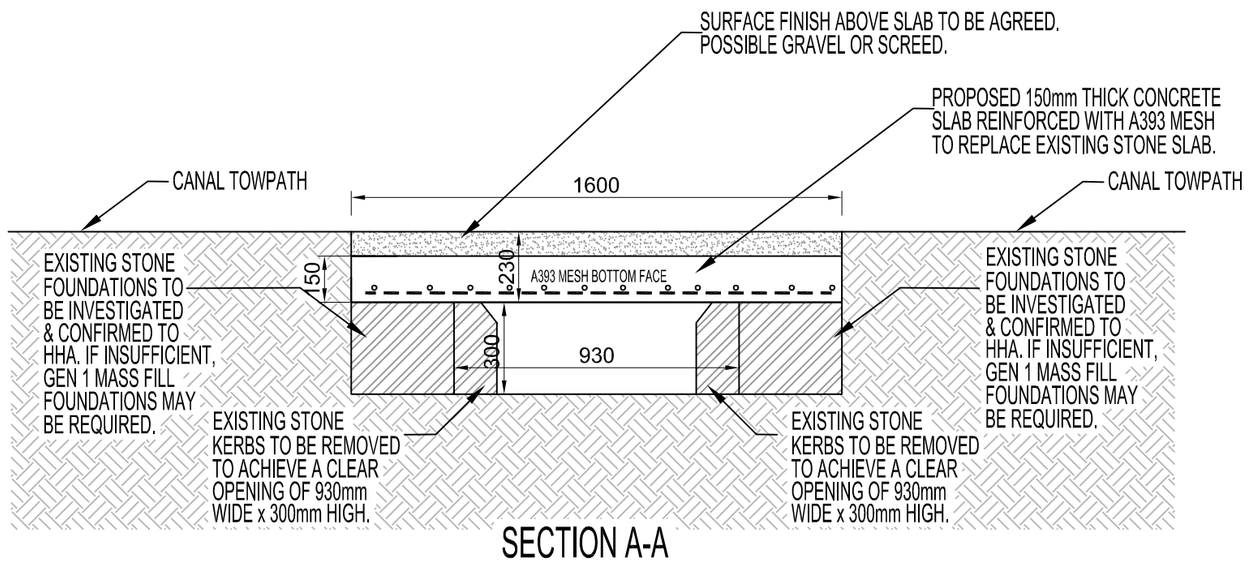

SECTION A-A

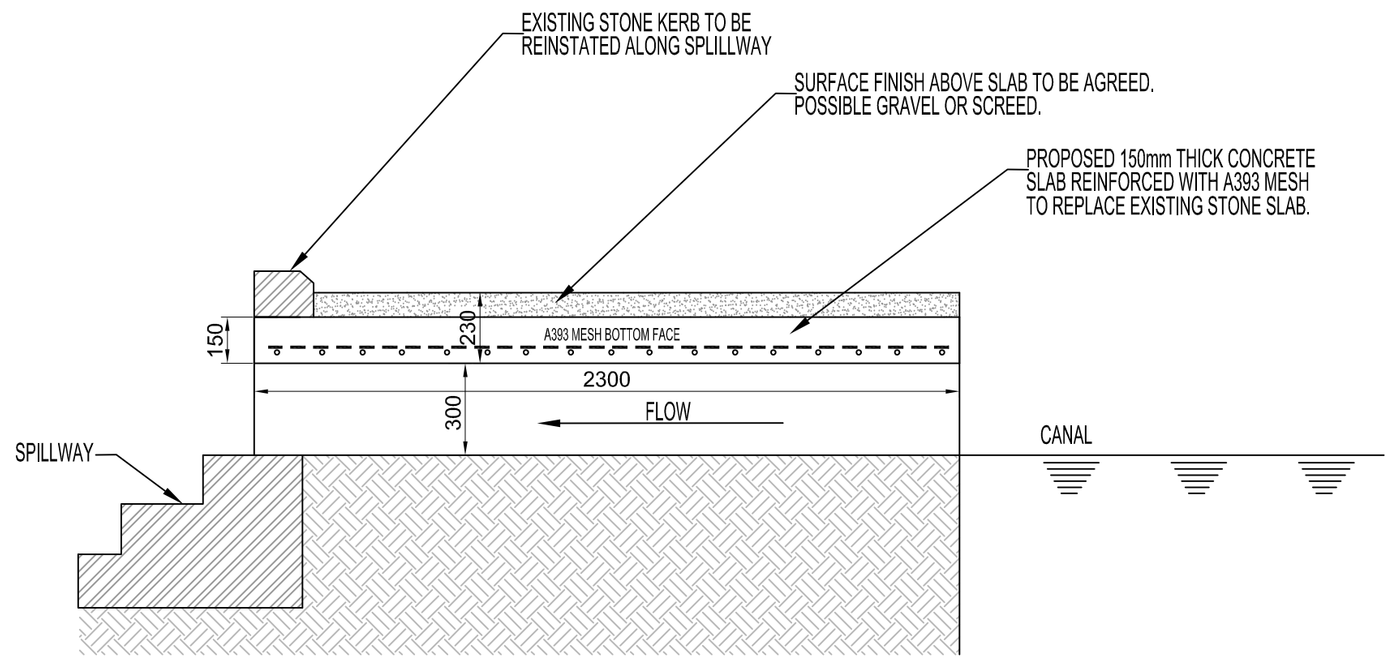

SECTION B-B

Haigh Huddleston & Associates
Civil Structural Engineering Consultants
Firth Buildings, 99 - 101 Leeds Rd, Dewsbury, WF12 7BU t 01924 464342 f 01924 450662
e trevor.haigh@haighhuddleston.co.uk

Client
Persimmon Homes South Yorkshire

Project
Lunhill Road, Lundhill

Detail
Spillway cover slab

Dwn	Chkd	Date	Scale	Dwg No.
PW	MH	Mar 23	1:20	E23/8056/200