




**EXISTING FRONT ELEVATION**
SCALE 1:100

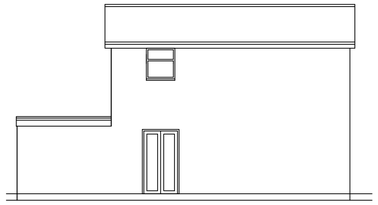


**EXISTING SIDE ELEVATION**
SCALE 1:100



**EXISTING REAR ELEVATION**
SCALE 1:100




**PROPOSED FRONT ELEVATION**
SCALE 1:100

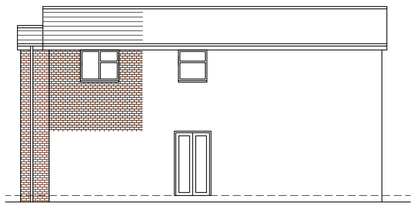


**PROPOSED SIDE ELEVATION**
SCALE 1:100



**PROPOSED REAR ELEVATION**
SCALE 1:100

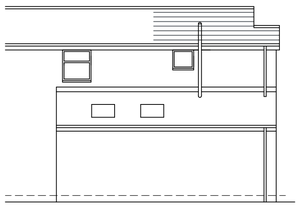

**PROPOSED SIDE ELEVATION**
SCALE 1:100

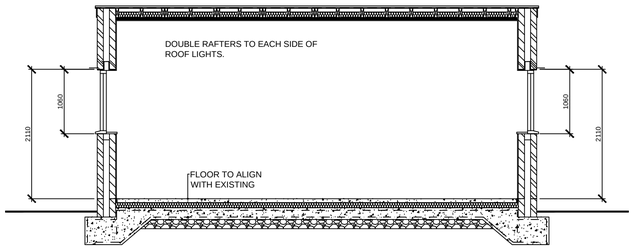



**SECTION**
SCALE 1:50

NOTE: CONTRACTOR TO DETERMINE DETAILS OF EXISTING FOUNDATIONS & FLOOR CONSTRUCTION PRIOR TO FORMATION OF NEW.
DETAILS TO BE REVISED TO THE SATISFACTION OF THE BUILDING CONTROL OFFICER IF REQUIRED.





**LOCATION PLAN**
SCALE 1:1250

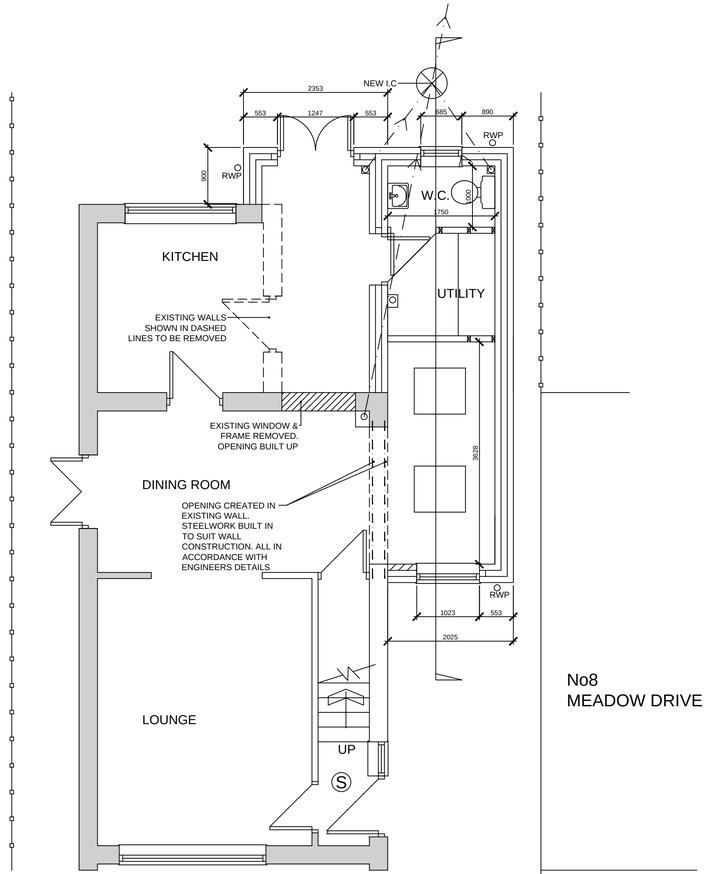


**PROPOSED GROUND FLOOR PLAN**
SCALE 1:50

No8
MEADOW DRIVE

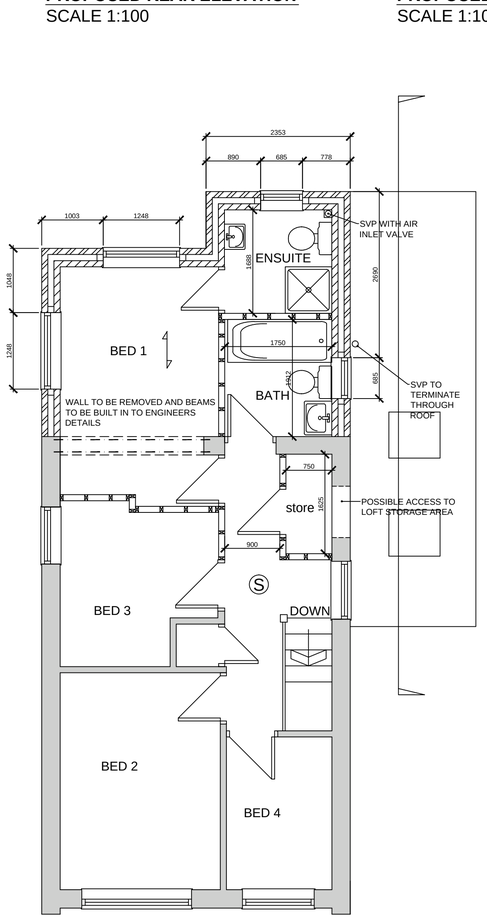


**PROPOSED FIRST FLOOR PLAN**
SCALE 1:50

**BACKGROUND AND PURGE VENTILATION**
Background ventilation - Controllable background ventilation via trickle vents to BS EN 13141-3 within the window frame to be provided to new habitable rooms at a rate of min 5000mm²; and to kitchens, bathrooms, WCs and utility rooms at a rate of 2500mm²
Purge ventilation - New Windows/rooflights to have openable area in excess of 1/20th of their floor area, if the window opens more than 30° or 1/10th of their floor area if the window opens less than 30°
Internal doors should be provided with a 10mm gap below the door to aid air circulation.
Ventilation provision in accordance with the Domestic Ventilation Compliance Guide.

**EXTRACT VENTILATION**
Bathroom to have mechanical vent ducted to external air to provide min 15 litres / sec extraction.
Utility room provide mechanical ventilation ducted to external air capable of extracting at a rate of 30 litres per second.
W/C to have mechanical ventilation ducted to external air with an extract rating of 15l/s operated via the light switch.
Vent to be connected to light switch and to have 15 minute over run if no window in room. Internal doors should be provided with a 10mm gap below the door to aid air circulation. Ventilation provision in accordance with the Domestic Ventilation Compliance Guide. Intermittent extract fans to BS EN 13141-4. All fixed mechanical ventilation systems, where they can be tested and adjusted, shall be commissioned and a commissioning notice given to the Building Control Body.

**RAINWATER DRAINAGE**
New rainwater goods to be new 110mm UPVC half round gutters taken and connected into 68mm dia UPVC downpipes. Rainwater taken to new soakaway, situated a min distance of 5.0m away from any building, via 110mm dia UPVC pipes surrounded in 150mm granular fill. Soakaway to be min of 1 cubic metre capacity (or to depth to Local Authorities approval) with suitable granular fill and with geotextile surround to prevent migration of fines. If necessary carry out a porosity test to determine design and depth of soakaway.

**UNDERGROUND FOUL DRAINAGE**
Underground drainage to consist of 100mm diameter UPVC proprietary pipe work to give a 1:40 fall. Surround pipes in 100mm pea shingle. Provide 600mm suitable cover (900mm under drives). Shallow pipes to be covered with 100mm reinforced concrete slab over compressible material. Provide rodding access at all changes of direction and junctions. All below ground drainage to comply with BS EN 1401-1: 2009.

**INSPECTION CHAMBERS**
Underground quality proprietary UPVC 450mm diameter inspection chambers to be provided at all changes of level, direction, connections and every 45m in straight runs. Inspection chambers to have bolt down double sealed covers in buildings and be adequate for vehicle loads in driveways.

**ABOVE GROUND DRAINAGE**
All new above ground drainage and plumbing to comply with BS EN 12056-2:2000 for sanitary pipework. All drainage to be in accordance with Part H of the Building Regulations. Wastes to have 75mm deep anti vac bottle traps and rodding eyes to be provided at changes of direction.

Size of wastes pipes and max length of branch connections (if max length is exceeded then anti vacuum traps to be used)
Wash basin - 1.7m for 32mm pipe 4m for 40mm pipe
Bath/shower - 3m for 40mm pipe 4m for 50mm pipe
W/c - 6m for 100mm pipe for single WC
All branch pipes to connect to 110mm soil and vent pipe terminating min 900mm above any openings within 3m.
Or to 110mm upvc soil pipe with accessible internal air admittance valve complying with BS EN 12380, placed at a height so that the outlet is above the trap of the highest fitting.
Waste pipes not to connect on to SVP within 200mm of the WC connection.
Supply hot and cold water to all fittings as appropriate.

**SOIL AND VENT PIPE**
Svp to be extended up in 110mm dia UPVC and to terminate min 900mm above any openings within 3m. Provide a long radius bend at foot of SVP.

**AUTOMATIC AIR VALVE**
Ground floor fittings from WC to be connected to new 110mm UPVC soil pipe with accessible internal air admittance valve complying with BS EN 12380, placed at a height so that the outlet is above the trap of the highest fitting and connected to underground quality drainage encased with pea gravel to a depth of 150mm.

**PIPEWORK THROUGH WALLS**
Where new pipework passes through external walls form rocker joints either side wall face of max length 600mm with flexible joints with short length of pipe bedded in wall.
Alternatively provide 75mm deep pre-cast concrete plank lintels over drain to form opening in wall to give 50mm space all round pipe: mask opening both sides with rigid sheet material and compressible sealant to prevent entry of fill or vermin.

**EXISTING STRUCTURE**
Existing structure including foundations, beams, walls and lintels carrying new and altered loads are to be exposed and checked for adequacy prior to commencement of work and as required by the Building Control Officer.

**BEAMS**
Supply and install new structural elements such as new beams, roof structure, floor structure, bearings, and padstones in accordance with the Structural Engineer's calculations and details. New steel beams to be encased in 12.5mm Gyproc FireLine board with staggered joints, Gyproc FireCase or painted in Nullifire S or similar intumescent paint to provide 1/2 hour fire resistance as agreed with Building Control. All fire protection to be installed as detailed by specialist manufacturer.

**LINTELS**
- For uniformly distributed loads and standard 2 storey domestic loadings only
Lintel widths are to be equal to wall thickness. All lintels over 750mm sized internal door openings to be 65mm deep pre-stressed concrete plank lintels. 150mm deep lintels are to be used for 900mm sized internal door openings. Lintels to have a minimum bearing of 150mm on each end. Any existing lintels carrying additional loads are to be exposed for inspection at commencement of work on site. All pre-stressed concrete lintels to be designed and manufactured in accordance with BS 8110, with a concrete strength of 50 or 40 N/mm² and incorporating steel strands to BS 5896 to support loadings assessed to BS 5977 Part 1.
For other structural openings provide proprietary insulated steel lintels suitable for spans and loadings in compliance with Approved Document A and lintel manufactures standard tables. Stop ends, DPC trays and weep holes to be provided above all externally located lintels.

**RAFT FOUNDATION**
Raft and floor slab design to Structural Engineer's calculations and details. Steel reinforcement must be lapped at least 450mm for both mesh and mild steel bars and provided with 40mm concrete cover.
Dig out for new raft foundation down to firm load bearing strata. Ground to be free from contamination. Raft foundation to be provided on 150mm well consolidated hardcore capable of supporting a load of at least 50kN/m².
Provide 85mm Celotex insulation and 25mm perimeter insulation on 1200 gauge DPM.
DPM to be laid on a blinded reinforced concrete slab of the raft foundation as engineers details.
Floor to be provided with 75mm screed (65mm if reinforced).
Wall fixings to be suitable for the different settlement where the existing building abuts the extension. Internal stiffening beams may also be necessary. All new foundations to be below invert level of any drains.

**FULL FILL CAVITY WALL**
To achieve minimum U Value of 0.28W/m²K
New cavity wall to comprise of 105mm facing brick to match existing. Full fill the cavity with 100mm Rockwool Cavity insulation as manufacturer's details. Inner leaf to be 100mm lightweight block, K value 0.16, (Aircrete, Celcon solar, Topblock toplite standard). Internal finish to be 12.5mm plasterboard on dabs. Walls to be built with 1:1:6 cement mortar.

**DPC**
Provide horizontal strip polymer (hyload) damp proof course to both internal and external skins minimum 150mm above external ground level. New DPC to be made continuous with existing DPC's and with floor DPM. Vertical DPC to be installed at all reveals where cavity is closed.

**WALL TIES**
All walls constructed using stainless steel vertical twist type retaining wall ties built in at 750mm ctrs horizontally, 450mm vertically and 225mm ctrs at reveals and corners in staggered rows. Wall ties to be suitable for cavity width and in accordance with BS 5268-6.1: 1996 and BS EN 845-1: 2003

**CAVITIES**
Provide cavity trays over openings. All cavities to be closed at eaves and around openings using Thermabate or similar non combustible insulated cavity closers. Provide vertical DPCs around openings and abutments. All cavity trays must have 150mm upstands and suitable cavity weep holes (min 2) at max 900mm centres.

**EXISTING TO NEW WALL**
Cavities in new wall to be made continuous with existing where possible to ensure continuous weather break. If a continuous cavity cannot be achieved, where new walls abuts the existing walls provide a movement joint with vertical DPC. All tied into existing construction with suitable proprietary stainless steel profiles.

**PITCHED ROOF**
Roofing tiles to match existing with 100mm headlap on 25 x 38mm tanalised sw treated battens on layer breather felt to relevant BBA Certificate. Supported on 47 x 150mm grade C24 rafters at max 400mm centres. Insulation to be 100mm Celotex GA4000 between rafters and 45mm Celotex TB4000 under rafters. Fix 12.5mm foil backed plasterboard (joints staggered) and 5mm skim coat of finishing plaster to the underside of all ceilings using galvanized plasterboard nails.
Provide cross ventilation to roof with opening at eaves level at least equal to continuous strip 25mm wide. Mono pitched roofs to have ridge/high level ventilation equivalent to a 5mm gap via proprietary tile vents spaced in accordance with manufacturer's details.
Restraint strapping - 100mm x 50mm wall plate strapped down to walls. Rafters to be strapped to gable walls@ 2m c/c max, straps built into cavity, across at least 3 timbers with noggins. All straps to be 1000 x 30 x 5mm galvanized straps or other approved to BSEN 845-1 at 2m centres.

**LEAD WORK AND FLASHINGS**
All lead flashings, any valleys or soakers to be Code 5 lead and laid according to Lead Development Association. Flashings to be provided to all jambs and below window openings with welded upstands. Joints to be lapped min 150mm and lead to be dressed 200mm under tiles, etc. All work to be undertaken in accordance with the Lead Development Association recommendations.

**INTERNAL STUD PARTITIONS**
100mm x 50mm softwood treated timbers studs at 400mm ctrs with 50 x 100mm head and sole plates and solid intermediate horizontal noggins at 1/3 height or 450mm. Provide min 10kg/m³ density acoustic soundproof quilt tightly packed (eg. 100mm Rockwool or Isowool mineral fibre sound insulation) in all voids the full depth of the stud. Partitions built off doubled up joists where partitions run parallel or provide noggins where at right angles, or built off DPC on thickened concrete slab if solid ground floor. Walls faced throughout with 12.5mm plaster board with skim plaster finish. Taped and jointed complete with beads and stops.

**INTERMEDIATE FLOORS**
Intermediate floor to be 25mm t&g flooring grade chipboard or floorboards laid on 170 x 50mm C24 joists at 400mm ctrs. Lay 100mm Rockwool mineral fibre quilt insulation min 10kg/m³ or equivalent between floor joists. Ceiling to be 12.5 FireLine plasterboard with skim plaster set and finish. Joist spans over 2.5m to be strutted at mid span using 38 x 38mm herringbone strutting or 38mm solid strutting (at least 2/3 of joist depth). In areas such as kitchens, utility rooms and bathrooms, flooring to be moisture resistant grade in accordance with BS EN 312:2010. Identification marking must be laid upper most to allow easy identification. Provide lateral restraint where joists run parallel to walls, floors are to be strapped to walls with 1000mm x 30mm x 5mm galvanised mild steel straps or other approved in compliance with BS EN 845-1 at max 2.0m centres, straps to be taken across minimum 3 no. joists. Straps to be built into walls. Provide 38mm wide x ¾ depth solid noggins between joists at strap positions.

**ELECTRICAL**
All electrical work required to meet the requirements of Part P (electrical safety) must be designed, installed, inspected and tested by a competent person registered under a competent person self certification scheme such as BRE certification Ltd, BSI, NICEIC Certification Services or Zurich Ltd. An appropriate BS7671 Electrical Installation Certificate is to be issued for the work by a person competent to do so. A copy of a certificate will be given to Building Control on completion.

**INTERNAL LIGHTING**
Install low energy light fittings that only take lamps having a luminous efficiency greater than 45 lumens per circuit watt and a total output greater than 400 lamp lumens. Not less than three energy efficient light fittings per four of all the light fittings in the main dwelling spaces to comply with Part L of the current Building Regulations and the Domestic Building Services Compliance Guide.

**HEATING**
Extend all heating and hot water services from existing and provide new TVRs to radiators. Heating system to be designed, installed, tested and fully certified by a GAS SAFE registered specialist. All work to be in accordance with the Local Water Authorities bye laws, the Gas Safety (Installation and Use) Regulations 1998 and IEE Regulations.

**SMOKE DETECTION**
Mains operated linked smoke alarm detection system to BS EN 14604 and BS5839-6:2004 to at least a Grade D category LD3 standard and to be mains powered with battery back up. Smoke alarms should be sited so that there is a smoke alarm in the circulation space on all levels/ storeys and within 7.5m of the door to every habitable room. If ceiling mounted they should be 300mm from the walls and light fittings. Where the kitchen area is not separated from the stairway or circulation space by a door, there should be an interlinked heat detector in the kitchen.

**ESCAPE WINDOWS**
Provide emergency egress windows to any newly created first floor habitable rooms and ground floor inner rooms. Windows to have an unobstructed openable area of 450mm high x 450mm wide, minimum 0.33m sq. The bottom of the openable area should be not more than 1100mm above the floor. The window should enable the person to reach a place free from danger from fire.

**NEW AND REPLACEMENT WINDOWS**
New and replacement windows to be double glazed with 16mm argon gap and soft coat low-E glass. Window Energy Rating to be Band C or better and to achieve U-value of 1.6 W/m²K. The door and window openings should be limited to 25% of the extension floor area plus the area of any existing openings covered by the extension.

**NEW AND REPLACEMENT DOORS**
New and replacement doors to achieve a U-Value of 1.80W/m²K. Glazed areas to be double glazed with 16mm argon gap and soft low-E glass. Glass to be toughened or laminated safety glass to BS 6206, BS EN 14179 or BS EN ISO 12543-1:2011 and Part K (Part N in Wales) of the current Building Regulations.

NOTE: ALL DIMENSIONS TO BE CHECKED ON SITE


White Agus PARTNERSHIP
8 MORSTON BUSINESS PARK, WHALEY ROAD, BARUGH GREEN, BARNSLEY. S75 1HQ
Phone: 01226 208482
Fax: 01226 283030
Email: info@whiteaguspartnership.co.uk
Web: www.whiteaguspartnership.co.uk
ARCHITECTURAL SERVICES AND SURVEYORS


| | |
|---|---|
| Project.<br>PROPOSED EXTENSION AT<br>10 MEADOW DRIVE, MONK BRETTON<br>BARNSLEY, S71 2JZ | Client.<br>MR W.MITCHELL |
| Drawing Title.<br>PLANS, SECTION & ELEVATIONS | Date. JULY 2013 — Scale. 1:50 @ A1<br>Ref. 13-002 — Dwg. No. 02 — Rev. B |

| Date | Suffix | Description | Date | Suffix | Description |
|---|---|---|---|---|---|
| 10-10-13 | A | SIDE EXTENSION REVISED | | | |
| 27-05-14 | B | ROOF TO SIDE EXTENSION REVISED | | | |