


# NOISE SURVEY LTD

## Noise Assessment Report

**Report Ref:** 210TOWNHALL  
**Client:** Torrian Construction  
**Site Location:** Hoyland Town Hall  
High Street  
Hoyland  
Barnsley S74 9AD  
**Date of Issue:** 10<sup>th</sup> July 2017  
**Date of Assessment:** Tuesday 4<sup>th</sup> July – Thursday 6<sup>th</sup> July 2017

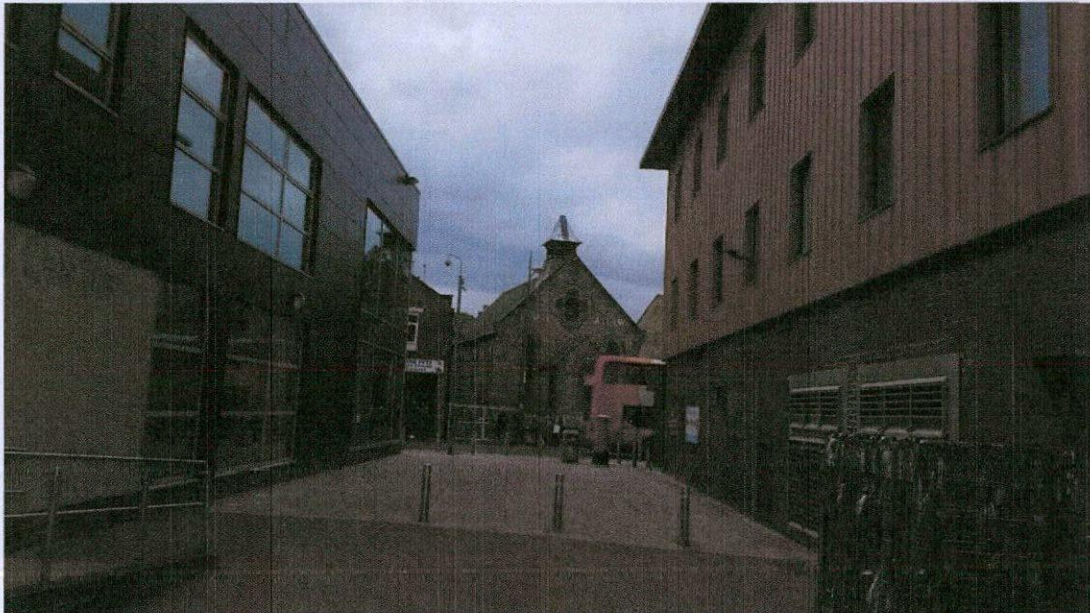

Picture 1: The building to the right is Hoyland Town Hall . This measurement location is labelled ML2.

### Executive Summary

The front of Hoyland Town Hall (ML1) has a daytime level of  $L_{Aeq(16\text{ hour})}$  81dB and a night time  $L_{Aeq(8\text{ hour})}$  of 53dB. LAFmx reached 85dB during the night.

The side of Hoyland Town Hall that has the mechanical vents to the ground floor (ML2) has a daytime level of  $L_{Aeq(16\text{ hour})}$  76dB a night time  $L_{Aeq(8\text{ hour})}$  of 59dB. LAFmx reached 88dB during the night.

# NOISE SURVEY LTD

The side of Hoyland Town Hall that is above the Cooperative food store and opposite Hoyland Market (ML3) has a daytime level of  $L_{Aeq(16\text{ hour})}$  55dB a night time  $L_{Aeq(8\text{ hour})}$  of 43dB.  $L_{AFmx}$  reached 75dB during the night.

In relation to BS8233:2014 and WHO (2009) these levels are too high and have to be actively reduced in order to ensure that internal noise levels for each dwelling does meet the guidelines. However reduction of the external noise to acceptable levels internally is achievable. This can be done by using windows, doors and ventilation that has the  $R_{w(C;Ctr)}$  specified herein for the respective rooms.

The WHO (2009) recommendation for  $L_{AFmax}$  of 60dB and an  $L_{Aeq(8\text{ hour})}$  of 45dB outside bedrooms may not be achievable. However the development should not be prohibited if the planners deem the development as desirable in the circumstances as acknowledged in BS8233:2014.

Application of the sound reduction recommendations in this report will meet the standards for internal noise levels required by the national planning policy framework guidelines. If users of the property keep external windows and doors closed, they will be at a low risk of adverse noise impact.

## **Uncertainty in the measurement is $\pm 4$ dB**

### **Objective:**


The property known as Hoyland Town Hall on High Street Hoyland Barnsley S74 9AD was a building used as offices. The Client proposes to convert the existing building into residential flats from the 1<sup>st</sup> to the 2<sup>nd</sup> floor.

The purposes of this noise assessment is to determine the level of environmental noise likely to impact the building and the type and level of sound reduction required from external windows, doors and ventilation that is required to satisfy the guidelines in BS8233:2014 and WHO(2009).

### **Source under Assessment**

To the front of the property is High Street (ML1) characterized by road traffic and pedestrian noise. To the right of the building is Hoyland Street market (ML3) and to the left of the building is the Hoyland Center (ML2). The building is located in a commercial area.

# NOISE SURVEY LTD

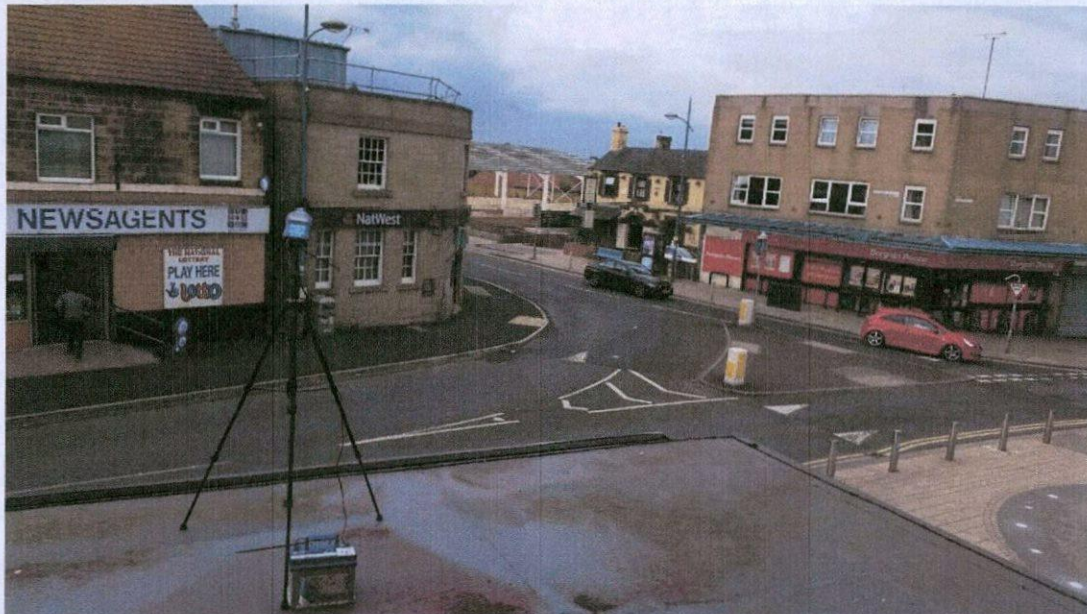

Picture 2: Measurements at the first floor level of Hoyland Town Hall facing high street. This measurement location is labelled ML1.

## Methodology

Measurements were taken at three locations including the front and both sides of Hoyland Town Hall. Three Casella Cel-490 type 1 sound level meters were used to take measurements of residual noise levels. The meters were calibrated and placed at the front and sides of Hoyland Town Hall at first floor level. The meters were calibrated before and after the measurements successfully.


## Façade Correction

Façade measurements occur when the meter is in front of a large reflective surface at a distance of less than 3.5m away from the reflective surface. In order to convert measurements to free field equivalents, a façade correction is required. This is done by reducing the measured levels by up to 3dB. In this instance a façade correction is required for measurements above the mechanical ventilation (ML2) because the meter was 1m from the façade. The other two measurement locations (ML1 and ML3) were equivalent to free field conditions and require no façade correction.

# NOISE SURVEY LTD




Picture 3: Measurements to the side of Hoyland Town Hall facing Hoyland Market and above the Co-operative food store. This measurement location is labelled ML3.

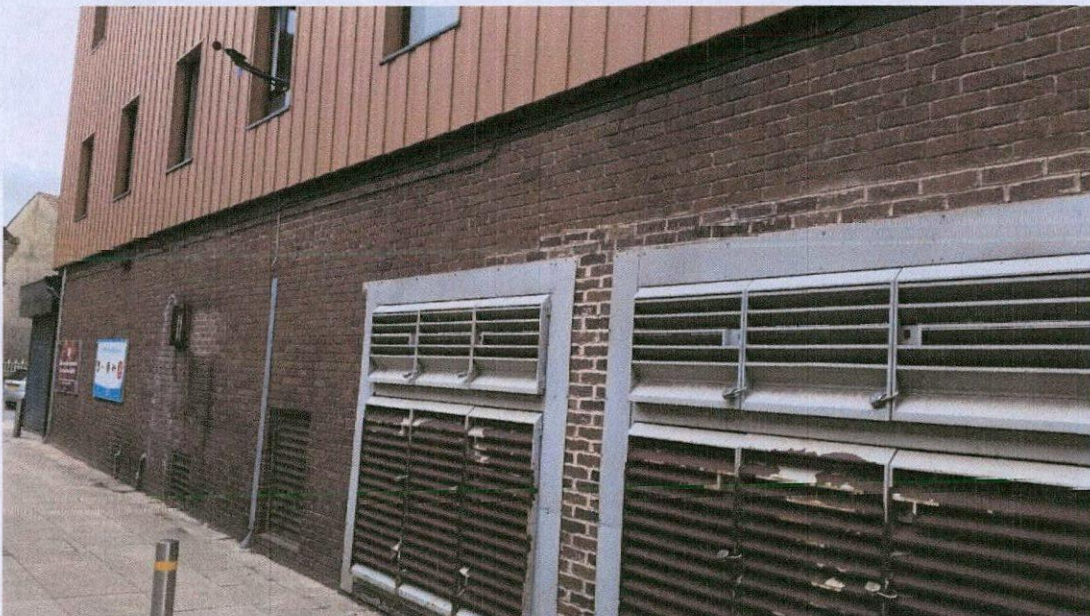

Picture 4: Measurements at the side of Hoyland Town Hall above the mechanical ventilation system. This measurement location is labelled ML2.

# NOISE SURVEY LTD

## Site and Measurement Locations

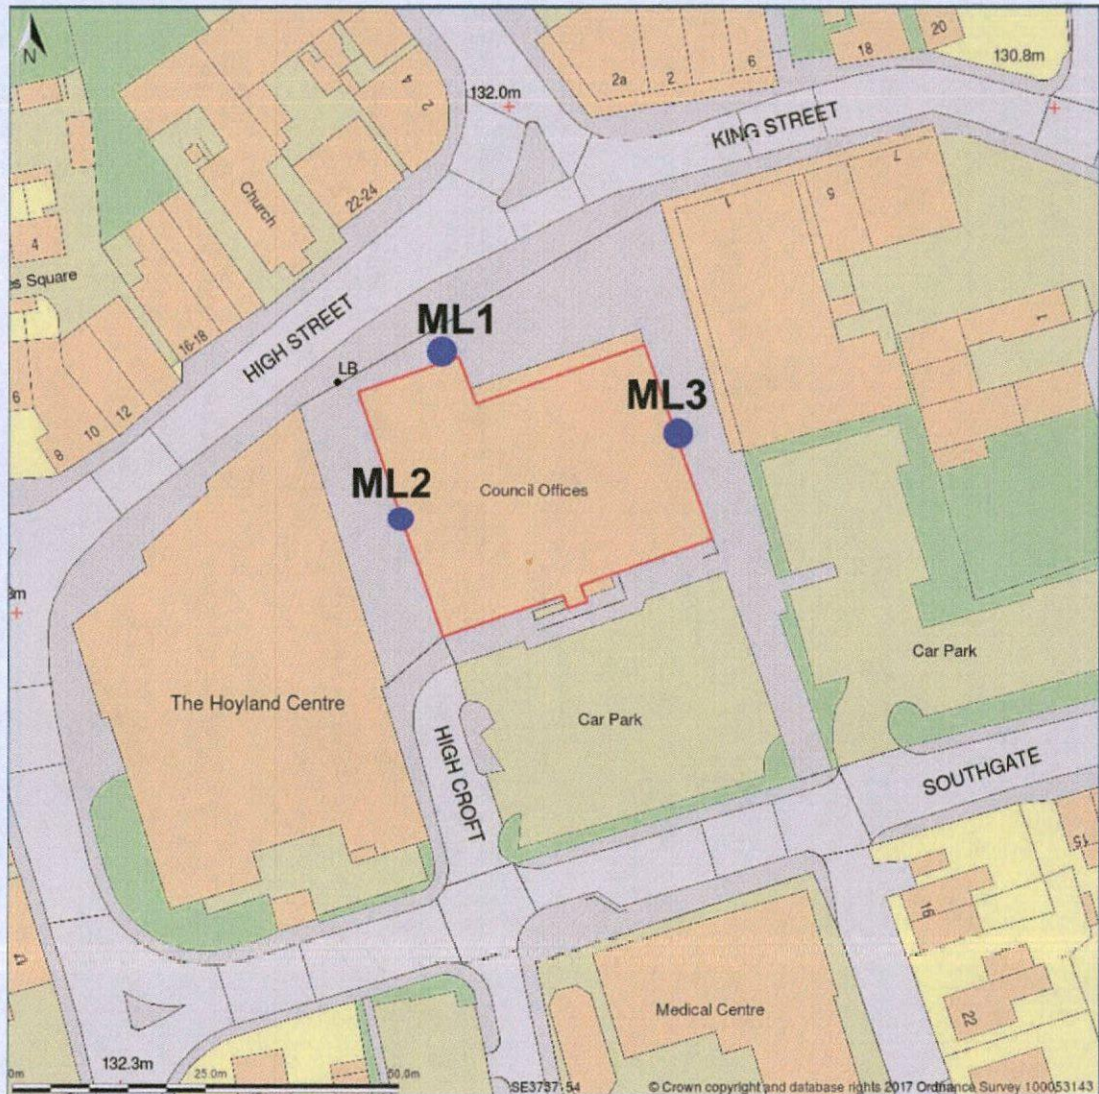

Site plan 1: This is a site location plan purchased and cropped from the website <https://www.buyaplan.co.uk> on 10<sup>th</sup> June 2017 at 13:00. The full site plan is attached as part of this report in the Appendix. The red border indicates Hoyland Town Hall. The blue circles show measurement locations 1 – 3 respectively.

## Date and Time of Measurements

Tuesday 4<sup>th</sup> July – Thursday 6<sup>th</sup> July 2017 (Hoyland Town Hall)

# NOISE SURVEY LTD

## Measuring Equipment & Calibration

The sound level meters used at ML1, ML2 and ML3 were Casella Cel-490, a class 1 meter laboratory calibrated traceable to UKAS standards serial number 240855, 230643 and 240790. At the beginning and at the end of measurements the meter was calibrated with an acoustic calibrator before and after the measurements with negligible deviation ( $\leq 0.4\text{dB}$ ). The meters all calibrated successfully before and after measurements.

### Noise Levels

#### ML1 Noise Levels (Front with High Street )

Day  $L_{Aeq(16\text{ hour})}$  = 81 dB LAFmx 110dB Night  $L_{Aeq(8\text{ hour})}$  53dB LAFmx 85dB

**ML2 Noise Levels (Side next to Hoyland Center). A façade correction of -3dB has been applied to these results.**

Day  $L_{Aeq(16\text{ hour})}$  76dB LAFmx 104dB Night  $L_{Aeq(16\text{ hour})}$  59dB LAFmx 88dB

#### ML3 Noise Levels (Side next to Hoyland market)

Day  $L_{Aeq(16\text{ hour})}$  55dB LAFmx 88dB Night  $L_{Aeq(16\text{ hour})}$  43dB LAFmx 75dB

(see measurement data in the Appendix).

The noise levels exceed the BS8233:2014 guidelines and require mitigation.

### BS8233:2014 Criteria

Table 1 below is taken from BS8233:2014. It shows the guide lines for internal ambient noise levels. The guidelines in BS8233:2014 are also advised by WHO (2009).

Activity	Location	Day (07:00 -23:00)	Night (23:00 – 07:00)
Resting	Living Room	35 $L_{Aeq(16\text{ hour})}$	-

# NOISE SURVEY LTD

Dining	Dining room/area	40 LAeq (16 hour)	-
Sleeping(daytime resting)	Bedroom	35 LAeq (16 hour)	30 LAeq (16 hour)

Table 1: BS8233:2014 noise level for internal habitable rooms.

In addition the WHO (2009) has guidance for outdoor living areas such as gardens for day time noise of 50 – 55dB LAeq (16 hour). It has a LAFmax of 45dB inside bedrooms and a LAFmax of 60dB outside bedrooms, (see table 2 below).

Specific Environment	LAeq dB	Time base (hours)	LAFmax dB
Outdoor living area (day)	55	16	
Outdoor living area (evening)	50	16	
Inside bedrooms (sleeping)	30	8	45
Outside bedrooms	45	8	60

Table 2: WHO (2009) guidelines

## Recommendations for Dwelling facing ML1 (Hoyland Town Hall Front to High Street)

- Living rooms should have windows, external doors, external walling and ventilation with a sound reduction of  $R_w(c;ctr)$  50dB. The sound reduction is set to account for some uncertainty  $\pm 4$ dB (see uncertainty section below).
- Dining rooms should have windows, external doors, external walling and ventilation with a sound reduction of  $R_w(c;ctr)$  45dB. The sound reduction is set to account for some uncertainty  $\pm 4$ dB (see uncertainty section below).
- Bed rooms should have windows, external doors, external walling and ventilation with a sound reduction of  $R_w(c;ctr)$  50dB. The sound reduction is set to account for some for **WHO (2009) recommendations of LAFmx night of 45dB inside bedrooms and to allow for some uncertainty.**

# NOISE SURVEY LTD

## **Recommendations for Dwelling facing ML2 (Hoyland Town Hall Side and above mechanical vents opposite Hoyland Center)**

- Living rooms should have windows, external doors, external walling and ventilation with a sound reduction of  $R_w(c;ctr)$  45dB. The sound reduction is set to account for some uncertainty  $\pm 4$ dB (see uncertainty section below).
- Dining rooms should have windows, external doors, external walling and ventilation with a sound reduction of  $R_w(c;ctr)$  40dB. The sound reduction is set to account for some uncertainty  $\pm 4$ dB (see uncertainty section below).
- Bed rooms should have windows, external doors, external walling and ventilation with a sound reduction of  $R_w(c;ctr)$  47dB. The sound reduction is set to account for some for WHO (2009) recommendations of LAFmx night of 45dB inside bedrooms and to allow for some uncertainty.

## **Recommendations for Dwelling facing ML3 (Hoyland Town Hall facing Hoyland Market and above the Cooperative Food Store)**

- Living rooms should have windows, external doors, external walling and ventilation with a sound reduction of  $R_w(c;ctr)$  24dB. The sound reduction is set to account for some uncertainty  $\pm 4$ dB (see uncertainty section below).
- Dining rooms should have windows, external doors, external walling and ventilation with a sound reduction of  $R_w(c;ctr)$  19dB. The sound reduction is set to account for some uncertainty  $\pm 4$ dB (see uncertainty section below).
- Bed rooms should have windows, external doors, external walling and ventilation with a sound reduction of  $R_w(c;ctr)$  34dB. The sound reduction is set to account for some for WHO (2009) recommendations of LAFmx night of 45dB inside bedrooms and to allow for some uncertainty.

**It should be noted that the development relies on windows being closed to achieve internal noise level guidelines. As a result acoustic ventilation must be provided that does not require windows to be open. Acoustic ventilation in bedrooms, dining rooms and living rooms must achieve the minimum sound reduction stated for that room.**

# NOISE SURVEY LTD

WHO (2009) has an external LAFmx night of 60dB outside bedrooms. This is not achievable because LAFmx night is 85dB at ML1, 88dB at ML2 and 75dB at ML3.

A data sheet from Pilkington glass has been attached showing glazing that achieves the sound reductions index of  $R_{w(c;ctr)}$  50dB as recommended in this report.

Pilkington provides glazing. Huet provides acoustic doors that achieve the required  $R_{w(c;ctr)}$  Greenwoods acoustic ventilation provides ventilation that would be suitable. Data sheets have been attached as part of this report to assist the Client in achieving the required sound insulation. The client does not have to source these products from the suppliers mentioned in this report. The suppliers mentioned herein are for example purposes only.

No special acoustic measures are required for hallways, bathrooms and kitchens unless they form part of a Dining room, Living room or bedroom.

The day time noise levels are outside the LAeq (16 hour) 50 – 55dB for outside living space.

Achieving the sound reduction as stated in this report will meet the standards for day and night time levels in the specified rooms.

## Context of the Noise Environment

WHO (2009) provides guidance of night time  $L_{Aeq(8\text{ hour})}$  of 45dB outside bedrooms. Adverse health effects arise from sleep disturbance when the window to the bedroom is left open. This means that persons sleeping with the window open are likely to have disturbed sleep if outside noise levels are greater than night time  $L_{Aeq(8\text{ hour})}$  45dB. For this reason the WHO (2009) guidelines recommend noise levels outside bedrooms to be  $L_{Aeq(8\text{ hour})}$  45dB or lower. This requirement may not be achievable in the presence of road traffic noise.

Should  $L_{Aeq(8\text{ hour})}$  45 dB outside bedrooms not be achievable BS8233:2014 (see below) provides for the approval of development if the planners deem the development as desirable.

## LAFmx 45dB Inside Bedrooms

The SRI of the windows, external doors and ventilation has been calculated to reduce internal LAFmx to 45dB and to also achieve the day time  $L_{Aeq(16\text{hour})}$  of 35dB and the night time  $L_{Aeq(8\text{hour})}$  of 30dB.

# NOISE SURVEY LTD

## National Planning Policy Framework (NPPF) and Litchfield District Local Plan Strategy 2015 Policy BE1 'High Quality Development'

The national policy framework states at paragraph 109 new and existing developments should be prevented;

“from contributing to or being put at unacceptable risk from, or being adversely affected by unacceptable levels of soil, air, water or noise pollution or land instability..”

At paragraph 123 the NPPF states;

“Planning policies and decisions should aim to avoid noise from giving rise to significant adverse impacts on health and quality of life as a result of new development..”

The proposed development is within an elevated noise environment where LAFmax reached 85dB during the night at ML1. The area has a daytime level of  $L_{Aeq(16\text{ hour})}$  81dB and a night time  $L_{Aeq(8\text{ hour})}$  of 53dB at ML1.

At ML2 LAFmax reached 88dB night and has a daytime level of  $L_{Aeq(16\text{ hour})}$  76dB and a night time  $L_{Aeq(8\text{ hour})}$  of 59dB.

At ML3 LAFmax reached 75dB night and has a daytime level of  $L_{Aeq(16\text{ hour})}$  55dB and a night time  $L_{Aeq(8\text{ hour})}$  of 43dB.

Achieving the weighted sound reduction index for windows, doors and ventilation as specified in this report will satisfy the main standards for internal habitable rooms and should fulfill the requirements of the national planning policy framework.

It should be noted that users of the proposed dwellings are at risk of adverse noise impact when external doors and windows are left open.

BS8233:2014 accepts that external noise level guidelines may not be attainable but in certain circumstances development is acceptable, see section 7.7.2 and 7.7.3.2 of BS8233:2014 reproduced below.

# NOISE SURVEY LTD

## Section 7.7.2 Internal Ambient Noise Levels for Dwellings of BS8233:2014 states

Note 4: Regular individual noise events (for example, scheduled aircraft or passing trains) can cause sleep disturbance. A guideline value may be set in terms of SEL or  $L_{AFMAX}$  depending on the character and number of events per night. Sporadic noise events could require separate values.

Note 5: If relying on closed windows to meet the guide values, there needs to be an appropriate alternative ventilation that does not compromise the façade insulation or the resulting noise level.

Note 7: Where development is considered necessary or desirable, despite external noise levels above WHO guidelines, the internal target levels may be relaxed by up to 5 dB and reasonable internal conditions still achieved.

## Section 7.7.3.2 Design Criteria for External Noise of BS8233:2014 states

“For traditional external areas that are used for amenity space, such as gardens and patios, it is desirable that the external noise level does not exceed 50dB  $L_{Aeq,T}$  with an upper guideline of 55dB  $L_{Aeq,T}$  which would be acceptable in noisier environments. However, it is also recognized that these guideline values are not achievable in all circumstances where development might be desirable. In higher noise areas, such as city centres or urban areas adjoining the strategic transport network, a compromise between elevated noise levels and other factors, such as the convenience of living in these locations or making efficient use of land resources to ensure development needs can be met, might be warranted. In such a situation, development should be designed to achieve the lowest practicable levels in these external amenity spaces, but should not be prohibited,” (BS8233:2014).

### Uncertainty

The noise levels were obtained by direct onsite measurements. The sound level meter was fitted with a wind shield and maintained on a tripod throughout the measurement period. Once readings were started, the sound level meter was free from human interference. This was done to minimize uncertainty in the readings.

In addition, the readings were taken during suitable weather conditions. Each measurement was conducted for a duration sufficient to provide a representation of  $L_{Aeq,(8\text{ hour})}$  for night time and  $L_{Aeq,(16\text{ hour})}$  for day time.

# NOISE SURVEY LTD

The site is currently subject to construction noise that will not be present once the developments are completed. No adjustment to account for this reduction in noise levels has been made to the measurements data.

Additional measurements at ML3 were not used because workmen had placed a radio, generating elevated noise levels, next to the microphone (see appendix for measurement data).

The calibration of the sound level meter at the beginning and end of the readings showed a maximum drift of 0.4 dB at the start and end of the reading. This is considered normal.

Laboratory calibration uncertainty of the sound level meter is  $\pm 1$  dB

The nature of the road traffic noise may vary from time to time depending on but not limited to the number of vehicles, type of vehicles and the speed at which they are travelling. An uncertainty factor of  $\pm 4$ dB has been added to account for variations that can occur day to day.

$$u = \sqrt{a^2 + b^2 + c^2 \dots etc}$$

$$U = \sqrt{1 + 5^2}$$

$$U = \pm 4 \text{ dB}$$

**Uncertainty in the measurement is  $\pm 4$  dB**

## Conclusion

The front of Hoyland Town Hall (ML1) has a daytime level of  $L_{Aeq(16 \text{ hour})}$  81dB and a night time  $L_{Aeq(8 \text{ hour})}$  of 53dB. LAFmx reached 85dB during the night.

The side of Hoyland Town Hall that has the mechanical vents to the ground floor (ML2) has a daytime level of  $L_{Aeq(16 \text{ hour})}$  76dB a night time  $L_{Aeq(8 \text{ hour})}$  of 59dB. LAFmx reached 88dB during the night.

# NOISE SURVEY LTD

The side of Hoyland Town Hall that is above the Cooperative food store and opposite Hoyland Market (ML3) has a daytime level of  $L_{Aeq(16 \text{ hour})}$  55dB a night time  $L_{Aeq(8 \text{ hour})}$  of 43dB.  $L_{AFmx}$  reached 75dB during the night.

In relation to BS8233:2014 and WHO (2009) these levels are too high and have to be actively reduced in order to ensure that internal noise levels for each dwelling does meet the guidelines. However reduction of the external noise to acceptable levels internally is achievable. This can be done by using windows, doors and ventilation that has the  $R_{w}(C;Ctr)$  specified herein for the respective rooms.

The WHO (2009) recommendation for  $L_{AFmax}$  of 60dB and an  $L_{Aeq(8 \text{ hour})}$  of 45dB outside bedrooms may not be achievable. However the development should not be prohibited if the planners deem the development as desirable in the circumstances as acknowledged in BS8233:2014.

Application of the sound reduction recommendations in this report will meet the standards for internal noise levels required by the national planning policy framework guidelines. If users of the property keep external windows and doors closed, they will be at a low risk of adverse noise impact.

## Uncertainty in the measurement is $\pm 4$ dB

Signed:

*Donald I Angir*

Donald Angir AM IOA BA(Hons)

Noise Consultant

Noise Survey Ltd

## BIBLIOGRAPHY

British Standards Institution (2014) BS EN 8233:2014 **Guidance on Sound Insulation and Noise Reduction for Buildings**. London. BSI

World Health Organization Europe (2009) **Night Noise Guidelines for Europe**. Copenhagen WHO

# NOISE SURVEY LTD

Department for Communities and Local Government (2012) National Planning Policy

Framework. Crown London

---

## APPENDIX A

### Measuring Equipment

Casella Cel-490 sound level meter type 1 laboratory calibrated traceable to UKAS standards serial number 240855 last calibration date November 2016.

Casella Cel-490 sound level meter type 1 laboratory calibrated traceable to UKAS standards serial number 240790 last calibration date April 2016. Used at ML1.

Casella Cel-490 sound level meter type 1 laboratory calibrated traceable to UKAS standards serial number 240855 last calibration date December 2016. Used at ML2.

Casella Cel-490 sound level meter type 1 laboratory calibrated traceable to UKAS standards serial number 230643 last calibration date November 2016. Used at ML3.

Casella Cel 284/2 type 1 field acoustic calibrator serial no. 4/01021674 laboratory calibrated traceable to UKAS standards August 2015.

Kane May Thermostat model KM330 serial: 723858 calibrated 19/05/2015 by Stroma Technology certificate: 723858-150519

Kaindl Electronic model: Windtronic 2 Anemometer.

### Weather Conditions

Wind speeds were below 5m/s with no precipitation. Cloud cover ranged from 10% - 90% during the measurement duration. The temperature ranged from 7°C to 24°C during the measurement period. All measurements were conducted during suitable weather conditions.

### Measurement Data

Hoyland Town Hall Front (ML1 facing High Street) meter serial no. 240790

Date	Time	LAF	LAFmx	LAFmn	LAeq
		dB	dB	dB	dB
04/07/2017	17:24:20	66.6	81.9	50.4	62
04/07/2017	18:24:20	58.9	82.4	49	61.9
04/07/2017	19:24:20	64.2	84.8	45.4	60.8

# NOISE SURVEY LTD

04/07/2017	20:24:20	50.6	85.2	44.8	59.8
04/07/2017	21:24:20	59.1	81.9	44	59.9
04/07/2017	22:24:20	65.7	84.8	42.6	58.7
04/07/2017	23:24:20	60.4	78.3	41.1	53.8
05/07/2017	00:24:20	41.4	71.8	40.7	52
05/07/2017	01:24:20	41.7	65.5	40.6	46.4
05/07/2017	02:24:20	41.7	66.5	40.6	44.9
05/07/2017	03:24:20	42.4	66.2	41	44.1
05/07/2017	04:24:20	42.6	83.6	40.9	50.5
05/07/2017	05:24:20	50	78.6	41.1	52.3
05/07/2017	06:24:20	64.2	89.7	41.4	57
05/07/2017	07:24:20	57.6	86.7	42.5	60.9
05/07/2017	08:24:20	63.1	83.5	44	62.5
05/07/2017	09:24:20	51.6	77.1	47.1	62.2
05/07/2017	10:24:20	60.8	87.2	44.7	61.6
05/07/2017	11:24:20	61.4	104.6	48.2	72
05/07/2017	12:24:20	59.1	81	48.2	62.3
05/07/2017	13:24:20	61.8	78.5	47.3	61.4
05/07/2017	14:24:20	58.2	80.1	46.1	60.4
05/07/2017	15:24:20	59.6	81.9	48.2	61.1
05/07/2017	16:24:20	62.1	84.9	46.7	61.5
05/07/2017	17:24:20	58.7	80.4	48.8	61.1
05/07/2017	18:24:20	61.6	90.9	46.8	63.6
05/07/2017	19:24:20	53.2	81.9	45.4	60.1
05/07/2017	20:24:20	64.1	110.2	46.1	91.7
05/07/2017	21:24:20	59.8	88.8	58.5	63.9
05/07/2017	22:24:20	49.4	83.3	41.9	58.2
05/07/2017	23:24:20	42.2	81	40.8	55.3
06/07/2017	00:24:20	42.3	72.6	40.7	50.8
06/07/2017	01:24:20	51.5	78.1	41.3	56.2
06/07/2017	02:24:20	42.8	78.6	40.8	57.3
06/07/2017	03:24:20	42	82.1	40.7	56.8
06/07/2017	04:24:20	41.7	82.5	40.6	54.5
06/07/2017	05:24:20	49	72	40.7	51.5
06/07/2017	06:24:20	58.4	80.4	41.3	56.4
<b>06/07/2017</b>	<b>07:24:20</b>	<b>58.4</b>	<b>82.7</b>	<b>43.1</b>	<b>60.8</b>
<b>06/07/2017</b>	<b>08:24:20</b>	<b>62.2</b>	<b>80.3</b>	<b>46.9</b>	<b>63.2</b>
<b>06/07/2017</b>	<b>09:24:20</b>	<b>61</b>	<b>80.2</b>	<b>48</b>	<b>62.4</b>
<b>06/07/2017</b>	<b>10:24:20</b>	<b>58.9</b>	<b>86.1</b>	<b>48.8</b>	<b>61.3</b>
<b>06/07/2017</b>	<b>11:24:20</b>	<b>69.2</b>	<b>85.6</b>	<b>50.3</b>	<b>62.4</b>
<b>06/07/2017</b>	<b>12:24:20</b>	<b>61.7</b>	<b>86.9</b>	<b>49.5</b>	<b>62</b>

# NOISE SURVEY LTD

06/07/2017	13:24:20	70.2	79.9	47.6	61
06/07/2017	14:24:20	68.6	80.2	47.4	61
06/07/2017	15:24:20	55.1	83	46.8	61.1

Table 3: Measurements at ML1. The blue highlight are night time and the green levels are day timehourly noise level logs.

**Hoyland Town Hall Side (ML2 side opposite Hoyland Center with mechanical vents underneath)  
meter serial no. 240855**

Date	Time	LAFmx dB	LAeq dB	LAF10.0 dB	LAF90.0 dB
04/07/2017	15:48:21	78.4	63.1	64.5	61.5
04/07/2017	16:48:21	80.8	63.3	64.5	61.5
04/07/2017	17:48:21	86.2	63.1	64	61
04/07/2017	18:48:21	88.2	62.6	63.5	61
04/07/2017	19:48:21	87.8	62.2	63	61
04/07/2017	20:48:21	82.8	62.2	63	60.5
04/07/2017	21:48:21	72.1	61	61.5	60.5
04/07/2017	22:48:21	73.1	60.9	61	60.5
04/07/2017	23:48:21	65.8	60.6	61	60
05/07/2017	00:48:21	65.7	60.7	61	60.5
05/07/2017	01:48:21	67	60.7	61	60.5
05/07/2017	02:48:21	76.4	60.8	61	60.5
05/07/2017	03:48:21	73.4	60.8	61	60.5
05/07/2017	04:48:21	84.7	61.9	62	60.5
05/07/2017	05:48:21	90.6	64.1	64.5	60.5
05/07/2017	06:48:21	95.8	65.6	65.5	61
05/07/2017	07:48:21	86.9	63.7	65	61
05/07/2017	08:48:21	77.2	63	64.5	61
05/07/2017	09:48:21	102.5	69.2	64.5	61
05/07/2017	10:48:21	88.3	64.5	65.5	61
05/07/2017	11:48:21	76.1	62.8	64	61
05/07/2017	12:48:21	79.7	62.6	64.5	61
05/07/2017	13:48:21	85.4	63.5	65	61
05/07/2017	14:48:21	84.5	63.4	65	61
05/07/2017	15:48:21	77.6	62.8	64.5	61
05/07/2017	16:48:21	95	64.4	64	61
05/07/2017	17:48:21	76.8	62.2	64	60.5
05/07/2017	18:48:21	106.5	89.5	91	61
05/07/2017	19:48:21	98.5	70.6	64	61
05/07/2017	20:48:21	84.4	61.4	62	60.5
05/07/2017	21:48:21	75.1	61.2	61.5	60.5

# NOISE SURVEY LTD

05/07/2017	22:48:21	75	60.8	61	60
05/07/2017	23:48:21	79.3	61	61.5	60.5
06/07/2017	00:48:21	73	60.8	61	60.5
06/07/2017	01:48:21	81.1	61.5	62.5	60.5
06/07/2017	02:48:21	76.2	61	61.5	60
06/07/2017	03:48:21	76.4	60.8	61	60
06/07/2017	04:48:21	82.7	61.6	62	60.5
06/07/2017	05:48:21	97.8	68.6	65.5	60.5
06/07/2017	06:48:21	86.6	64.6	65.5	61
06/07/2017	07:48:21	89.3	65.9	67	61.5
06/07/2017	08:48:21	84.8	63.4	64.5	61
06/07/2017	09:48:21	80.8	63.7	65	61.5
06/07/2017	10:48:21	89.5	63.9	64.5	61
06/07/2017	11:48:21	80.3	63	64.5	61
06/07/2017	12:48:21	84.6	63.8	65	61
06/07/2017	13:48:21	81.1	63.6	65	61.5

Table 4: Measurements at ML2. The blue highlight are night time and the green levels are day time hourly noise level logs.

**Hoyland Town Hall ML3 Facing market and above the Co-operative food store. Meter serial no. 230643**

Date	Time	LAF dB	LAFmx dB	LAFmn dB	LAeq dB
04/07/2017	16:55:54	52.6	79.3	43.7	51.8
04/07/2017	17:55:54	47.6	71.5	40.7	51.1
04/07/2017	18:55:54	47	75.3	39.2	51.4
04/07/2017	19:55:54	49.7	73.7	36.8	50.3
04/07/2017	20:55:54	51.3	77.9	35.4	51.4
04/07/2017	21:55:54	44	75.5	34.5	48.1
04/07/2017	22:55:54	51.9	64.8	31.1	43.9
04/07/2017	23:55:54	31.1	67.6	30	41.3
05/07/2017	00:55:54	32.9	57.5	30.2	36.3
05/07/2017	01:55:54	32.8	61.6	30.4	36.9
05/07/2017	02:55:54	32.3	55.1	30.4	35.5
05/07/2017	03:55:54	41.1	66.5	30.5	39.6
05/07/2017	04:55:54	35.8	65.5	31.4	45.1
05/07/2017	05:55:54	43.3	75.1	31.8	48.5
05/07/2017	06:55:54	48	81.7	37.1	52.7
05/07/2017	07:55:54	53.4	84	41.4	55
05/07/2017	08:55:54	48.2	86.1	40.4	56.7
05/07/2017	09:55:54	51.3	87.8	40.7	57.8

# NOISE SURVEY LTD

05/07/2017 10:55:54 64.4 78.7 41 59

Table 5: Measurements at ML3. The blue highlight are night time and the green levels are day time hourly noise level logs. LAeq (11 hrs) taken as representative of LAeq (16hrs)

**Second set of measurements at ML3 not used because construction workers had placed radio playing loud music next to the sound level meter.**

Date	Time	LAF	LAFmx	LAFmn	LAeq
		dB	dB	dB	dB
05/07/2017	16:02:17	46.3	70.9	41.7	51
05/07/2017	17:02:17	53.7	76.7	42.5	51.5
05/07/2017	18:02:17	45.1	74.4	40.6	51.4
05/07/2017	19:02:17	59.8	70	39.3	50.8
05/07/2017	20:02:17	48.9	92.4	39	65
05/07/2017	21:02:17	42.3	78.5	35.6	50.5
05/07/2017	22:02:17	52.1	72	34.7	49
05/07/2017	23:02:17	52.6	67.8	34.1	45.3
06/07/2017	00:02:17	45.2	67.6	31.2	42.7
06/07/2017	01:02:17	41.7	62.8	32.4	40.4
06/07/2017	02:02:17	36.4	68	32.2	45.6
06/07/2017	03:02:17	34.3	67.9	30.9	44.9
06/07/2017	04:02:17	35.2	61.7	31.8	42.1
06/07/2017	05:02:17	43.6	84.7	34.2	48.3
06/07/2017	06:02:17	54.1	79.2	36.9	51.6
06/07/2017	07:02:17	61.4	84.2	44.9	57.8
06/07/2017	08:02:17	57.8	81.6	48.2	59.5
06/07/2017	09:02:17	53.8	79.1	46.9	57.3
06/07/2017	10:02:17	55.6	80.2	47.8	56.9
06/07/2017	11:02:17	54.6	87.4	47.6	57.6
06/07/2017	12:02:17	47.2	79.6	42	52.4
06/07/2017	13:02:17	50.1	85.4	41.8	64.7
06/07/2017	14:02:17	59.3	81.2	46.9	64.3
06/07/2017	15:02:17	67.1	78.1	44.9	64.1


Table 6: Measurements at ML3. Measurements not used because of high levels of noise from worker radio placed next to the sound level meter.

# NOISE SURVEY LTD

Site plan 2: Original full site location.



## Compass House Hoyland S74 9AD

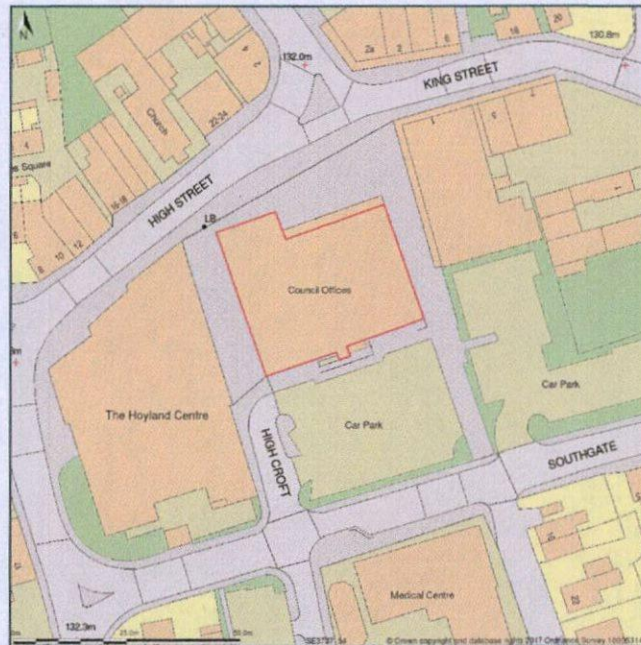

Site Plan shows area bounded by: 437300.45, 400477.8, 437441.87, 400619.22 (at a scale of 1:1250), OSGridRef: SE3737 54. The representation of a road, track or path is no evidence of a right of way. The representation of features as lines is no evidence of a property boundary.

Produced on 10th Jul 2017 from the Ordnance Survey National Geographic Database and incorporating surveyed revision available at this date. Reproduction in whole or part is prohibited without the prior permission of Ordnance Survey. © Crown Copyright 2017. Submitted by www.buyaplan.co.uk a licensed Ordnance Survey partner (100063149). Unique plan reference: #00238431-12BU1B

Ordnance Survey and the OS Symbol are registered trademarks of Ordnance Survey, the national mapping agency of Great Britain. Buy A Plan logo, pdf design and the www.buyaplan.co.uk website are Copyright © Pass Inc Ltd 2017