




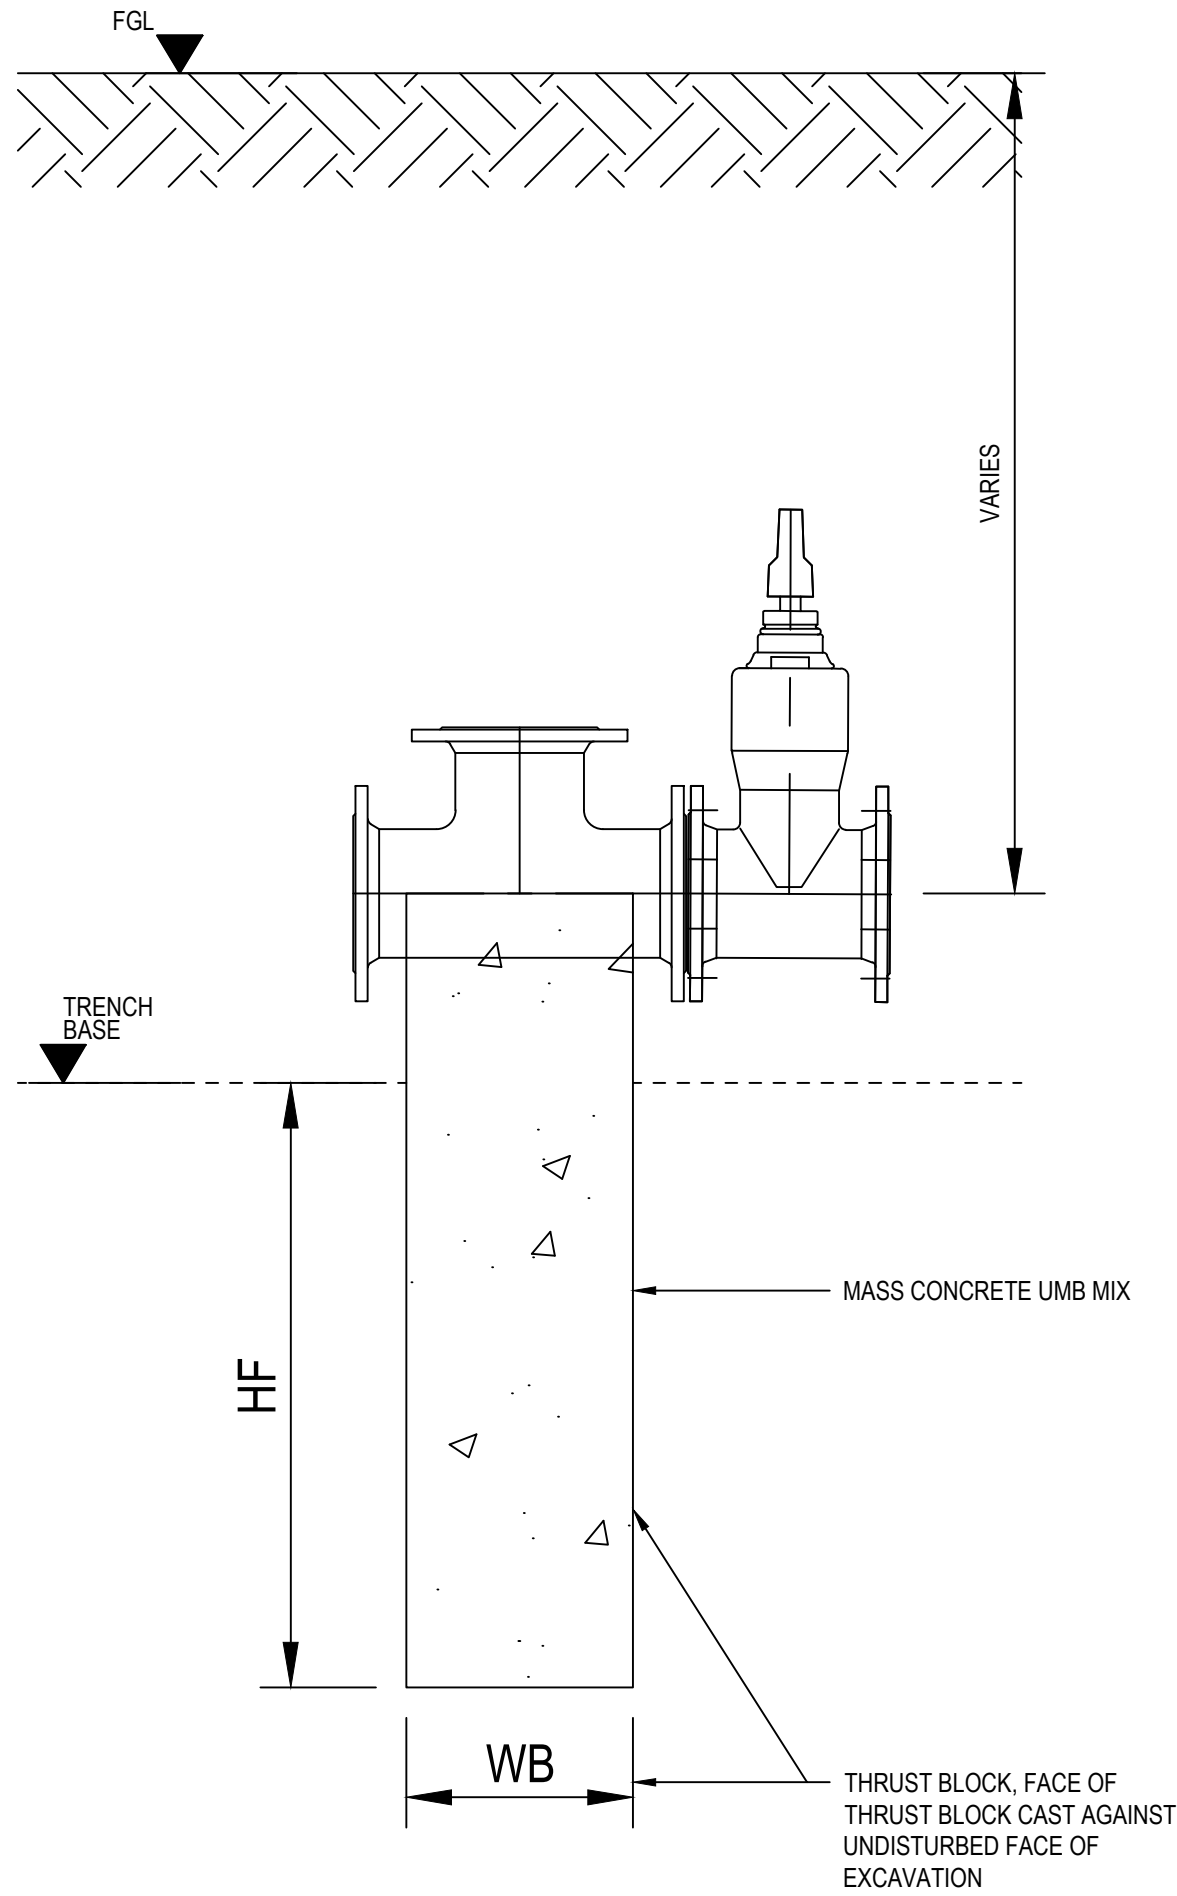

SECTION A-A
SCALE 1:10

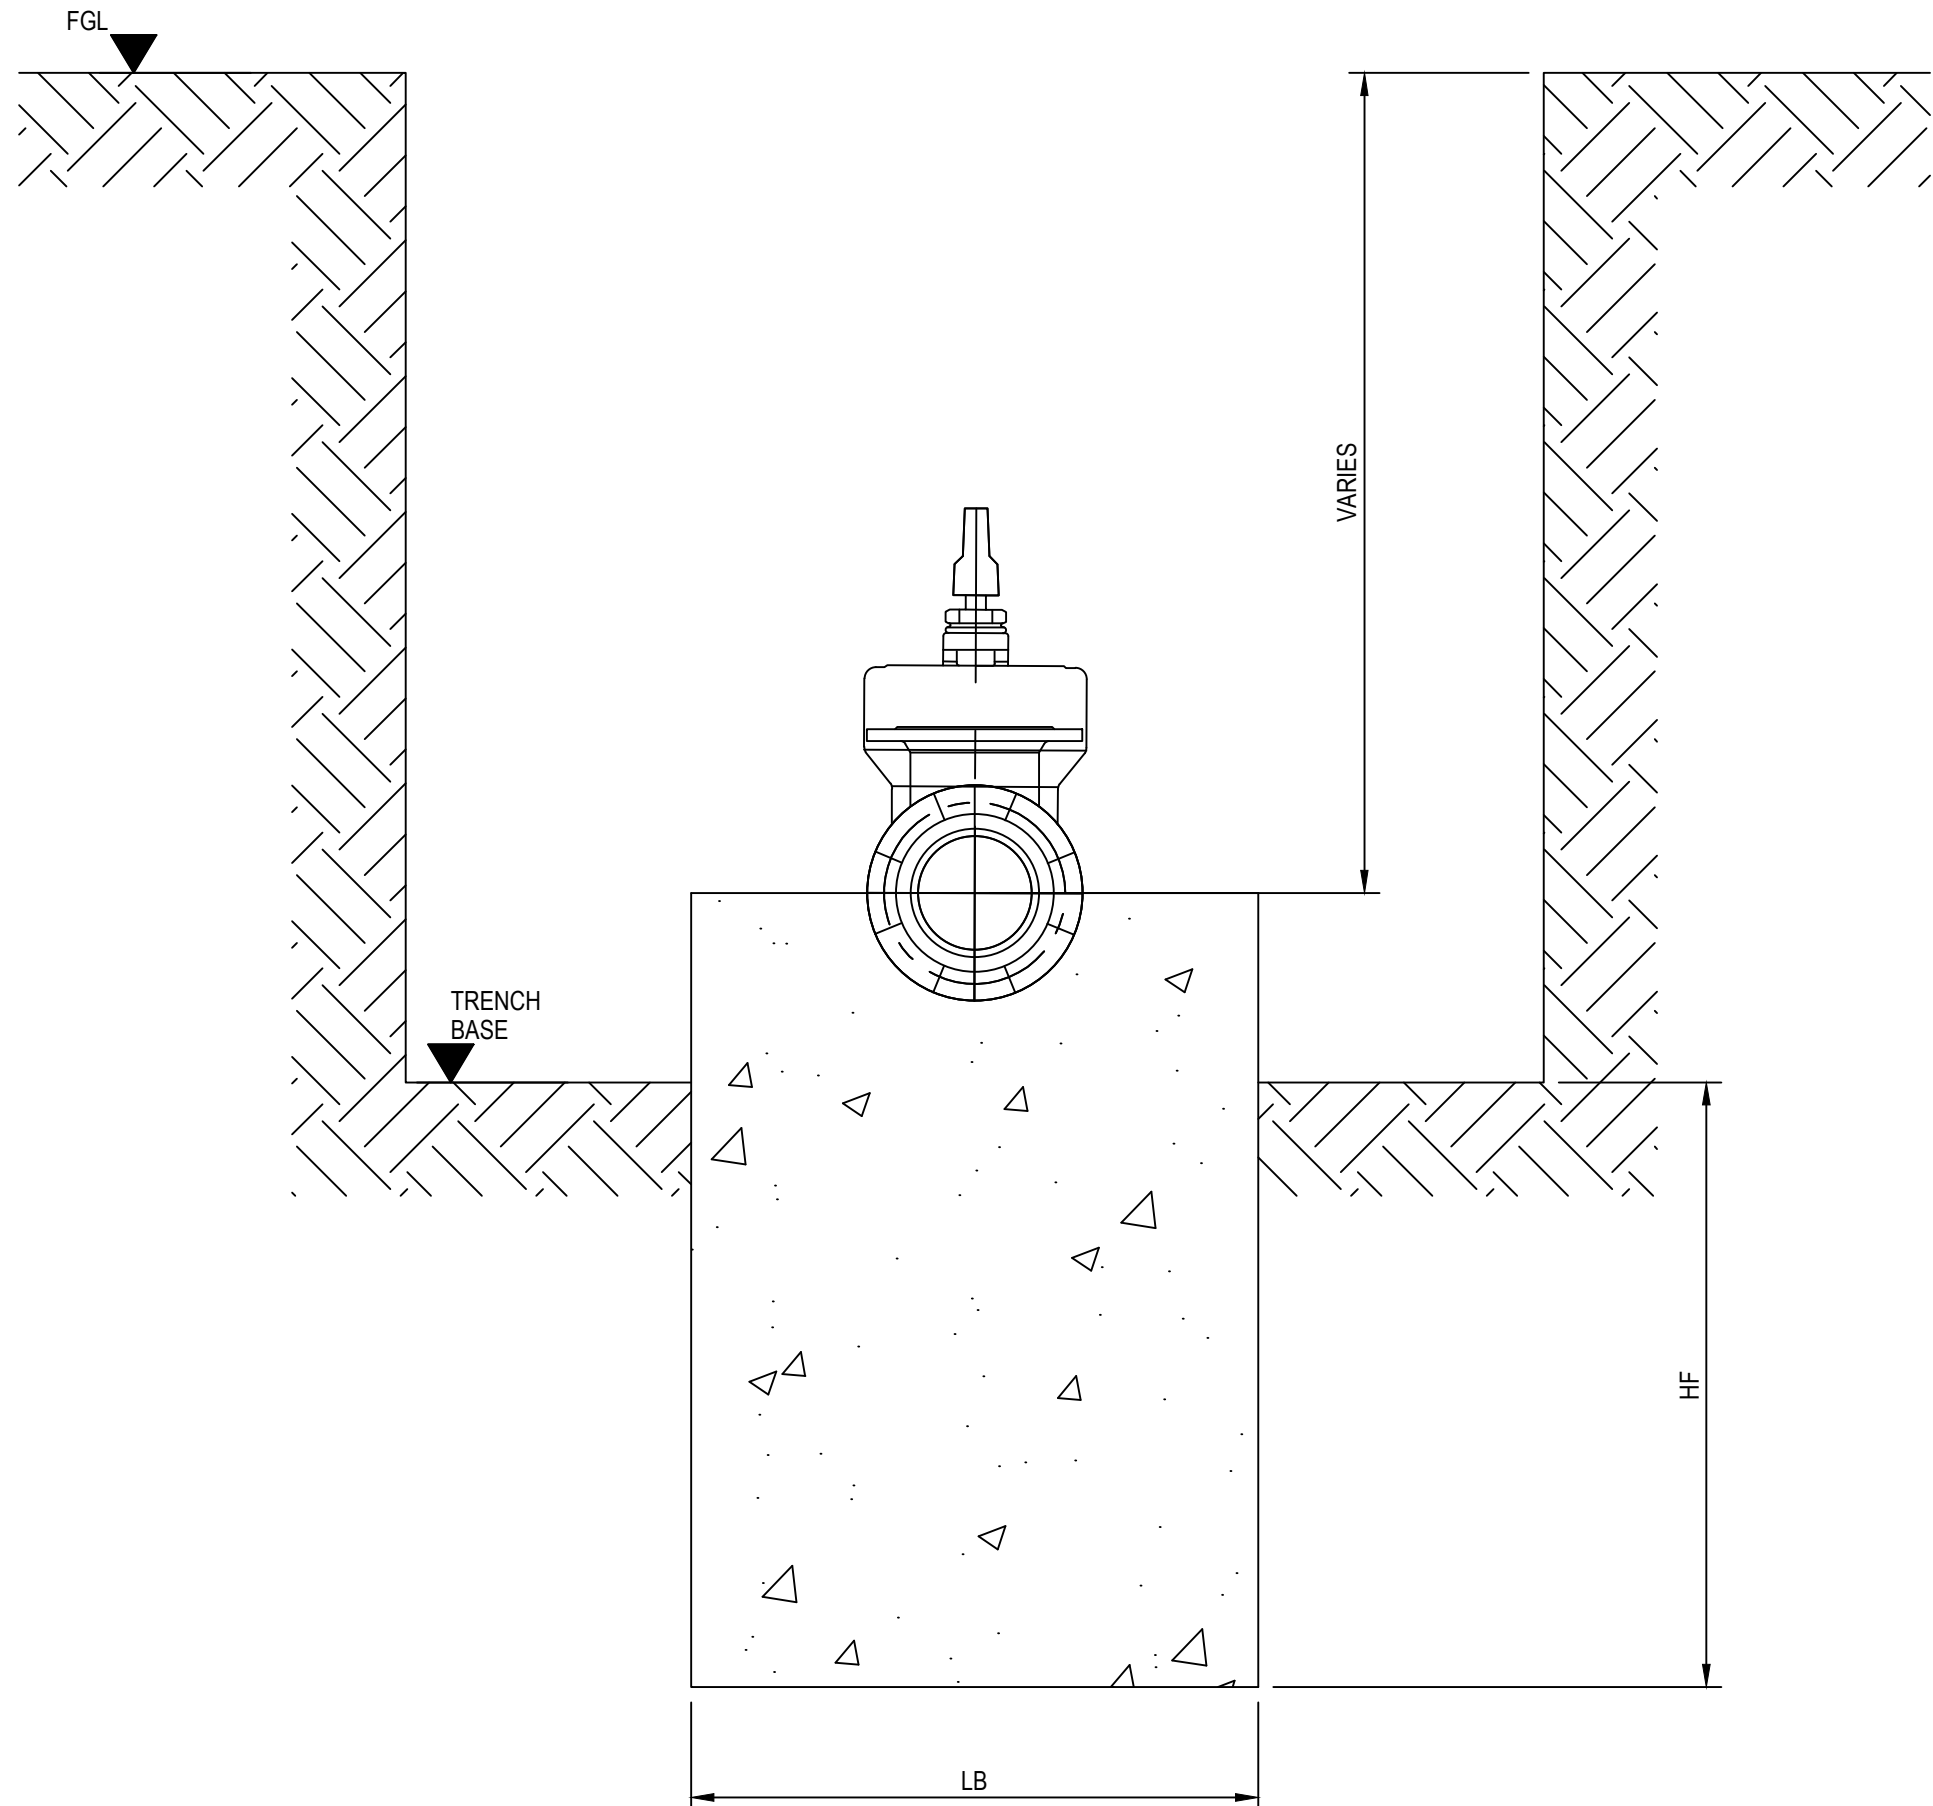

SECTION B-B
SCALE 1:10

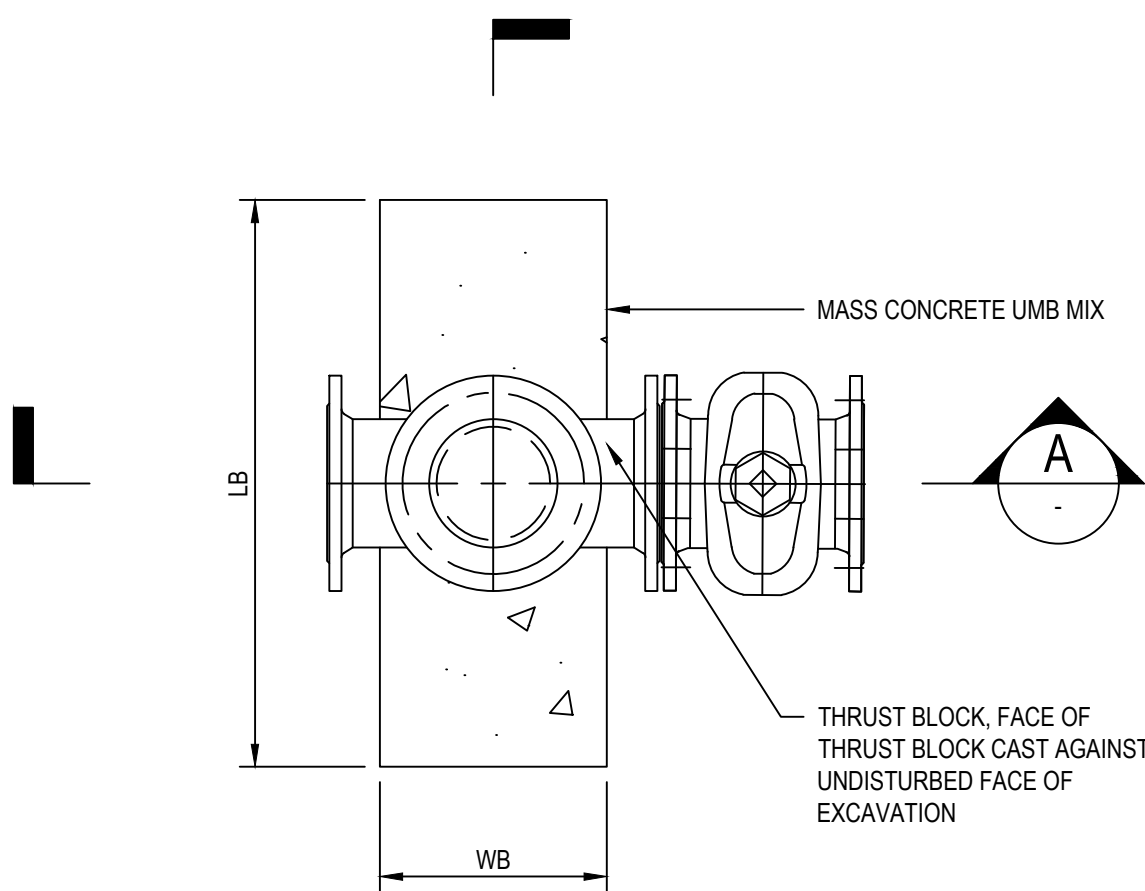

PLAN
SCALE 1:10

- NOTES:
- DO NOT SCALE FROM THIS DRAWING.
 - ALL DIMENSIONS ARE IN MILLIMETRES (mm) & ALL LEVELS ARE IN METRES (m) AOD, UNLESS STATED OTHERWISE.
 - ALL DIMENSIONS & LEVELS CHECKED ON SITE AND ANY DISCREPANCIES REPORTED TO THE DESIGNER.
 - THRUST BLOCK LOCATIONS TO BE CONFIRMED ON SITE IF REQUIRED.
 - MINIMUM CONCRETE COVER TO PIPE 150mm.
 - THE BLOCK BEARING FACE AND BASE OF BLOCK ARE CAST AGAINST AN UNDISTURBED GROUND SURFACE.
 - PIPE SIZES AND TEST PRESSURES ARE INDICATED IN THE TABLES.
 - CONCRETE GRADE UMB MIX.
 - FOR GENERAL GUIDANCE ON THE DESIGN AND CONSTRUCTION OF THE THRUST BLOCKS REFER TO CIRIA REPORT 128 (1994).

P01	PRELIMINARY ISSUE	JS	NT	VB	23.04.19
No.	Revision	Drawn	Job Manager	Project Director	Date

Drawing Revisions
Note: * indicates signatures on original issue of drawing or last revision of drawing

GHD Livigunn Limited
Conditions of Use. This document may only be used by GHD's client (and any other person who GHD has agreed can use this document) for the purpose for which it was prepared and must not be used by any other person or for any other purpose.



Alexandra House, Lawnswood Business Park,
Leeds, LS16 6QY, United Kingdom
T 44 (0)113 487 8600
E UKmail@ghd.com W www.ghd.com

Client **KEEPMOAT HOMES**

Project **CARLTON ROAD
BARNSELEY**

Title **THRUST BLOCK
DETAIL SHEET**

Scale	AS SHOWN	DO NOT SCALE
Drawn	JS	Designer NT
Drafting Check	VB	Design Check VB

Approved (Project Director)	
Date	
This Drawing must not be used for Construction unless signed as Approved	
Drawing No.	Original Size
44-12501429-C153	A1
Rev.	P01

PRELIMINARY