

| LEGEND | |
|--------|--|
| SYMBOL | DESCRIPTION |
| | SYLVANIA SCOPE WALL MOUNTED LED UP/DOWNLIGHTER MOUNTED AT 2.5m FFL |
| | KINGFISHER ZACTIS 285w LED FLOODLIGHT MOUNTED AT 10.4m FFL |
| | KINGFISHER ZACTIS 285w LED FLOODLIGHT MOUNTED AT 8.0m FFL |
| | KINGFISHER ALUDA 100w LED FLOODLIGHT MOUNTED AT 6.0m FFL |
| | PHOTOCELL |


- NOTES:
- FOR BUILDING SERVICES INFORMATION ONLY.
 - DO NOT SCALE FROM THIS DRAWING.
 - THIS DRAWING TO BE READ IN COLOUR.
 - THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE SPECIFICATION AND ALL OTHER RELEVANT DOCUMENTS.
 - ALL WORKS SHALL BE CARRIED OUT IN ACCORDANCE WITH BS 7671:2018 (AS CURRENT AMENDMENT) ET 18th EDITION OF THE WIRING REGULATIONS.
 - REFER TO ZONES C & D ROOF LEVEL LIGHTING DRAWINGS FOR CIRCUIT REFERENCES. LIGHTS FED FROM 16A SPAN BSEN 60309 SOCKETS FROM THE ROOFTOP.
 - SYLVANIA SCOPE UP/DOWNLIGHTERS TO BE FED FROM BASEMENT LEVEL IN LV CONDUIT RISING UP THROUGH THE STEEL COLUMNS IN GALVANISED CONDUIT TO LUMINAIRE POSITION. WALL LIGHTS TO ZONE C 500V, 15, 19 & 20 & ZONE A CABLING TO BE RUN EXTERNALLY IN SURFACE GALVANISED STEEL CONDUIT AT HIGH LEVEL WITH BAKK ENTRY FLEXIBLE CONDUIT DROP TO EACH LUMINAIRE WITHIN THE GRC COLUMN TO THE LUMINAIRE POSITION.
 - M&E SERVICES TO PUBLIC REALM BY OTHERS.
 - REFER TO DRAWING NUMBER BGW2-AGL-ZZ-ZZ-DR-E-G500-4101 FOR EXTERNAL M&E SERVICES TO THE SERVICE ROAD.
 - INDUSTRIAL SOCKET CONNECTIONS FOR HIGH LEVEL FLOODLIGHTS (CW1) AND CHRISTMAS LIGHTS (X1) TO BE CONNECTED VIA WEATHERPROOF ADAPTABLE CONNECTION BOX WITH 3-CORE 2.5mm FLEX.
 - REFER TO DRAWING NO. BGW2-AGL-ZX-ZZ-DR-E-G541-3014 FOR EXTERNAL LIGHTING CONTROLS SCHEMATIC.
 - REFER TO DRAWING NO. BGW2-AGL-ZX-RF-DR-E-G541-3011 FOR ROOF LEVEL LIGHTING CONTROL SCHEMATIC.

REFER TO DRAWING NUMBER BGW2-AGL-ZZ-ZZ-DR-E-G500-4101 FOR EXTERNAL M&E SERVICES TO THE SERVICE ROAD


REFER TO DRAWING NUMBER BGW2-AGL-ZZ-ZZ-DR-E-G500-4101 FOR EXTERNAL M&E SERVICES TO THE SERVICE ROAD

SEE NOTE 10 & 12

SEE NOTE 10 & 12

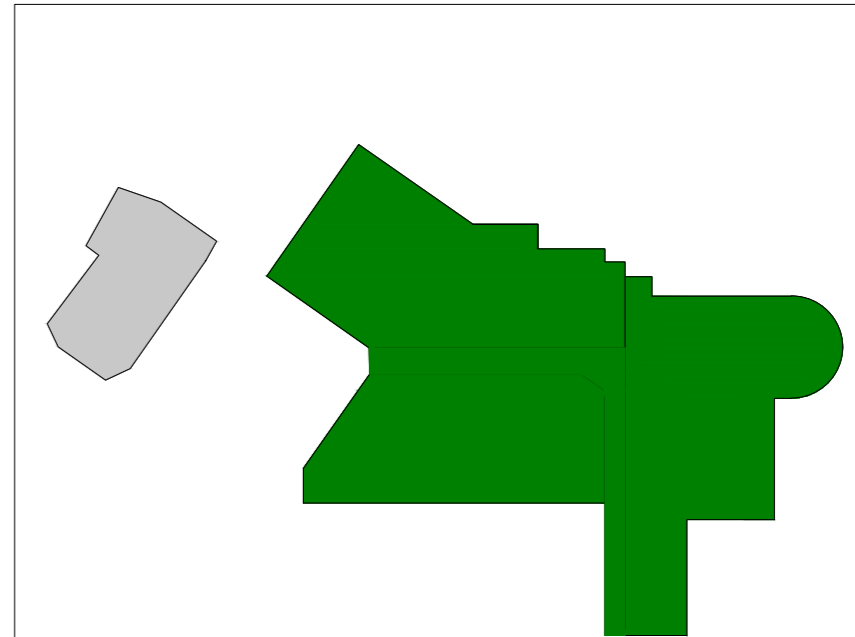

LOCATION PLAN

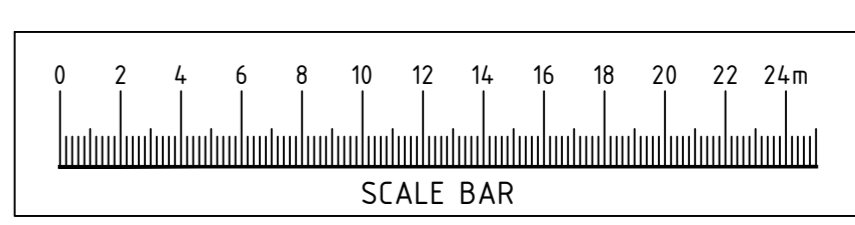

| | |
|---|---|
| <p>Revised</p> <p>NO</p> <p>DESCRIPTION</p> <p>DATE</p> | <p>16.08.19</p> <p>ISSUED FOR COMMENT</p> |
| <p>Anderson Green</p> <p>www.andersongreen.co.uk</p> | <p>Nottingham 0115 974 4141</p> <p>Sheffield 0114 242 5013</p> <p>London 0207 501 8841</p> <p>Leeds 0113 243 2672</p> |
| <p>Henry Boot</p> <p>H.B. H.E. BARNES</p> <p>Electrical & Mechanical Services Contractor</p> | <p>STAGE 4b</p> |
| <p>BARNESLEY GLASSWORKS PHASE 2</p> | <p>ZONES B, C & D BUILDING EXTERNAL & COVERED WALKWAY (MALL) LIGHTING</p> |
| <p>MN PA GP 16.08.19 A0 1:250</p> <p>Project No. / Designer / Date / Level / Type / Risk / Class / Drawing No. / Scale / Revision</p> | <p>BGW2-AGL-ZZ-ZZ-DR-E-G541-2303 S3 P01</p> |