



REV	DATE	COMMENTS	Drn	Chk
0	28.02.11	Original	SMT	CN

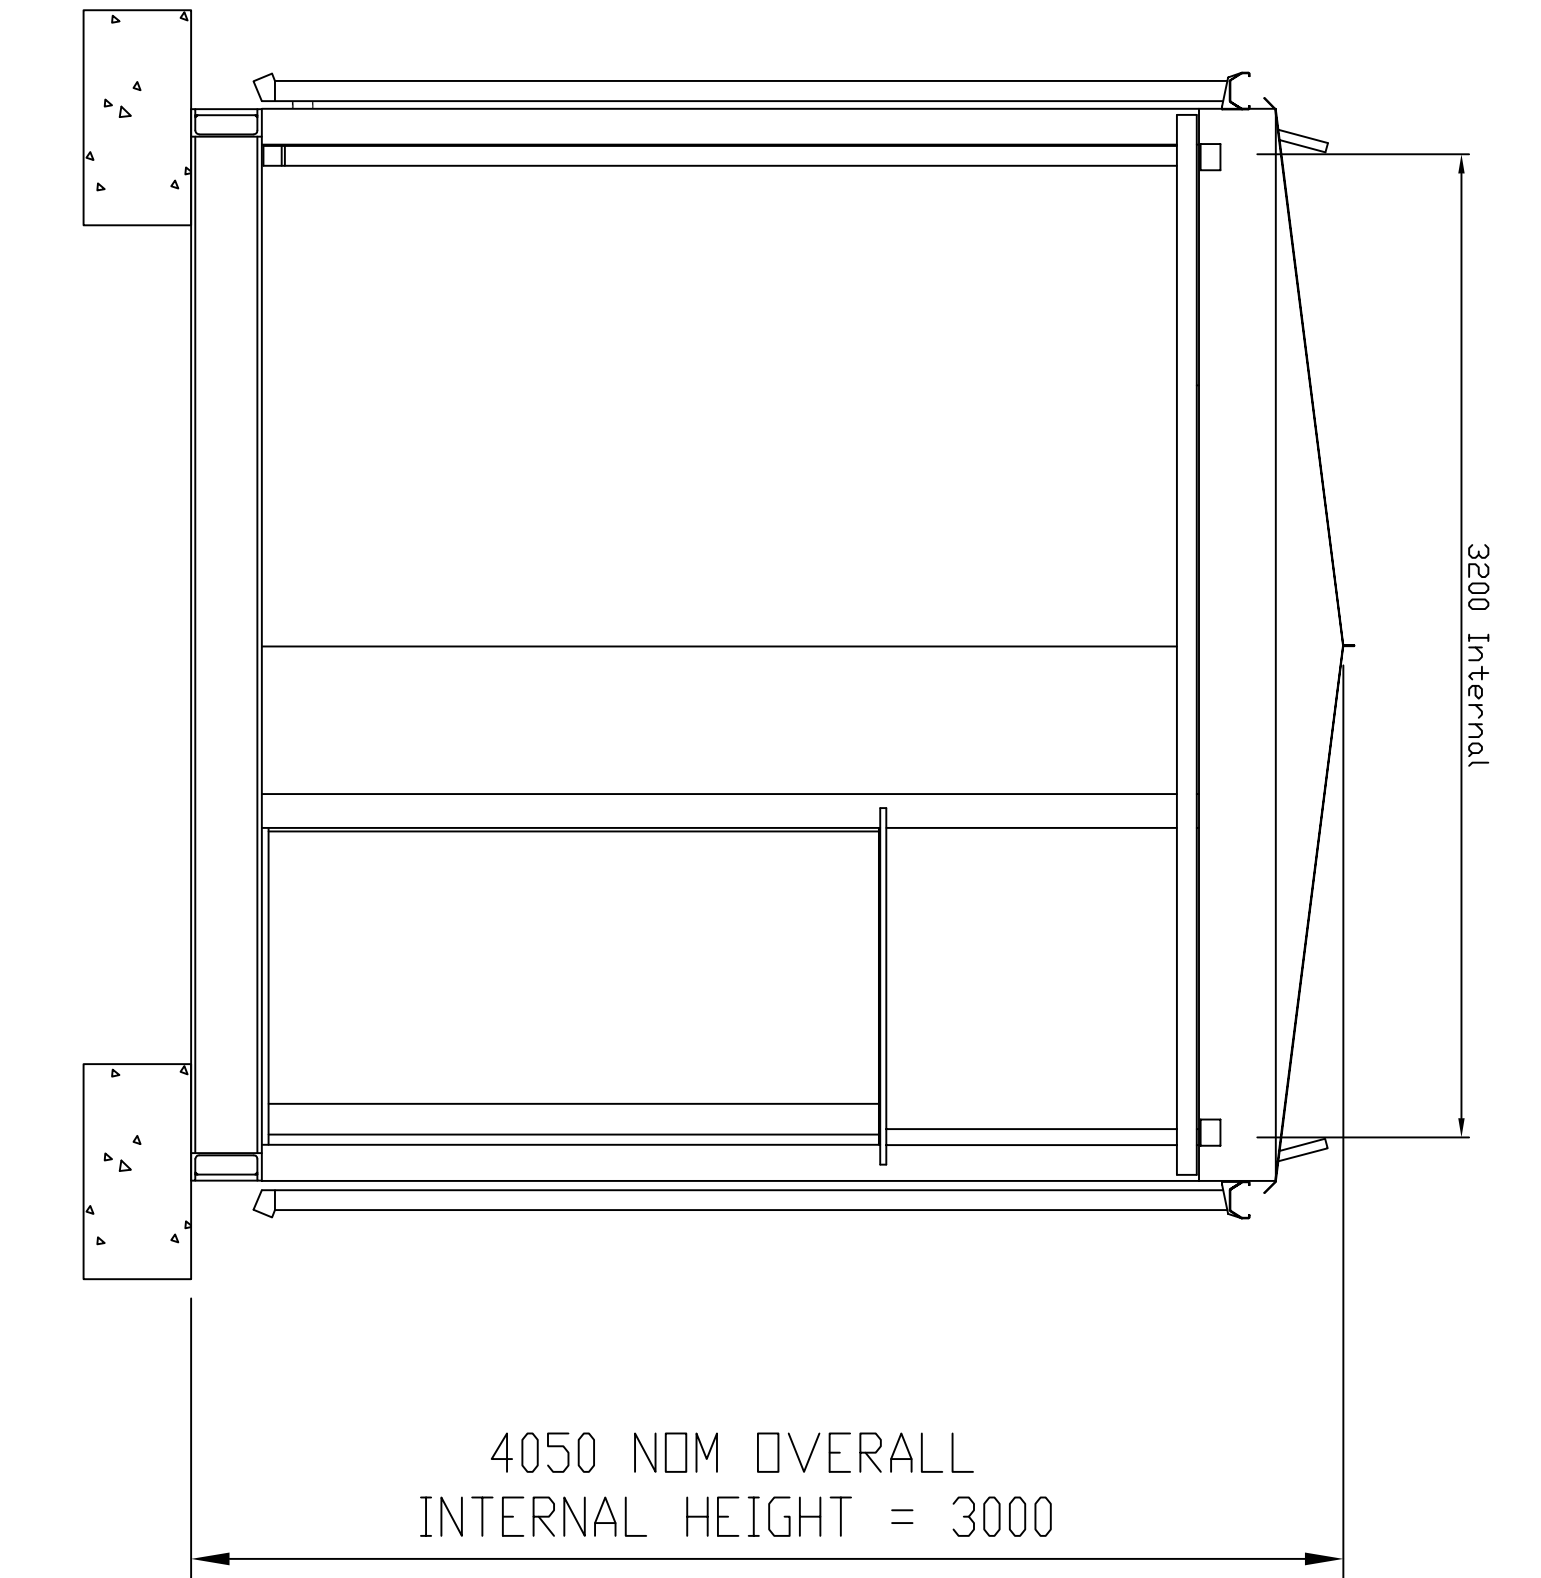


END ELEVATION

STRIP FOUNDATIONS as shown, depth and width to suit local conditions to support loading of 15KN (unfactored) per metre run. FOUNDATION DETAIL requires a level tolerance of ± 2mm with a trowelled finish.

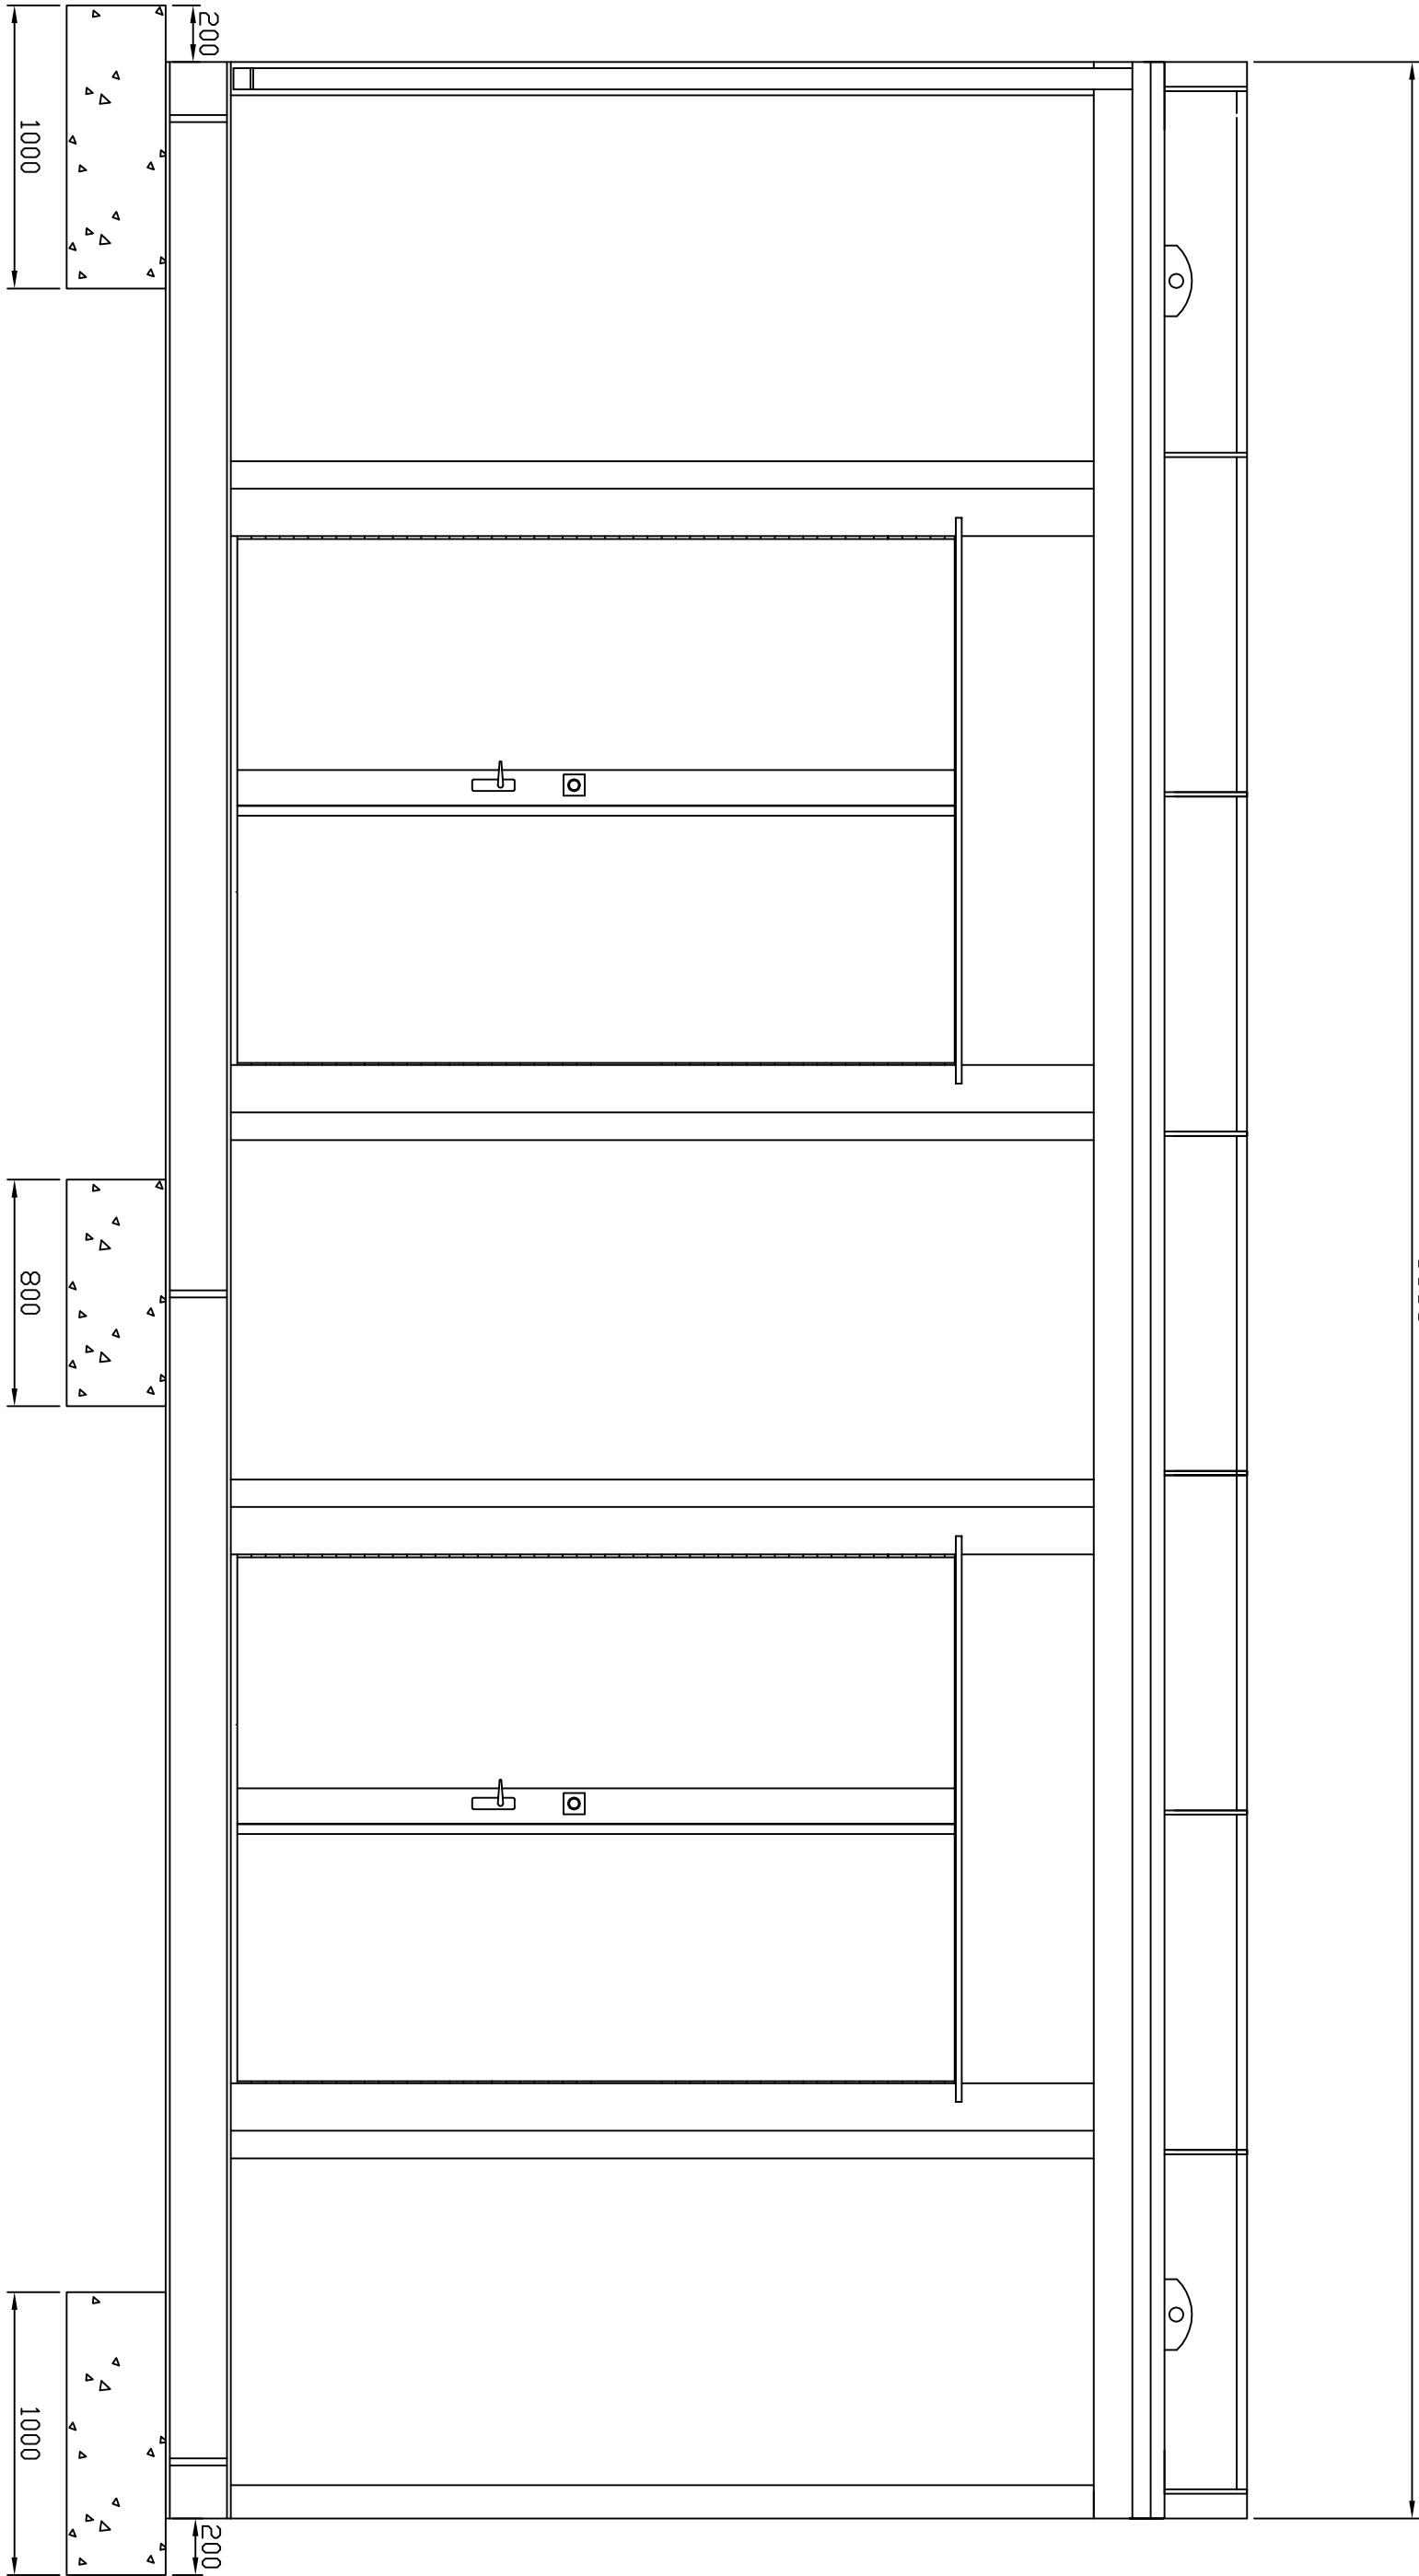

FRONT ELEVATION

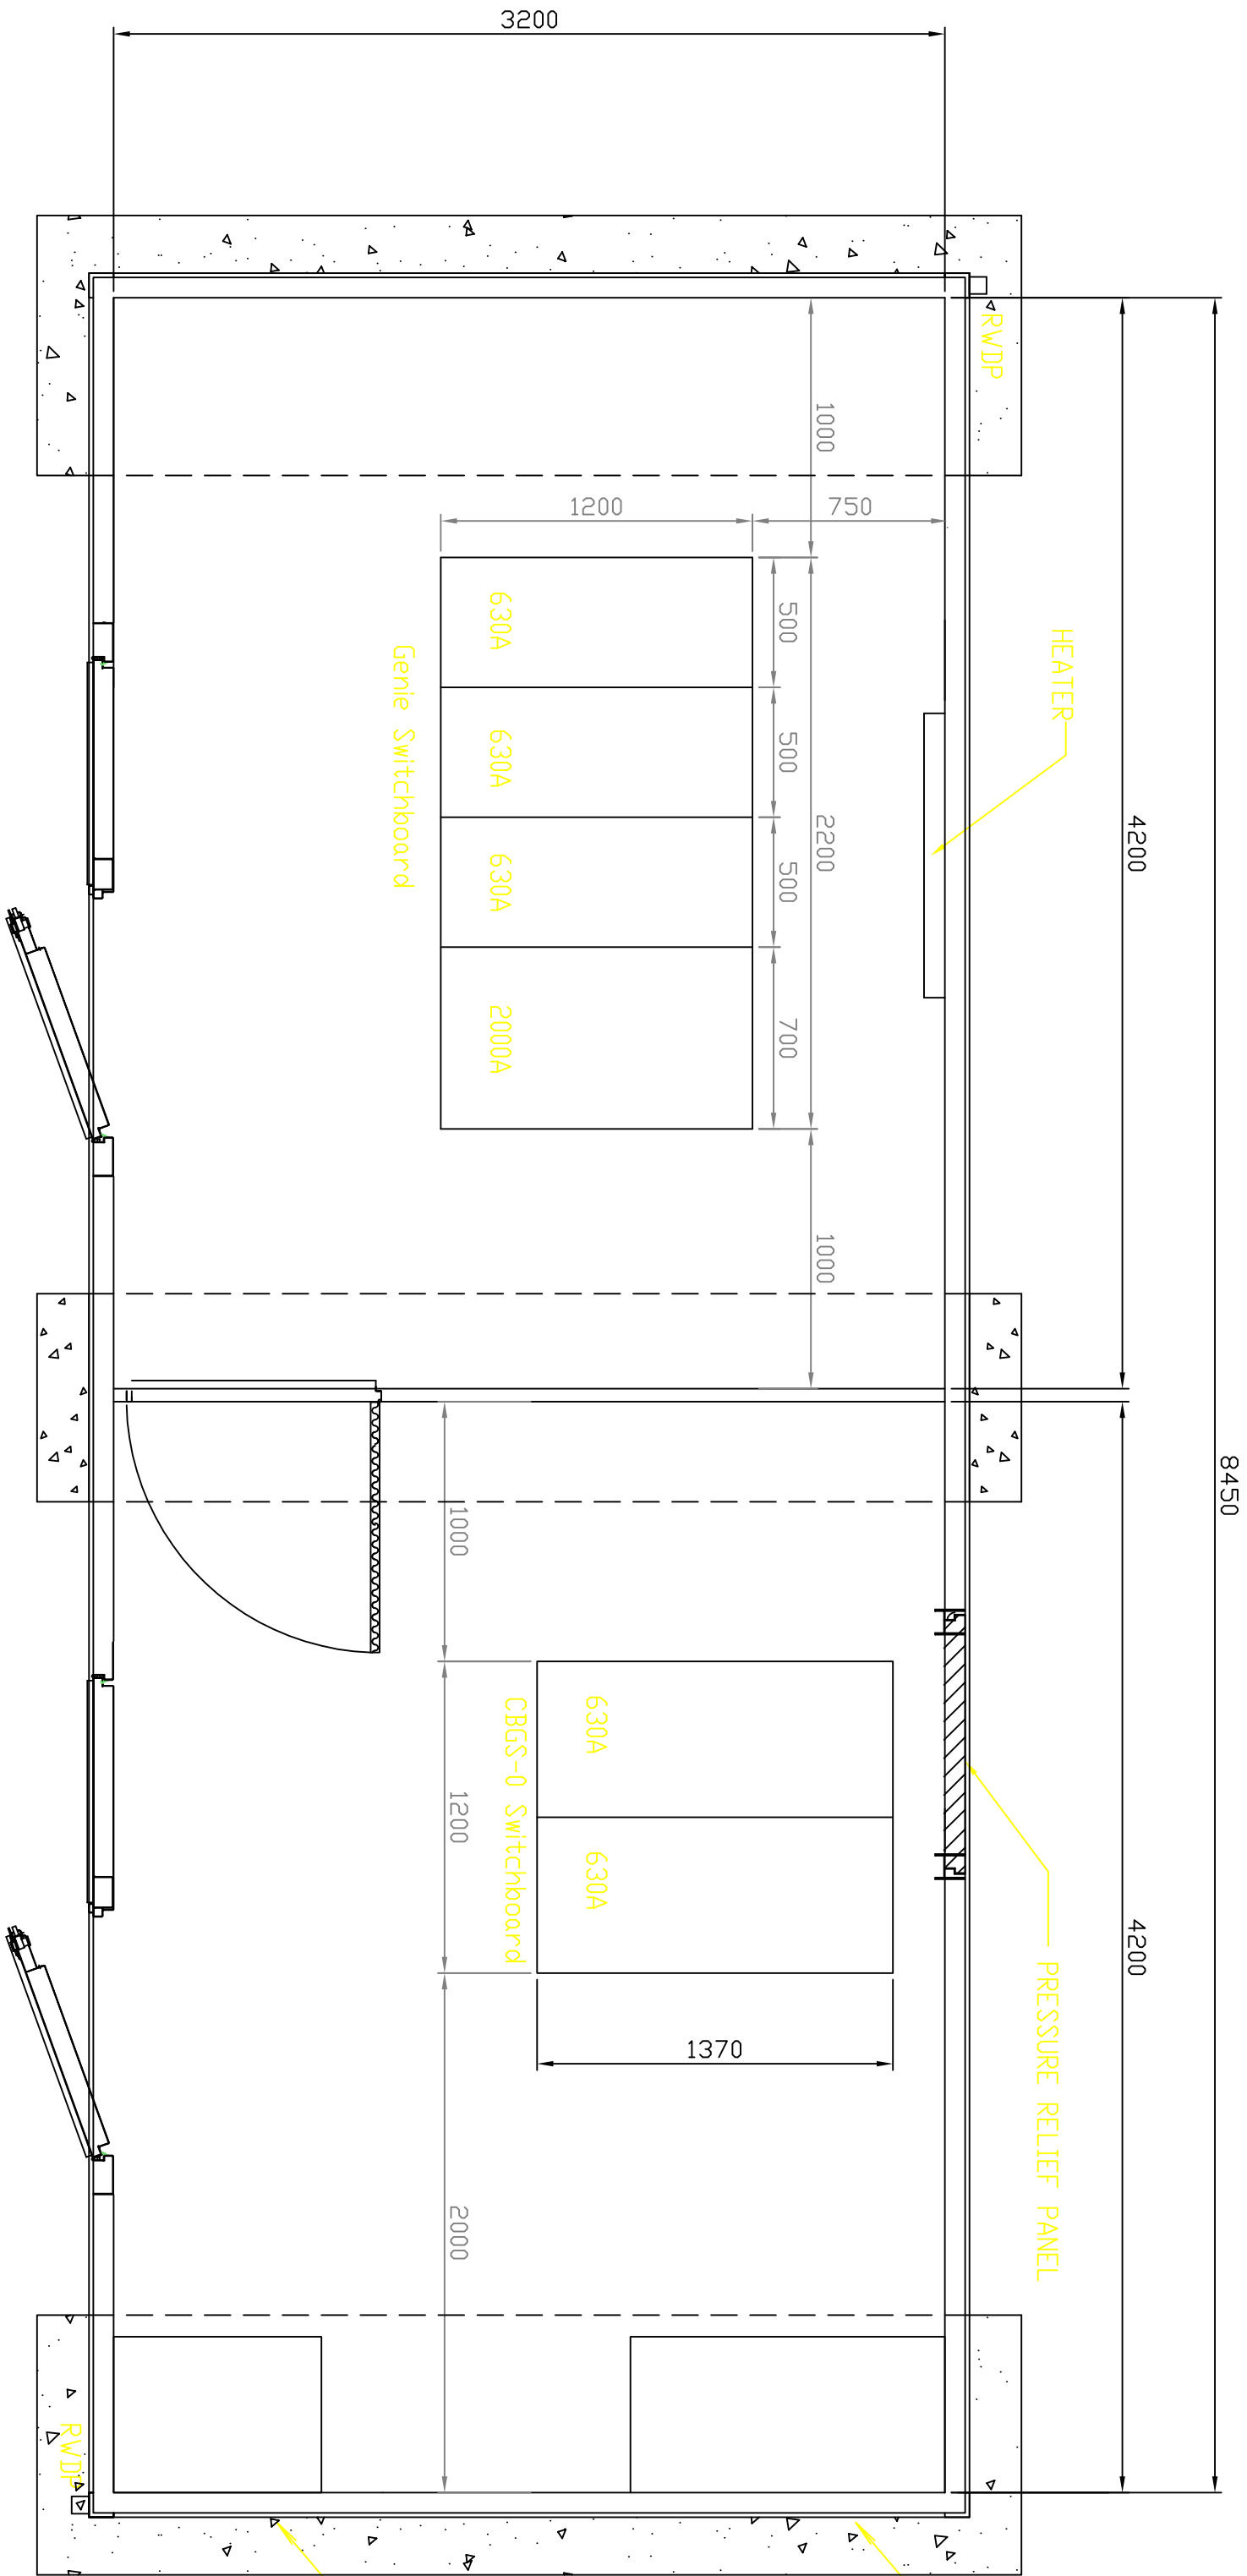

NOTE: PANEL DEPTH INCREASES TO 2200mm IF VTs ARE FITTED *

CLIENT Green Frog			
PROJECT			
TITLE General Arrangement Containerised Substation			
DRAWN BY SMT	DATE DRAWN 28.02.2011	CHECKED BY CN	DATE CHECKED 28.02.2011
APPROVED BY	DATE APPROVED	SCALE 1:25	SHEET No.
DRAWING No. PR-GA-20134725-001			REV. 0