



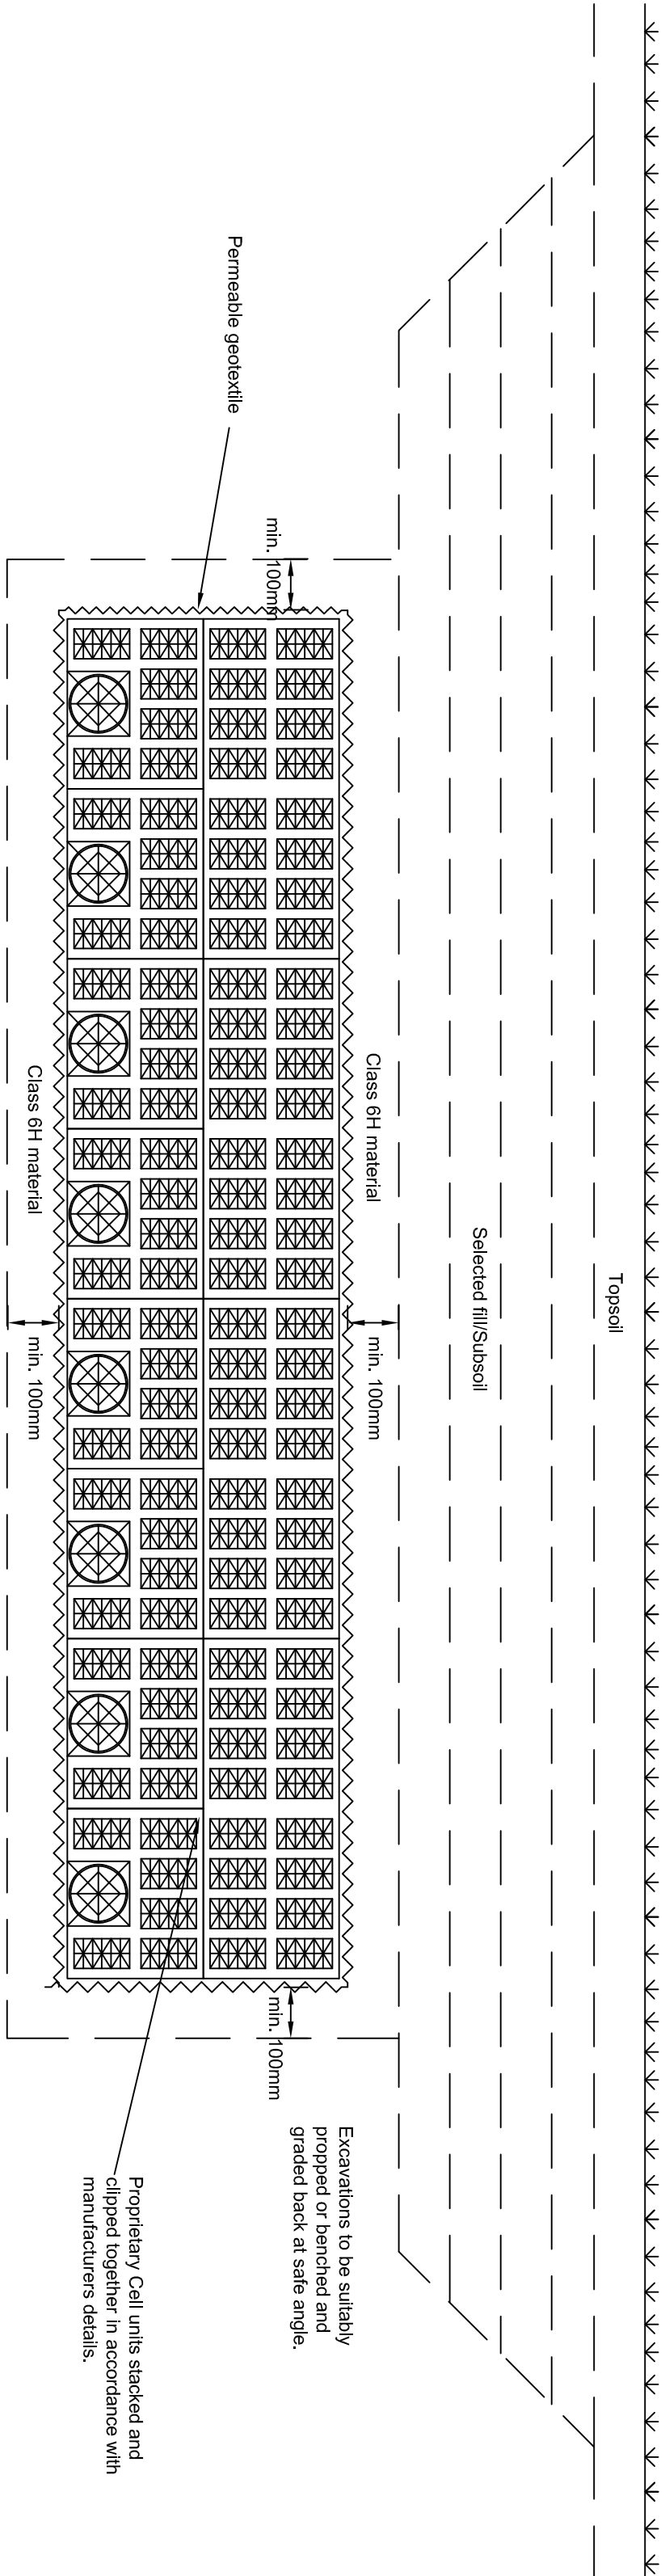

Typical Cell Unit Soakaway

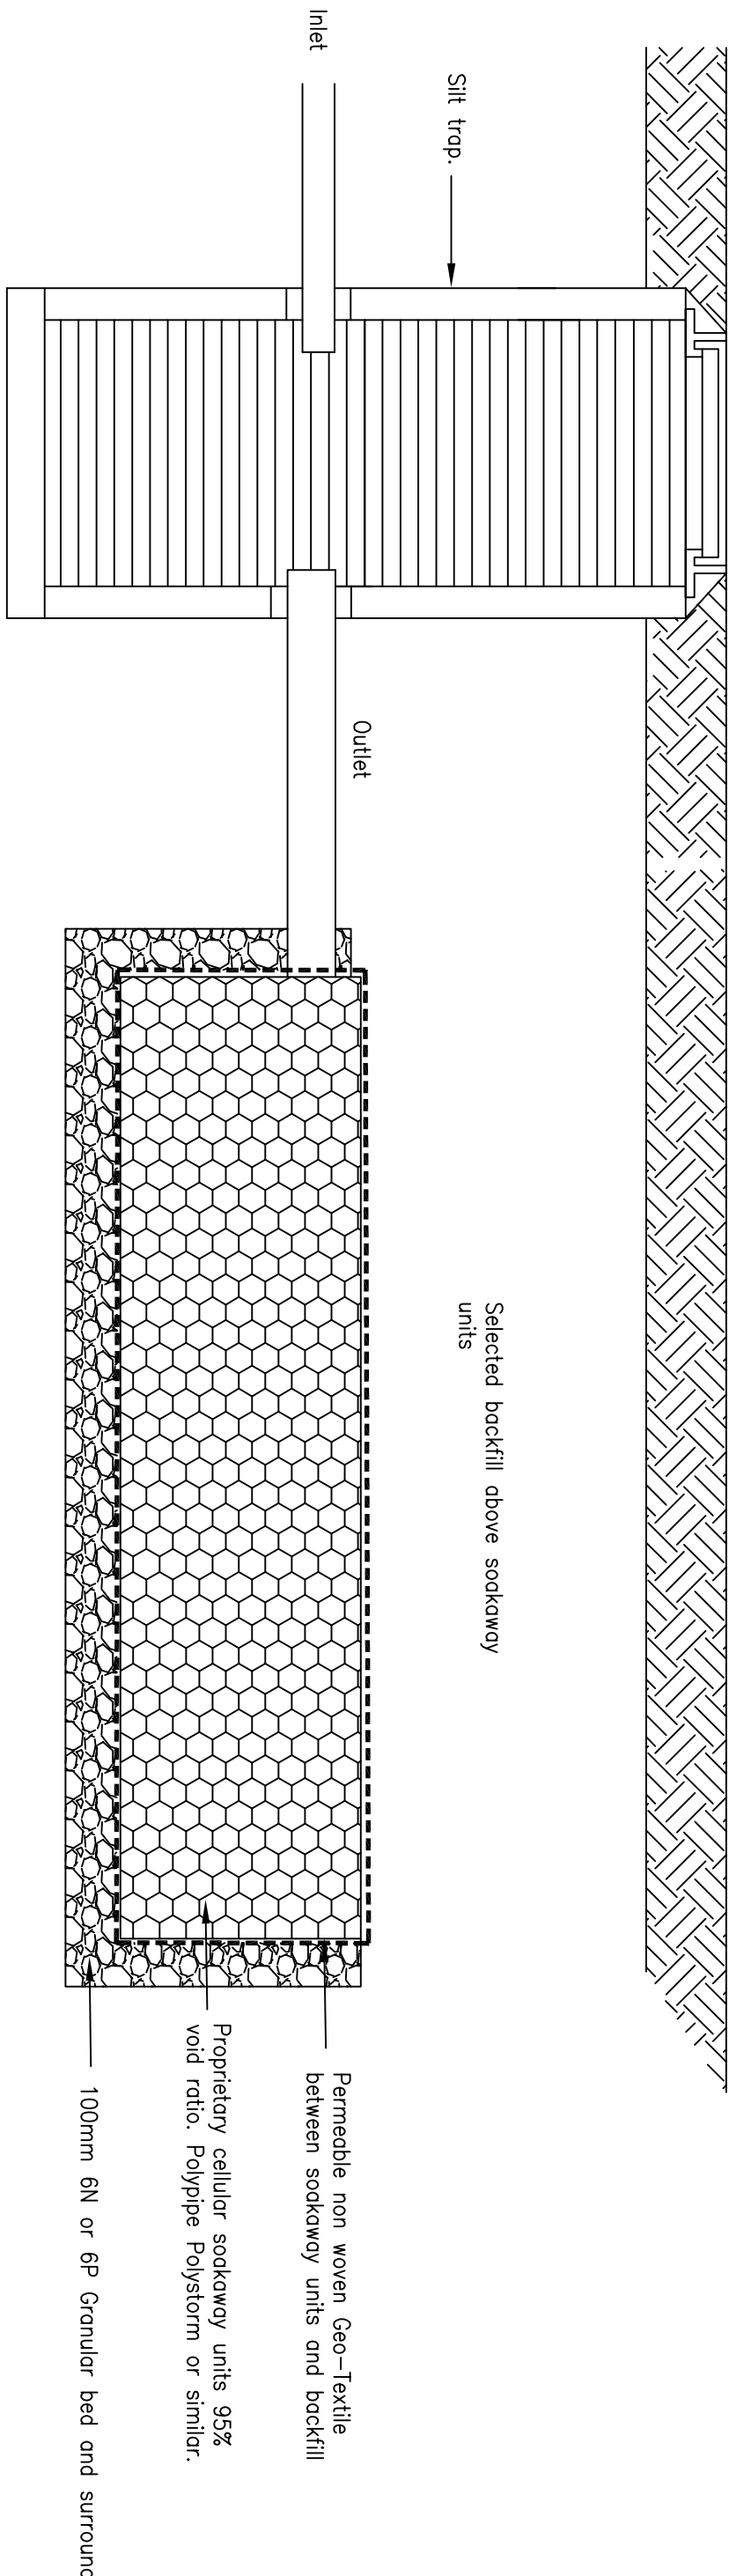


Longitudinal Section

NOTES

Soakway units to be installed in accordance with manufacturers recommendations and guidelines.


Cell unit manufacturer to confirm backfill and cell type based upon geotechnical report and proposed vehicle loadings.

Please refer to Drainage drawing for invert levels and sizes.

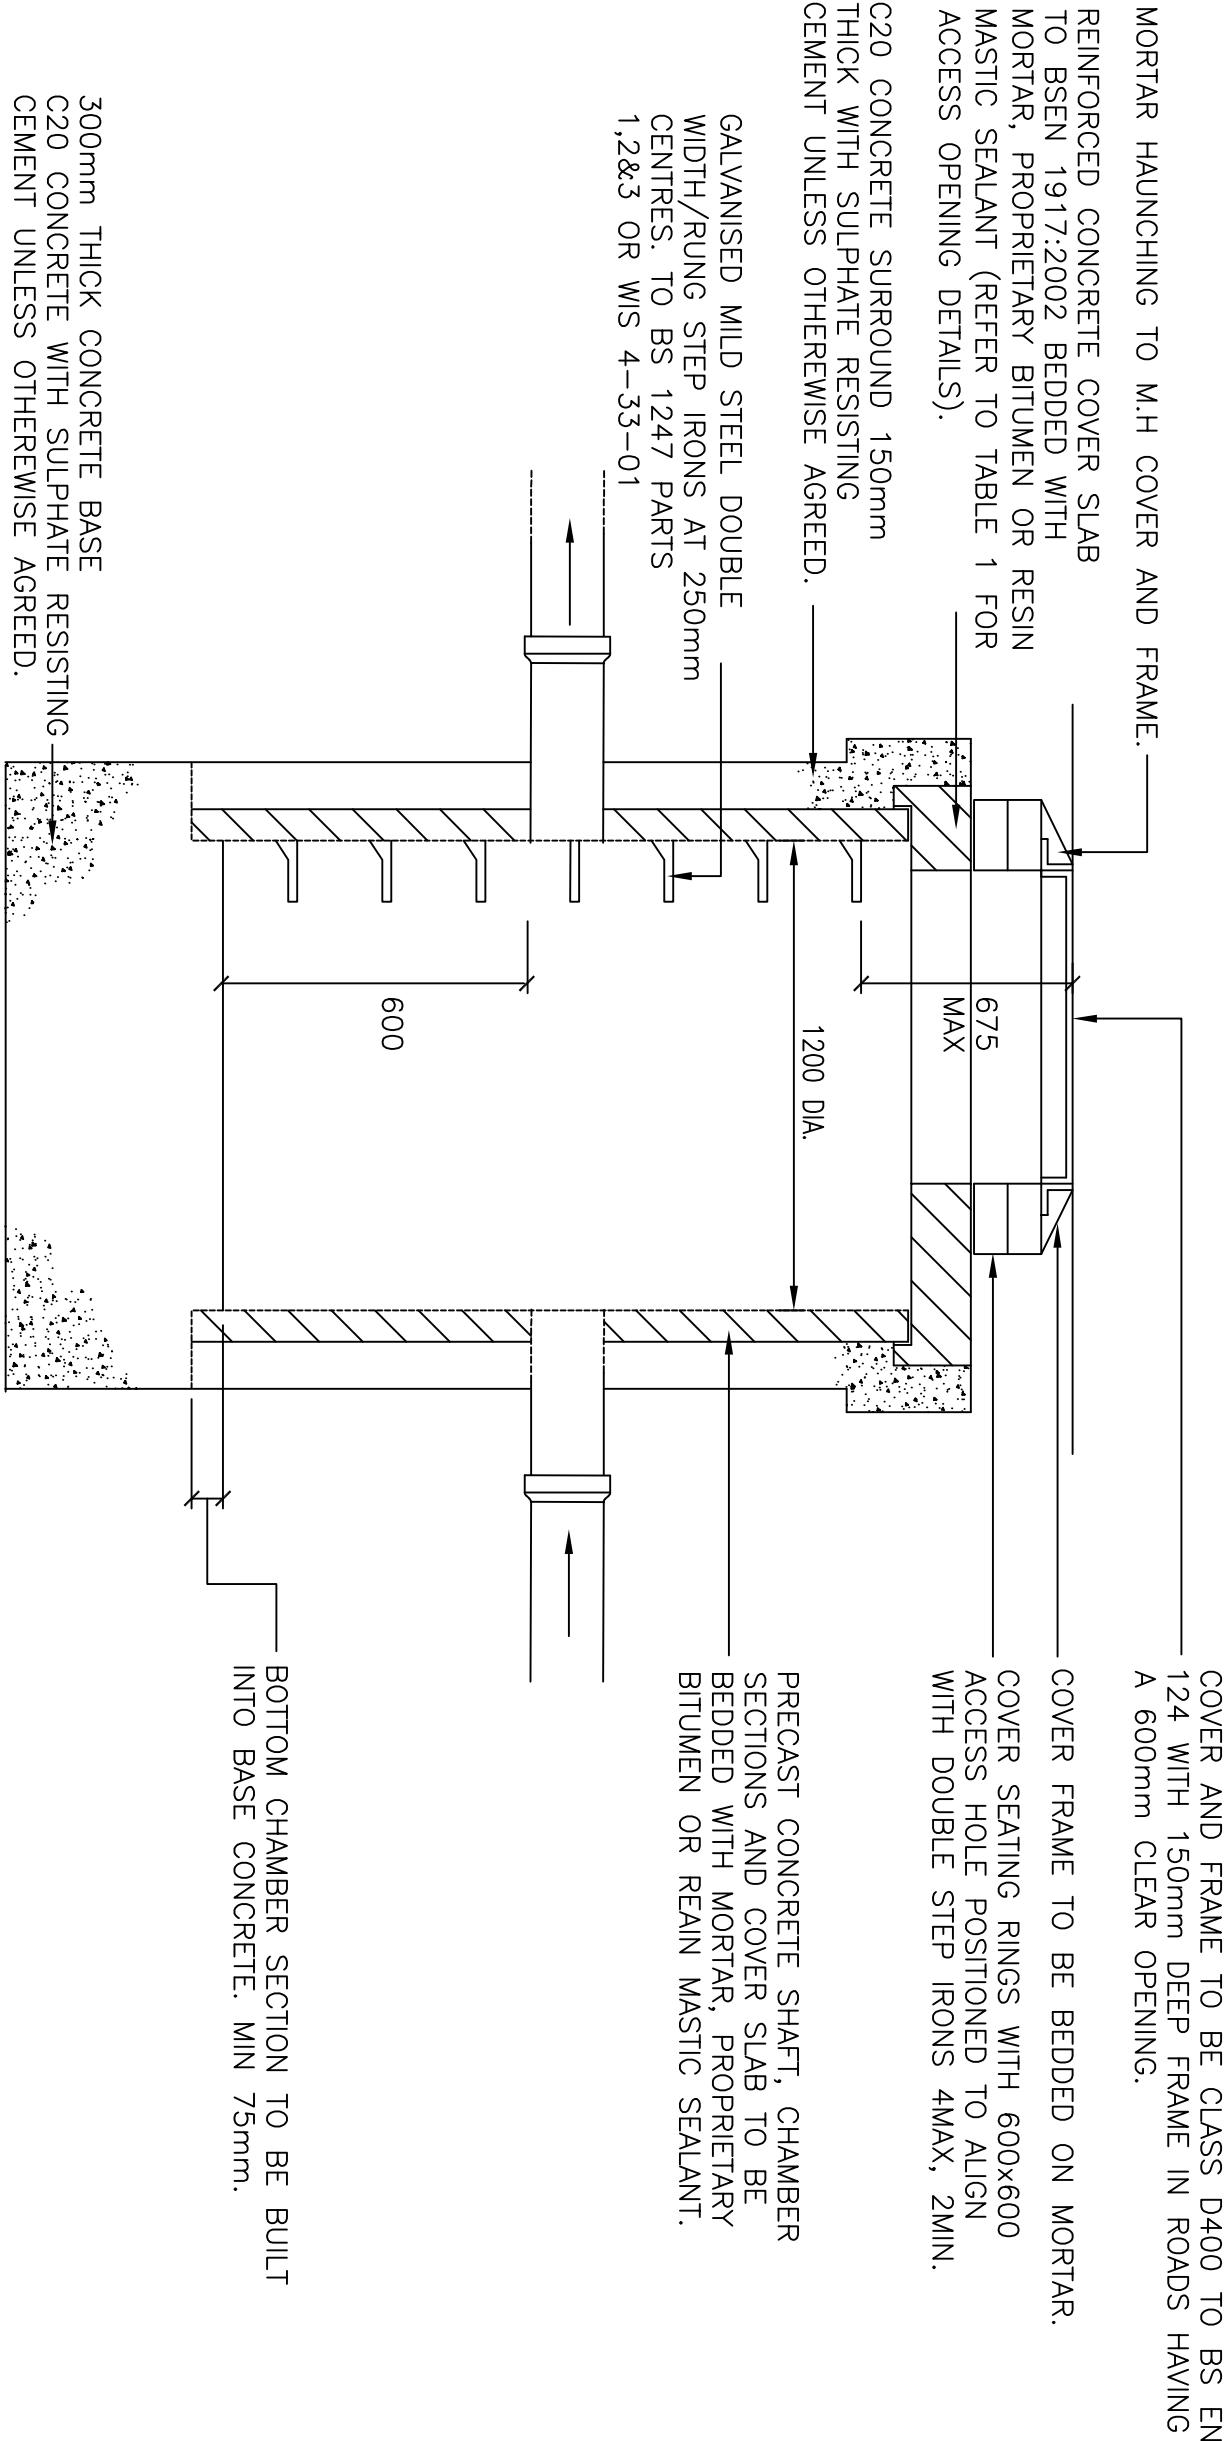

SECTION

PIPE DIA (mm)	ROCKER PIPE LENGTH (m)
150–300	0.6
675–750	1.00
>750	1.25

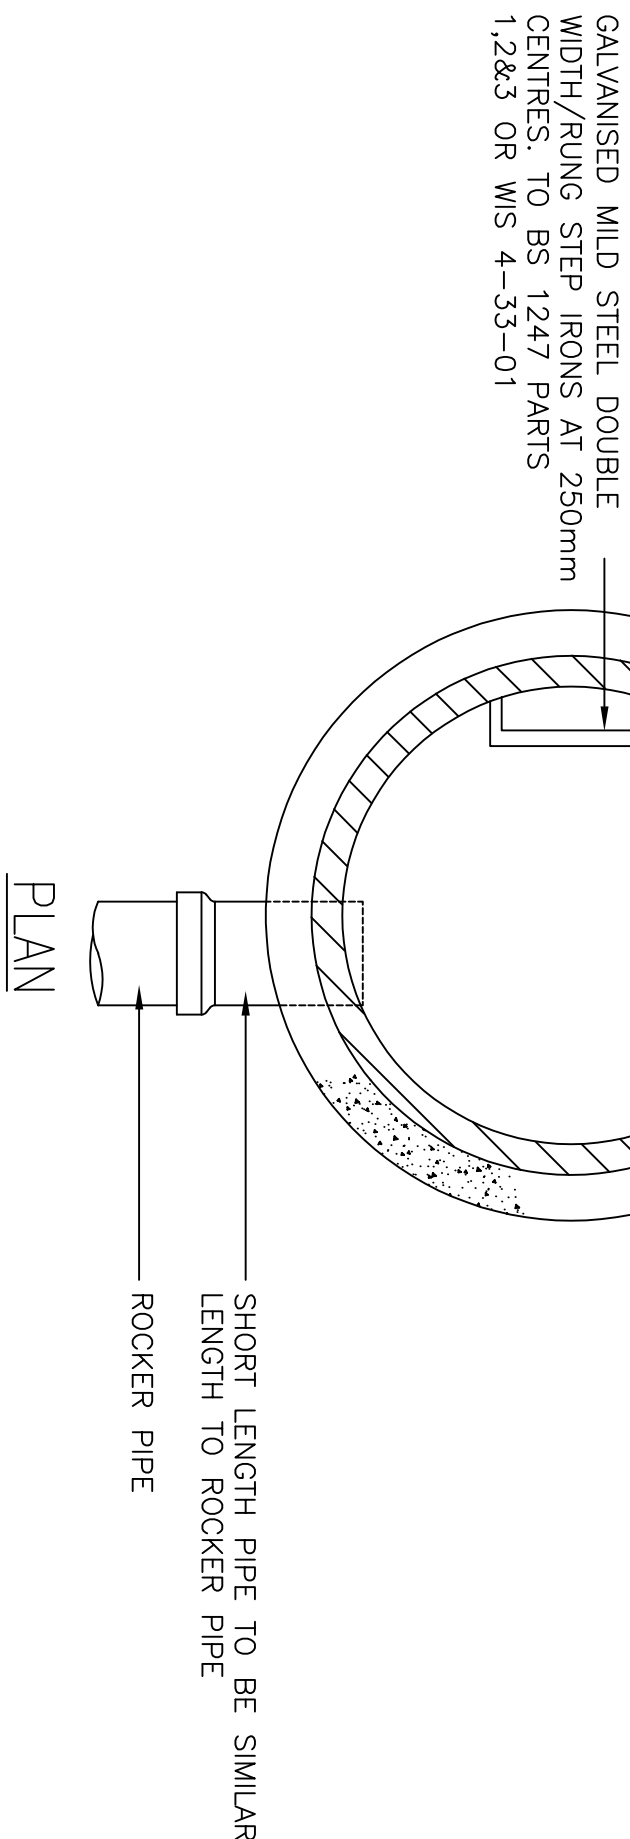

SILT TRAP

Rev	Details	Date	Drawn	CHK
	Ackroyd and Abbott			
	Foulstone School - Commercial			
	Nanny Marr Road, Darfield, Barnsley			
	Soakaway and Silttrap			
	Typical details			

Dwg No. : STE/21/02/03
Date : 12-2-21
Scale : Not to scale
Copyright © Shaun Tonge Engineering