

NOTE !
Clients must ensure that the requirements of the Party Wall Act 1996 are strictly adhered to and all legal requirements of the act discharged, prior to any work commencing adjacent to existing party and boundary walls.


Do Not Scale Drawing
All Dimensions to be Checked on Site Prior to Commencement

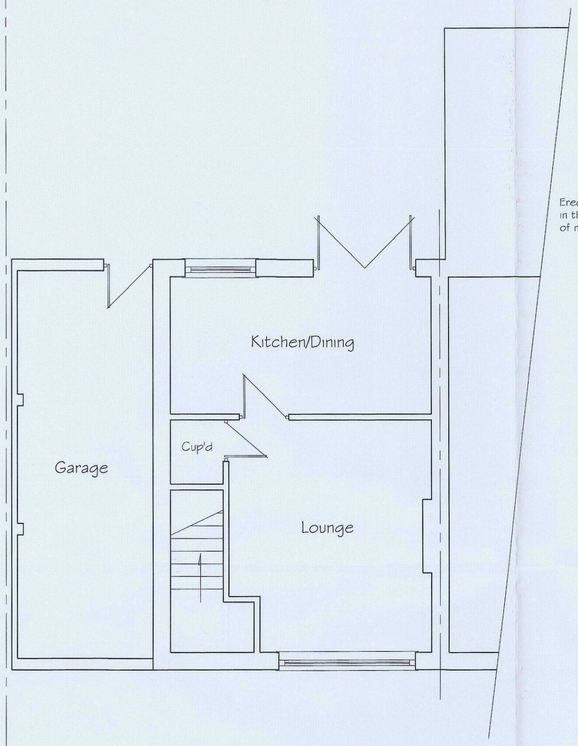


Existing Ground Floor Plan

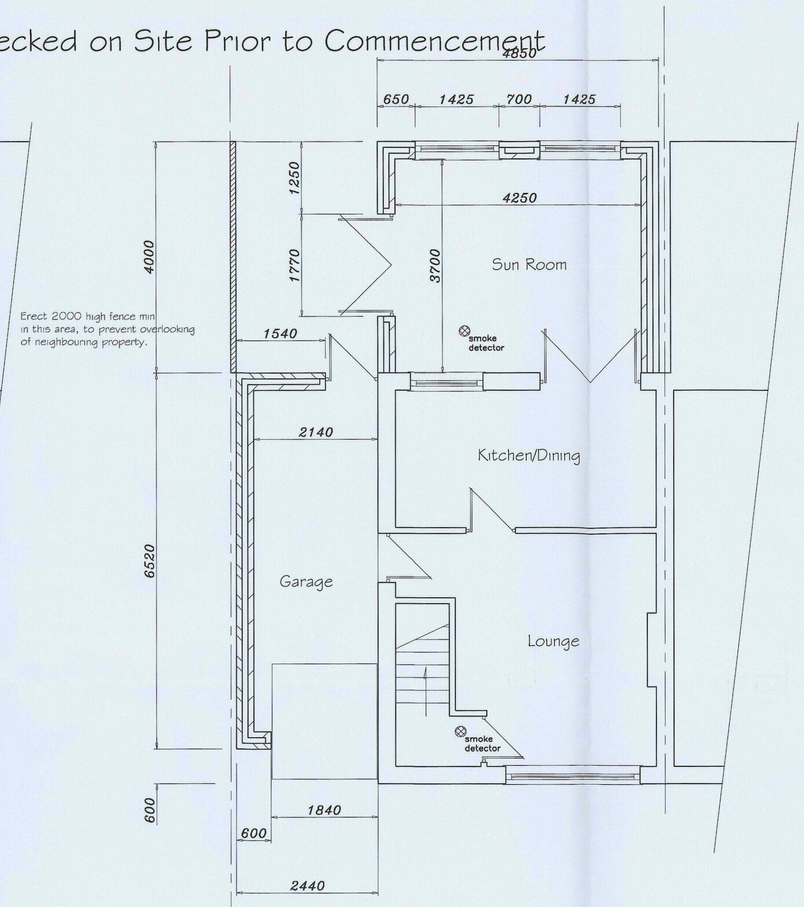


Proposed Ground Floor Plan




Existing Front Elevation



Proposed Front Elevation



Existing Rear Elevation



Proposed Rear Elevation

applicant

Mr J P Grice
38 Silverstone Avenue
Cudworth
Barnsley
S72 8LY

ELECTRICAL: All electrical work is required to meet the requirements of Part P (Electrical Safety) and must be designed, installed and tested by an electrician registered under the 'Competent Persons Scheme'
Prior to completion the Council must be satisfied that Part P has been complied with; and an appropriate BS 7671 Electrical Installation certificate will be issued for the work by a person competent to do so;
Alternatively an application will be made seperately to the Local Authority Building Control in respect of the Approved Documents for the inspection and testing of the electrical installation;
All internal light fittings to accept energy efficient bulbs only; external lighting to have lamps that do not exceed 150W and automatically switch off when there is enough daylight; and when not required at night;

VENTILATION: trickle ventilation to habitable rooms equal to 8000 sq. mm.; mechanical ventilation to kitchen equal to 60 litres per sec or 30 if incorperating a cooker hood; mechanical ventilation to new en suite equal to 15 litres per sec; switch with light and with 15min run over;

HEATING: Central heating by extension of existing system; all new radiators to be fitted with TRV's; temperature control by room stats;

GENERAL NOTES: Samples of all external materals to be used in the construction of the dwelling to be submitted to and approved by the Planning Department prior to commencement;

Amendements, Application No: 2016/0243.
1. Extension set back from front face of existing by 600mm and roof line of extension lowered.
2. 2000mm fence shown on plan to screen patio doors from overlooking neighbouring property.

TWO STOREY SIDE EXTENSION

ROOF: Roof of conc interlocking tiles in style and colour to match existing dwelling; on 38x25 tanalised s.w. battens; on 1 No layer of breathable felt; on trusses designed and manufactured by GETECH Timber Engineering Limted or similar; calculations for trusses to be submitted to and approved by the Local Authority 28 days prior to commencement; trusses set at 600 crs.; 100x25 diagnal wind bracing; web bracing; & ceiling bracing to full length of roof; solid noggings and packings at all anchor points; roof construction to comply with BS 5263 Part 3; 3 No. end trusses to be tied to walls using Catnic straps; screwed to walls and to cover 3 No trusses; 100x75 wallplate anchored by 30x5x450 galv. M.S. straps set at 2000 crs. max. 100x50 binders set at all node points; ceiling of 300 thick Crown loft roll 40 insulation; laid 100 between trusses, 200 over; underdrawn with 12.5 thick plasterboard and skim; 112 half round upvc gutters on 225x25 white upvc facia; upvc soffit fitted with soffit vents, soffit ventilation to be equal to continuous 10mm ventilation strip; and covered by insect proof mesh; 76 dia. upvc fallpipes; 100 dia. underground drainage pipework to existing soakaways, or new soakaways 5000 min from buildings; position of soakaways to be determined on site in conjunction with building inspector; perculation tests to be carried out as necessary;

INTERNAL WALL: New internal wall to be of 75x50 studding; plasterboard and skim both sides; cavity fill with insulation, min density 10kg per metre squared to give sound insulation;

WALLS: Walls of cavity construction; outer leaf of facings to match existing; 100 cavity with 100 thick Crown Dritherm cavity slab 32 insulation; 100 thick low density block inner leaf; concrete commons to both leaves below d.p.c.; and cavity fill with weak mix concrete to ground level; or use Thermalite Foundation Blocks; d.p.c. to be min 150 min above finished G.L.; internal finish of plasterboard on dabs and skim; continuous adhesive to penmeter of dry lining and a foamed polyurathane between the windows/doors and surrounds to reduce air leakage; polyfoam cavity closures to be used at all cills and jambs to eliminate any thermal bridge and to achieve an airtight seal between windows and inner leaf; all joists built into walls to be fully mastic sealed; care to be taken with the extension to ensure minimal air leakage; stainless steel twist wall ties set at 750 crs. horizontal; 450 crs. vertical; 225 crs. around openings and up unbonded reveals; horizontal and vertical d.p.c. to all openings; Catnic lintels over all openings as marked on plan; min end bearing 150; all returns min 665;
brickwork bond 3 in 6; blockwork bond every other course; or use Catnic wall ties;

GROUND FLOOR: Ground Floor of 100 thick concrete; on 100 thick Celotex insulation; on 2000g visqeen dpm; bonded to horizontal dpc's; on 125 thick consolidated hardcore;

FIRST FLOOR: Floor of 22 thick flooring board; on 150x50 flooring joists set at 450crs; insulation to floor to be 170 Crown loft roll laid between joists; ground floor ceiling of 12 thick plasterboard and skim;

FOUNDATIONS: foundations of 610x225 concrete strips at depth to the satisfaction of the LA Building Inspector; but with 760 min dig; 900 if into clay; and lower than any drains;

WINDOWS AND DOORS: All windows to be double glazed with 16 gap and low E coating; and to give 1/20 of internal floor area opening min; frames of white upvc by Yorkshire Windows or similar; all glazing to doors and side panels within 1500 of floor level and to windows within 800 of floor level to be of safety glazing; safety glazing to be permanently marked to BS 6206; new windows to be escape windows; min unobstructed opening 750x450; cill height between 800 and 1100;

BMBC
CORPORATE MAIL ROOM
27 APR 2016
Received by:
ORIGINAL COPY


DRG. No: JP1215/08 Sheet 1 of 2 sheets
Amendment a

PROPOSED SINGLE STOREY REAR EXTENSION and TWO STOREY SIDE EXTENSION at 38 SILVERSTONE AVENUE, CUDWORTH, S72 8LY.


PROPOSED PLANS AND ELEVATIONS
Scale 1:50 & 1:100 - NOVEMBER 2015

NOTE !
Clients must ensure that the requirements of the Party Wall Act 1996 are strictly adhered to and all legal requirements of the act discharged, prior to any work commencing adjacent to existing party and boundary walls.


Do Not Scale Drawing
All Dimensions to be Checked on Site Prior to Commencement

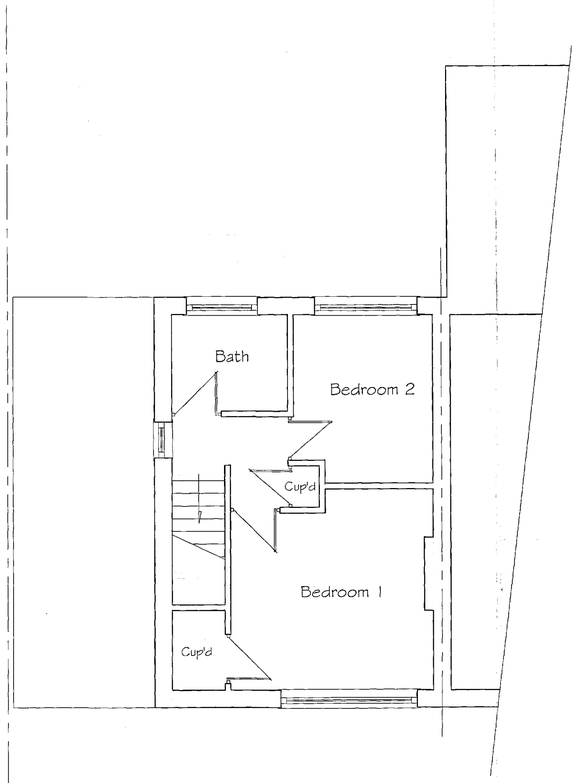


Existing First Floor Plan

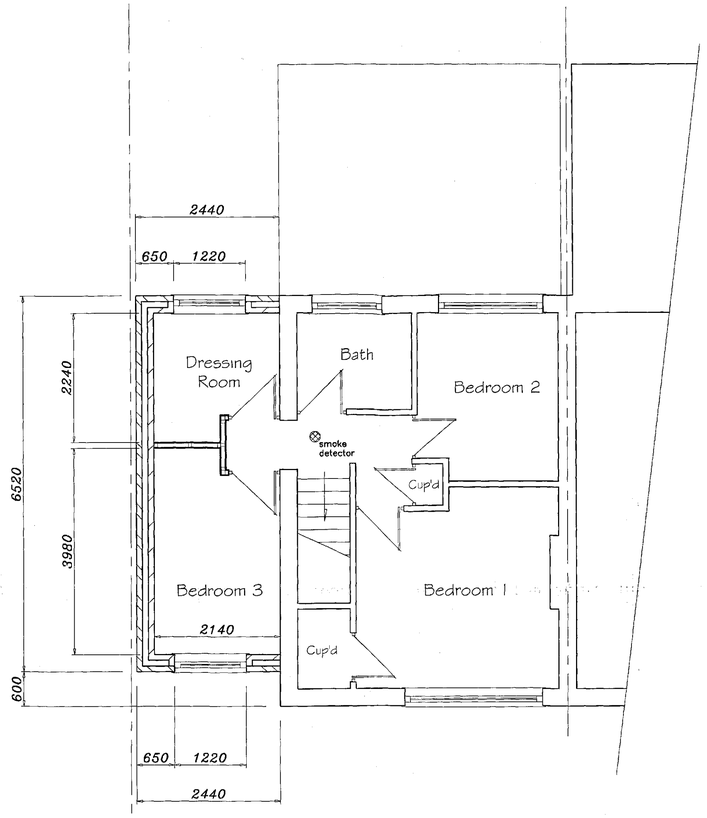


Proposed First Floor Plan

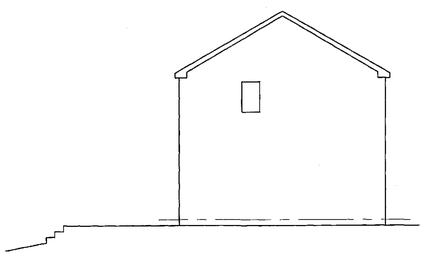


Existing Side Elevation

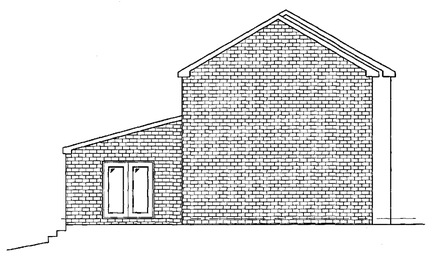

Proposed Side Elevation



Section Thro Sun Room

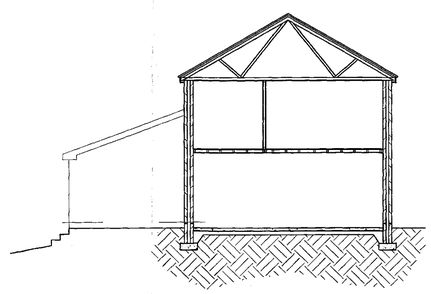

Section Thro Side Elevation

ELECTRICAL: electrical spec as two storey extension

VENTILATION: trickle ventilation to habitable rooms equal to 8000 sq. mm.; under floor ventilation by air bricks set at 900 crs;

HEATING: Central heating by extension of existing system; all new radiators to be fitted with TRV's; temperature control by room stats;

GENERAL NOTES: Samples of all external materials to be used in the construction of the dwelling to be submitted to and approved by the Planning Department prior to commencement;

applicant

Mr J P Grice
38 Silverstone Avenue
Cudworth
Barnsley
S72 8LY

ROOF: Roof of conc interlocking tiles in style and colour to match existing dwelling (tiles to suit low pitch); on 38x25 tanalised s.w. battens; on 1 No layer of breathable felt; on 200x50rafters set at 400crs; solid noggings and packings at all anchor points; roof construction to comply with BS 5263 Part 3, 100x75 wallplate anchored by 30x5x450 galv. M.S. straps set at 2000 crs. max.; support rafters from 100x75 wallplate secured to existing wall using Rawplugs at 2000crs; spike all rafters to wallplates; insulation to roof by 175 thick RoofMax Rafter Slab between rafters, with 25.5 thickPolyfoam Linerboard over rafters, finish with 9.5 thick plasterboard and skim; 112 half round upvc gutters on 225x25 white upvc facia; upvc soffit fitted with soffit vents, soffit ventilation to be equal to continuous 10mm ventilation strip; and covered by insect proof mesh; 76 dia. upvc fallpipes; 100 dia. underground drainage pipework to soakaways 5000 min from buildings; position of soakaways to be determined on site in conjunction with building inspector; percolation tests to be carried out as necessary; Flashing to existing to extend 150 vert min;
Construct lead lined valley's around existing windows; of BML milled lead code 5 or 6;

WALLS: Walls spec as bedroom walls(see sheet 1)

GROUND FLOOR: Ground Floor of 22 thick flooring t&g boarding, on 100x63 floor joists set at 400 crs; honey comb sleeper wall at mid span to give max span of joists 1800; insulation to floor by 100 thick Crown Loft Roll between joists, suspended on polypropylene support netting; min gap from wall to chipboard floor of 10mm; apply self adhesive strip to underside of skirting boards and two beads of sealant to the back; ensure foam strip is compressed before fixing skirting in place;

FOUNDATIONS: foundations as bedroom extension (see sheet 1);

Site of 100 conc on 125 consolidated hardcore;

WINDOWS & DOORS: windows and doors as two storey extension;

BMBC
CORPORATE MAIL ROOM
27 APR 2015
Received by:
ORIGINAL COPY

DRG. No: JP1215/08 sheet 2 of 2 sheets
Amendment a

PROPOSED SINGLE STOREY REAR EXTENSION and TWO STOREY SIDE EXTENSION at 38 SILVERSTONE AVENUE, CUDWORTH, S72 8LY.

PROPOSED PLANS AND ELEVATIONS
Scale 1:50 & 1:100 - NOVEMBER 2015