

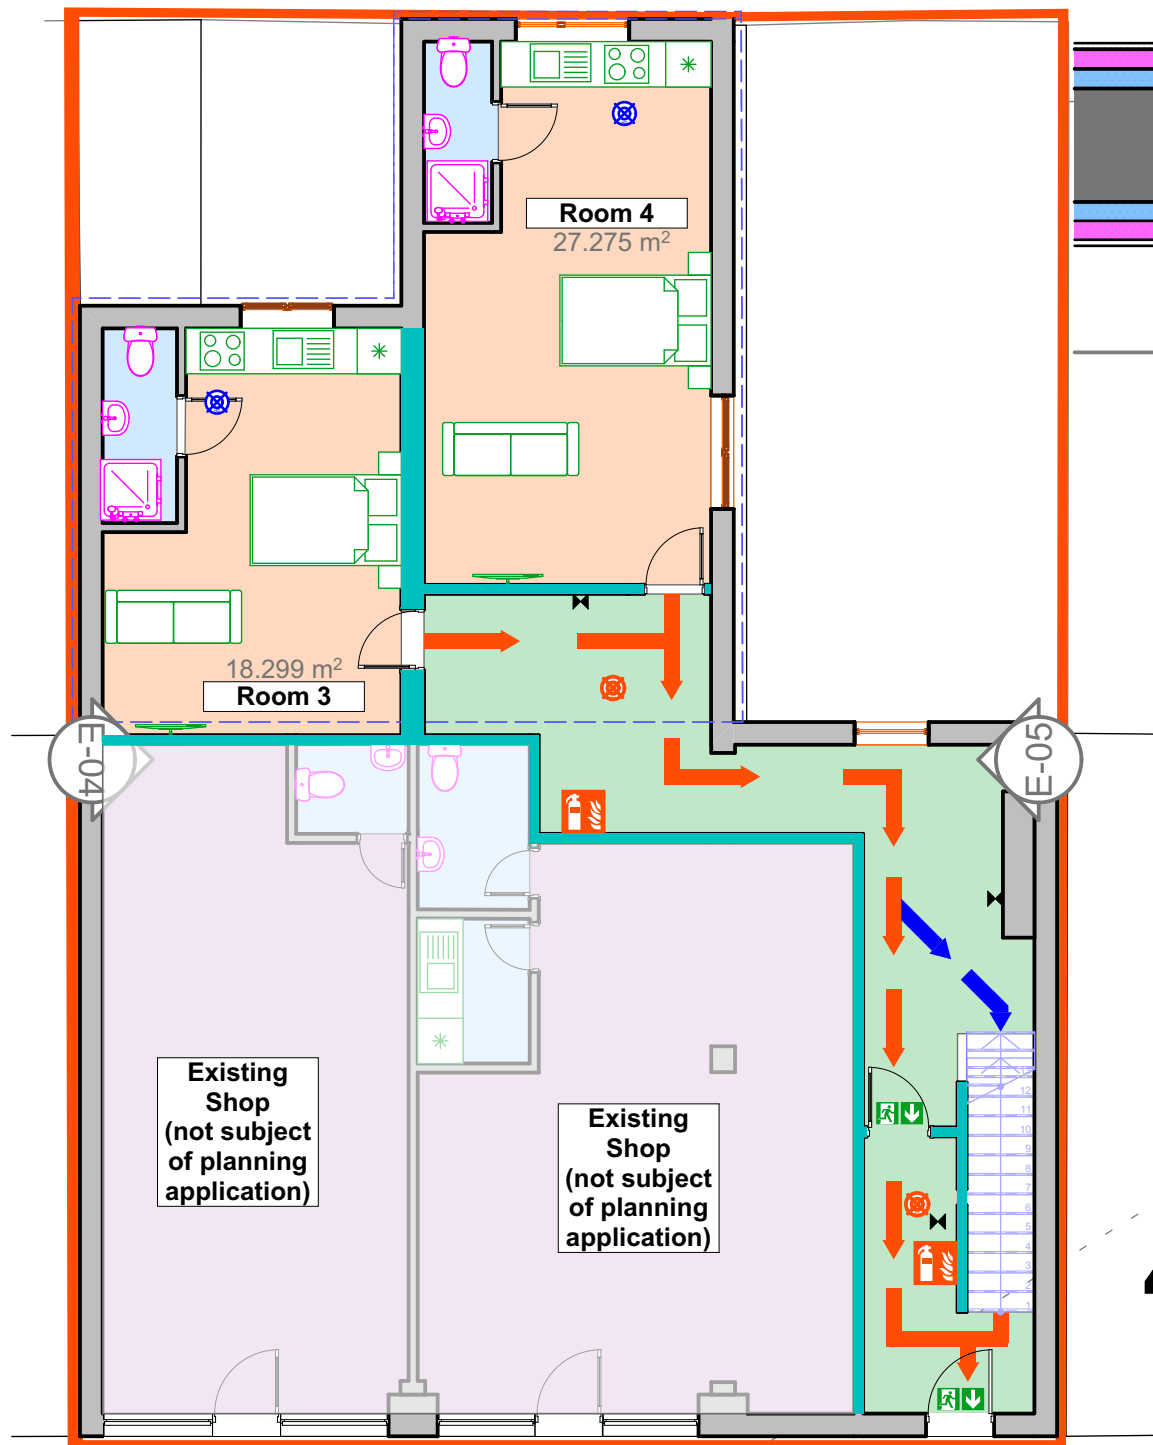


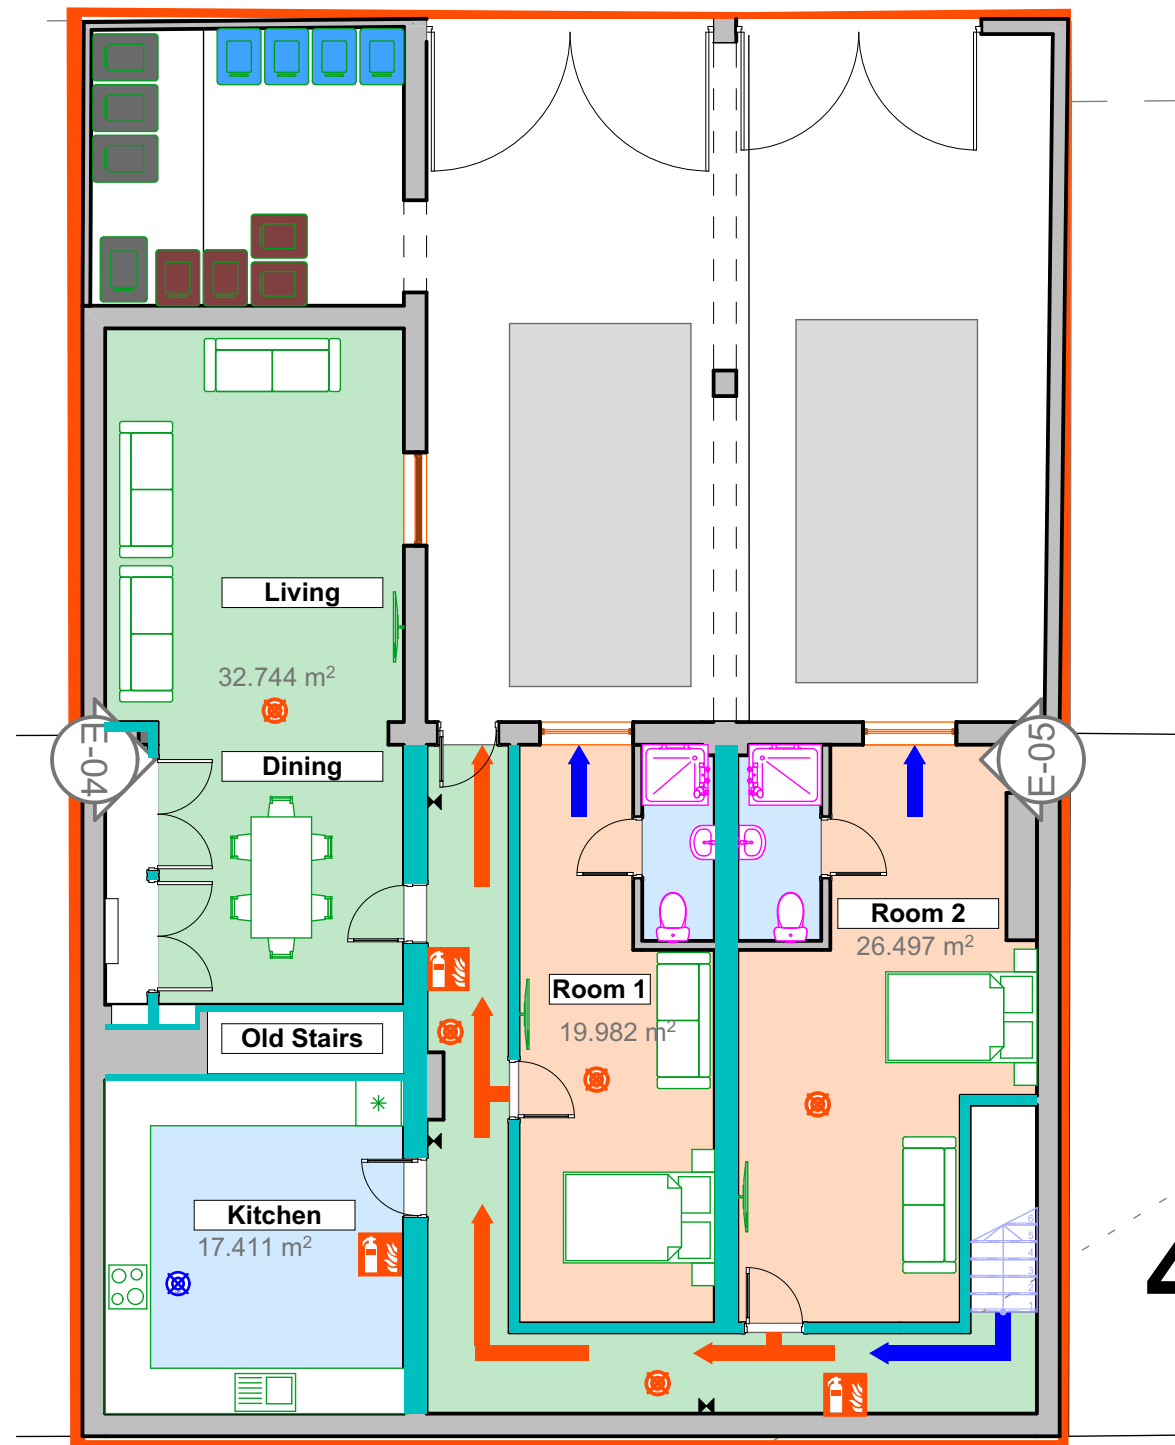

4mm Plaster Skim
12.5mm 1/2 hour Fireboard
12.5mm Sound Board
Existing Wall
12.5mm Sound Board
12.5mm 1/2 hour Fireboard
4mm Plaster Skim

Wall Types 1:5

- Fire Equipment - Kitchens to have Fire Blankets
- Primary Fire Escape Route
- Secondary Fire Escape Route
- Smoke Detector
- Heat Detector
- Fire Exit Sign
- Emergency Lighting

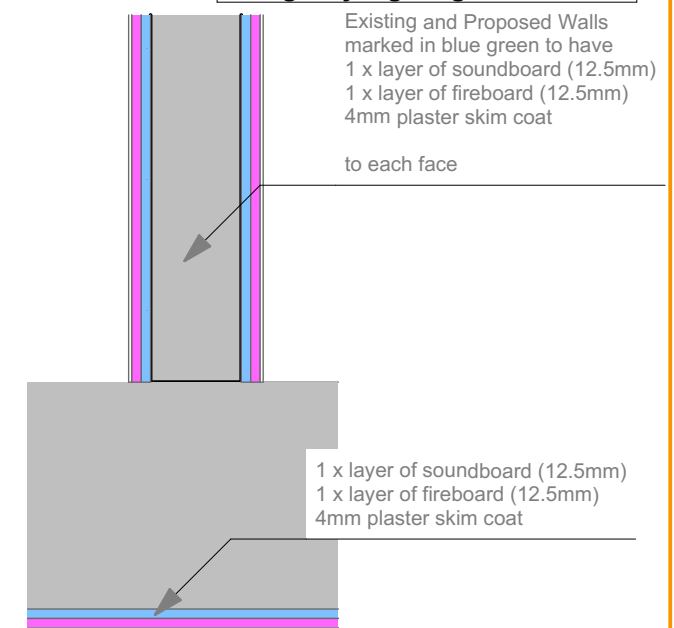


Ceiling Treatment to be used to provide 1 hour fire protection between commercial units and residential units

2 B1-Basement 1:100

1 GF-Ground Floor 1:100

Ceiling Fire Protection 1:10

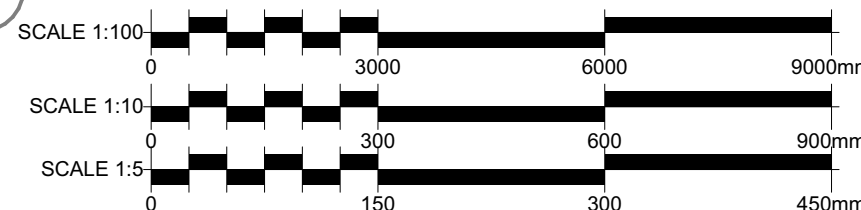

All Dimensions subject to verification on site. Do Not Scale From Paper Drawings. (If in doubt refer to the Architect)

Rev	Change	Date
-	amended to planning comments	02/09/2026

RIBA Chartered Practice

. - 417.01.6 - Fire Plan Basement and Ground Floor Subject to Planning / Building Control Approval

eznat

Eznat - architecture | development
One Business Village, Emily Street, Hull
HU9 1ND

CLIENT CO.	#Client Full Name	DRAWING NO.	417.01.6
CLIENT ADDRESS	<CLIENT_ADDRE	LAYOUT TITLE.	Fire Plan
SS>		REVISION	Basement and
PROJECT NAME.		SCALE.	Ground Floor