

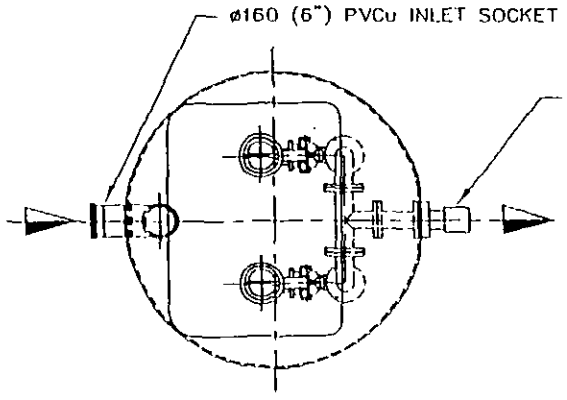


PLAN VIEW

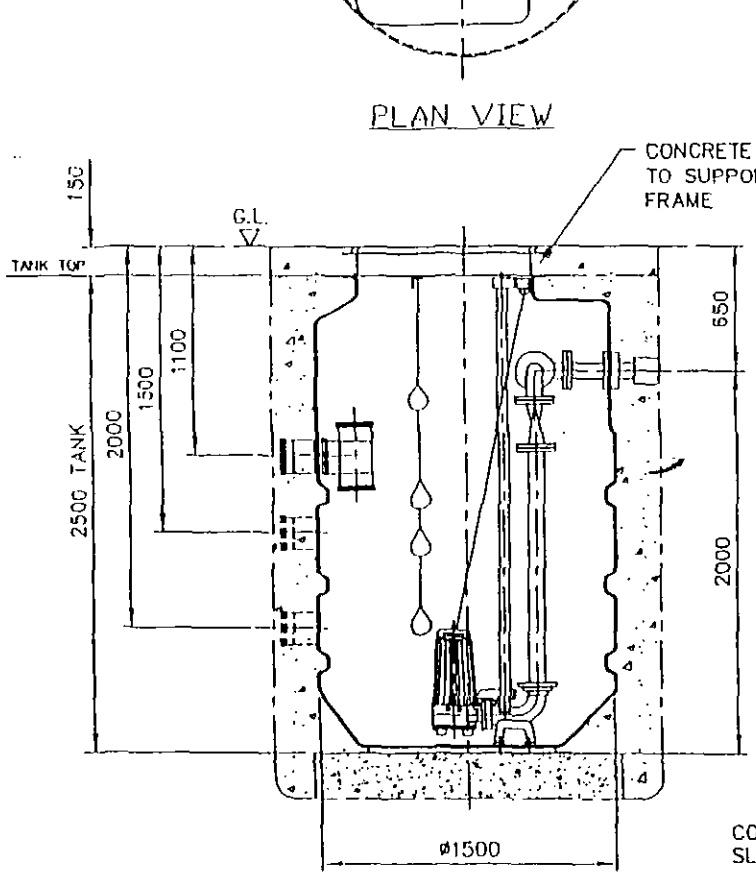

SECTIONAL ELEVATION

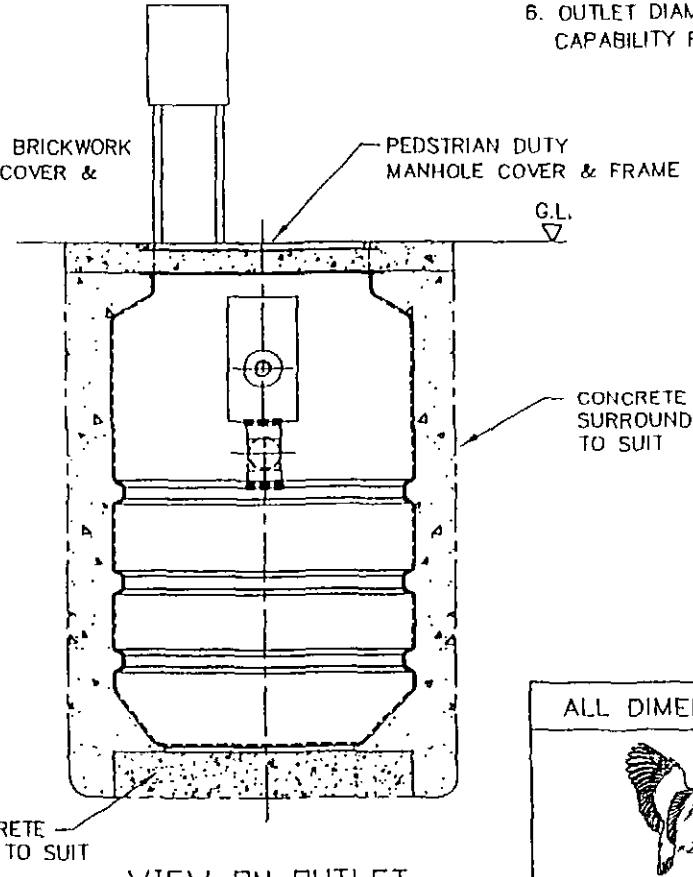

VIEW ON OUTLET

NOTES:-

1. POLYETHYLENE TANK SUPPLIED WITH LOOSE COVER FOR SITE BEDDING INTO CONCRETE SURROUND.
2. ELECTRICAL CONTROL PANEL SUPPLIED ON LEGS OR WITHIN A GRP KIOSK AT ADDITIONAL COST.
3. ALL CIVIL WORKS BY OTHERS.
4. PUMPS AND LEVEL REGULATORS SUPPLIED BOXED FOR FITTING ON SITE.
5. PUMPS SUPPLIED WITH 5M OF CABLE FOR CONTROL PANEL INSTALLATION ADJACENT TO THE WELL. LONGER CABLES CAN BE PROVIDED AT ADDITIONAL COST.
6. OUTLET DIAMETER DETERMINED BY PUMP TYPE AND SOLIDS HANDLING CAPABILITY REFER TO QUOTATION FOR DIAMETER.

ALL DIMENSIONS ARE IN MILLIMETRES – DO NOT SCALE

ISSUE	DATE	DRAWN
2	19.01.07	COBRA
1	05.07.05	COBRA

THIRD ANGLE PROJECTION

KEE PROCESS LIMITED
COLLEGE ROAD, ASTON CLINTON, AYLESBURY
BUCKS. HP22 5EZ Tel: (01296) 634500

TITLE


ø1500 CRUDE SEWAGE PUMP STATION (TWIN PUMPS)

SCALE	1:20	D.O. REF.	A2


DRAWING No. 882305 | ISSUE 2

This drawing is copyright and may not be reproduced or used without the written permission of Kee Process Limited.


KEE PROCESS RESERVE THE RIGHT TO CHANGE SPECIFICATIONS WITHOUT NOTICE

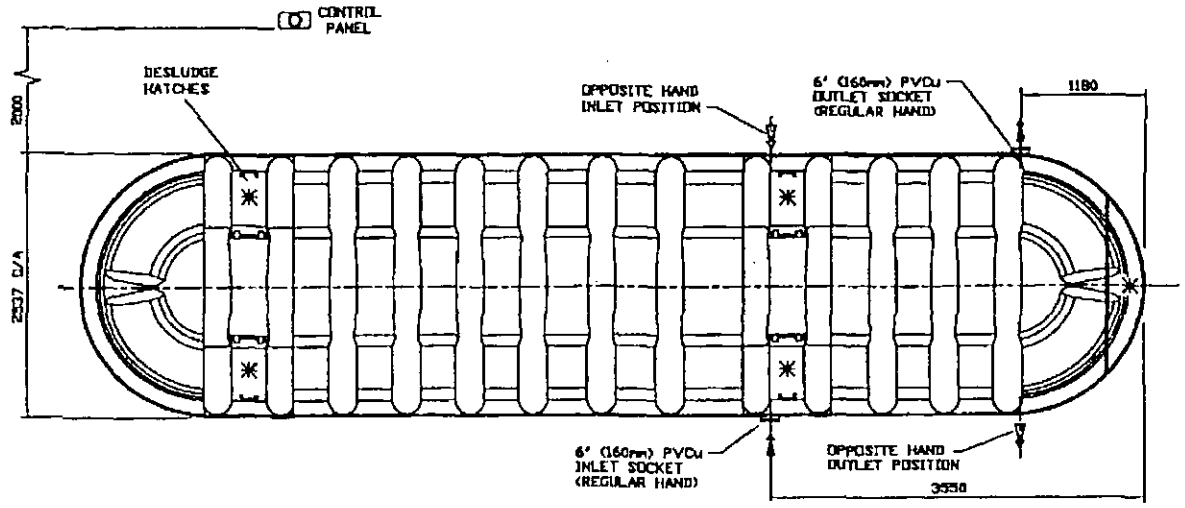

PLAN VIEW

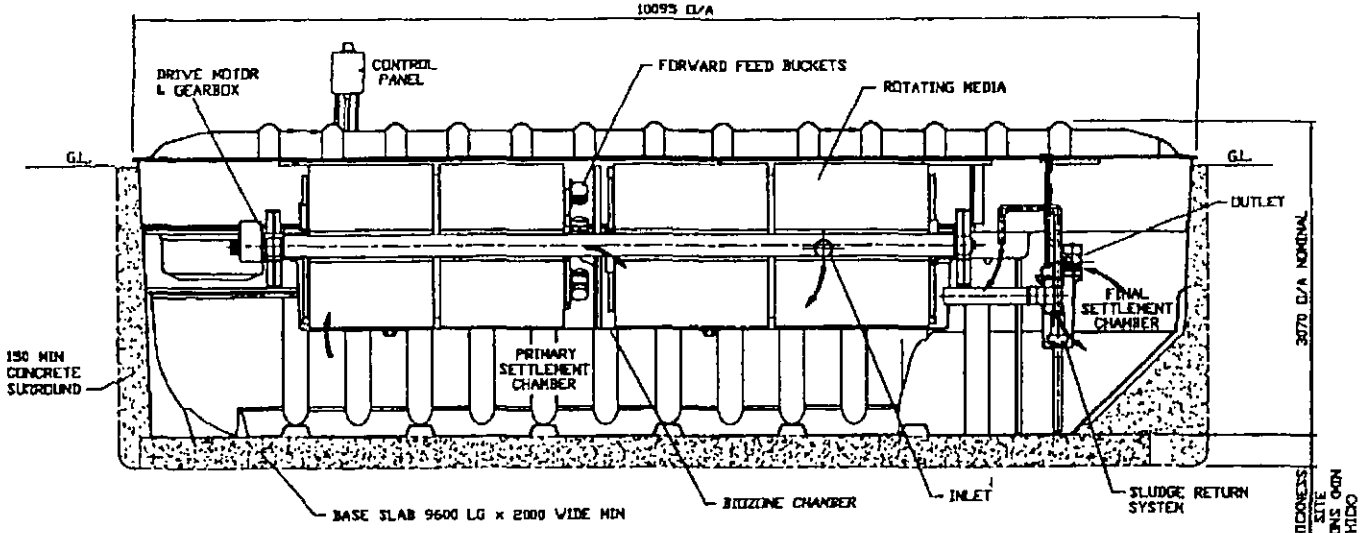

SECTION ON C.L. INCLUDING INLET

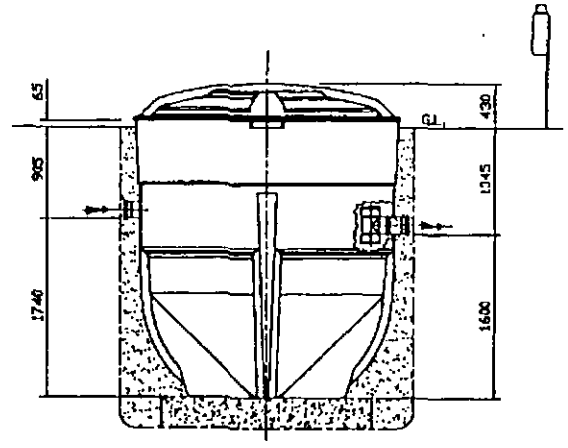

NOTES

1. NuDisc TANK AND COVERS ARE MANUFACTURED IN GLASS REINFORCED PLASTIC (G.R.P.). COVER IS FINISHED IN GREEN TO B.S.4800 TINT 12:B:25
2. THIS DRAWING MUST BE USED FOR DIMENSIONAL INFORMATION ONLY.
3. INSTALLATION GUIDELINES ARE GIVEN SEPERATELY.
4. SLING POSITIONS ARE MARKED ON ACTUAL UNIT.
5. DRY WEIGHT= 4700 Kg

ISSUE	DATE	DRAWN
7	05.12.07	COBRA
6	07.03.06	COBRA
5	14.12.05	COBRA
4	28.05.03	MGB
3	16.01.03	MGB
2	24.07.02	MGB
1	30.04.02	ARC

THIRD ANGLE PROJECTION

ALL DIMENSIONS ARE IN MILLIMETRES – DO NOT SCALE

KEE

KEE PROCESS LIMITED
COLLEDE ROAD, ASTON CLINTON, AYLESBURY
BUCKS HP22 5EX Tel: (01296) 634500

TITLE

KEE 1400 NuDisc RBC PACKAGED TREATMENT SYSTEM.

SCALE	D.A. SIZE
1:25	A1

DRAWING No. 881392

ISSUE 7


This drawing is copyright and may not be reproduced or used without the written permission of the Process Limited. KEE PROCESS RESERVE THE RIGHT TO REVISE SPECIFICATIONS WITHOUT NOTICE

GRP KIOSKS - STANDARD RANGE

IMAGE PLASTICS LIMITED

Model D12

A small double door Kiosk for equipment such as a small control panel or an area board meter. Kiosk can be wall or floor mounted.

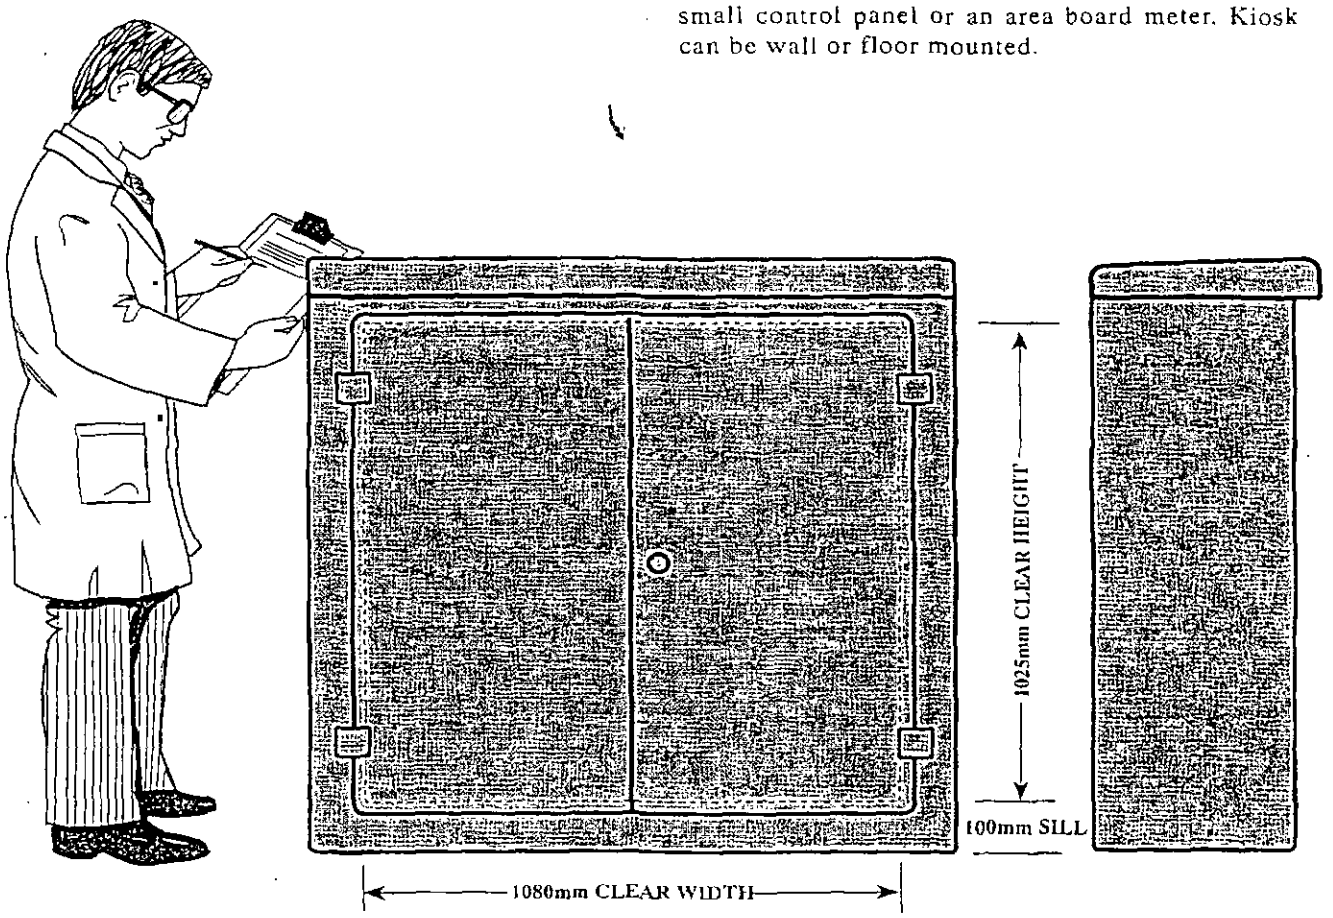

Standard Features

- *GENUINE YALE LOCK*
- *PLYWOOD BACKBOARD*
- *S.S. HINGES*
- *SOLID GRP BASE*
- *NARROW DOOR PILLARS*

D12 - DIMENSIONS

Overall Height.....1250mm
Overall Width.....1250mm
Overall Depth.....400mm
Clear Door Opening:
1025mm high x 1080mm wide
Backboard size:
1000mm high x 1190mm wide

Consent to Discharge Certificate of Holder

Water Resources Act 1991 as amended by the Environment Act 1995 and Water Act 2003

Environment Agency

Consent Number: C4772

This Certificate confirms that the person(s)/company named below is the registered holder of the consent. Keep the certificate with the consent document for future reference.

If you transfer responsibility for the discharge to somebody else you must:

- Tell us as soon as you can before the proposed transfer date – complete the *Consent to discharge – Notice of transfer (Part b)* below and return it to the address given.
- Pass the consent to them

The Consent Holder: Enterprise Inns Plc
3 Monks Path Hall Road
Solihull
West Midlands
B90 4SJ

T

Discharge details:

Type: Sewage Effluent

Location: The Old Post Office, Low Swithen, Haigh, Barnsley,, S75 4DE

Consent to discharge – Notice of transfer (Part b)

Use part b of this form to request a transfer of the consent to another person/company. Once you and that person/company have completed the details below, return Part b of this form to us at the address shown below. Until the consent has been transferred, you may still be liable for prosecution for breach of consent, even though you are no longer on the site. If the proposed transfer does not take place, you must inform us immediately.

Part B Please complete in block capitals or type.

To: Authorisations Team, Phoenix House, Global Avenue, Leeds, LS11 8PG
Consent Number: C4772

The proposed new holder of this consent is:
Name:
Address:

Postcode:

Proposed date of transfer to proposed new holder:

Current holder declaration:

Name:

Address:

Post Code:

Position:

Signed:.....Dated.....

New holder declaration:

Name:

Address:

Post Code:

Position:

Signed:.....Dated.....

COPY

NATIONAL RIVERS AUTHORITY

THE WATER RESOURCES ACT 1991 - SECTION 88 - SCHEDULE 10

REVIEW OF CONSENT TO DISCHARGE

NOTICE IS HEREBY GIVEN to Enterprise Inns Plc , 3 Monks Path Hall Road Solihull West Midlands B90 4SJ , that the conditions of the consent specified below are hereby modified to read as set out below:-

Consent No. C4772
dated 04-09-87

Nature of effluent or other matter to which this consent refers:

Domestic sewage

Place(s) at which discharge may be made:

THE OLD POST OFFICE
PUBLIC HOUSE
Haigh

Parish: --

District: Barnsley

N.G.R.: SE 300 113

Receiving water:

Tributary of River Dearne

CONDITIONS subject to which this consent is given:

1. The effluent shall not be discharged otherwise than at the place stated above.

2. The discharge shall not be other than domestic sewage after treatment in a sewage treatment plant which shall be designed and installed to BS 6297 1983 (or its replacement), and maintained in correct working order at all times.

3. Facilities shall be provided so as to enable samples of the effluent to be safely and conveniently obtained.

4. The NATURE AND COMPOSITION of the effluent shall be such:-

   (a) that the solids in suspension dried at 105 degrees Celsius do not exceed 30 milligrams per litre; and

   (b) that the Biochemical Oxygen Demand (using the allylthiourea modification) in five days at 20 degrees Celsius does not exceed 20 milligrams per litre.

COPY

CONDITIONS subject to which this consent is given (continued)

5. The VOLUME of effluent discharged in any one day shall not exceed 13.5 cubic metres.

Notes

If the discharger feels that the conditions imposed by the review of this consent are unreasonable, he may, within three months of the date given below, appeal to the Secretary of State for the Environment, Room A404, Water Environment A Division, Romney House, 43 Marsham Street, London SW1P 3PY.

No notice will be served by virtue of paragraph 6 (2) or 6 (4) of Schedule 10 to the Water Resources Act 1991 in respect of this consent, during the period of 2 years from the date of this commencement.

Explanatory note:-

i) paragraph 6(2) empowers the Authority to revoke a consent or impose or modify conditions.

ii) Paragraph 6 (4) empowers the Secretary of State to direct the Authority to do so.

(Signed) ..... (Date of commencement) 8.7.93

B D Ogden
Acting Environment Manager

National Rivers Authority
Northumbria and Yorkshire Region
Rivers House
21 Park Square South
Leeds
LS1 2QG

YORKSHIRE WATER AUTHORITY

CONTROL OF POLLUTION ACT 1974 - Section 34

CONSENT TO DISCHARGE

Given to:

Enterprise Inns Plc
3 Monks Path Hall Road
Solihull
West Midlands
B90 4SJ

Consent No. C4772

Nature of effluent to which the consent relates:

Sewage effluent

Place(s) at which discharges may be made:

PROPOSED PUBLIC HOUSE
at the Old Post Office
Haigh

Parish: -
District: Barnsley
N.G.R.: SE 300 113

As indicated on annexed map and site plan

Receiving surface water, specified underground water or land:

Tributary of River Dearne

CONDITIONS subject to which this consent is given:

1. The discharge shall not be made otherwise than at the place stated above.

2. The discharge shall not be other than domestic sewage after treatment in a sewage treatment plant which shall be designed and installed to BS 6297 1983 (or its replacement).

3. Facilities shall be provided so as to enable samples of the effluent to be conveniently obtained.

4. The NATURE AND COMPOSITION of the effluent shall be such:-

   (a) that the solids in suspension dried at 105 degrees Celsius do not exceed 30 milligrams per litre; and
   (b) that the Biochemical Oxygen Demand (using the allylthiourea modification) in five days at 20 degrees Celsius does not exceed 20 milligrams per litre.

5. Under conditions of dry-weather flow the VOLUME of effluent discharged in any one day shall not exceed 13.5 cubic metres.

CONDITIONS subject to which this consent is given (continued):

Notes

If the applicant or discharger considers that the conditions of this consent are unreasonable he may, within three months from the giving of the consent, appeal to the Secretary of State for the Environment, Department of the Environment, Water Quality Division, Romney House, 43 Marsham Street, London SW1P 3PY.

This consent will not, without the written agreement of the discharger, be altered or revoked before the expiration of the period ending with the thirty-first day of October 198 9 unless by virtue of section 38(3) of the Act.

(Signed) ..... (Date) 4 September 1987
Chief Scientific Officer

West Riding House
67 Albion Street
LEEDS LS1 5AA