


Do not scale off this drawing. All dimensions to be reported in Portakabin Limited.

© Portakabin Limited 2007
This drawing is the property of Portakabin Limited. It must not be copied or reproduced or divulged to anyone without written permission.



* NOTE O/A WIDTH FOR CONTINENTAL EUROPEAN BUILDINGS

DOOR & WINDOW POSITIONS MAY BE DIFFERENT TO THOSE SHOWN ON SPECIFIC CONTRACT DRAWINGS

STANDARD COLOURS




External: Wall Cladding, Fascia, Corner & Bottom Wall Trim, Door Edge, Door Leaf

Door Frame, Door Furniture, Windows

Floor

Inner Legs

- Sales & Scottish Divisions: Alpacas nearest BS ref. 18 B 17
- Hire & European Divisions: Greenway Grey nearest BS ref. 10 A 05
- Sales & Scottish Divisions: Britannia Blue nearest BS ref. 18 F 58
- Hire, Mail & Grey nearest BS ref. 18 B 25
- Portakabin & Events: Poppy Red nearest BS ref. 14 E 53
- European Divisions: Greenway Grey nearest BS ref. 10 A 05
- Silver Anodised Aluminium
- Mail & Hire: NCS S 2502 N RAL 05 080 70 05
- Sales & Scottish Divisions: Britannia Blue nearest BS ref. 18 F 58
- Hire: Grey nearest RAL 7042
- Portakabin & Events: Blue Grey nearest BS ref. 18 B 29
- European Divisions: Blue nearest RAL 5011
- White: nearest BS ref. 100 F 55
- Not J-galv galvanised

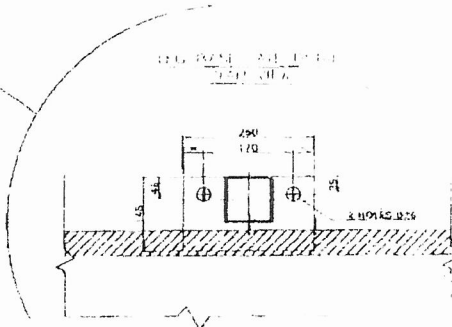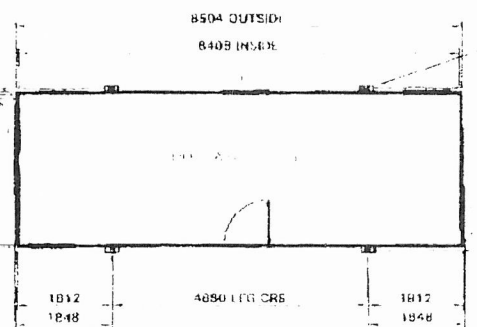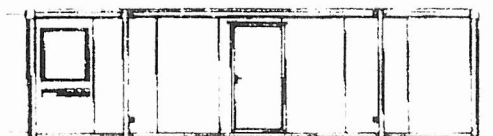

Portakabin

Portakabin Limited, Northampton Road, W03 7 007
Telephone 01904 511445 Fax 01904 613644

PORTAKABIN SOL 15

SPECIFICATION
DRAWING
S1082

LODASTRUT LEG OPTION

1 10.07 R SCHOFIELD
1:5 & 1:50
002894

- KEY
- OPEN WINDOW
 - FIXED WINDOW
 - RWF RAIN WATER PIPE

FOUNDATIONS

Simple foundations of level handstandings are required to be capable of taking the foundation design load at each foot position of 30kN, which includes the dead weight of the building, imposed foot load of 3kN/m², imposed roof load of 0.75kN/m², and a basic wind speed to meet the requirements of BS6399: Part 2. The foundations are to be designed in accordance with BS9004 with level tops of a tolerance of ±3mm. The base of ground under the building plus a surrounding 500mm must be no higher than 50mm below the tops of the building foundations.

All buildings are to be anchored to the foundations via the baseplate using M20 anchor bolts, unless it can be established that no other or other forces are likely to be applied so as to exceed the intrinsic stability of the building in its intended state. All Lodastrut legs should be fully retracted onto the safety stops with the leg pins fitted through the outer legs and secured by the locking collar.

It is recommended that professional advice is obtained for the design of the foundations.