
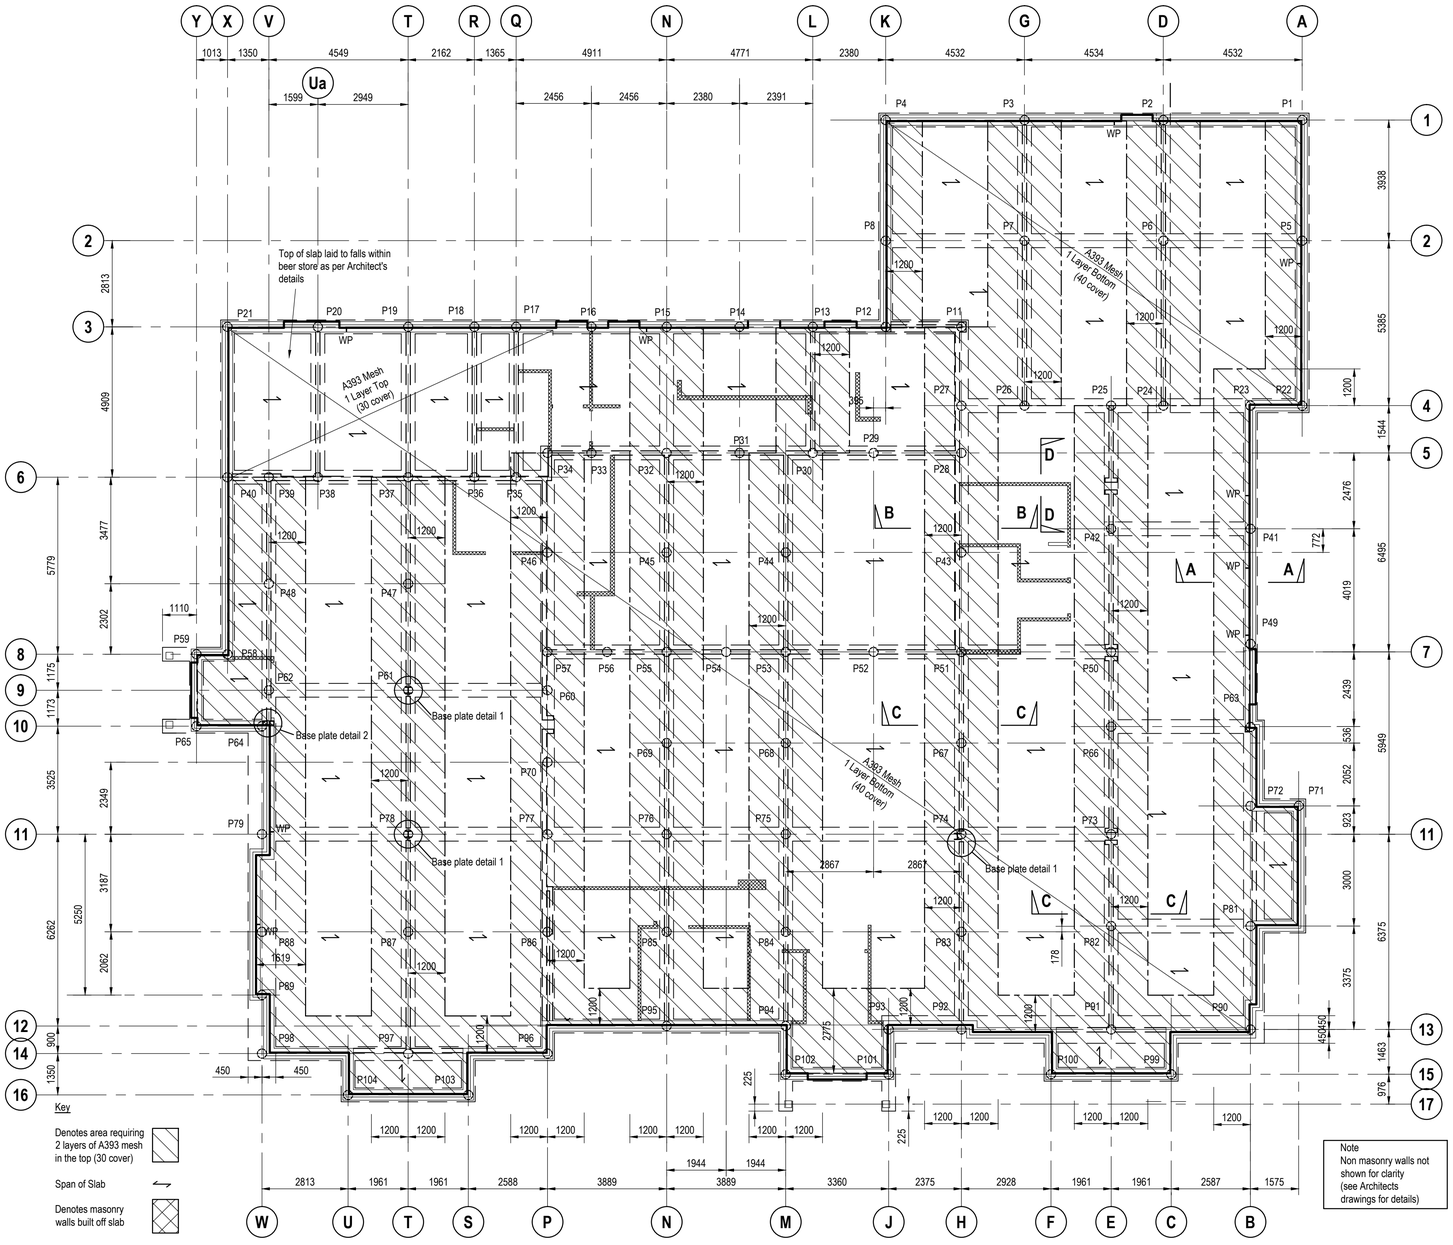



PLAN ON GROUND FLOOR SLAB

Finished floor level = 133.600


All sub-floor ventilation to be in accordance with NHBC guidelines/Building Regulation requirements (latest revision).

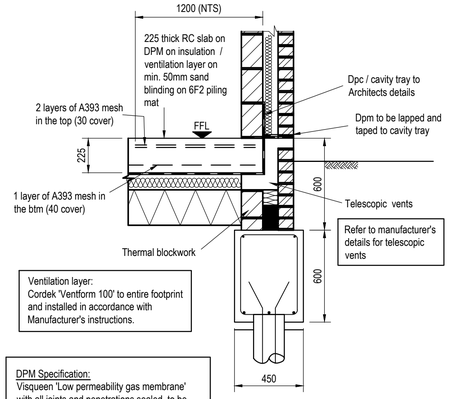


SECTION A - A

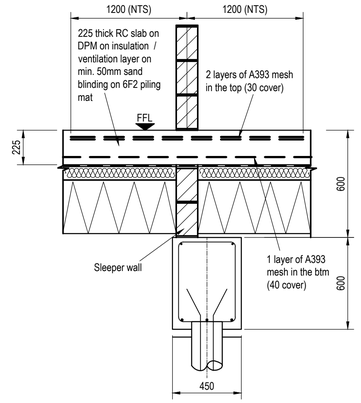


SECTION B-B

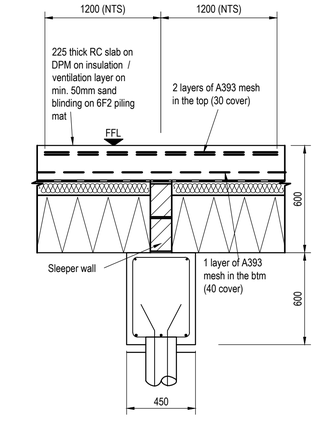


SECTION C-C

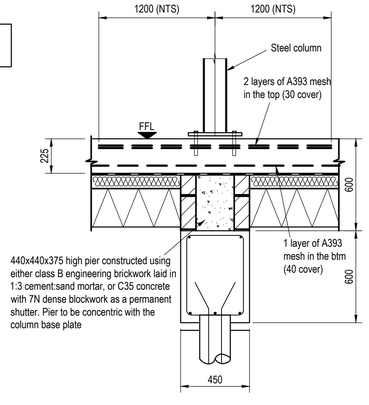

SECTION AT TYPICAL COLUMN BASE

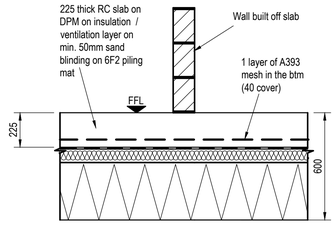


SECTION D-D




ELEVATION ON BASEPLATE

SCALE 1:20

Required for (140SHS columns, Baseplates 2 and 3 only)



TYPICAL PLAN ON SERVICE PENETRATION THROUGH DPM BARRIER

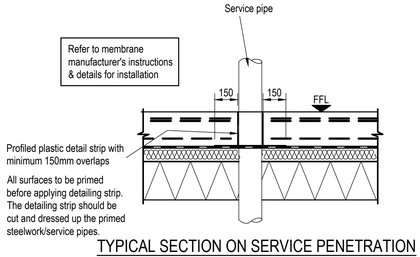

TYPICAL SECTION ON SERVICE PENETRATION THROUGH DPM BARRIER

Notes:-

1. Where this drawing has been issued in electronic .dwg format it has been done so in good faith. jnpgroup do not take any responsibility for any inaccuracies in the electronic data, which should be checked against the paper (or .pdf) drawing issue. Any apparent discrepancies should be immediately reported to jnpgroup. The electronic .dwg file should not be assumed to be to scale and should not be used for 'overlaying', setting out or checking of any third party information. All dimensions should be taken from the paper (or .pdf) version of the drawing. Electronic drawings may contain third party information. jnpgroup take no responsibility for this information, which should be checked against the originators paper drawing(s).
2. All working dimensions to be checked on site.
3. Do not scale.
4. Any discrepancies between drawings of different scales, and between drawings and specification where appropriate to be notified to The Engineer for decision.
5. Copyright reserved. This drawing may only be used for The Client and location specified in the title block. It may not be copied or disclosed to any third party without the prior written consent of jnpgroup.
6. This drawing should only be used for construction if the drawing status is "Construction". jnpgroup take no responsibility for construction works undertaken to drawings which are not marked with this status.

Health and Safety Note:
The details on this drawing have been prepared on the assumption that a competent contractor will be carrying out the works. If the contractor(s) considers that there is insufficient Health and Safety information on this drawing, this should immediately be brought to the attention of the designer.

HAZARD IDENTIFICATION BOX		
This table is provided to assist the Principal Contractor to fulfil their obligations under the CDM Regulations 2007		
Construction Hazard	Maintenance / Cleaning Hazard	Demolition / Adaption Hazard

Insitu Ground Slab Notes

1. The concrete used will be RC28/35 designated mix to BS8500 -1:2006. The maximum aggregate size is to be 20mm, slump to be 75mm.
2. The concrete shall be well compacted using a vibrating poker.
3. The mesh reinforcement shall be in accordance with BS4483.

   minimum lap lengths shall be:
   A252 mesh - 400mm

   Cover to mesh to be:

   30mm top
   50mm btm and sides

   Proprietary chairs are to be used to support the mesh.
4. Reinforcing bars to be high yield steel to BS4449.
5. H10 barx x 1000 long to be placed across corners in all openings of floor slab.
6. Floor slab to have a power float finish.

Rev.	Date	Amendment	By	Chk.
A	14.10.15	Floor layout updated to Architect's latest layout rec'd 13.10.15	RAC	JT

Status: Tender

john newton & partners
jnpgroup
Consulting Engineers
www.jnpgroup.co.uk
Chesham • Brighouse • Leamington Spa • **Sheffield** • Teesside
Tel: 01142 443500 E-mail: sheffield@jnpgroup.co.uk

Client	GREENE KING DEVELOPMENTS
Job	PROPOSED AMENITY RESTAURANT DEARNE VALLEY BARNSLEY
Title	GROUND FLOOR SLAB LAYOUT
Scale	1:100 & 1:20 @ A1
Date	03.09.15
Drawn By	HA
Eng. Check	JT
Tech. Check	

Accredited Contractor Reg: 66479 Supplier No. 000026

Drawing No. S10019-02 Rev. A

QA Ref: QD019 Rev B