

DPC's
To be provided to External walls 150 mm above gfl. All door and window jamb / heads Under lintels Above all air bricks

Water supply
Hot water taps to be installed on the left. A notice confirming that the hot water system has been properly commissioned, and issued by a person competent to do so, is to be provided on completion

Electrical Installations.
All installations to be subject to certification under the "competent persons scheme" Qualified to a min of Part P A certificate shall be supplied on completion of all electrical works
Lighting - 75% to be low energy.
Light switches to be fixed 1200 above mfl. Power sockets to be fixed at 450mm above mfl.

Means of escape.
1 No self contained operated smoke alarm to BS 5446 Part 1 to be installed on each storey smoke detectors interlinked and located at top and bottom of stairs.
All detectors to be a min of 300 mm from any wall.
Interconnected & wired to a separated fused circuit. Battery back up required.

General
Re site any utility services where applicable around the extension. Re site any meter boxes outside line of walls.

Construction (Design and Management) Regulations 1994
Applicable to all projects except work to a persons own house other than that carried out by the developer.
The client shall be advised that all projects lasting for more than 30 days or include more than 4 people engaged on the construction on site at any one time shall be subject to the above regulation.
The client shall take all reasonable steps to ensure that the appointed contractors have the competence and adequate resources sufficient to manage the construction work and comply with the above regulations.
If the project is subject to the above regulation the client shall appoint a planning supervisor and ensure that notice is served on the health and safety executive at tender acceptance stage using form 10.

Roof design (Trusses.)
The roof shall be of timber construction all as per supplier's calculations. Calculations to be supplied to building control for approval a min of 28 days prior to commencement on site. Trusses to be at 600 mm c/c
Fixing of roof timbers to vertical walls to 6 x 2 timber wall plate fixed to wall by m12 at 600 c/c or to horizontal wall plate
Valleys or connection of roof to walls to have 5 lb lead flashing.
Artificial stone tiles, appearance to match adjacent properties, on timber tile battens of 40 mm x 19 mm c/c to suit tile type on sarkin felt. Roof shall ensure a continued air flow. Soffits shall be fitted with vents or a 25 mm gap with bird mesh.
Ridge vents shall be fitted where necessary and as directed by the Building Inspector.
Roof to be suitably wind braced to appendix A of BS 5268 PT 3.
100 x 65 sw wall plates secured to brickwork with galv steel straps @ 1800 c/c

Garage Lateral Restraint to floors / gable roof
Galvanised mild steel strap 38 x 5 @ 2m c/c to joists and rafters spanning 3 joists with solid noggins at 450 c/c down cavity.


Garage Roof Ventilation.
Ridge ventilation to be equivalent to a continuous gap strip of 5 mm.
Eaves to be equivalent to a continuous gap strip of 25mm.

General Plumbing and Drainage.
Hepworth or similar 112mm UPVC gutters, brackets and fittings down pipe to be 75 mm dia.
Surface / Foul water drainage
All external drains to be 100mm Osm plastic pipe bed and surround in gravel to falls
Foul - 1:80
Surface water - 1:100
All new surface water to be taken to a soakaway a min of 5m from any building
All drainage and protection details to existing shall be agreed with the Building Inspector.
All internal drainage to connect into new s & v pipe
Pipe sizes - Basin 32mm up to 1.7m run. Sink / shower 40mm up to 3m run 50mm up to 4m run WC - 100 mm. Separate connections and 75 mm deep seal traps to 100 s & v terminating internally with non return valve.
Head of foul drain runs to be vented naturally to external air.
External stacks vented traditionally terminating 900 mm above any open light within 3 m with suitable cage. Shower trays to have access panel to trap. All joints push fitted & access panels provided at all changes in direction.
All internal s&v to be insulated with min 50mm rockwool.


Doors / windows.
All to be UPVC double glazed (min 16 mm gap between panes) glazed with Pilkington K glass with soft low "E" coating.
Style and colour of all to match existing.
All windows to have 1/20 th floor area as open light.
Safety glass (stamped accordingly) to be provided to all critical areas. - Door and panels 1.5 m from mfl. Or windows within 800 mm from mfl.
Obscure glass to be fitted to wc windows.
Trickle vents to be provided to all new windows 8000 mm2 min equivalent area

Internal walls
Non load bearing walls
Walls to be from timber studing 75 mm x 50 mm with 12 mm plaster board and skim. Studs @ 450 c/c horiz and noggins at 900 vert c/c
A minimum of 50 mm insulation to be provided to we walls, with double skin of plasterboard to inside face.
Ceilings to be finished with 12 mm plasterboard / skim
WC wall to have a min of 10 kg / m2 density mineral felt insulation.


Facia / soffit boards
From 25 mm x 250 mm or similar
In timber or pvc. provide air vents as described.

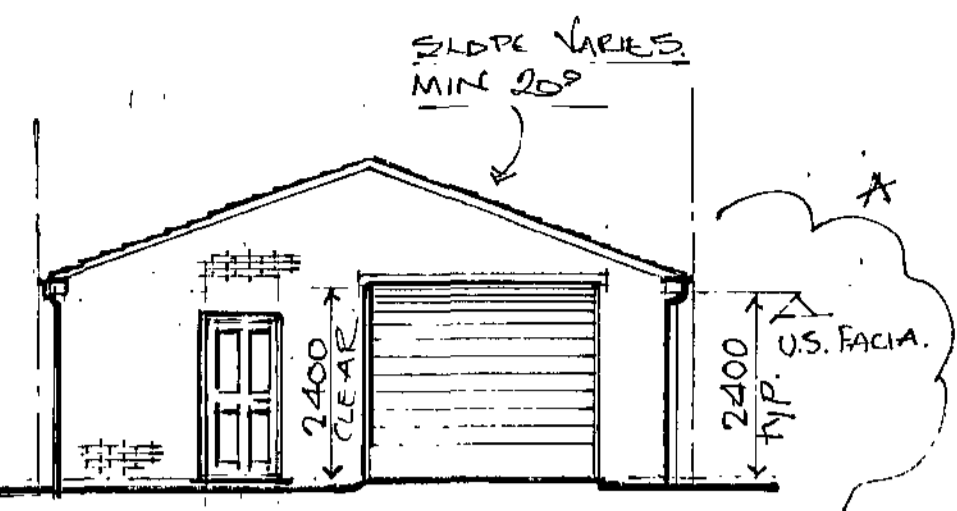

Proposed Elevation On 6

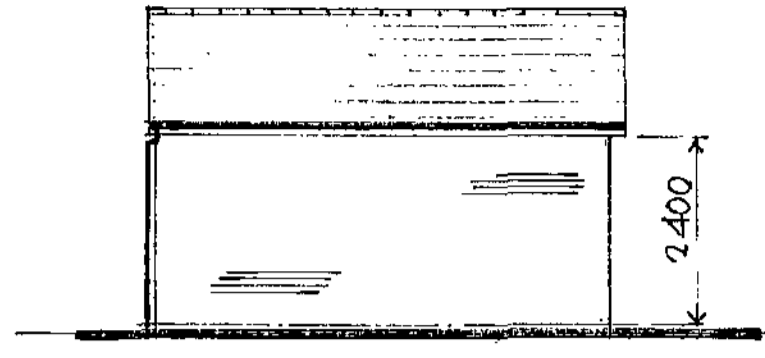

Proposed Elevation On 5
(Elev on 5A HANDLED.)

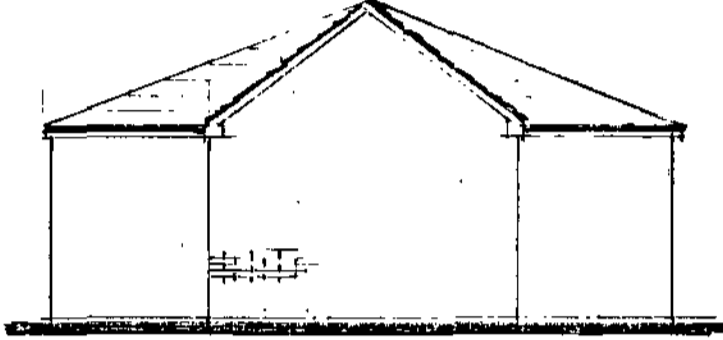

Proposed Elevation On 4

Walls
Internal skin
100 mm Thermolite shield or similar blockwork
Cavity
For 100 mm air gap filled with 50 gap + 50 Kingspan X8 (UNINSULATED TO GARAGE.)
Cavity fill of weak mix concrete to be no higher than 225 mm below highest dpe
All cavity wall returns to be 655 mm minimum.
Insulated cavity closers to be provided to all reveals.

External skin
Stainless vertical twist wall ties to be provided at 750 horiz c/c and 450 mm vert c/c, every block depth to reveals.
Weep holes to be provided where applicable.


Lintols
"Carnic". Size and type as agreed with the Building Inspector.
End bearing for all lintols to be 150 mm.

Conservatory
Wall / roof design to be as per manufacturers specifications
All design details to be submitted to the L.A a min of 28 days prior to commencement.
Valley gutter to be the responsibility of the conservatory supplier.


Mechanical air extraction.
Bathrooms to be 15 l / sec min. wired to light pull cord with min 15 minute over run.
Kitchens to have 3 air changes / hr and 60 L / sec min.
All mechanical ventilators to be ducted to outside air.




Proposed Elevation On 3

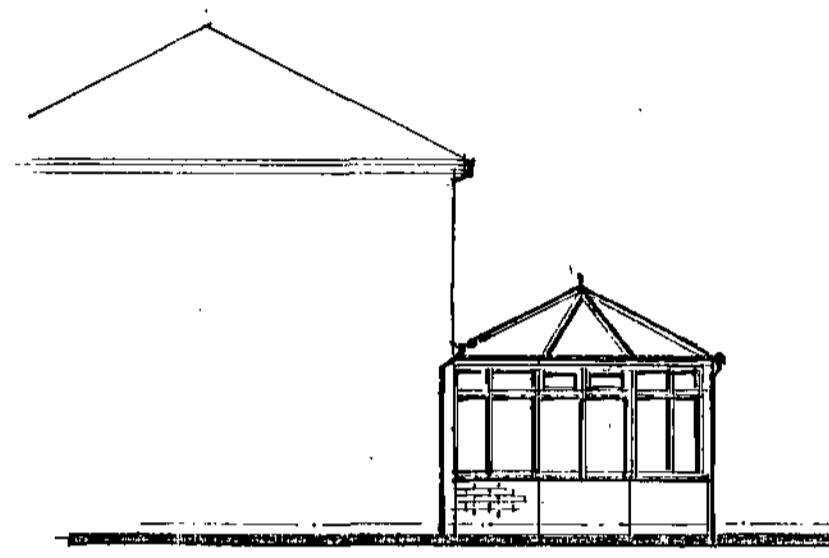

Proposed Elevation On 2

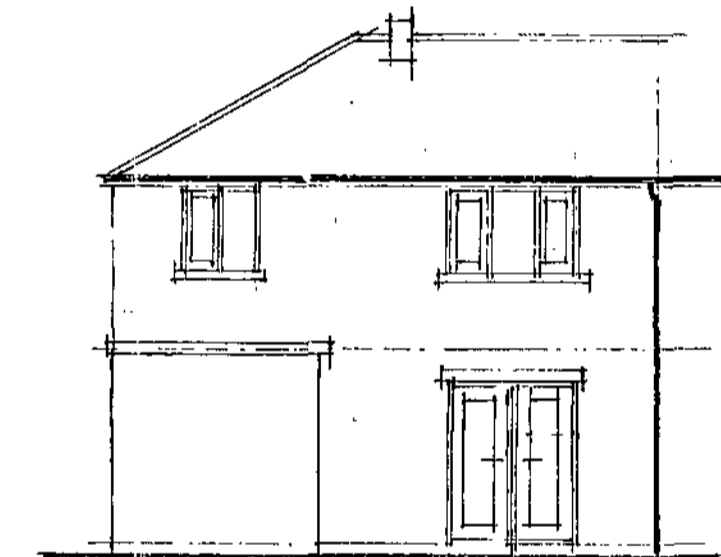


Existing Elevation On 1

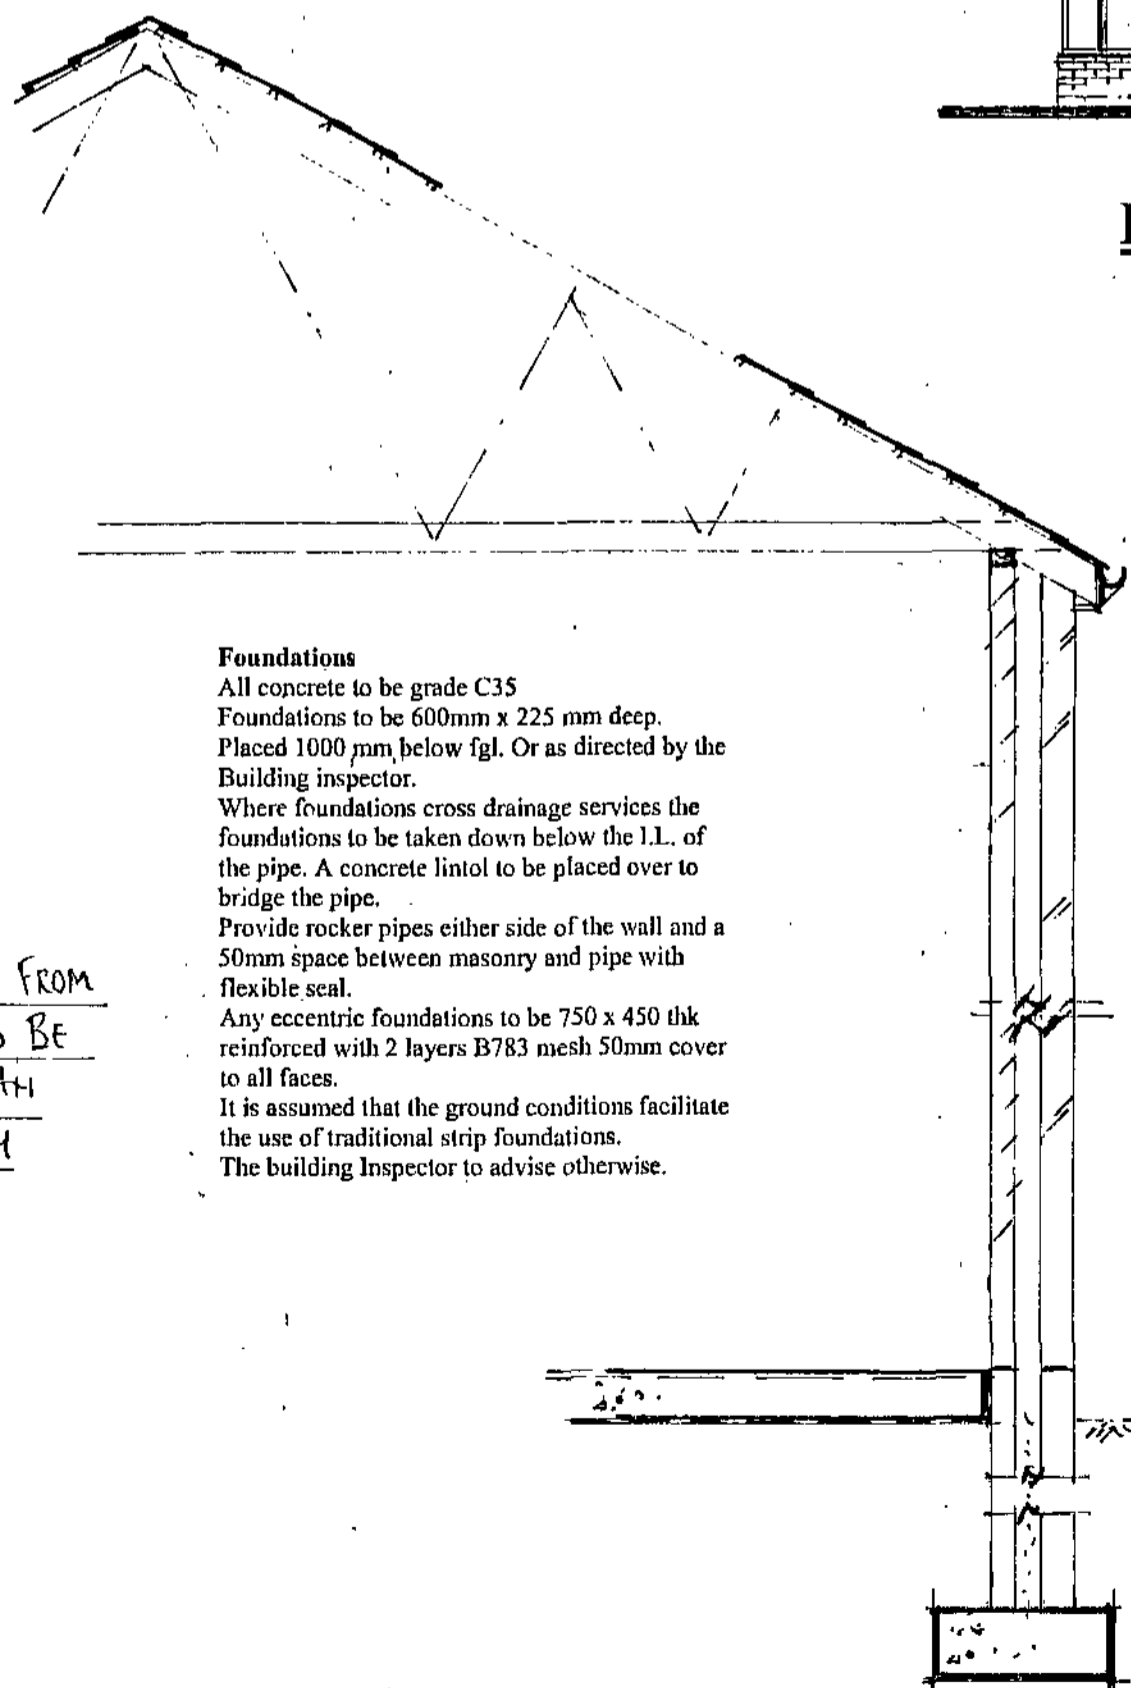


Typical Section On A - A

Foundations
All concrete to be grade C35
Foundations to be 600mm x 225 mm deep.
Placed 1000 mm below gfl. Or as directed by the Building Inspector.
Where foundations cross drainage services the foundations to be taken down below the I.L. of the pipe. A concrete lintol to be placed over to bridge the pipe.
Provide rocker pipes either side of the wall and a 50mm space between masonry and pipe with flexible seal.
Any eccentric foundations to be 750 x 450 thk reinforced with 2 layers B783 mesh 50mm cover to all faces.
It is assumed that the ground conditions facilitate the use of traditional strip foundations.
The building Inspector to advise otherwise.

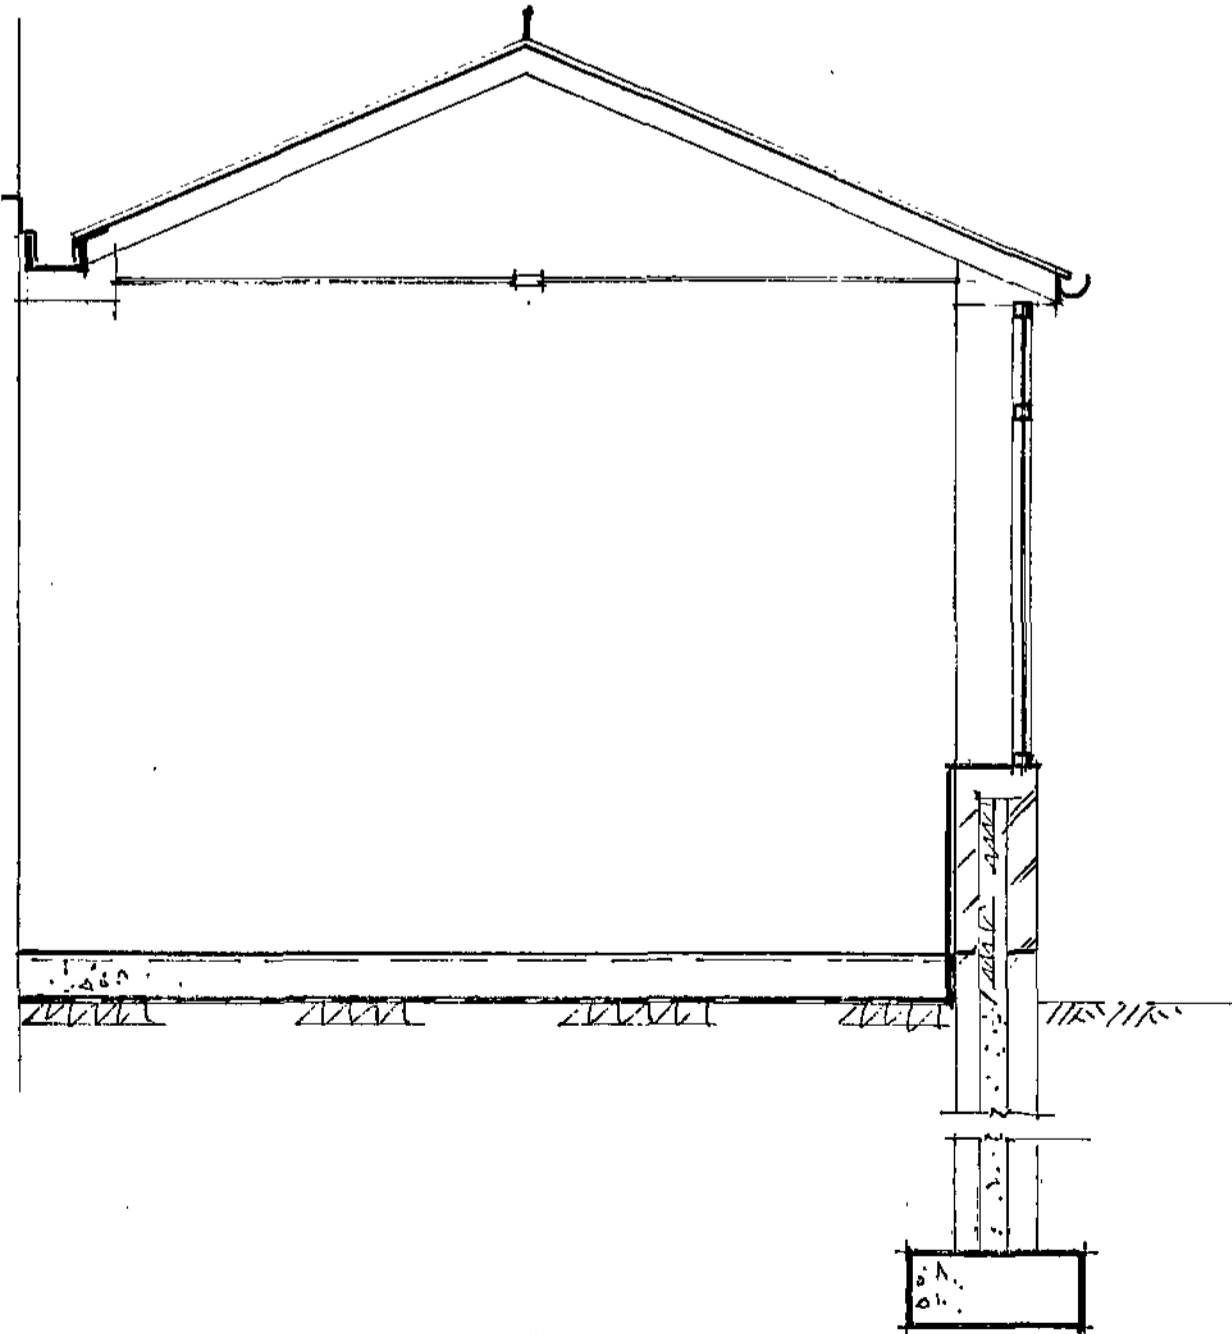

Typical Section On B - B

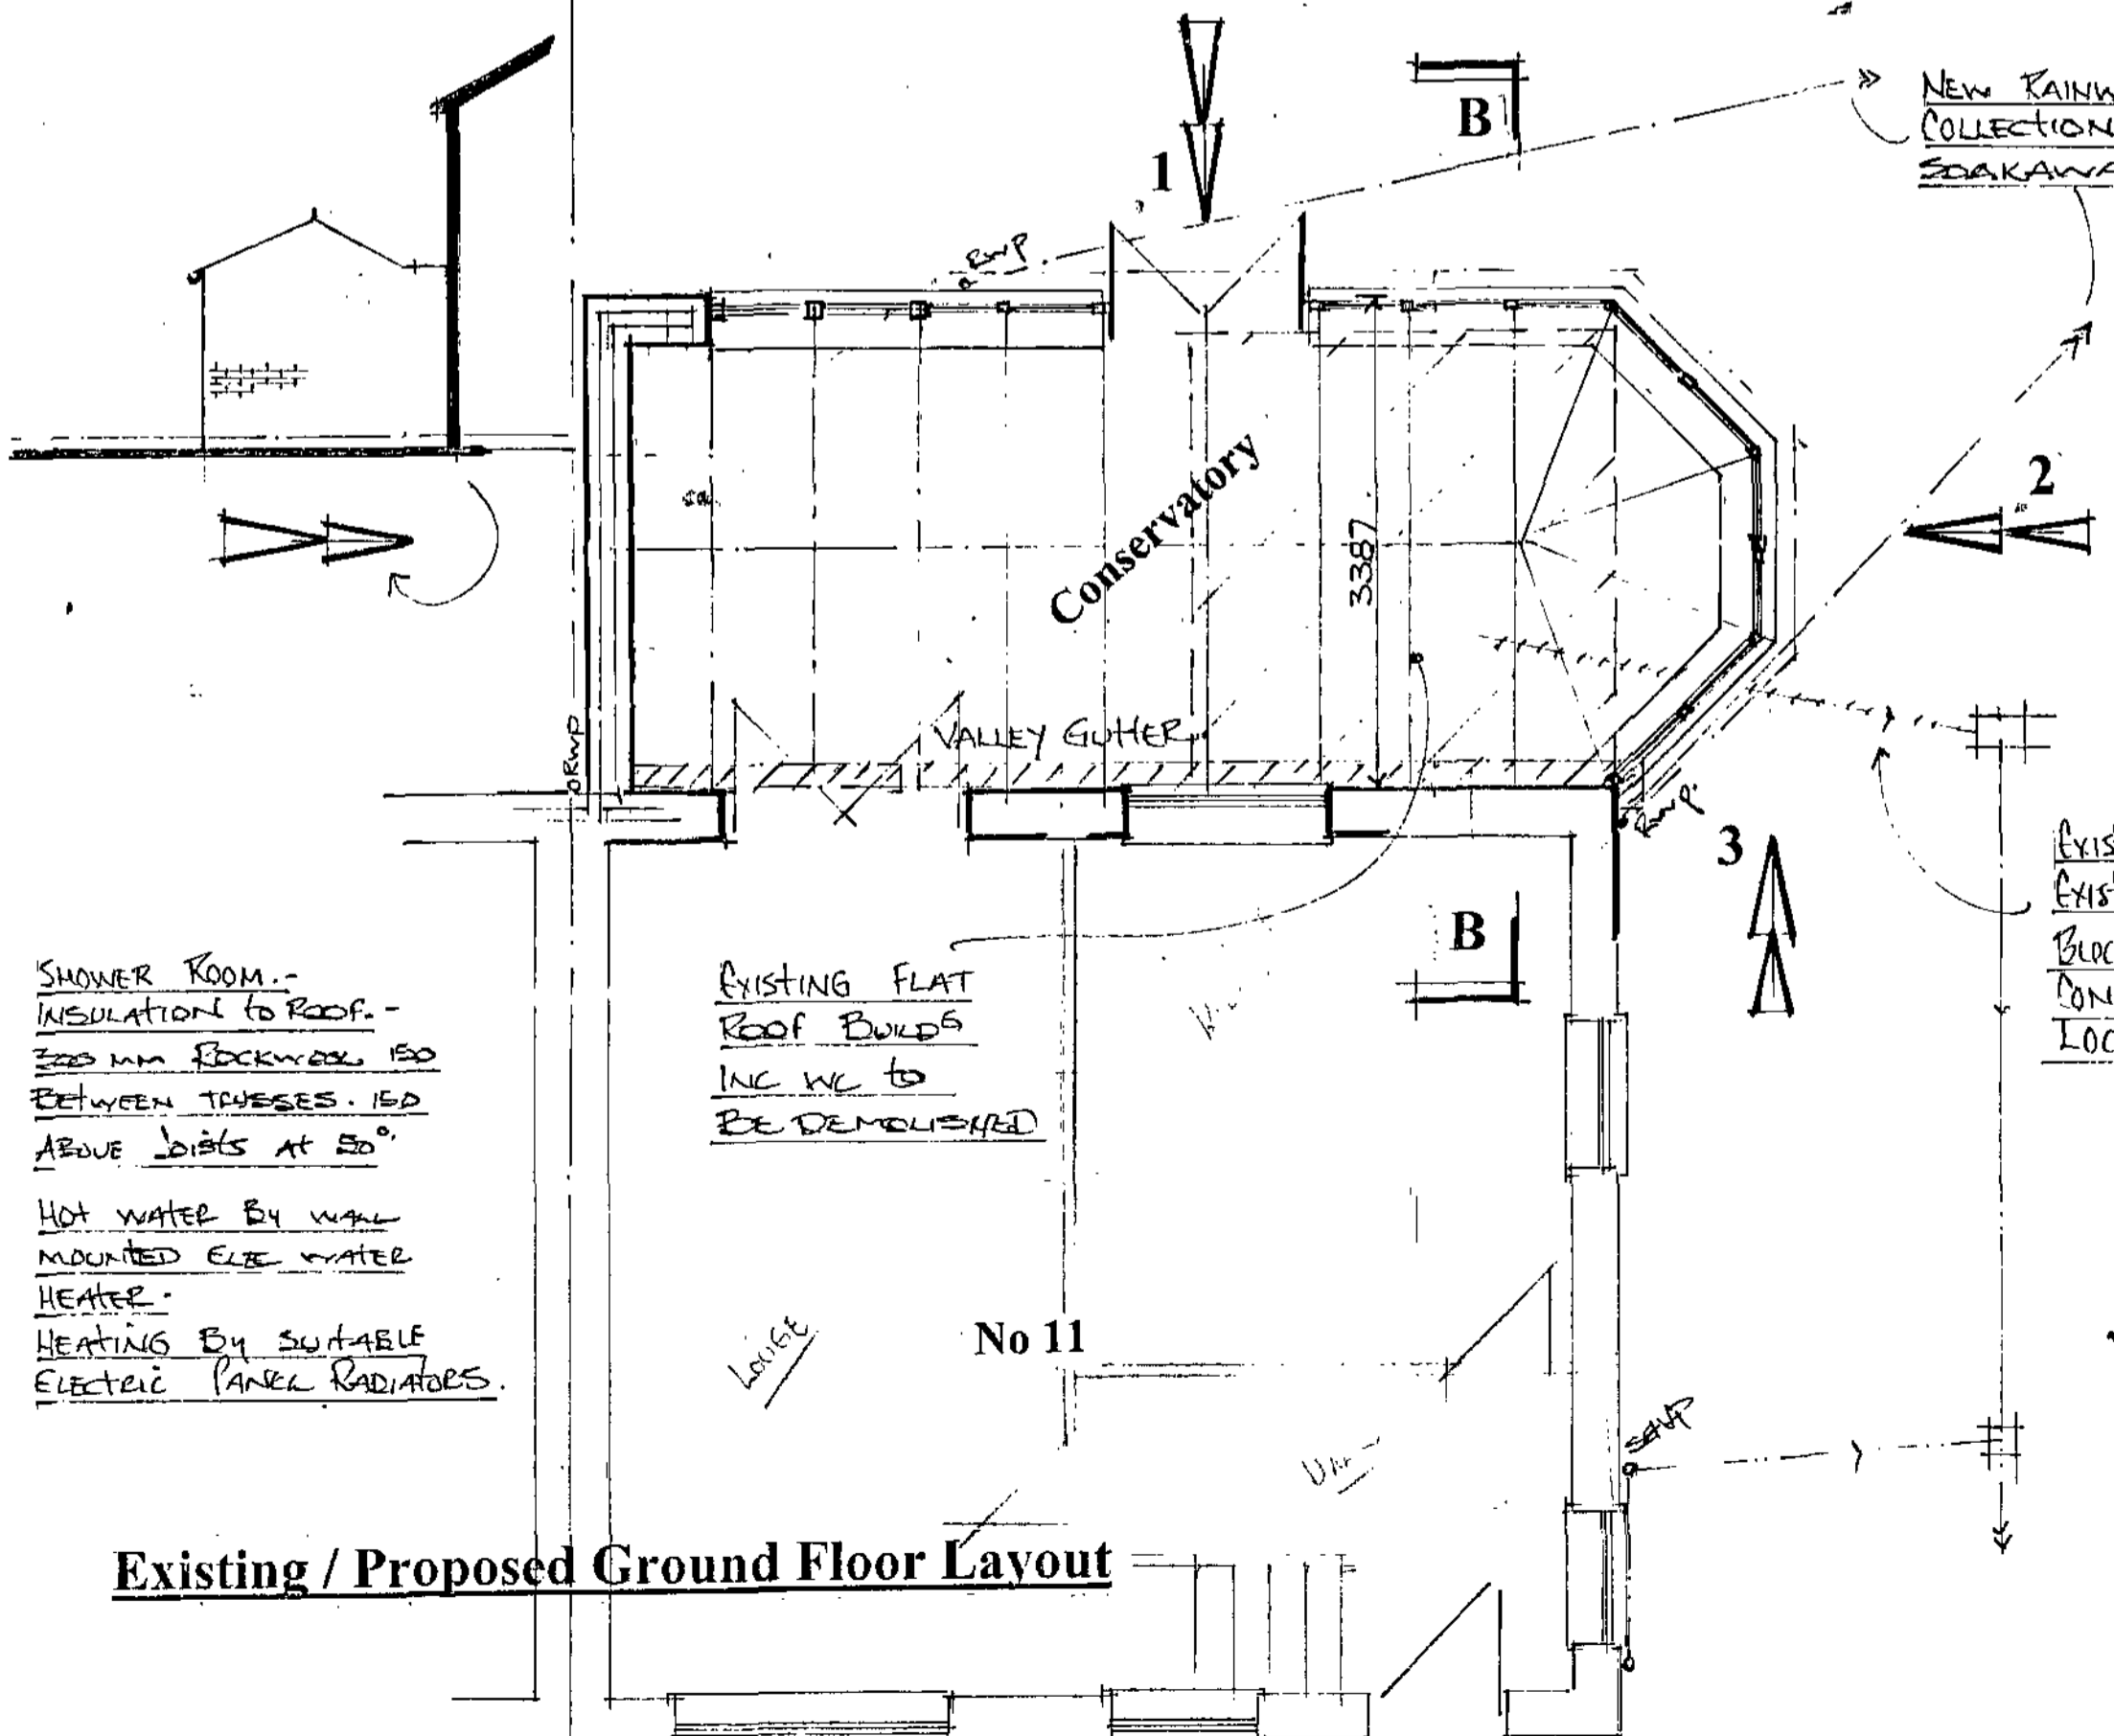

Existing / Proposed Ground Floor Layout

Concrete Ground Floor slabs.
To be 150 mm concrete with 1 No layer of A142 mesh reinforcement in top face. on 1200 gauge visqueen on sand blinding on 150 mm well compacted hardcore Provide 75 mm kingspan kooltherm k3 insulation under slab returning vertically around perimeter of slab.
Garage slab as above but with no insulation.

Radon Barrier
Where Radon Barrier is required visqueen to be 2000 g with all joints overlapped and gas taped and all penetrations thro to be sealed. This to continue thro the external leaf with trap dye. On suspended timber floor visqueen to be placed under oversite cone.

For category 1 land fill sites use gas membrane such as Monarflex or similar

U Values
The builder shall ensure that the following values are achieved.
Walls 0.28w/m2k
g.f. 0.22 (with P/a 09)
Windows / doors 1.6w/m2k

NOTES:
All dimensions must be checked on site and not scaled from this drawing.

Scope of Works

General.
Construction of a Detached garage and rear conservatory.

Notes.
General
These plans and details have been prepared for the purpose of providing information to the local authority to assist them in determining approval or rejection of planning / building regulations.
These notes and details indicated on these drawing drawings are to be checked and verified by the contractor at the time of pricing and prior to commencement, the builder shall satisfy himself that all details and dimensions are correct.
Any discrepancies shall be identified at the time of tendering and the client notified in writing of such changes required.
All dimensions to be taken to the nearest brick size.
This price shall be deemed to include for: Any additional calculations as required by building control and as a result any additional building works that may be required.
Satisfying all current relevant codes of practices and British Standards shown or omitted from these drawings.
When appropriate it is the owners responsibility to serve notice on the adjoining / adjacent neighbours for the proposed works under the Party Wall act 1996. The explanatory booklet can be obtained free of charge from ODPM free literature PO Box 236 West Yorkshire LS23 7NB. Tel 0870 122 6236

E	
D	
C	
B	
A	14.4.11 WC REMOVED! GLASS 240MM FACIA.
Date	Revisions

© copyright

11 Shirland Avenue
Athersley South
Barnsley
S71 3SA

Client
Colette Reade

Job Title
Proposed Detached Garage + Conservatory

Drawing Title
General Arrangement / Elevations.

Scale **1 : 50 1 : 100 1 : 25**
Date **9.3.11** Drawn by **Steve Camps**

Drg. No. **CR / 01** Rev. **A**

