
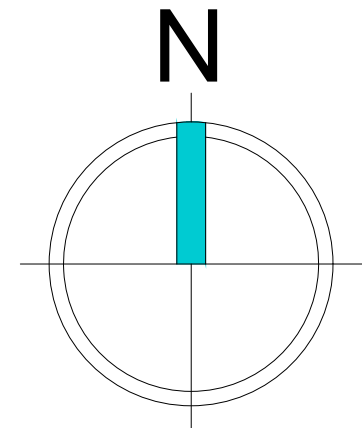


- (E) = Electric Vehicle Charging Point Location (EVCP)
(E) = Lockable Electric Vehicle Charging Point Location (EVCP)

Notes

- 1) Single 13amp external Socket to be Installed within garages or adjacent driveways & parking spaces.
- 2) Minimum IP66 Rated socket when positioned externally.
- 3) Positioning of socket to be 1000mm from Ground Level and located within min 5m of parking space.
- 4) Every dwelling to have a EVCP

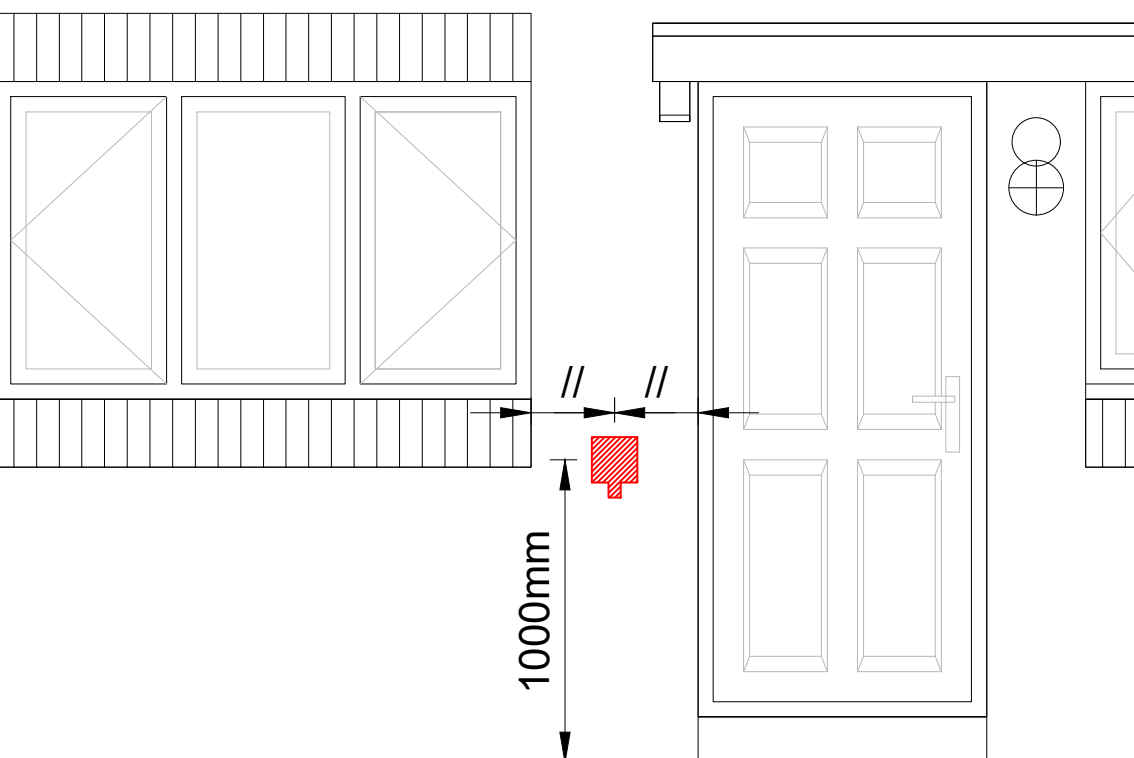

Typical Front Elevation
(when parking is directly in front of the dwelling)
Scale 1:25

A Layout updated to the approved planning layout and EVCP spec updated to reflect 13amp sockets with addition of some lockable sockets JP 02-12-20

DATE	16/07/2020	DRAWN	JP
SCALE	1:500	CHK	DC

Electric Vehicle Charging Points

Thurnscoe 3
Barnsley

Dwg No	2066-Y2-04-100	Rev	A
--------	----------------	-----	---

Keepmoat, The Waterfront, Lakeside Boulevard,
Doncaster, DN4 5PL.
Tel: 01302 346620 www.keepmoat.com

