
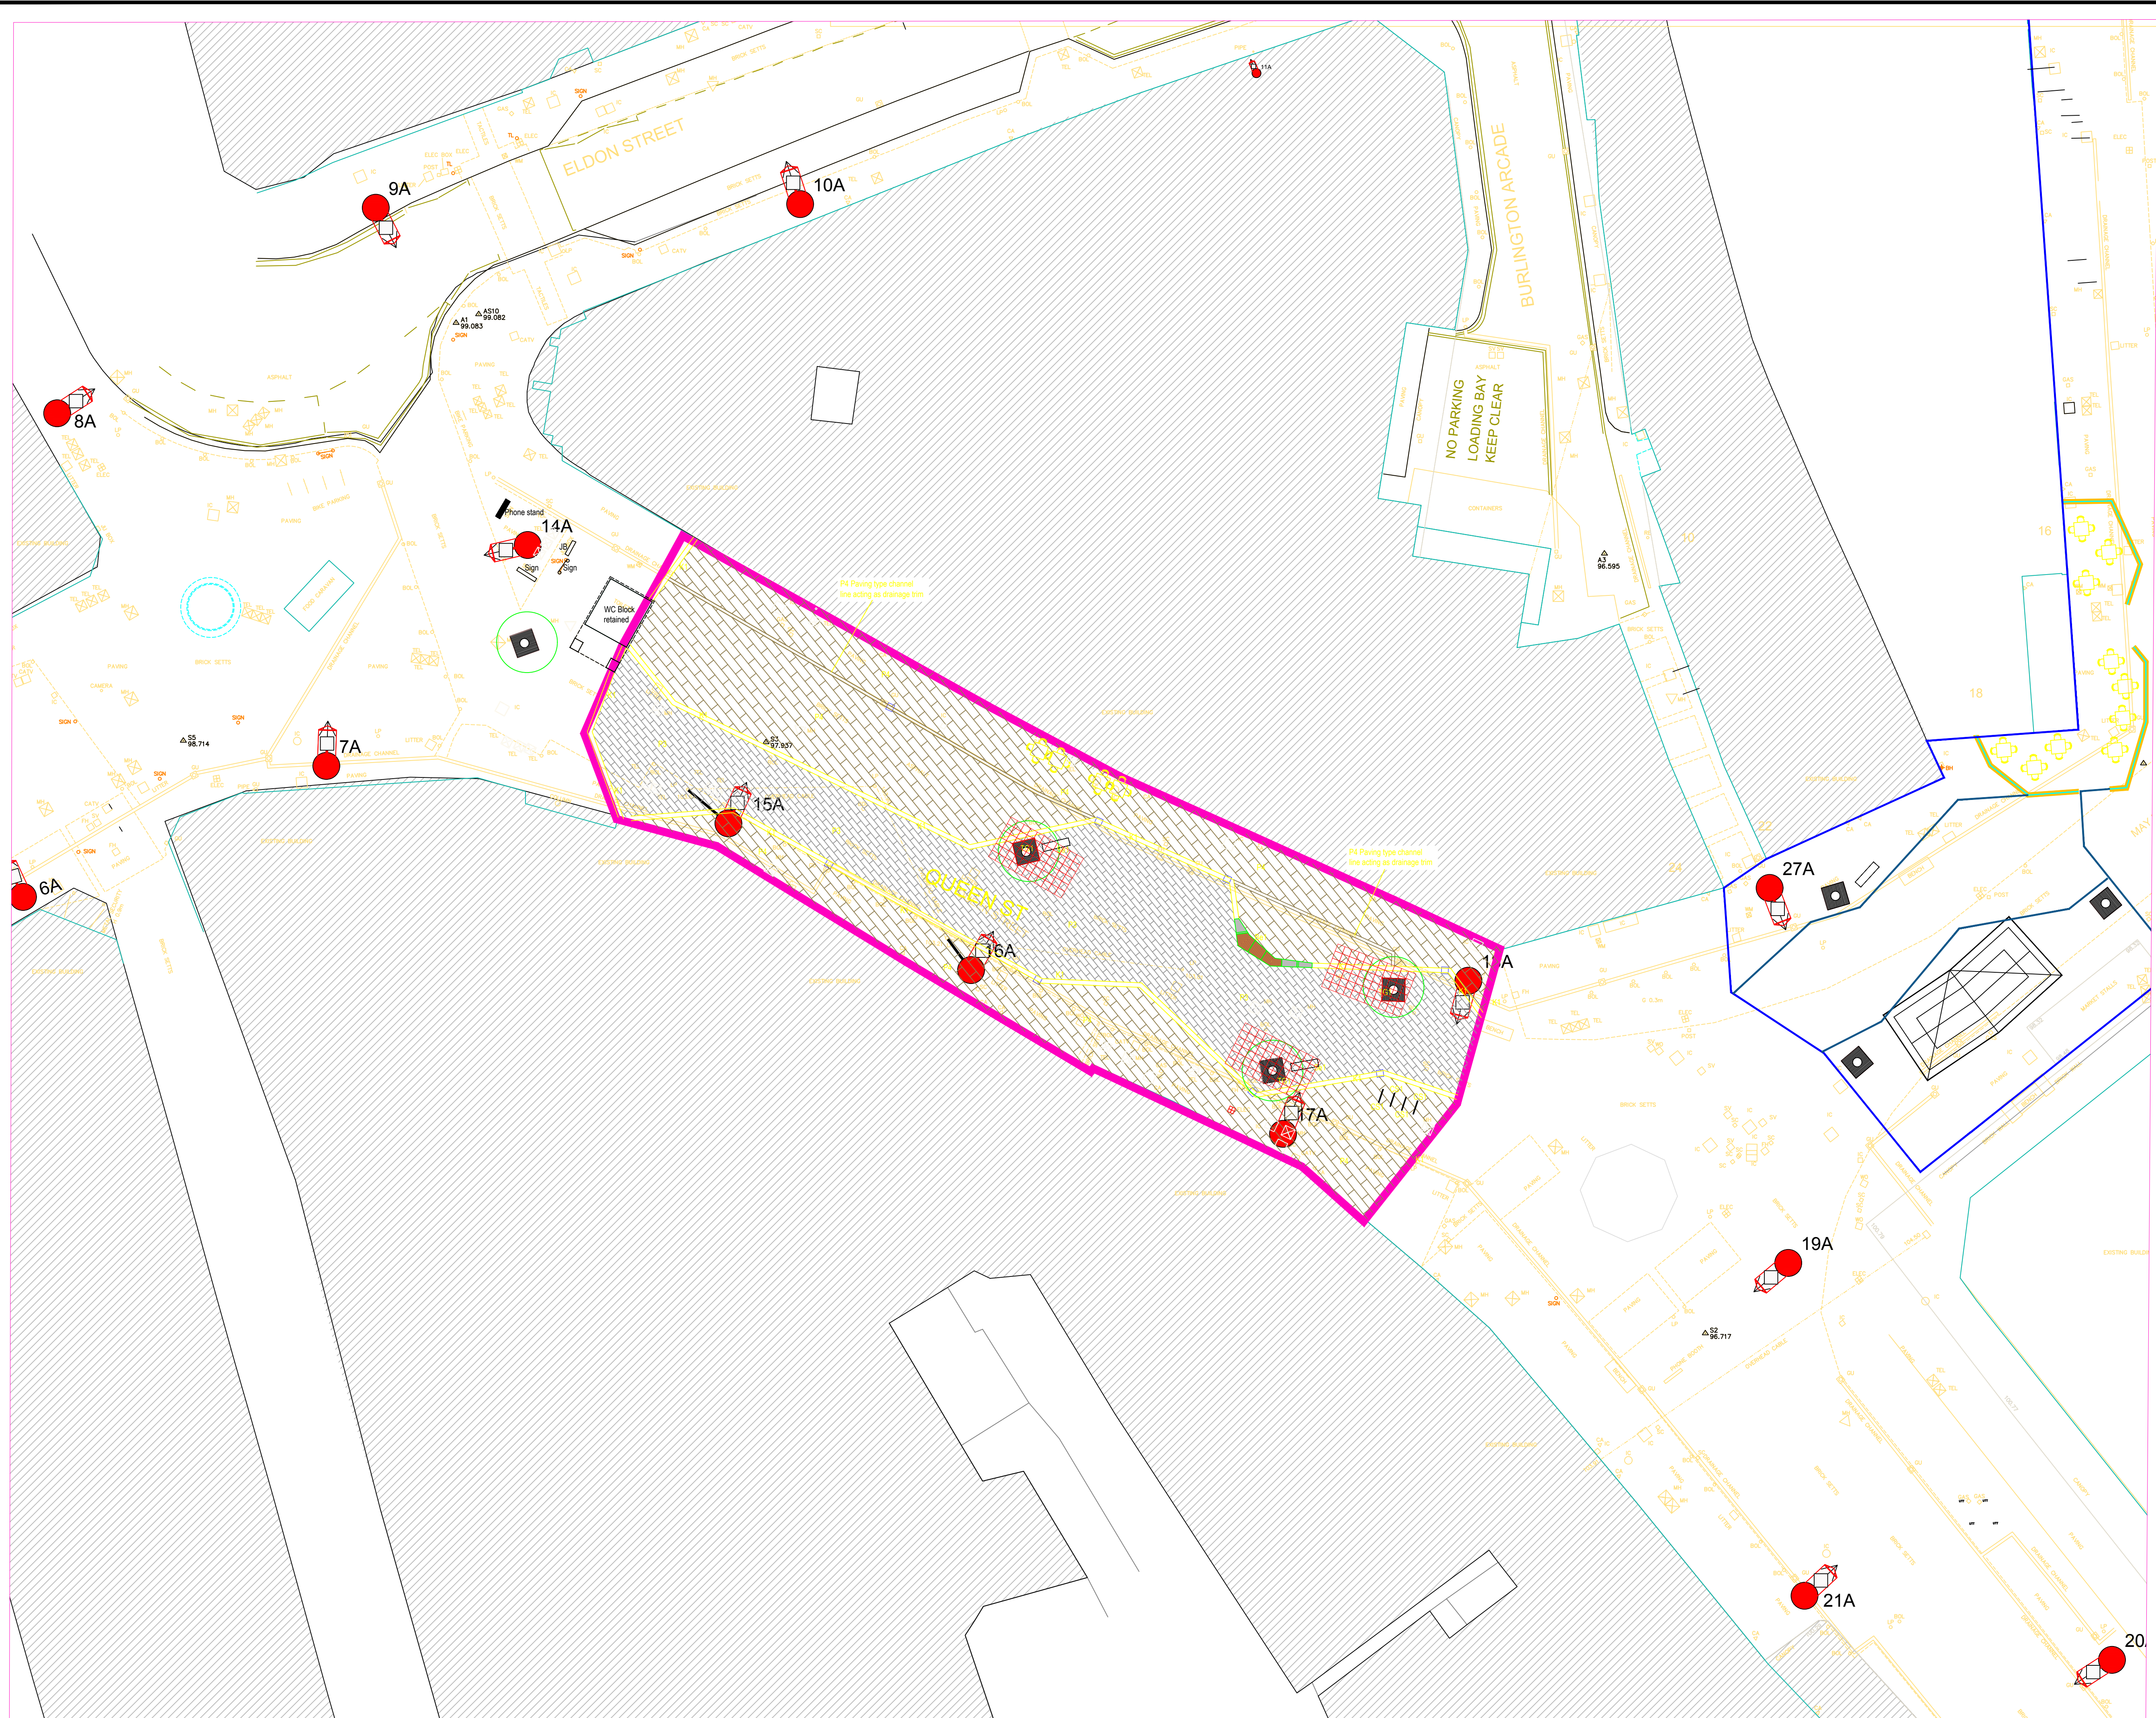





 Site Extents

 10m Galvanised steel column with Philips City Soul Gen2 20Klm Led lantern complete with electronic PEC

 125mm Ø ducting to NPG requirements with 600mm cover. Sand surround and NPG duct tape cover.

17A and 18A have been installed previously.

All material to comply fully with current BMBC Street lighting specification.

All lighting columns are to be provided with an inmetered single phase electrical supply via the REC cable network. It is expected that the contractor will coordinate with the REC regarding the installation of any cable ducts they may require.

This map is reproduced from Ordnance Survey material with the permission of Ordnance Survey on behalf of the Controller of Her Majesty's Stationary Office © Crown copyright. Unauthorised reproduction infringes Crown copyright and may lead to prosecution or civil proceedings. 100022264 (2009).

Rev.	By	Amendments	Date
A	NL	Channel position amended	Apr 19
B	NL	Issued for construction	Jun 19



BARNSELEY
Metropolitan Borough Council

Project The Glass Works Public Realm Works			
Drawing title Queen Street Street Lighting / Ducting			
Scale 1:200	Drawn NL	Checked	Date Mar 19
Drawing No. BBTC BMB_N3_C_G700_PL_00_22			File

Paul Castle Service Director, Place Directorate
Environment & Transportation (Business Unit 6)
P.O. Box 601, Westgate Plaza One, Westgate
Barnsley. S70 9FA
Tel. (01226) 770770 Fax. (01226) 772222