




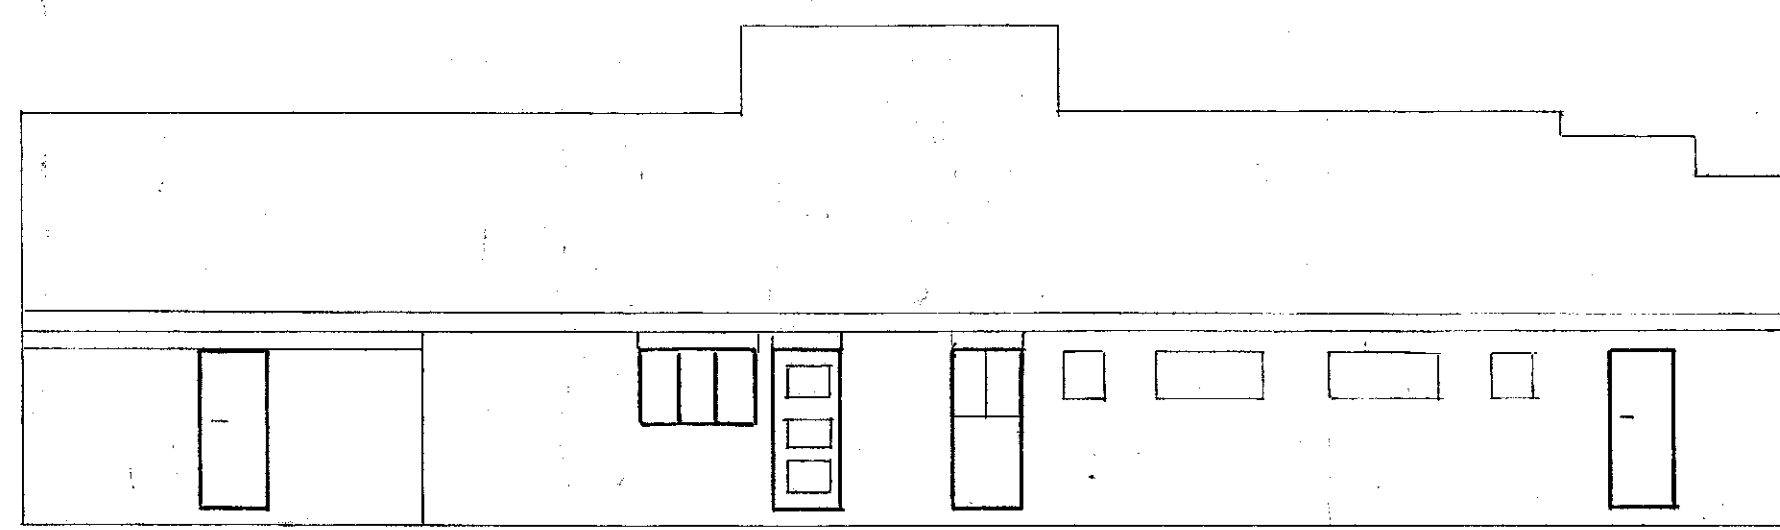


EXISTING REAR ELEVATION

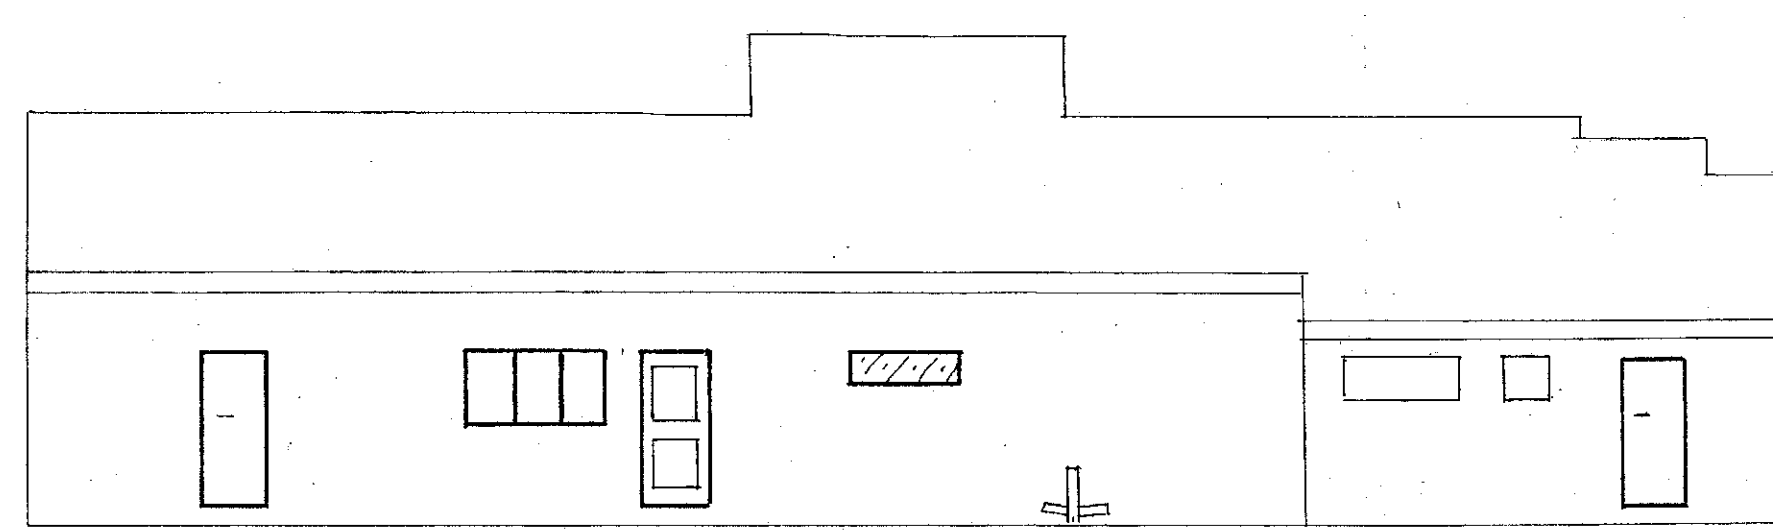


PROPOSED REAR ELEVATION

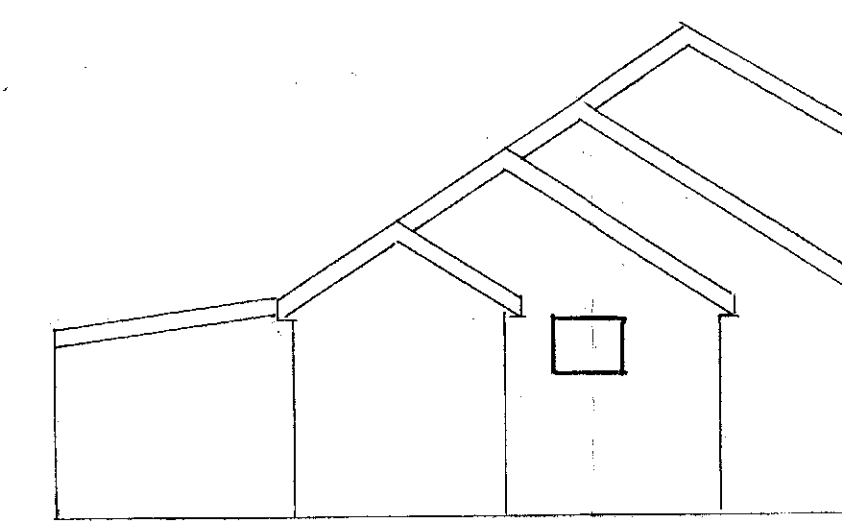


EXISTING SIDE ELEVATION

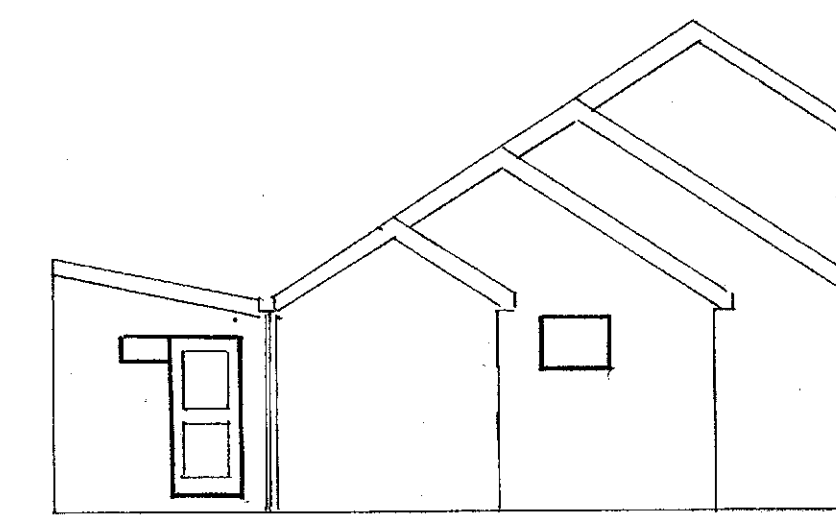


PROPOSED SIDE ELEVATION

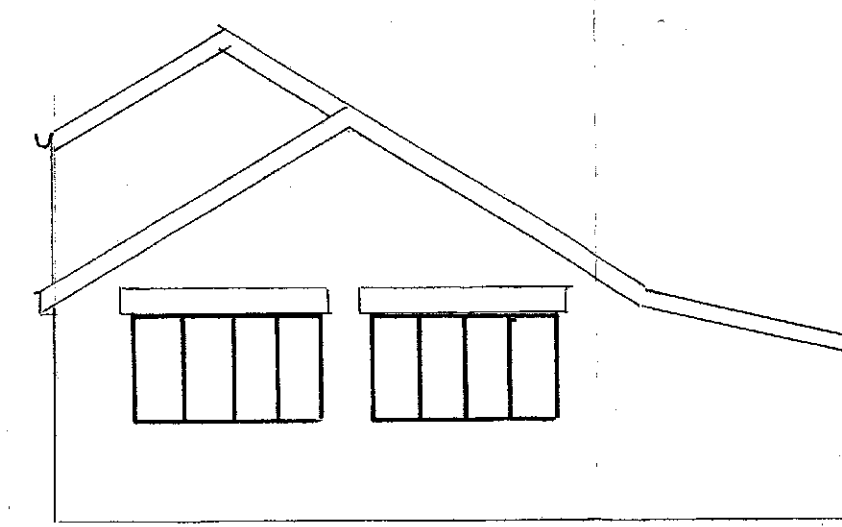

EXISTING SIDE ELEVATION

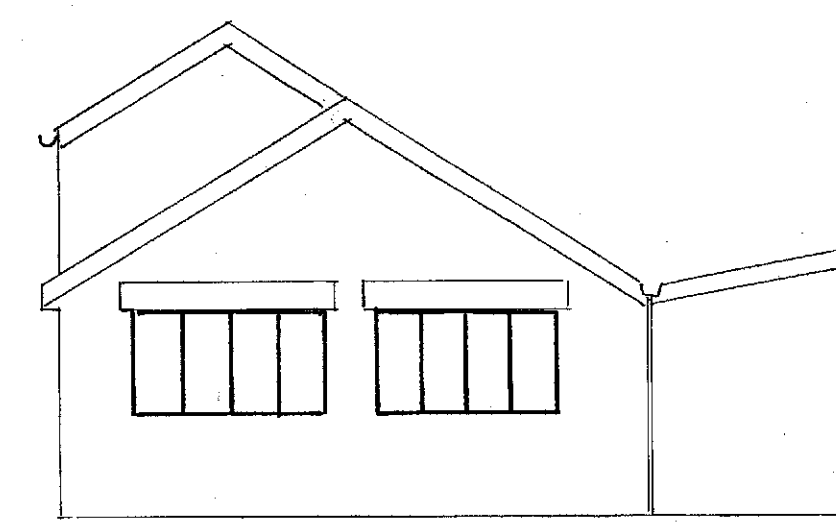

PROPOSED SIDE ELEVATION

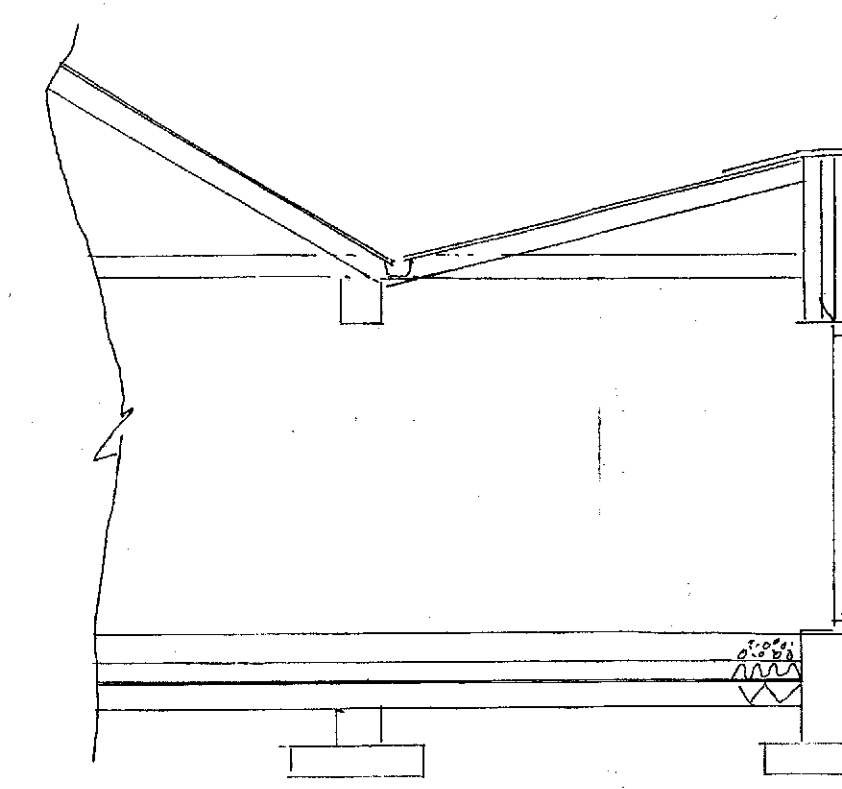

SECTION THRU A-A SCALE 1:50

FOUNDATIONS

- 600x150mm CONC. STRIP DEPTH 750mm SUBJECT TO LA APPROVAL

WALLS

- TRENCH BLOCKS BELOW G.L.
- BRICKWORK TO MATCH EXISTING
- 100mm LWT LAND BLOCKS
- 100mm CAVITY FILLED WITH DETHERM INSULATION BATTI
- CL 90/100 LINTELS OVER ALL EXTERNAL OPENINGS WITH DPL APRON OVER 4 WEEP HOLES EVERY 900mm END BEAMS TO BE 150mm MIN
- REVEALS TO BE INSULATED
- HORIZONTAL DPL 150mm MIN ABOVE G.L. 150mm DPL'S TO ALL REVEALS
- 665mm MIN TO EXTERNAL REVEALS
- NEW BRICKWORK TIE TO EXISTING WITH TIGHTENING OF SCREW IN TIE OR SIMILAR EVERY 225mm 1 ENDSURE A CONTINUOUS CAVITY

FLOOR

- 150mm WELL COMPACTED HARDWARE
- 25mm SAND BLINDING
- 1200 GAUGE UNISURE DPM
- 100mm KINGSPAN RDDLTHRU R3 FLOOR BOARD
- 150mm LAMINATE WITH A STEEL TROWEL POLISHED FINISH

Roof


- 100x50mm WALL PLATE
- 125x50mm CEILING JOIST AT 400mm CENTRES
- 150x50mm RAFTERS AT 400mm CENTRES
- 1m HOLDING STRAPS EVERY 3 RAFTERS
- 1m INTERNAL RESTRAINT STRAPS TO HORIZONTAL & CUTUPS EVERY 15m WITH BOLLING TO SUPPORT
- 150mm INSULATION BETWEEN JOISTS & 150mm LAMINATE AT 90°
- INSULATED STEEL PROFILED PLASTIC COATED GULLY
- INSULATED STEEL PROFILED PLASTIC COATED STEEL FINISH ROOF TO MATCH EXISTING. ALL ABUTMENTS TO BE FITTED IN ACCORDANCE WITH MANUFACTURERS DETAILS
- STEEL PROFILED PLASTIC COATED ANGLE LAMP RIG
- BULDER TO ENSURE ROOF GULLY IS SUITABLE FOR FITCH IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS

Drainage


- 665mm RUPS TO MATCH EXISTING SW. TO CONNECT TO EXISTING 150 TO SWAMPWATER 5m AWAY FROM BUILDING 4m 3 Below INVERT LEVEL
- FOUL FROM KITCHEN TO CONNECT TO NEW I.C. FOUL FROM TOILETS & RET CHANGING TO CONNECT TO SUB STATION 1 TO NEW I.C.
- IC'S TO BE BUILT WITH CLASS B ENGINEERING ON 150mm CONCRETE BASE
- ALL PIPES & FITTINGS TO BE SUPERSLEVE
- SANITARY FITTINGS TO GULLY TO AHD

GENERAL


- ALL WINDOWS & DOORS TO MATCH EXISTING & TO HAVE TRICKLE VENTS 800mm² TO BE Pilkington K GLASS WITH WITH A 10mm AIR GAP & SELF CLOSING VALVE TO BE 1.6 DOORS TO HAVE TIGHTENED GLASS
- KITCHEN TOILETS & CHANGING ROOM TO HAVE A FAN EXTRACTING 60L SEC & CONTROLLED BY AN INDEPENDENT SWITCH
- WIRING WIRE SMOKE ALARMS TO BE PROVIDED TO CIRCULATION AREAS WITH BATTERY BACKUP INTERLINKED TO A SEPARATE CIRCUIT
- ALL ELECTRICAL WORK TO MEET REQUIREMENTS OF PART P ELECTRICAL SAFETY & MUST BE DESIGNED, INSTALLED, INSPECTED & TESTED BY A COMPETENT PERSON REGISTERED UNDER THE COMPETENT PERSON SCHEME A COPY OF THE BUILDING REGS SELF CERTIFICATE TO BE GIVEN TO THE LA ON COMPLETION OF THE WORK

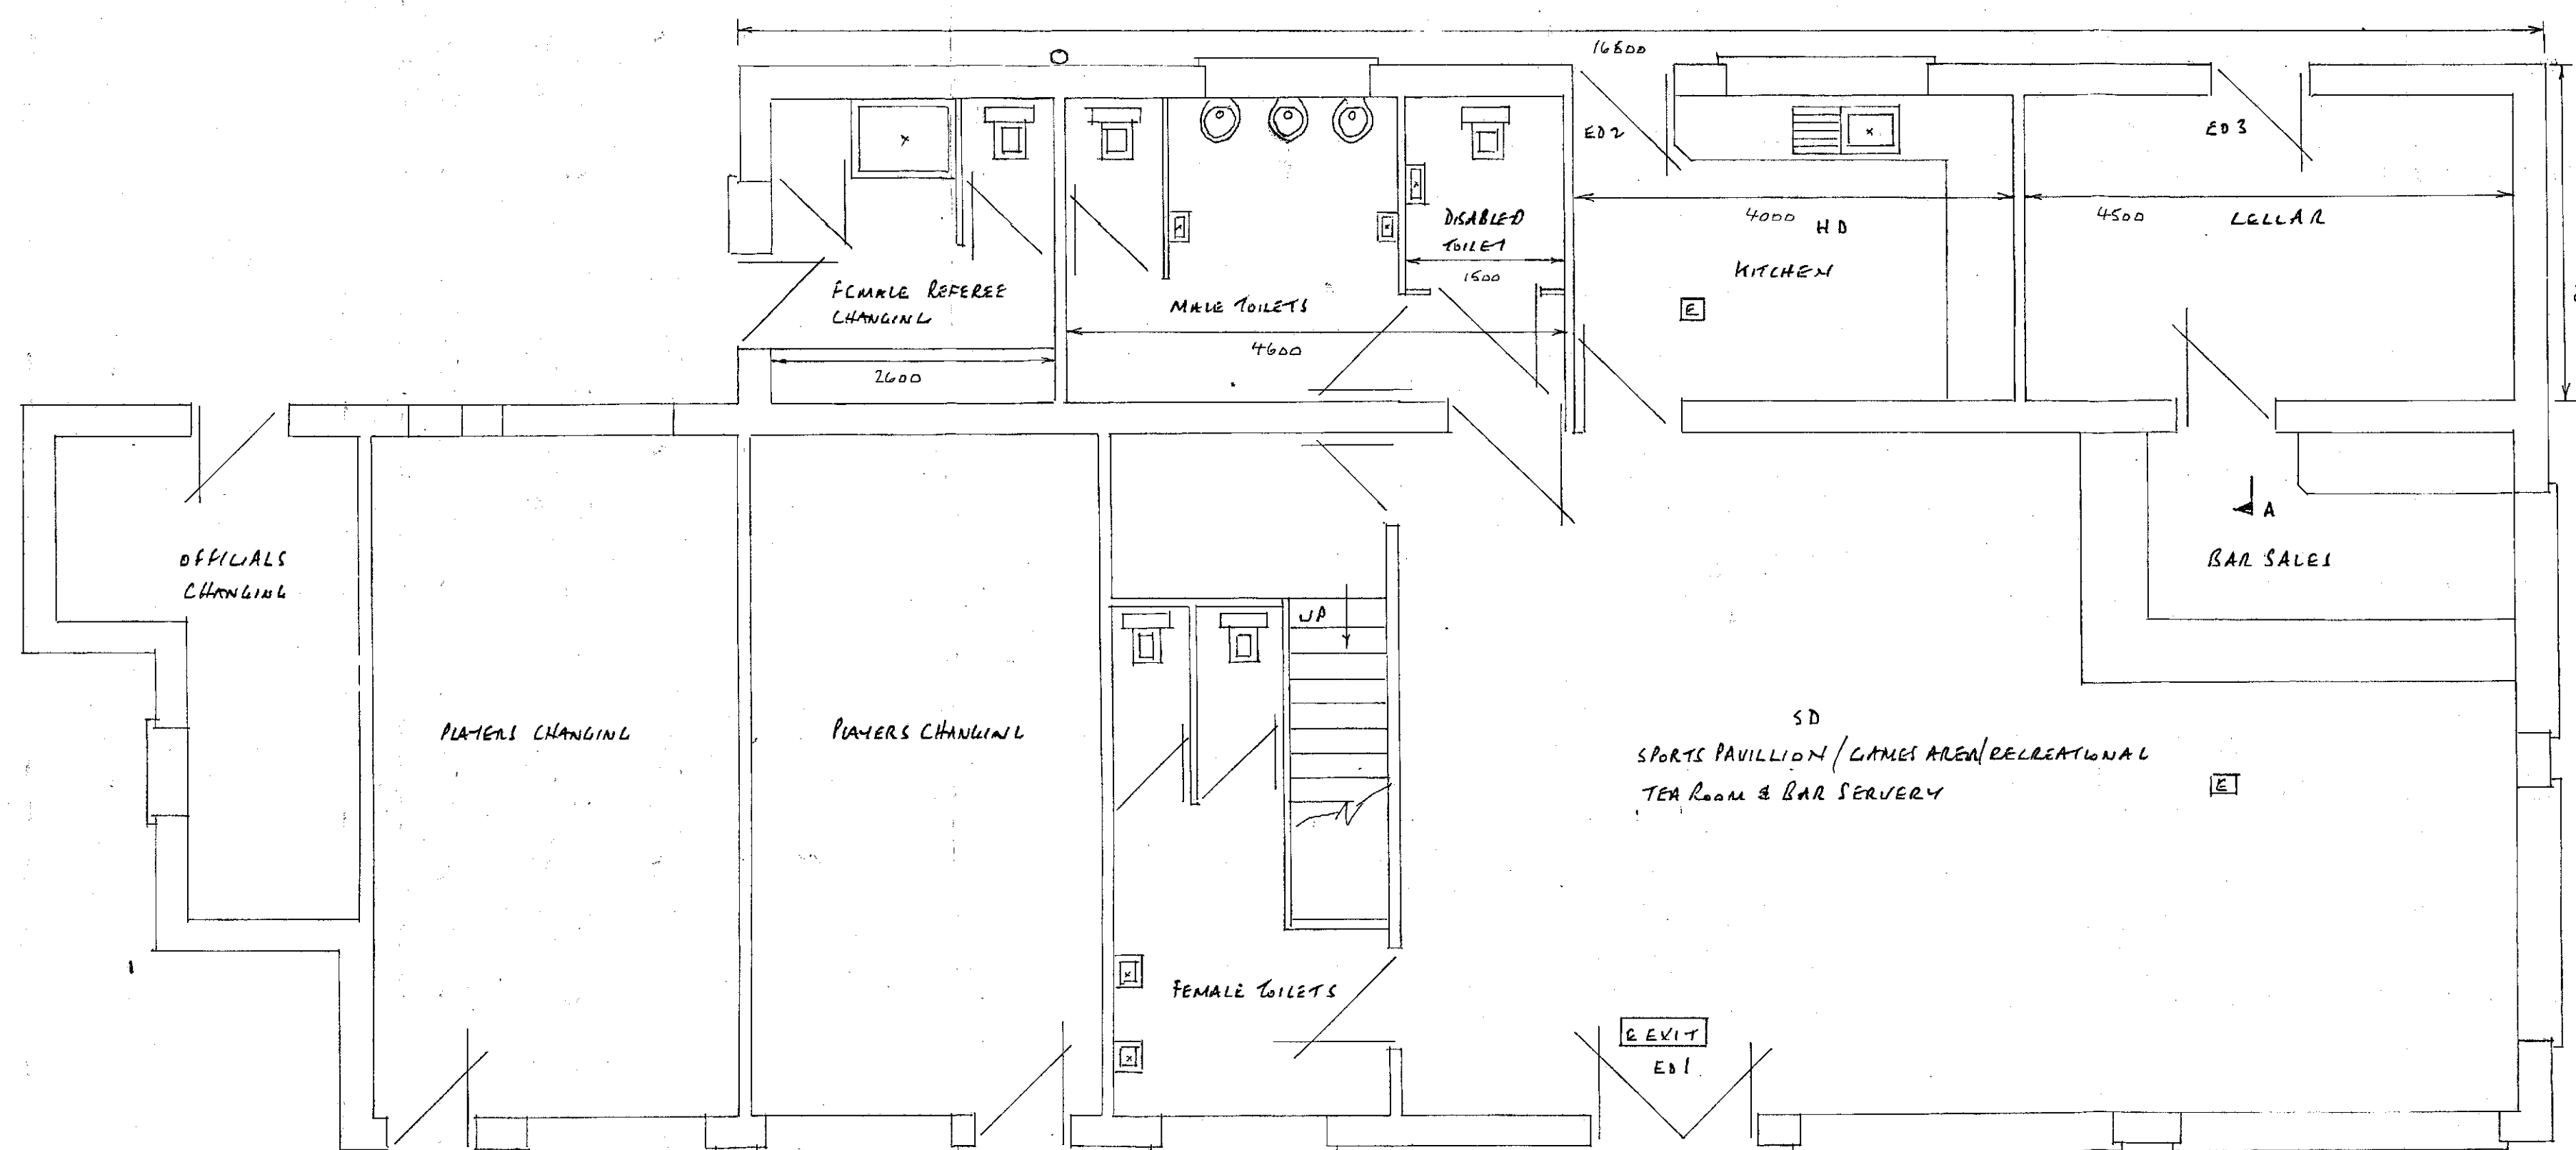

PROPOSED PLAN SCALE 1:50

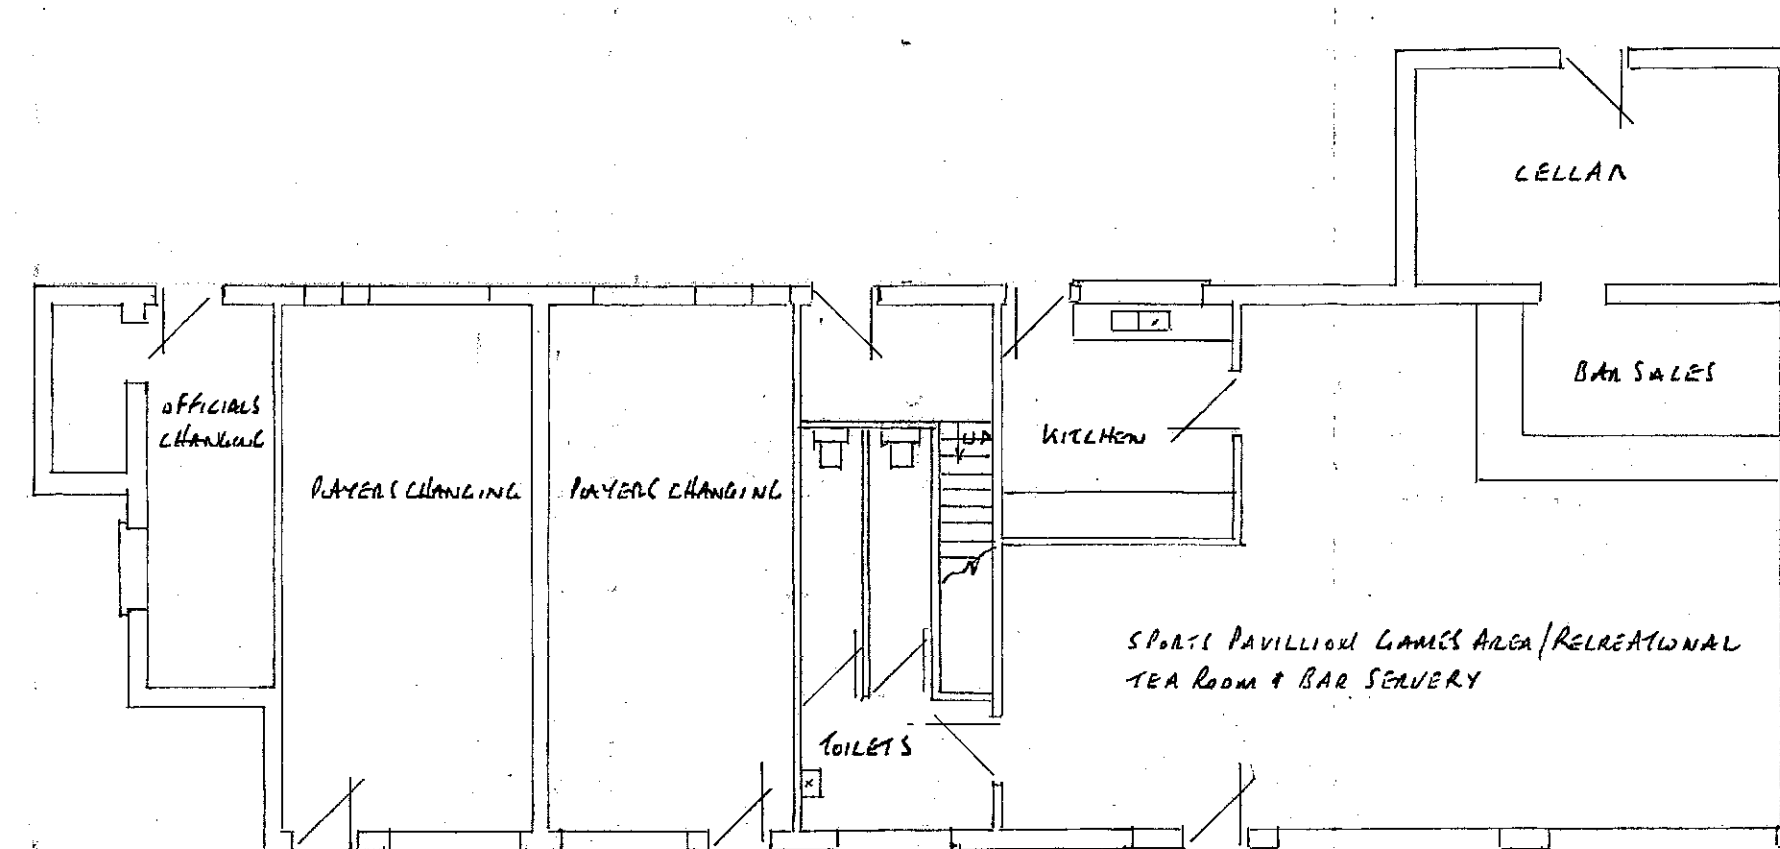

EXISTING PLAN SCALE 1:100

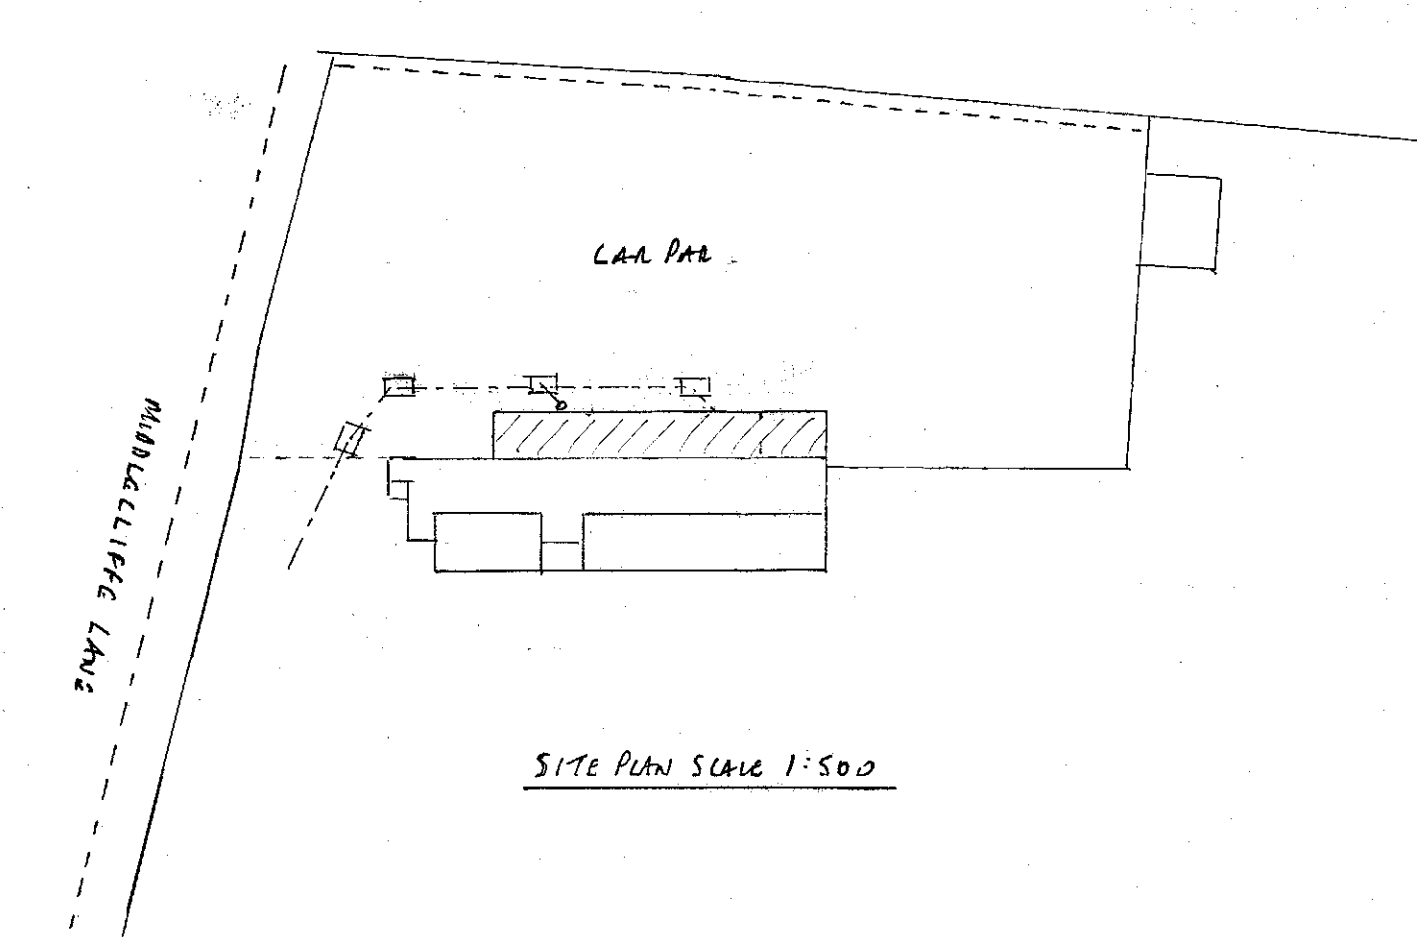

SITE PLAN SCALE 1:500

- ED1-ED2 DEMONSTRATE FIRE ESCAPE DOORS
- EXIT EMERGENCY EXIT SIGNAGE
- SD DEMONSTRATE SMOKE DETECTORS
- HD DEMONSTRATE HEAT DETECTORS
- E EMERGENCY LIGHTS
- HEATING ALTERATIONS TO BE DONE BY A GAS SAFETY REGISTERED ENGINEER & TRIV RAO FOR EXTENSION OF THE HEATING SYSTEM
- STAINLESS STEEL TIE WIRTS IN CAVITY PLACED 750mm HORIZONTALLY 450mm VERTICALLY & 225mm TO REVEALS

PROPOSED SINGLE STOREY REAR EXTENSION TO SPORTS PAVILLION AT :-

HOUGHTON MAIN MINERS WELFARE

HOUGHTON BARNISLEY

S2M2