

ATTENTION IS DRAWN TO THE REQUIREMENTS OF THE CONSTRUCTION DESIGN AND MANAGEMENT REGULATIONS 2015 AND THE DUTIES AND RESPONSIBILITIES CONTAINED THEREIN

- For longitudinal sections refer to drawing 0425/87/03.01
- No services are to be sited directly over, or within 1m of, an adoptable sewer or manhole.
- Private drainage connections to adoptable sewers to be via 45° junction.
- Off site manholes already built must have invert levels checked prior to connection to the off site drainage.
- Any connections to existing sewers/manholes are to be supervised by Yorkshire Water.
- All connections to proposed public sewers to be minimum 150mm.
- Any land drain or water course on site to be diverted as not to pass under proposed buildings. Diversion to be approved and inspected on site by the Local Authority.

- Yorkshire Water General Notes**
- All adoptable sewer works and material to be in accordance with "Sewers for Adoption" 6th Edition, the relevant British/European and Yorkshire Water's Standards/Requirements/Addendum to the Mechanical and Electrical Specification and Kitemarked.
 - Manhole covers shall have a clear opening of 600mm and shall be Class D400 to BS EN 124 with 150mm deep frames in highways.
 - Filled ground must be filled and consolidated under the supervision, and to the satisfaction, of Yorkshire Water before any sewer works are carried out.
 - Cover slabs must carry the BS Kitemark or will be rejected by the Yorkshire Water inspector. Where the clear opening of the Kitemarked product is different to that of the cover and frame, a loading bearing slab should be fitted above the cover slab to bring the size down to 600x600mm for the Yorkshire Water specified cover size. Please refer to the Concrete Pipe Systems Association (CPSA), "Technical Bulletin" issued autumn 2004 for Kitemarked cover slab opening sizes. The adoptable sewers should be a minimum of 1m and manholes 0.5m from kerb faces and service margins.
 - Sewers must have 5 metres clearance from trees and hedges, (please also refer to Figure 2.3 on page 33 in "Sewers for Adoption" 6th Edition for restrictions on tree planting adjacent to Sewers).
 - Sewers to be laid in Class "S" bedding (150mm granular bed and surround). Where depth of cover to top of the sewer is less than 1.2m in highways and verges (or less than 900mm in none vehicular access areas) then a concrete slab should be provided above the granular bed and surround.
 - Adoptable plastic sewer pipes to be BS1 Kitemarked (Certified to WS 4-35-01 and BS/EN13476). Adoptable sewer pipes to be laid in maximum 3 metre lengths unless there is a specific operational need to lay longer.
 - Plastic channel sections in manholes are not acceptable and clayware is preferable. Plastic channels are difficult to set in concrete and a satisfactory finish cannot be obtained on the benching.
 - The chamber size of manholes with more than one connection in them may need to be increased an increment to accommodate the connections and bends.
 - Yorkshire Water policy is not to accept Type "C" brick manhole and 1050mm dia manhole rings. Instead it is preferred that you use a type "B" manhole with 1200mm dia or 1500mm dia rings, with the opening sized above the chamber where depth of cover to pipe soffit is 1-1.5m.
 - Surface water and foul rising mains to be provided with marker tape above the rising mains.
 - If plastic pipes are to be used then the following should apply:
 - All adoptable sewers to be BS1 Kitemark (certified to WS 4-35-01).
 - Bedding and backfill material to conform to the requirements of Water Industry Specification 4-08-02 (Table A2)
 - Where plastic pipes are proposed for adoptable sewers, structural calculations for the plastic pipes and a site investigation report to prove that the ground condition is suitable for the plastic pipes are to be produced.
 - Where plastic pipes are installed into the ground prior to getting full technical approval, the developer must provide a CCTV survey of the prospectively adoptable sewers and a deformation test (Light-Line test) of the plastic pipes.
 - Demarcation chambers to be a min. 450mm chamber for 100mm foul & 150mm surface water pipes up to 1.2m deep. For depths greater than 1.2m, restricted access opening to 350mm is required for safety reasons.
 - Maximum depth of demarcation chamber to be 2m, where depth exceeds 2m, manhole to be constructed as type B manhole.
 - Where a B125 cover and frame has been approved, this must not be coated in plastic and must have lifting eyes suitably sized to accommodate standard lifting keys. Screw down covers are not acceptable.
 - Yorkshire Water is not obliged to accept filter drain/land drainage runoff into the public sewer network or adoptable drainage system (directly or indirectly). An alternative method of disposal of the land drainage runoff will therefore be required and you will have to liaise with the Land Drainage Authority/Land Drainage Section with regard to the disposal of the filter drain/land drainage runoff is required.
 - Sulphate resisting cement (C20-DC2) and precast concrete products must be used or a laboratory report provided proving that such precautions are not necessary.
 - Strength of vitrified clay pipes (if used) to be 40kN/m for 100A, 40kN/m for 150A, 45kN/m for 225A and 72kN/m for 300A. All concrete pipes to be Class 120 concrete to EN 1916/BS 5911-1:2002.
 - All levels of existing drainage to be confirmed prior to work commencing on site.
 - The contractor must allow for any lead's required for road and sewer opening permits, sewer connections and make the appropriate applications.
 - There should be enough clearance to accommodate the bedding for both pipes, approx 300mm; if crossover is near rocker then the clearance needed may be increased.

Consents will be required to all sewers outside of the public highway. Consents to be a minimum off-set 3m either side of proposed sewer. Larger pipes, attenuation tank and deeper sewers will require larger off-set distances as specified in Code for Adoption.

The attenuation has been designed based on the 1 in 100 year + 30% climate change storm event due to the topography of the site.

Yorkshire Water will require future access to the attenuation tank and flow control manhole.

Flow Control Manhole S36
 C160352
 I: 57.907 900A
 R: 57.857 150A
 Design Head: 2.20m
 Discharge Rate: 3.0/s

New connection into existing SW sewer. Size of sewer to be confirmed, assumed 300mm (3.60/150)
 I: 57.600 (300A)
 R: 57.750 (150A)
 It to be confirmed prior to works commencing and reported to the engineers. Connection subject to W8 approval via a S105 connection application. 21 days notice will be required.


New connection into existing FW sewer. Size of sewer to be confirmed, assumed 150mm (2.60/55A)
 I: 57.620 (150A)
 R: 57.620 (150A)
 It to be confirmed prior to works commencing and reported to the engineers. Connection subject to W8 approval via a S105 connection application. 21 days notice will be required.

Existing manholes will need to be inspected with a Yorkshire Water Inspector to check that it can accommodate the new connection and to check if any remedial works are required. It may be necessary to reconstruct the manhole at the developers expense.



FOR CONTINUATION SEE RIGHT

NOTE
 Lateral sewers to be Plastidrain (110 & 160 O.D.) in UPVC and manufactured by Hepworth or similar approved by Yorkshire Water. Demarcation chamber to be polypropylene Non-Entry Inspection Chamber up to 2.0m depth manufactured by Wavin or similar approved by Yorkshire Water to BS EN 13598-1:2003.

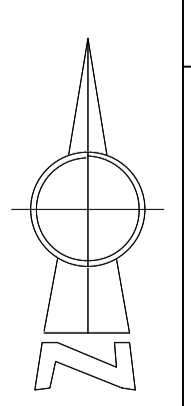

KEY	
	Storm water manhole
	Foul water manhole
	Storm water sewer
	Foul water sewer
	Combined sewer
	Gully
	Yard gully
	Channel Drain (min B125 grade cover)

FLOW CONTROL DATA S36

MANUFACTURER	HYDRO INTERNATIONAL
TELEPHONE	01275 878371
TYPE	HYDRO-BRAKE OPTIMUM
FLOW/HEAD	3.0 l/s @ 1.5m
HYDRO REF	SHE-0075-3000-1500-3000

To be installed in accordance with manufacturers specifications and recommendations before the manhole cover slab is installed

SUBJECT TO THE APPROVAL OF ALL RELEVANT AUTHORITIES

JMG	27.05.22	Issued for approval	DJC	MI	
Rev	By	Date	Revision	Chk	Appvd

ARP ASSOCIATES
 Chartered Consulting Engineers

Northwest House • 5 & 6 Northwest Business Park • Servia Hill, Leeds • LS26 2QH
 0113 245 6498 • 0113 244 3864 • Leeds@arpassociates.co.uk • www.arpassociates.co.uk

ARP Associates is a trading division of ARP Geotechnical Ltd, a company registered in England and Wales with company number 3773833, whose registered office is at 55 Northwest Business Park, Servia Hill, Leeds LS26 2QH

TITLE		SECTION 104 LAYOUT SHEET 1 OF 2	
PROJECT		GYPSY LANE, WOMBWELL	
CLIENT		MILLER HOMES (YORKSHIRE) LTD	
DRAWING STATUS		PRELIMINARY	
Scale	1:500 @ A1	Date	MAY 22
Drawn	DJC	Chk.	MI
Org. No.	0425/87/03.01	Rev	/