

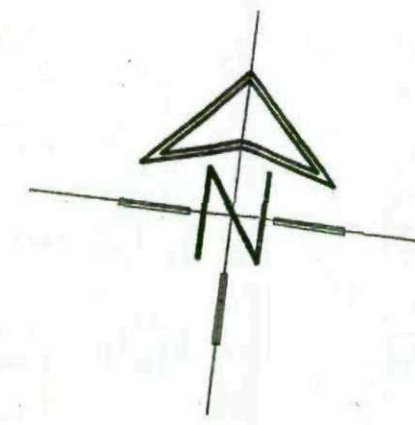
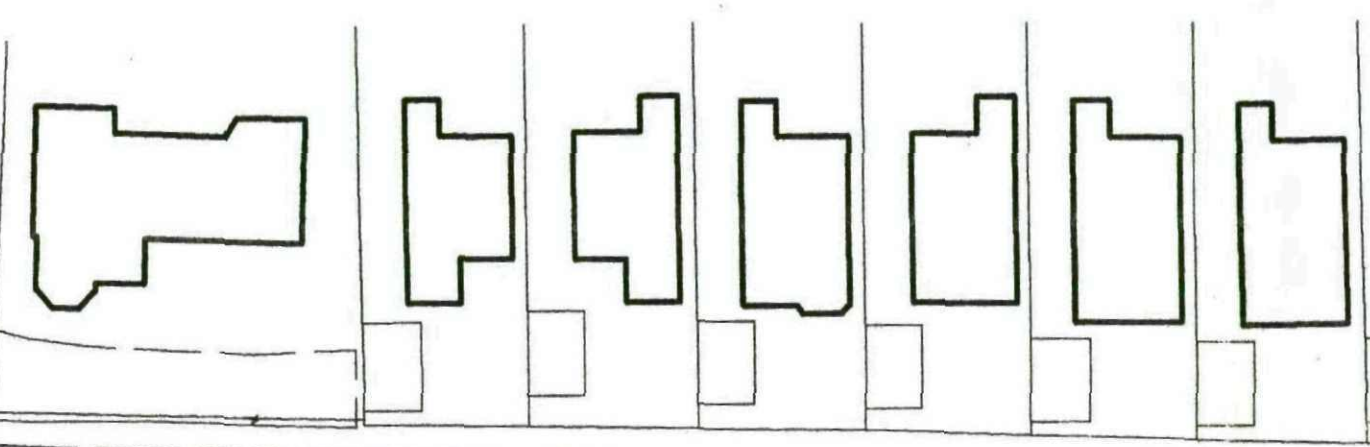


RWPS TO BE TAKEN TO SOAKAWAYS MINIMUM 6M FROM BUILDINGS WITH 2 CU M FILL BELOW INVERT. SUBJECT TO B.C.O. APPROVAL OF PERCOLATION TEST.

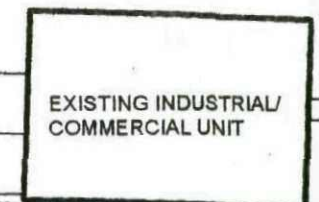

NEW 100MM DIA DRAIN LAID AT MIN 1 IN 40. WHERE DEPTH OF COVER BENEATH ROADWAY IS < 1200MM THE PIPE IS TO BE ENCASED IN CONCRETE WITH FLEXIBLE JOINTS AT 3M CC.

EXISTING CONNECTION TO MAIN SEWER

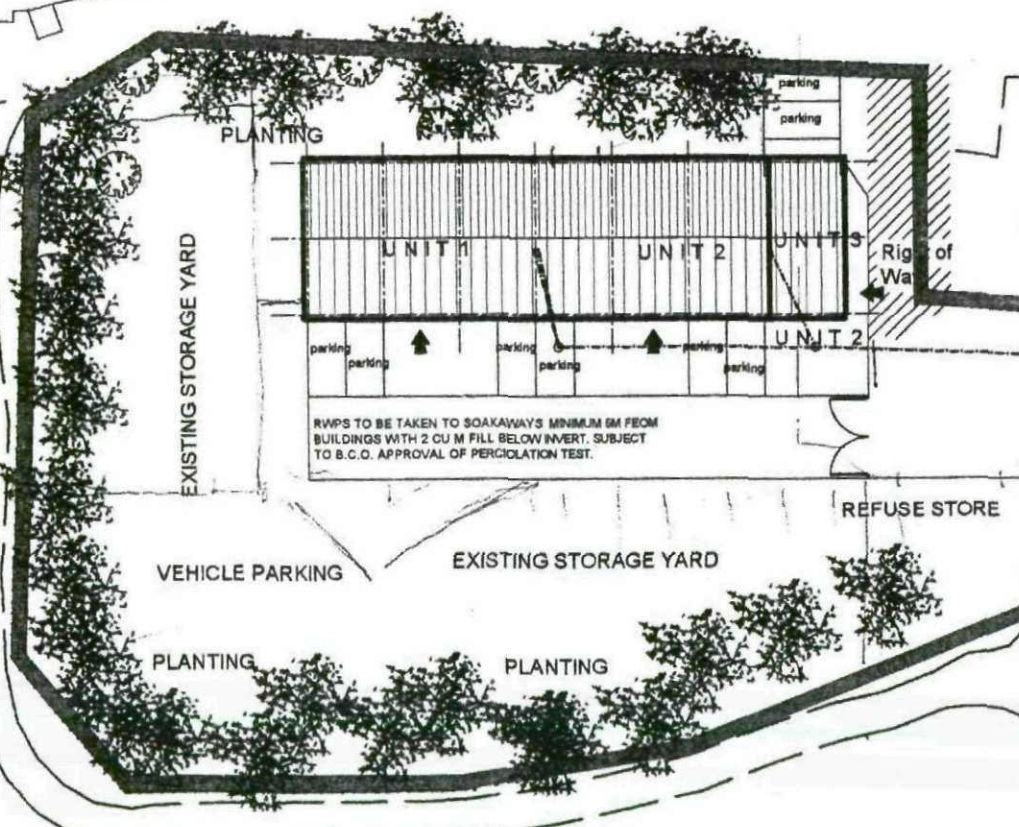

EXISTING STORAGE YARD

EXISTING ACCESS ROADWAY


SITE PLAN
SCALE 1:500

Fearn's Buildings



STOTTERCLIFFE ROAD

Westcliffe

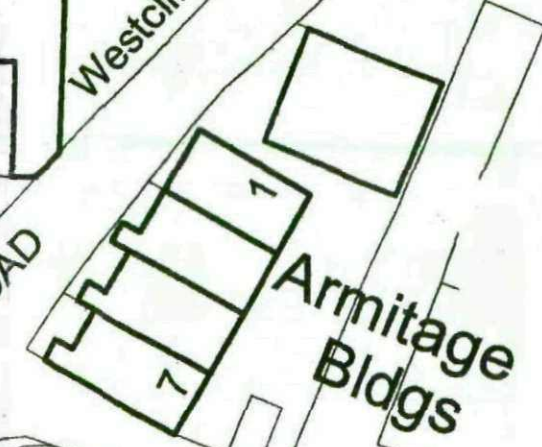

Armitage Bldgs