

**Mr Jason Hughes**

**Area 1 & 2  
Southview  
Darfield**

## **Drainage Assessment**

**Prepared by EWE Associates Ltd  
Final RevB April 2026**



**EWE Associates Ltd  
7 Waveney Close  
Burton Upon Stather  
Scunthorpe  
North Lincolnshire  
DN15 9DT  
M: 07875 972270  
e: [lea.favill@eweassociates.com](mailto:lea.favill@eweassociates.com)**

This document has been prepared solely as a Drainage Assessment for Mr Jason Hughes. EWE Associates Ltd accepts no responsibility or liability for any use that is made of this document other than by the Client for the purposes for which it was originally commissioned and prepared.

## CLIENT DETAILS

Mr Jason Hughes

## CONTRACT

This report describes work commissioned on behalf of Mr Jason Hughes by their representatives during August 2024. The representatives for the contract is Mr James Roberts. Lea Favill of EWE Associates Ltd carried out the work.

Date: 17<sup>th</sup> April 2026

Prepared by: .....



..... Lea Favill  
Director

## REVISION HISTORY

Draft Report Rev0 issued 22<sup>nd</sup> October 2024  
- 1No copy issued to James Roberts

Final Report RevA issued 3<sup>rd</sup> December 2024  
- 1No copy issued to James Roberts

Final Report RevB issued 17<sup>th</sup> April 2026  
- 1No copy issued to James Roberts

## **CONTENTS**

<b>1.</b>	<b>INTRODUCTION -----</b>	<b>4</b>
	Terms of Reference .....	4
	Approach to the Assessment.....	4
	Design Constraints .....	4
<b>2.</b>	<b>DESIGN OF PROPOSED SURFACE WATER DRAIANGE SYSTEM -----</b>	<b>6</b>
	Existing Runoff .....	6
	Catchment Area.....	6
	Yorkshire Water Sewer.....	6
	Drainage Strategy.....	6
	Adoption & Maintenance .....	6
	Proposed Drainage Strategy Area 1.....	7
	Proposed Drainage Strategy Area 2.....	8
	Crate Tank Maintenance .....	9
<b>3.</b>	<b>DESIGN OF PROPSOED FOUL DRAINAGE SYSTEM -----</b>	<b>10</b>
	Existing Foul Drainage .....	10
	Proposed Foul Drainage.....	10

### **APPENDICES:**

<b>APPENDIX A: -</b>	<b>YW SEWER PLAN</b>
<b>APPENDIX B: -</b>	<b>ADAS345 RUNOFF CALCULATIONS</b>
<b>APPENDIX C: -</b>	<b>DRAINAGE DRAWING</b>
<b>APPENDIX D: -</b>	<b>AREA 1 -WINDES DRAINAGE CALCULATIONS SHEETS</b>
<b>APPENDIX E: -</b>	<b>AREA 2 -WINDES DRAINAGE CALCULATIONS SHEETS</b>

## 1. INTRODUCTION

---

### Terms of Reference

This report was commissioned by Mr Jason Hughes to consider the surface water drainage system for the proposed residential development at Southview Darfield.

The proposal involves the construction 42 residential units and access roads. Area 1 includes 34 units and Area 2 includes 8 units. The drainage issues are being considered as part of the planning application.

### Approach to the Assessment

For the purposes of this study, the following have been considered: -

- Site level information and proposed finished levels of the building and external works.
- Catchment area draining to the existing public sewers.
- Existing infiltration characteristics of subsoils.
- Onsite constriction.
- Options available to developer.
- NPPF guidelines with regards to the control of runoff.
- PPG3 pollution prevention guidelines.
- Future adoption and management of drainage system.
- Discharge rates into Phase 1 and public sewer.
- Flood risk to adjacent land users.

### Design Constraints

For the purposes of this study, the following constraints have been applied: -

- The design is based on the proposed layout provided by the client's representative. At this stage no modifications to the layout are proposed.
- The proposal is for a residential development as such any SUDs features or attenuation structures will be maintained by the individual owner/maintenance company.
- SUDs features are to be recommended where practically possible.
- RB Geotechnical has undertaken percolation tests within the site. Trial holes within the site identified made ground and mudstone/sandstone. The infiltration rates estimated are extremely low and the site steeply slopes down from north to south. As such, soakaways not considered practical for this site.

- A site visit was completed during September 2020. During the visit no open or culverted watercourse were found. There is a 225mm diameter combined Yorkshire Water public sewer located within Snape Hill Road to the south of the site. The sewer is over 1.7m deep in line with the site entrance. There is a 225mm diameter combined Yorkshire Water public sewer located within Southview to the north of the site. The sewer is over 1.1m deep in line with the site entrance.
- Phase 1 of the development has been granted planning permission and highway/drainage conditions discharged. The Phase 2 development assumes that a connection will be made into the Phase 1 drainage system for both surface water and foul water drainage.
- The minimum design standard is 1 in 100 years plus climate change (40%). Based on latest climate change allowance figures dated February 2016.
- No on site above ground flooding will be acceptable up to and including 1 in 100 years plus climate change (40%) storm.
- A discharge rate of 8.6l/s has been estimated from the Area 1 based on ADAS345 greenfield runoff rates. The site is considered to be 100% permeable with no roofed or paved areas.
- Yorkshire Water requested restriction of 3.5l/s.

## **2. DESIGN OF PROPOSED SURFACE WATER DRAINAGE SYSTEM**

---

### **Existing Runoff**

Area 1 site has a total area of 1.313 hectares which is steeply sloping (1 in 5). There are no roofed or paved areas within the site. Due to the steep sloping site the ADAS345 method has been used to estimate the Qbar runoff from the site at 8.6l/s. The calculations are provided at Appendix B of this report. However, Yorkshire Water requested restriction of 3.5l/s.

Area 2 is only 0.1628 hectares in area and has a Qbar of approximately 1.1l/s calculated on a pro rata basis. As this is less than 3.5l/s which is the practical minimum discharge rate applied by Yorkshire Water a rate of 3.5l/s is recommended.

### **Catchment Area**

The catchment area was calculated from proposed layout drawing provide by the clients representative.

The total impermeable area for Area 1 has been estimated at 0.523 hectares.

The total impermeable area for Area 2 has been estimated at 0.043 hectares.

### **Yorkshire Water Sewer**

There is a 225mm diameter combined Yorkshire Water sewer located inline with the site entrance within Snape Hill Road to the south of the site. The sewer is at least 1.7m deep.

There is a 225mm diameter combined Yorkshire Water sewer located inline with the site entrance within Southview Road to the north of the site. The sewer is at least 1.1m deep.

There is a 150mm diameter Yorkshire Water sewer located within the adjacent Verona Rise to the west of the site which is 1.4m deep and an be accessed.

The sewer plan is provided at Appendix A of this report.

### **Drainage Strategy**

The proposed drainage strategy is as follows and is illustrated on the drainage layout drawing provided at Appendix C of this report. The drainage system will include oversized pipes within the adoptable highway and tanks located in areas which could allow easements directly off the adoptable highway.

### **Adoption & Maintenance**

It is considered that the piped drainage system within the adoptable highway will be adopted by Yorkshire Water and the tanks will be the responsibility of a private management company.

## Proposed Drainage Strategy Area 1

It is proposed to ultimately discharge any surface water flows generated by the development of the site which cannot drain via infiltration to the 150mm diameter Yorkshire Water combined sewer located in Verona Rise to the west.

The 0.523 ha will be directed to a system of oversized pipes and a tank.

The drainage strategy utilises an appropriately sized hydro brake to restrict the flow rate to a maximum of 3.5l/s. A second hydro brake will be provided due to the steep slopes within the proposed highway. As such, the flow will vary for each of the design storms shown above and it is expected that during the more extreme return periods there will be a considerable betterment as the hydro brake is likely to restrict flows to a lesser rate than estimated at present.

Based upon the assumption that the drainage authority will agree to the maximum discharge rates of 8.6l/s, a preliminary surface water network has been developed and attenuation has been sized using MicroDrainage software.

The model data for the proposed surface water drainage network has been obtained from the proposed development layout drawing and the drainage strategy drawing is provided at Appendix C of this report. A model has been developed to represent the main drainage runs within the proposed drainage network and contributing drainage areas within the development.

Overall, the hydraulic models include the following;

- 13 pipes to represent the proposed system
- hydro-brake downstream of pond (3.5l/s)
- 1 Tank
- 1 outfall into the surface water sewer

Impermeable area contributions have been based on those supplied on the proposed layout drawing, considered to be 100% impermeable, comprising of roofed and paved areas.

The models have been set up as a fixed runoff model assuming 100% runoff coefficient for roofed and paved areas. The rainfall characteristics for Darfield have been utilised with a value for M5-60 given as 20mm (the depth of rain in a once in five years one hour duration event); and r given as 0.40 (the ratio of the M5-60 rainfall to the M5-2day rainfall). For durations over 60 minutes the FEH runoff data for Darfield has been used.

## Hydraulic Modelling Results

The proposed MicroDrainage models have been simulated with the 1 in 100 year plus climate change (40%) return period design storm events with durations of 15, 60, 180, 360, 600, 900 and 1440 minutes. At the request of the Environment Agency seven day 10080 minute duration was also undertaken. The durations were run in both Winter and Summer profiles. It was found that the Winter profile was critical.

The table overleaf shows a summary of the 1 in 100 year plus climate change model runs and the impact on the drainage system in terms of peak depth within the system and flow through the hydro-brake.

The 1440 minute duration produced the largest flow through the hydro-brake (3.0 l/s) which is less than the restricted runoff rate (3.5l/s). The modelled result for the 1440 minute Winter model run is provided at Appendix D. There was no flooding during this event.

Return Period	Duration (min)	Peak water in tank	Peak flow into sewer	Status
100 yr+CC	15min	45.138	2.2	SUR
100 yr+CC	60min	45.381	2.3	SUR
100 yr+CC	180min	45.587	2.6	SUR
100 yr+CC	360min	45.735	2.8	SUR
100 yr+CC	600min	45.829	2.9	SUR
100 yr+CC	900min	45.856	2.9	SUR
100 yr+CC	1440min	45.889	3.0	SUR

## Proposed Drainage Strategy Area 2

The total roofed and paved catchment area has been estimated at 0.043 hectares and is shown on the strategy drawing provided at Appendix C of this report. The discharge rate into the combined sewer is 3.5l/s.

An assessment of the required balance volume for the roofed and paved area has been made using the estimated post development impermeable area shown on the strategy drawing and tabulated below in Table 1. Using WinDes Source Control software developed by Microdrainage the required attenuation has been calculated for the 1 in 100 year plus climate change (40%) event.

Reference should be made to Appendix E where the calculation sheets are provided. The attenuation sizes have been tabulated below in Table 1. The drainage strategy drawing provided at Appendix C shows the location of the storage tanks.

**Table 1: Storage Volume from 430m2 area**

Return Period	Modelled total volume over duration	Attenuation type	Length	Width	Depth
100yr+CC	15.6m3	8No Crate Tank	3	2	0.4

## Crate Tank Maintenance

Following construction regular inspection is recommended. The main concern is to reduce the level of siltation entering the tank and as such a catchpit manhole should be located directly upstream of the tank to intercept any silt being washed down the surface water system. It is recommended that this manhole is lifted and inspected on a monthly basis and any silt located in the bottom removed. Furthermore the location of the tank within the site should be clearly marked on a plan. This area should also be inspected for any deformation of the topsoil/pavement which could indicate settlement or failure. A log book should be completed which will show the inspection and maintenance history of the system. The log book, site plan and construction check list should form maintenance manual for the system.

The maintenance plan has been tabulated below and will be the responsibility of the appointed management company.

<b>Maintenance Schedule</b>	<b>Required action</b>	<b>Frequency</b>
Monitoring	Inspect catchpit manhole for silt and debris	Monthly
	Inspect crate tank locations for ground deformation	3 monthly
	Inspect crate tank for silt buildup	6 monthly
Regular Maintenance	Litter and debris removal from road gullies	Monthly
	Remove silt and debris from catchpit manholes	Monthly
Occasional Maintenance	Remove silt from crate tank	6 monthly
Remedial actions	Repair deformation of topsoil once settlement stopped	As required
	Repair deformation of paved areas once settlement stopped	As required

### **3. DESIGN OF PROPOSED FOUL DRAINAGE SYSTEM**

---


#### **Existing Foul Drainage**

There is a public combined sewer within Snape Hill Road and Southview Road.


#### **Proposed Foul Drainage**

A gravity connection can be made into the Yorkshire Water public sewer within Snape Hill Road and Southview Road based on the proposed floor levels.

Appendix A: - YW Sewer Plan

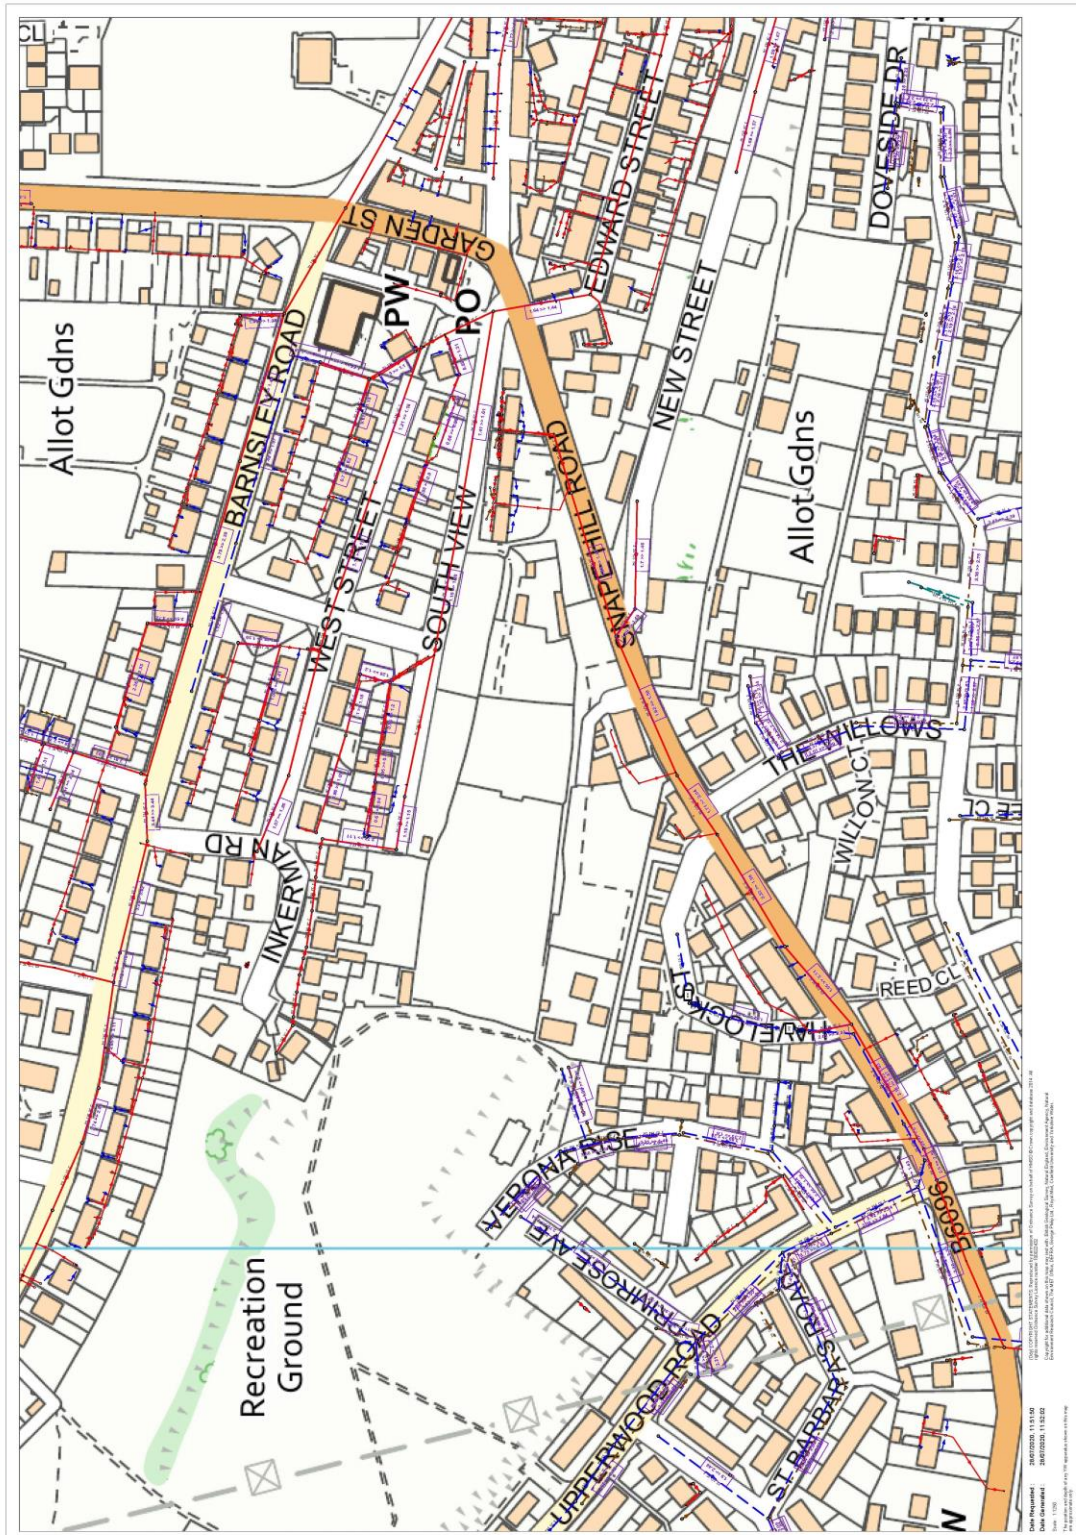



**Appendix B: - ADAS345 Runoff Calculations**


EWE Associates Ltd		Page 1
Windy Ridge Barn Thealby Lane Winterton DN15 9TG		
Date 22/10/2024 15:31 File	Designed By Lea Checked By	
Micro Drainage	Source Control W.12.4	
<u>ADAS 345 Mean Annual Flood</u>		
Input		
Area (ha)	1.313	Soil Type Factor (St) 0.450
Length (m)	65.000	Paved Area (%) 0.000
Average Slope (1:X)	5.0	Dominant Crop Type Grass
AAR (mm)	608	Region Number Region 3
<b>Results</b>		
		<b>l/s</b>
Q0 - Peak Flood Flow	7.4	
Total Q0	7.4	
QBAR	8.6	
Q1 year	7.4	
Q1 year	7.4	
Q2 years	8.1	
Q5 years	10.8	
Q10 years	12.5	
Q20 years	14.2	
Q25 years	14.7	
Q30 years	15.2	
Q50 years	16.4	
Q100 years	18.0	
Q200 years	20.4	
Q250 years	21.2	
Q1000 years	26.3	
©1982-2010 Micro Drainage Ltd		





**Appendix D: - Area 1 -WinDes drainage Calculations Sheets**

EWE Associates Ltd		Page 1							
Windy Ridge Barn Thealby Lane Winterton DN15 9TG									
Date 17/04/2026 09:43 File 100yr+CC40%Winter...	Designed By Lea Checked By								
Micro Drainage		Network W.12.4							
<u>Existing Network Details for Storm</u>									
PN	Length (m)	Fall (m)	Slope (1:X)	Area (ha)	T.E. (mins)	k (mm)	HYD SECT	DIA (mm)	
1.000	15.000	0.030	500.0	0.035	4.00	0.600	∞	600	
1.001	53.400	0.117	456.4	0.083	0.00	0.600	∞	600	
1.002	58.400	0.131	445.8	0.121	0.00	0.600	∞	600	
1.003	11.800	0.024	491.7	0.013	0.00	0.600	∞	600	
2.000	15.600	0.704	22.2	0.027	4.00	0.600	o	300	
3.000	12.500	0.042	297.6	0.029	4.00	0.600	o	300	
2.001	35.600	2.023	17.6	0.047	0.00	0.600	o	450	
2.002	56.600	3.636	15.6	0.095	0.00	0.600	o	450	
4.000	22.800	2.280	10.0	0.041	4.00	0.600	o	300	
2.003	25.700	1.764	14.6	0.038	0.00	0.600	o	600	
5.000	11.200	0.023	487.0	0.000	4.00	0.600	o	600	
1.004	40.700	0.271	150.2	0.000	0.00	0.600	o	150	
1.005	22.200	0.148	150.0	0.000	0.00	0.600	o	150	
PN	US/MH Name	US/CL (m)	US/IL (m)	US C.Depth (m)	DS/CL (m)	DS/IL (m)	DS C.Depth (m)	Ctrl	US/MH (mm)
1.000	1	46.833	44.987	1.246	48.275	44.957	2.718		1800
1.001	2	48.275	44.957	2.718	47.750	44.840	2.310		1800
1.002	3	47.750	44.840	2.310	46.260	44.709	0.951		1800
1.003	4	46.260	44.709	0.951	46.400	44.685	1.115		1800
2.000	5	54.412	52.812	1.300	54.029	52.108	1.621		1500
3.000	6	53.650	52.150	1.200	54.029	52.108	1.621		1500
2.001	7	54.029	52.108	1.471	51.885	50.085	1.350		1500
2.002	8	51.885	50.085	1.350	48.249	46.449	1.350		1500
4.000	9	50.685	48.729	1.656	48.249	46.449	1.500		1500
2.003	10	48.249	46.449	1.200	46.400	44.685	1.115		1500
5.000	11	46.400	44.708	1.092	46.400	44.685	1.115		1500
1.004	12	46.400	44.685	1.565	46.000	44.414	1.436	Hydro-Brake®	3000
1.005	13	46.000	44.414	1.436	45.666	44.266	1.250		1500
©1982-2010 Micro Drainage Ltd									

EWE Associates Ltd		Page 2				
Windy Ridge Barn Thealby Lane Winterton DN15 9TG						
Date 17/04/2026 09:43 File 100yr+CC40%Winter...	Designed By Lea Checked By					
Micro Drainage	Network W.12.4					
<u>Free Flowing Outfall Details for Storm</u>						
<b>Outfall Pipe Number</b>	<b>Outfall Name</b>	<b>C. Level (m)</b>	<b>I. Level (m)</b>	<b>Min I. Level (m)</b>	<b>D,L (mm)</b>	<b>W (mm)</b>
1.005		45.666	44.266	44.266	0	0
<u>Simulation Criteria for Storm</u>						
Volumetric Runoff Coeff	0.840	Foul Sewage per hectare (l/s)	0.000			
PIMP (% impervious)	100	Additional Flow - % of Total Flow	40.000			
Areal Reduction Factor	1.000	MADD Factor * 10m <sup>3</sup> /ha Storage	0.000			
Hot Start (mins)	0	Run Time (mins)	2880			
Hot Start Level (mm)	0	Output Interval (mins)	24			
Manhole Headloss Coeff (Global)	0.500					
Number of Input Hydrographs	0	Number of Storage Structures	1			
Number of Online Controls	1	Number of Time/Area Diagrams	0			
Number of Offline Controls	0					
<u>Synthetic Rainfall Details</u>						
Rainfall Model			FEH			
Return Period (years)			100			
Site Location	441350	403850	SE	41350	03850	
C (1km)			-0.025			
D1 (1km)			0.356			
D2 (1km)			0.406			
D3 (1km)			0.248			
E (1km)			0.301			
F (1km)			2.361			
Summer Storms			No			
Winter Storms			Yes			
Cv (Summer)			0.750			
Cv (Winter)			0.840			
Storm Duration (mins)			1440			
©1982-2010 Micro Drainage Ltd						

EWE Associates Ltd		Page 3	
Windy Ridge Barn Thealby Lane Winterton DN15 9TG			
Date 17/04/2026 09:43	Designed By Lea		
File 100yr+CC40&Winter...	Checked By		
Micro Drainage	Network W.12.4		
<u>Online Controls for Storm</u>			
<u>Hydro-Brake® Manhole: 12, DS/PN: 1.004, Volume (m³): 26.6</u>			
Design Head (m)	1.700	Hydro-Brake® Type	Md4
Invert Level (m)	44.685	Diameter (mm)	59
Design Flow (l/s)	3.5		
<b>Depth (m)</b>	<b>Flow (l/s)</b>	<b>Depth (m)</b>	<b>Flow (l/s)</b>
0.100	1.6	1.200	3.0
0.200	1.4	1.400	3.2
0.300	1.5	1.600	3.4
0.400	1.7	1.800	3.6
0.500	1.9	2.000	3.8
0.600	2.1	2.200	4.0
0.800	2.4	2.400	4.2
1.000	2.7	2.600	4.4
		3.000	4.7
		3.500	5.1
		4.000	5.4
		4.500	5.8
		5.000	6.1
		5.500	6.4
		6.000	6.6
		6.500	6.9
		7.000	7.2
		7.500	7.4
		8.000	7.7
		8.500	7.9
		9.000	8.1
		9.500	8.4
©1982-2010 Micro Drainage Ltd			

EWE Associates Ltd		Page 4					
Windy Ridge Barn Thealby Lane Winterton DN15 9TG							
Date 17/04/2026 09:43 File 100yr+CC40%Winter...	Designed By Lea Checked By						
Micro Drainage		Network W.12.4					
<u>Storage Structures for Storm</u>							
<u>Tank or Pond Manhole: 11, DS/PN: 5.000</u>							
Invert Level (m) 44.708							
<b>Depth (m)</b>	<b>Area (m<sup>2</sup>)</b>	<b>Depth (m)</b>	<b>Area (m<sup>2</sup>)</b>	<b>Depth (m)</b>	<b>Area (m<sup>2</sup>)</b>	<b>Depth (m)</b>	<b>Area (m<sup>2</sup>)</b>
0.000	260.0	1.400	0.0	2.800	0.0	4.200	0.0
0.200	260.0	1.600	0.0	3.000	0.0	4.400	0.0
0.400	260.0	1.800	0.0	3.200	0.0	4.600	0.0
0.600	260.0	2.000	0.0	3.400	0.0	4.800	0.0
0.800	260.0	2.200	0.0	3.600	0.0	5.000	0.0
1.000	260.0	2.400	0.0	3.800	0.0		
1.200	260.0	2.600	0.0	4.000	0.0		
©1982-2010 Micro Drainage Ltd							

EWE Associates Ltd		Page 5
Windy Ridge Barn Thealby Lane Winterton DN15 9TG		
Date 17/04/2026 09:43 File 100yr+CC40%Winter...	Designed By Lea Checked By	
Micro Drainage	Network W.12.4	

Summary of Results for 1440 minute 100 year Winter (Storm)

Margin for Flood Risk Warning (mm) 450.0

Analysis Timestep 2.5 Second Increment (Extended)

DTS Status ON

DVD Status ON

Inertia Status ON


  


PN	US/MH Name	Water Level (m)	Surcharged Depth (m)	Flooded Volume (m <sup>3</sup> )	Flow / Cap.	Overflow (l/s)	Pipe Flow (l/s)	Status
1.000	1	45.898	0.311	0.000	0.00	0.0	1.0	SURCHARGED
1.001	2	45.899	0.342	0.000	0.01	0.0	3.0	SURCHARGED
1.002	3	45.906	0.466	0.000	0.01	0.0	5.7	SURCHARGED
1.003	4	45.906	0.597	0.000	0.02	0.0	5.9	FLOOD RISK
2.000	5	52.818	-0.294	0.000	0.00	0.0	0.9	OK
3.000	6	52.175	-0.275	0.000	0.02	0.0	0.9	OK
2.001	7	52.118	-0.440	0.000	0.00	0.0	3.3	OK
2.002	8	50.103	-0.432	0.000	0.01	0.0	6.4	OK
4.000	9	48.735	-0.294	0.000	0.00	0.0	1.3	OK
2.003	10	46.468	-0.581	0.000	0.01	0.0	8.9	OK
5.000	11	45.889	0.581	0.000	0.02	0.0	2.7	SURCHARGED
1.004	12	45.907	1.072	0.000	0.21	0.0	3.0	SURCHARGED
1.005	13	44.461	-0.103	0.000	0.22	0.0	3.0	OK


©1982-2010 Micro Drainage Ltd


Appendix E: -

Area 2 -WinDes drainage Calculations Sheets

EWE Associates Ltd		Page 1			
Windy Ridge Barn Thealby Lane Winterton DN15 9TG					
Date 22/10/2024 14:22	Designed By Lea				
File 100yr+CC40% tank ...	Checked By				
Micro Drainage	Source Control W.12.4				
<u>Summary of Results for 100 year Return Period (+40%)</u>					
<b>Storm Event</b>	<b>Max Level (m)</b>	<b>Max Depth (m)</b>	<b>Max Control (l/s)</b>	<b>Max Volume (m³)</b>	<b>Status</b>
15 min Summer	54.639	0.339	2.4	12.2	O K
30 min Summer	54.672	0.372	2.4	13.4	O K
60 min Summer	54.682	0.382	2.4	13.7	O K
120 min Summer	54.670	0.370	2.4	13.3	O K
180 min Summer	54.648	0.348	2.4	12.5	O K
240 min Summer	54.623	0.323	2.4	11.6	O K
360 min Summer	54.573	0.273	2.4	9.8	O K
480 min Summer	54.521	0.221	2.4	7.9	O K
600 min Summer	54.472	0.172	2.4	6.2	O K
720 min Summer	54.443	0.143	2.4	5.1	O K
960 min Summer	54.416	0.116	2.3	4.2	O K
1440 min Summer	54.394	0.094	1.8	3.4	O K
2160 min Summer	54.378	0.078	1.4	2.8	O K
2880 min Summer	54.369	0.069	1.2	2.5	O K
4320 min Summer	54.357	0.057	0.8	2.0	O K
5760 min Summer	54.350	0.050	0.7	1.8	O K
7200 min Summer	54.345	0.045	0.5	1.6	O K
8640 min Summer	54.342	0.042	0.5	1.5	O K
10080 min Summer	54.339	0.039	0.4	1.4	O K
<b>Storm Event</b>	<b>Rain (mm/hr)</b>	<b>Time-Peak (mins)</b>			
15 min Summer	169.749	17			
30 min Summer	100.305	31			
60 min Summer	59.271	52			
120 min Summer	35.023	84			
180 min Summer	25.746	120			
240 min Summer	20.695	154			
360 min Summer	15.213	222			
480 min Summer	12.229	284			
600 min Summer	10.324	336			
720 min Summer	8.990	388			
960 min Summer	7.331	502			
1440 min Summer	5.499	736			
2160 min Summer	4.125	1100			
2880 min Summer	3.364	1468			
4320 min Summer	2.367	2200			
5760 min Summer	1.845	2928			
7200 min Summer	1.520	3672			
8640 min Summer	1.298	4376			
10080 min Summer	1.135	5136			
©1982-2010 Micro Drainage Ltd					

EWE Associates Ltd		Page 2			
Windy Ridge Barn Thealby Lane Winterton DN15 9TG					
Date 22/10/2024 14:22 File 100yr+CC40% tank ...	Designed By Lea Checked By				
Micro Drainage	Source Control W.12.4				
<u>Summary of Results for 100 year Return Period (+40%)</u>					
<b>Storm Event</b>	<b>Max Level (m)</b>	<b>Max Depth (m)</b>	<b>Max Control (l/s)</b>	<b>Max Volume (m³)</b>	<b>Status</b>
15 min Winter	54.683	0.383	2.4	13.8	O K
30 min Winter	54.724	0.424	2.4	15.2	O K
60 min Winter	54.738	0.438	2.4	15.6	O K
120 min Winter	54.715	0.415	2.4	14.9	O K
180 min Winter	54.680	0.380	2.4	13.7	O K
240 min Winter	54.643	0.343	2.4	12.3	O K
360 min Winter	54.561	0.261	2.4	9.4	O K
480 min Winter	54.471	0.171	2.4	6.2	O K
600 min Winter	54.428	0.128	2.4	4.6	O K
720 min Winter	54.410	0.110	2.2	4.0	O K
960 min Winter	54.393	0.093	1.8	3.3	O K
1440 min Winter	54.377	0.077	1.4	2.8	O K
2160 min Winter	54.365	0.065	1.0	2.3	O K
2880 min Winter	54.358	0.058	0.9	2.1	O K
4320 min Winter	54.348	0.048	0.6	1.7	O K
5760 min Winter	54.343	0.043	0.5	1.5	O K
7200 min Winter	54.339	0.039	0.4	1.4	O K
8640 min Winter	54.336	0.036	0.3	1.3	O K
10080 min Winter	54.334	0.034	0.3	1.2	O K
<b>Storm Event</b>	<b>Rain (mm/hr)</b>	<b>Time-Peak (mins)</b>			
15 min Winter	169.749	17			
30 min Winter	100.305	31			
60 min Winter	59.271	58			
120 min Winter	35.023	92			
180 min Winter	25.746	130			
240 min Winter	20.695	166			
360 min Winter	15.213	238			
480 min Winter	12.229	288			
600 min Winter	10.324	332			
720 min Winter	8.990	386			
960 min Winter	7.331	502			
1440 min Winter	5.499	738			
2160 min Winter	4.125	1096			
2880 min Winter	3.364	1436			
4320 min Winter	2.367	2176			
5760 min Winter	1.845	2928			
7200 min Winter	1.520	3600			
8640 min Winter	1.298	4360			
10080 min Winter	1.135	5032			
©1982-2010 Micro Drainage Ltd					

EWE Associates Ltd		Page 3
Windy Ridge Barn Thealby Lane Winterton DN15 9TG		
Date 22/10/2024 14:22 File 100yr+CC40% tank ...	Designed By Lea Checked By	
Micro Drainage	Source Control W.12.4	
<u>Rainfall Details</u>		
Rainfall Model	FEH	
Return Period (years)	100	
Site Location	441350 403850 SE 41350 03850	
C (1km)	-0.025	
D1 (1km)	0.356	
D2 (1km)	0.406	
D3 (1km)	0.248	
E (1km)	0.301	
F (1km)	2.361	
Summer Storms	Yes	
Winter Storms	Yes	
Cv (Summer)	0.750	
Cv (Winter)	0.840	
Shortest Storm (mins)	15	
Longest Storm (mins)	10080	
Climate Change %	+40	
<u>Time / Area Diagram</u>		
Total Area (ha) 0.043		
<b>Time</b> <b>(mins)</b>	<b>Area</b> <b>(ha)</b>	
0-4	0.043	
©1982-2010 Micro Drainage Ltd		

EWE Associates Ltd		Page 4					
Windy Ridge Barn Thealby Lane Winterton DN15 9TG							
Date 22/10/2024 14:22 File 100yr+CC40% tank ...	Designed By Lea Checked By						
Micro Drainage		Source Control W.12.4					
<u>Model Details</u>							
Storage is Online Cover Level (m) 55.500							
<u>Tank or Pond Structure</u>							
Invert Level (m) 54.300							
<b>Depth (m)</b>	<b>Area (m<sup>2</sup>)</b>	<b>Depth (m)</b>	<b>Area (m<sup>2</sup>)</b>	<b>Depth (m)</b>	<b>Area (m<sup>2</sup>)</b>	<b>Depth (m)</b>	<b>Area (m<sup>2</sup>)</b>
0.000	36.0	1.400	0.0	2.800	0.0	4.200	0.0
0.200	36.0	1.600	0.0	3.000	0.0	4.400	0.0
0.400	36.0	1.800	0.0	3.200	0.0	4.600	0.0
0.600	0.0	2.000	0.0	3.400	0.0	4.800	0.0
0.800	0.0	2.200	0.0	3.600	0.0	5.000	0.0
1.000	0.0	2.400	0.0	3.800	0.0		
1.200	0.0	2.600	0.0	4.000	0.0		
<u>Hydro-Brake® Outflow Control</u>							
Design Head (m)	1.000	Hydro-Brake® Type	Md4	Invert Level (m)	54.300		
Design Flow (l/s)	3.5	Diameter (mm)	68				
<b>Depth (m)</b>	<b>Flow (l/s)</b>	<b>Depth (m)</b>	<b>Flow (l/s)</b>	<b>Depth (m)</b>	<b>Flow (l/s)</b>	<b>Depth (m)</b>	<b>Flow (l/s)</b>
0.100	2.0	1.200	3.9	3.000	6.2	7.000	9.4
0.200	2.1	1.400	4.2	3.500	6.6	7.500	9.7
0.300	2.0	1.600	4.5	4.000	7.1	8.000	10.0
0.400	2.3	1.800	4.8	4.500	7.5	8.500	10.4
0.500	2.5	2.000	5.0	5.000	7.9	9.000	10.7
0.600	2.8	2.200	5.3	5.500	8.3	9.500	10.9
0.800	3.2	2.400	5.5	6.000	8.7		
1.000	3.6	2.600	5.7	6.500	9.1		
©1982-2010 Micro Drainage Ltd							