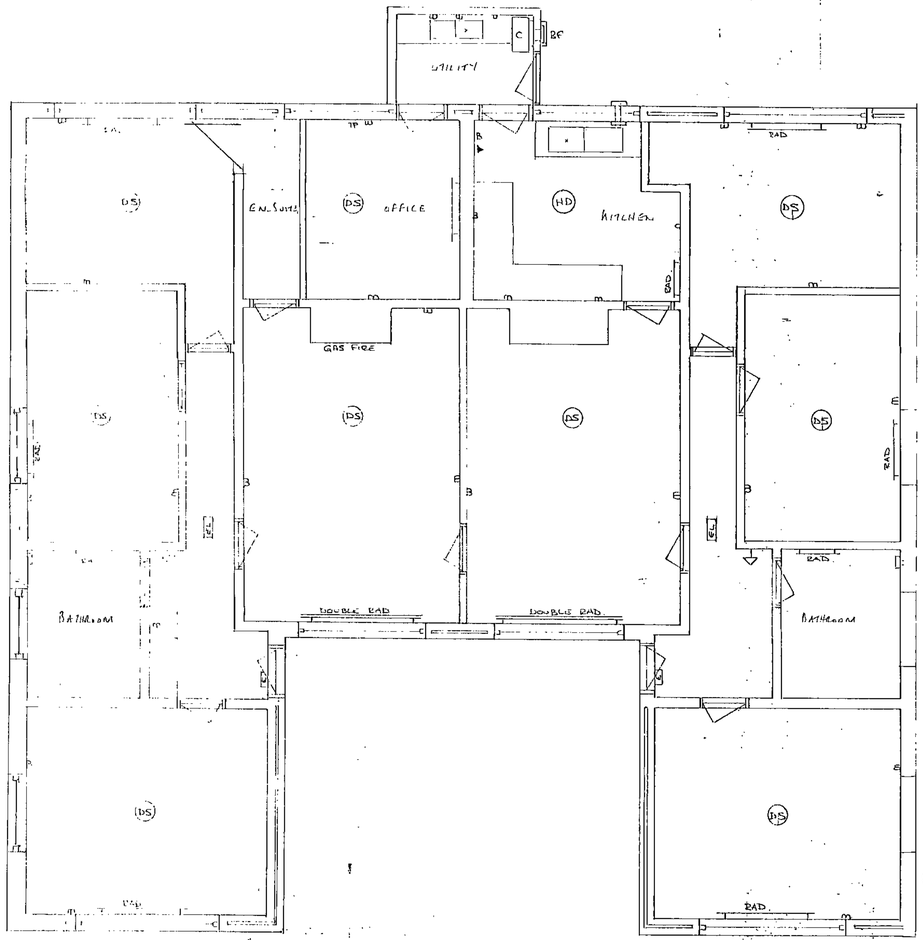


EXISTING GROUND FLOOR PLAN

KEY

(S)	SMOKE DETECTORS
FB	FIRE BLANKET.
◀	DRY POWDER FIRE EXTINGUISHER
◀	GL WATER EXTINGUISHER.
(M)	MECHANICAL EXTRACTOR.
S	SINGLE SOCKET
D	DOUBLE SOCKET
B	BALANCED FLUE
C	COMBINATION BOILER.
EL	EMERGENCY LIGHTING.
(HD)	HEAT DETECTOR

Barnsley Metropolitan Borough Council
BUILDING REGULATIONS
APPROVED
PLAN NO 93/3516/FC

RECEIVED
14 JUN 1993
BARNSLEY M.B.C.
BUILDING CONTROL

NOTES

UTILISE EXISTING SERVICES WHERE EVER POSSIBLE, CONTRACTOR TO LIAISE WITH CLIENT.

ELECTRICAL SYSTEMS TO BE BROUGHT UPTO CURRENT STANDARD BY APPROVED ELECTRICIAN WHO WILL ISSUE IEE CERTIFICATE.

FIRE ALARM SYSTEM TO COMPLY WITH B.S. 5839.

EMERGENCY LIGHTING TO COMPLY WITH B.S. 5266.

DESIGN OF HEATING BOILER AND RADIATORS TO BE CONFIRMED WITH APPROVED PLUMBER.

SWITCHES & LIGHTS TO BE AS EXISTING EXCEPT IN OFFICE AND KITCHEN WHERE DOUBLE FLUORESCENT LIGHTS WITH DEFUSERS TO BE USED.

ALL DETECTORS TO BE INTER-CONNECTING.

EMERGENCY LIGHTING EXTENDED TO FINAL EXITS. & BE 1hr NON-MAINTAINED SYSTEM.

CONDITIONAL APPROVAL

RECEIVED
19 JUL 2011
BARNSLEY M.B.C.
BUILDING CONTROL

Barnsley Metropolitan Borough Council
BUILDING REGULATIONS
APPROVED
PLAN No. 11/0566/FL

18 JUL 2011

Rev A. HEAT DETECTOR & NOTES ADDED 9/4/98

DRAWING TITLE
LAYOUT OF SERVICES


PROJECT
PROPOSED CHILDREN'S HOME

ADDRESS
398 PONTEFRACT ROAD
LUNDWOOD
BARNSLEY

SCALE
1:50

DRAWING No.
CH/01/03A

RECEIVED
19 AUG 2011

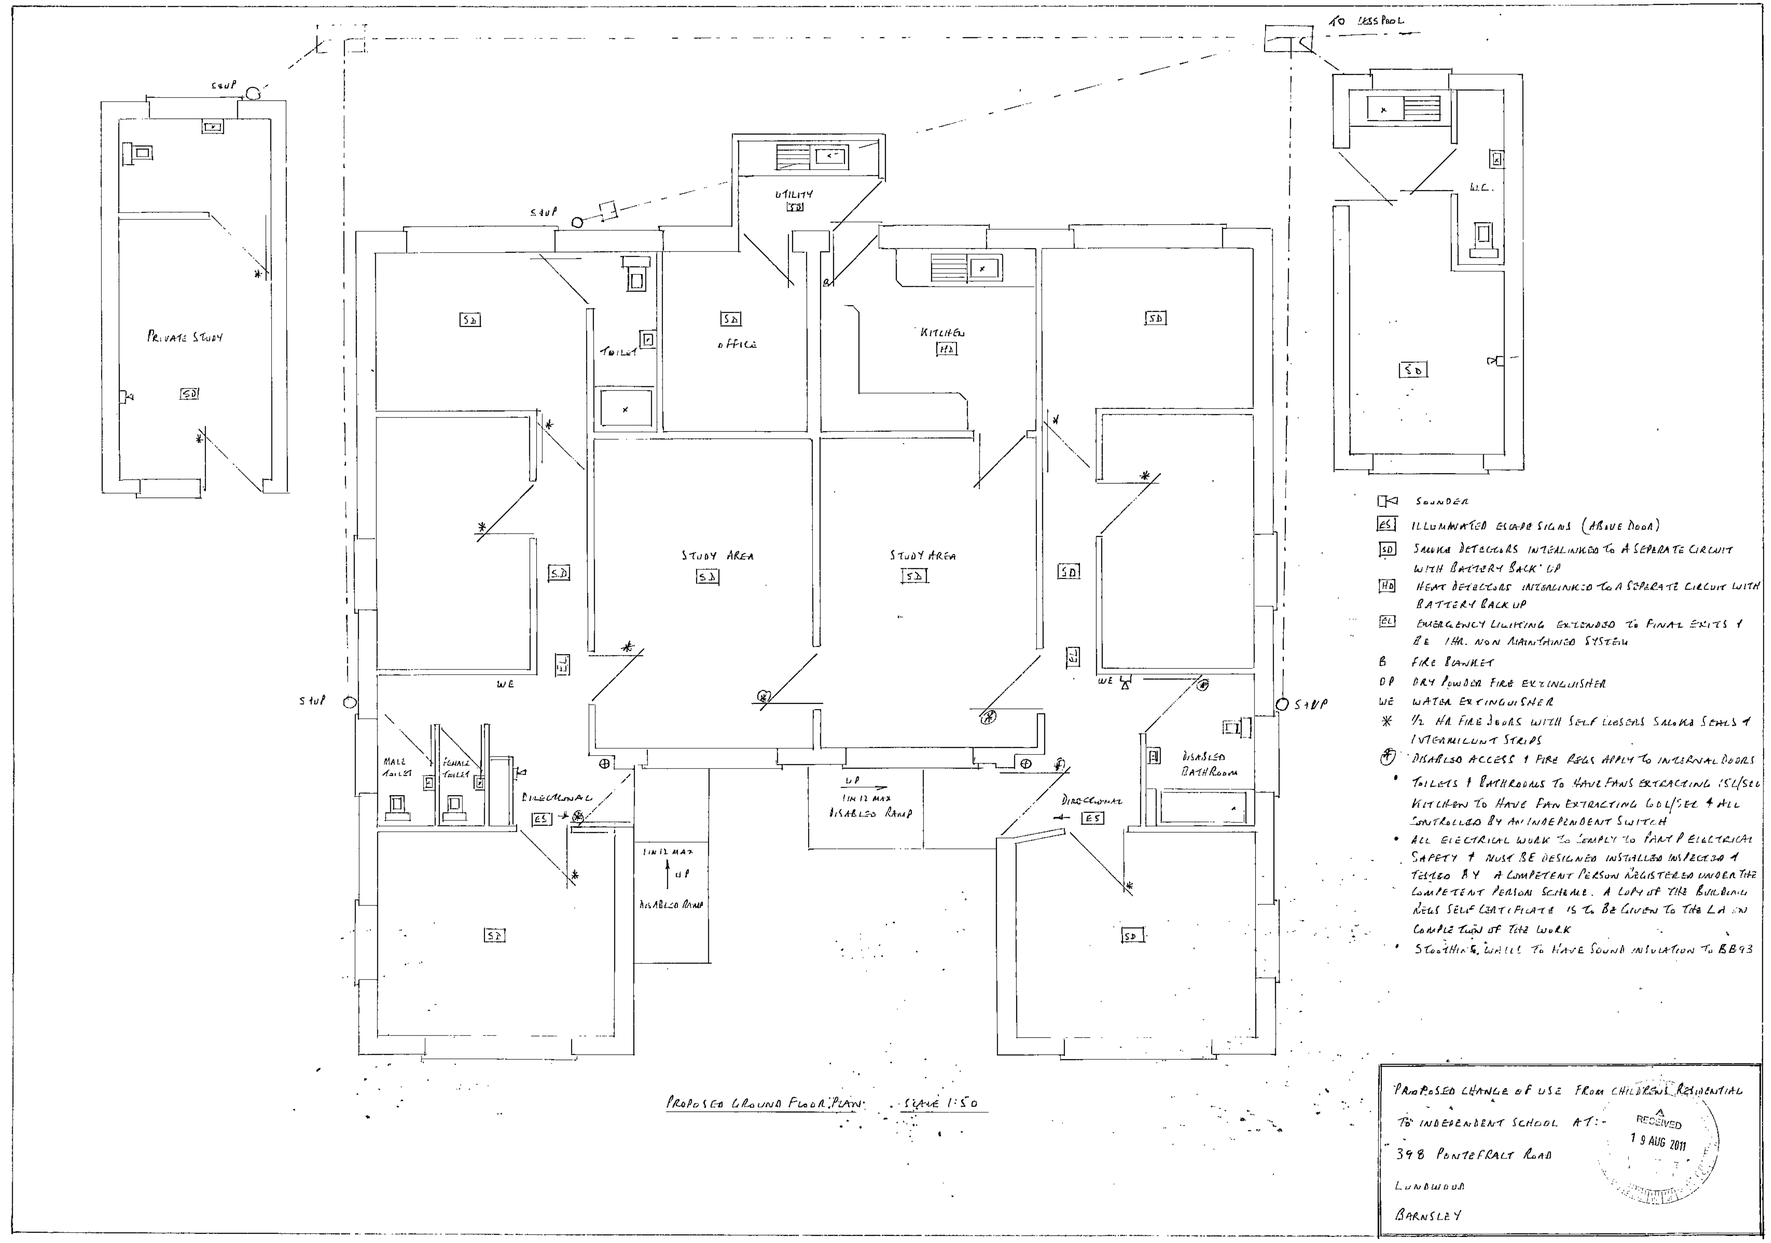

PROPOSED GROUND FLOOR PLAN SCALE 1:50

PROPOSED CHANGE OF USE FROM CHILDRENS RESIDENTIAL TO INDEPENDENT SCHOOL AT:-

398 PONTEFRACT ROAD

LUNDWOOD

BARNSLEY

RECEIVED
19 AUG 2011