

DRAWN USING AUTOCAD

FOUL WATER MCC KIOSK PLINTH DETAIL

Kiosk 1350 high
Kiosk Complies With Yorkshire water's SFA 6th Ed. Addendum

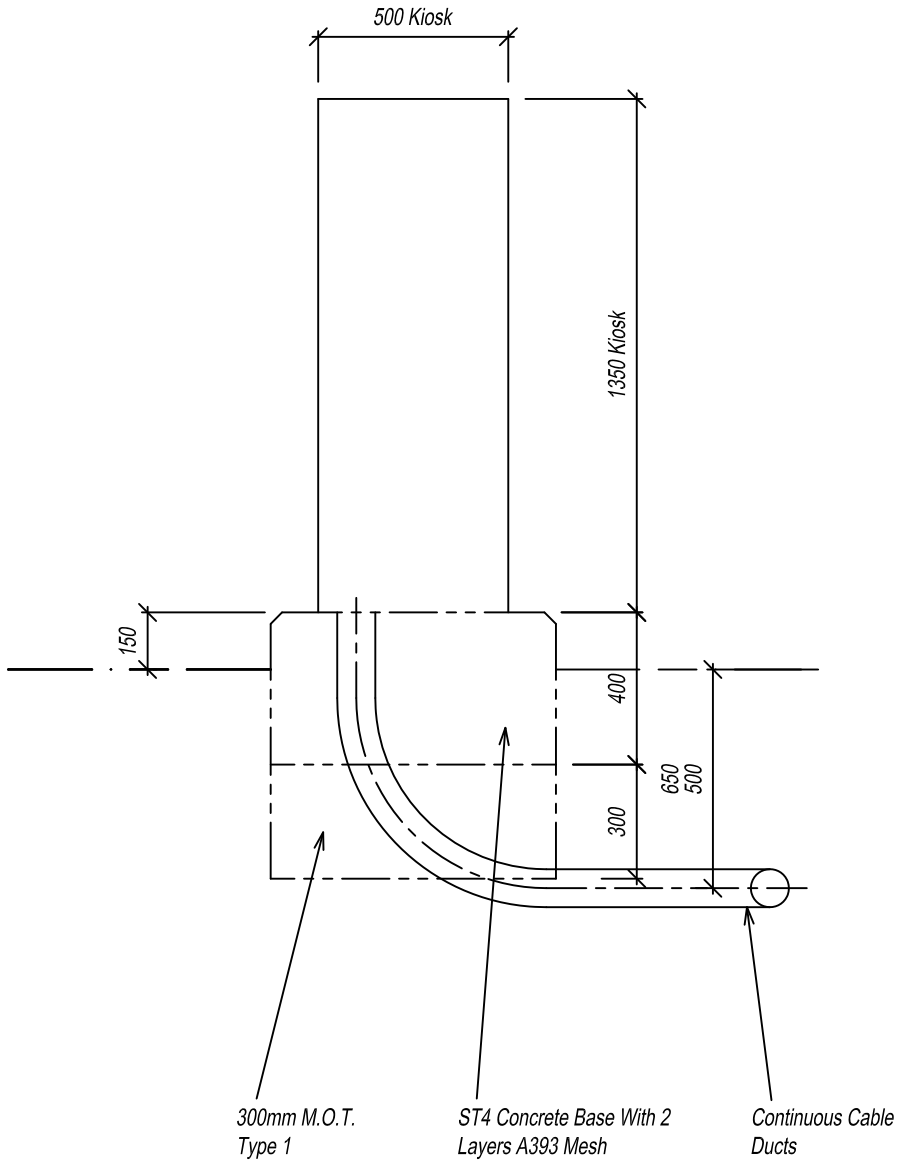

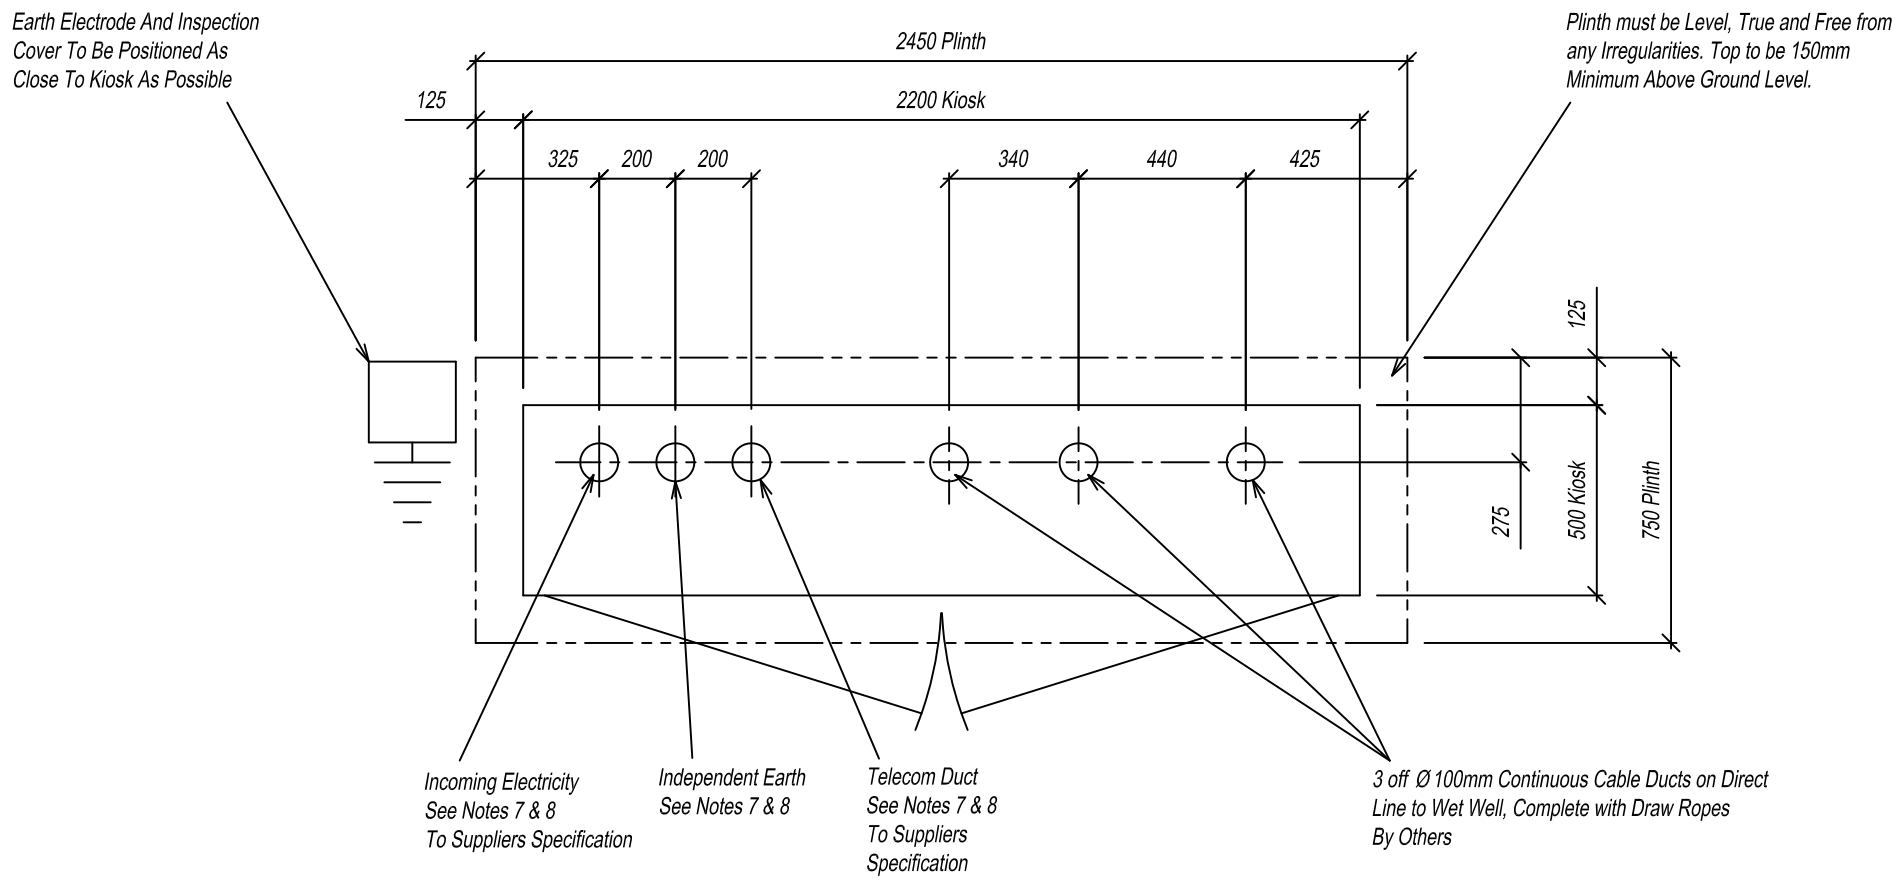

Tolerance on Duct Centre Positions ±10mm

All Ducts To Be Cut Level With Top Of Plinth

When The Installation Is Complete All Cable Ducts To Be Sealed To A Minimum Depth Of 100mm Maximum Depth Of 150mm With An Approved Polyurethane Foam Impervious To Water And Gas.

Kiosk doors fitted with triangular keyed camlocks at the top and bottom of each door and a secure hardened hasp and staple sized to take a padlock.

All cable ducts to be sealed in the kiosk and capped with a with a gas tight sealing putty 10ATEX 137 directive.

The kiosk must be located a min. 2m away from the wet well and valve chamber.

When The Installation Is Complete All Cable Ducts To Be Sealed To A Minimum Depth Of 100mm Maximum Depth Of 150mm With An Approved Polyurethane Foam Impervious To Water And Gas.

PIMS PUMPS LTD.
Unit 1, 106 Hawley Lane, Farnborough, Hampshire GU14 8JE
Telephone No. (01252) 513366 Fax No. (01252) 532695

FOUL WATER PUMPING STATION
BARNBURGH LANE
GOLDTHORPE

CLIENT GLEESON HOMES					
PR. REF. 17717	SCALE AT A1 1:10	SCALE AT A3 1:20	CHKd. C.A.R.	DATE 09-05-2012	
DRG. No. A 5514 - 03	©		DR'n. T.McE.	DATE 04-05-2012	