


**IT Trenching Works  
Wentworth Castle  
Gardens  
Oct 2018**

**All chambers JMF 104  
(internal dim 915mm x 445mm)  
except Long Barn chamber which  
should be JMF 106 (1310 x 610mm)**

**Red line: New excavation and 2No.  
100mm ducts in same trench.**

**Blue line: New excavation and 1no.  
100 mm duct**

**Yellow: No excavation - existing  
service run - 1no. 100mm duct**



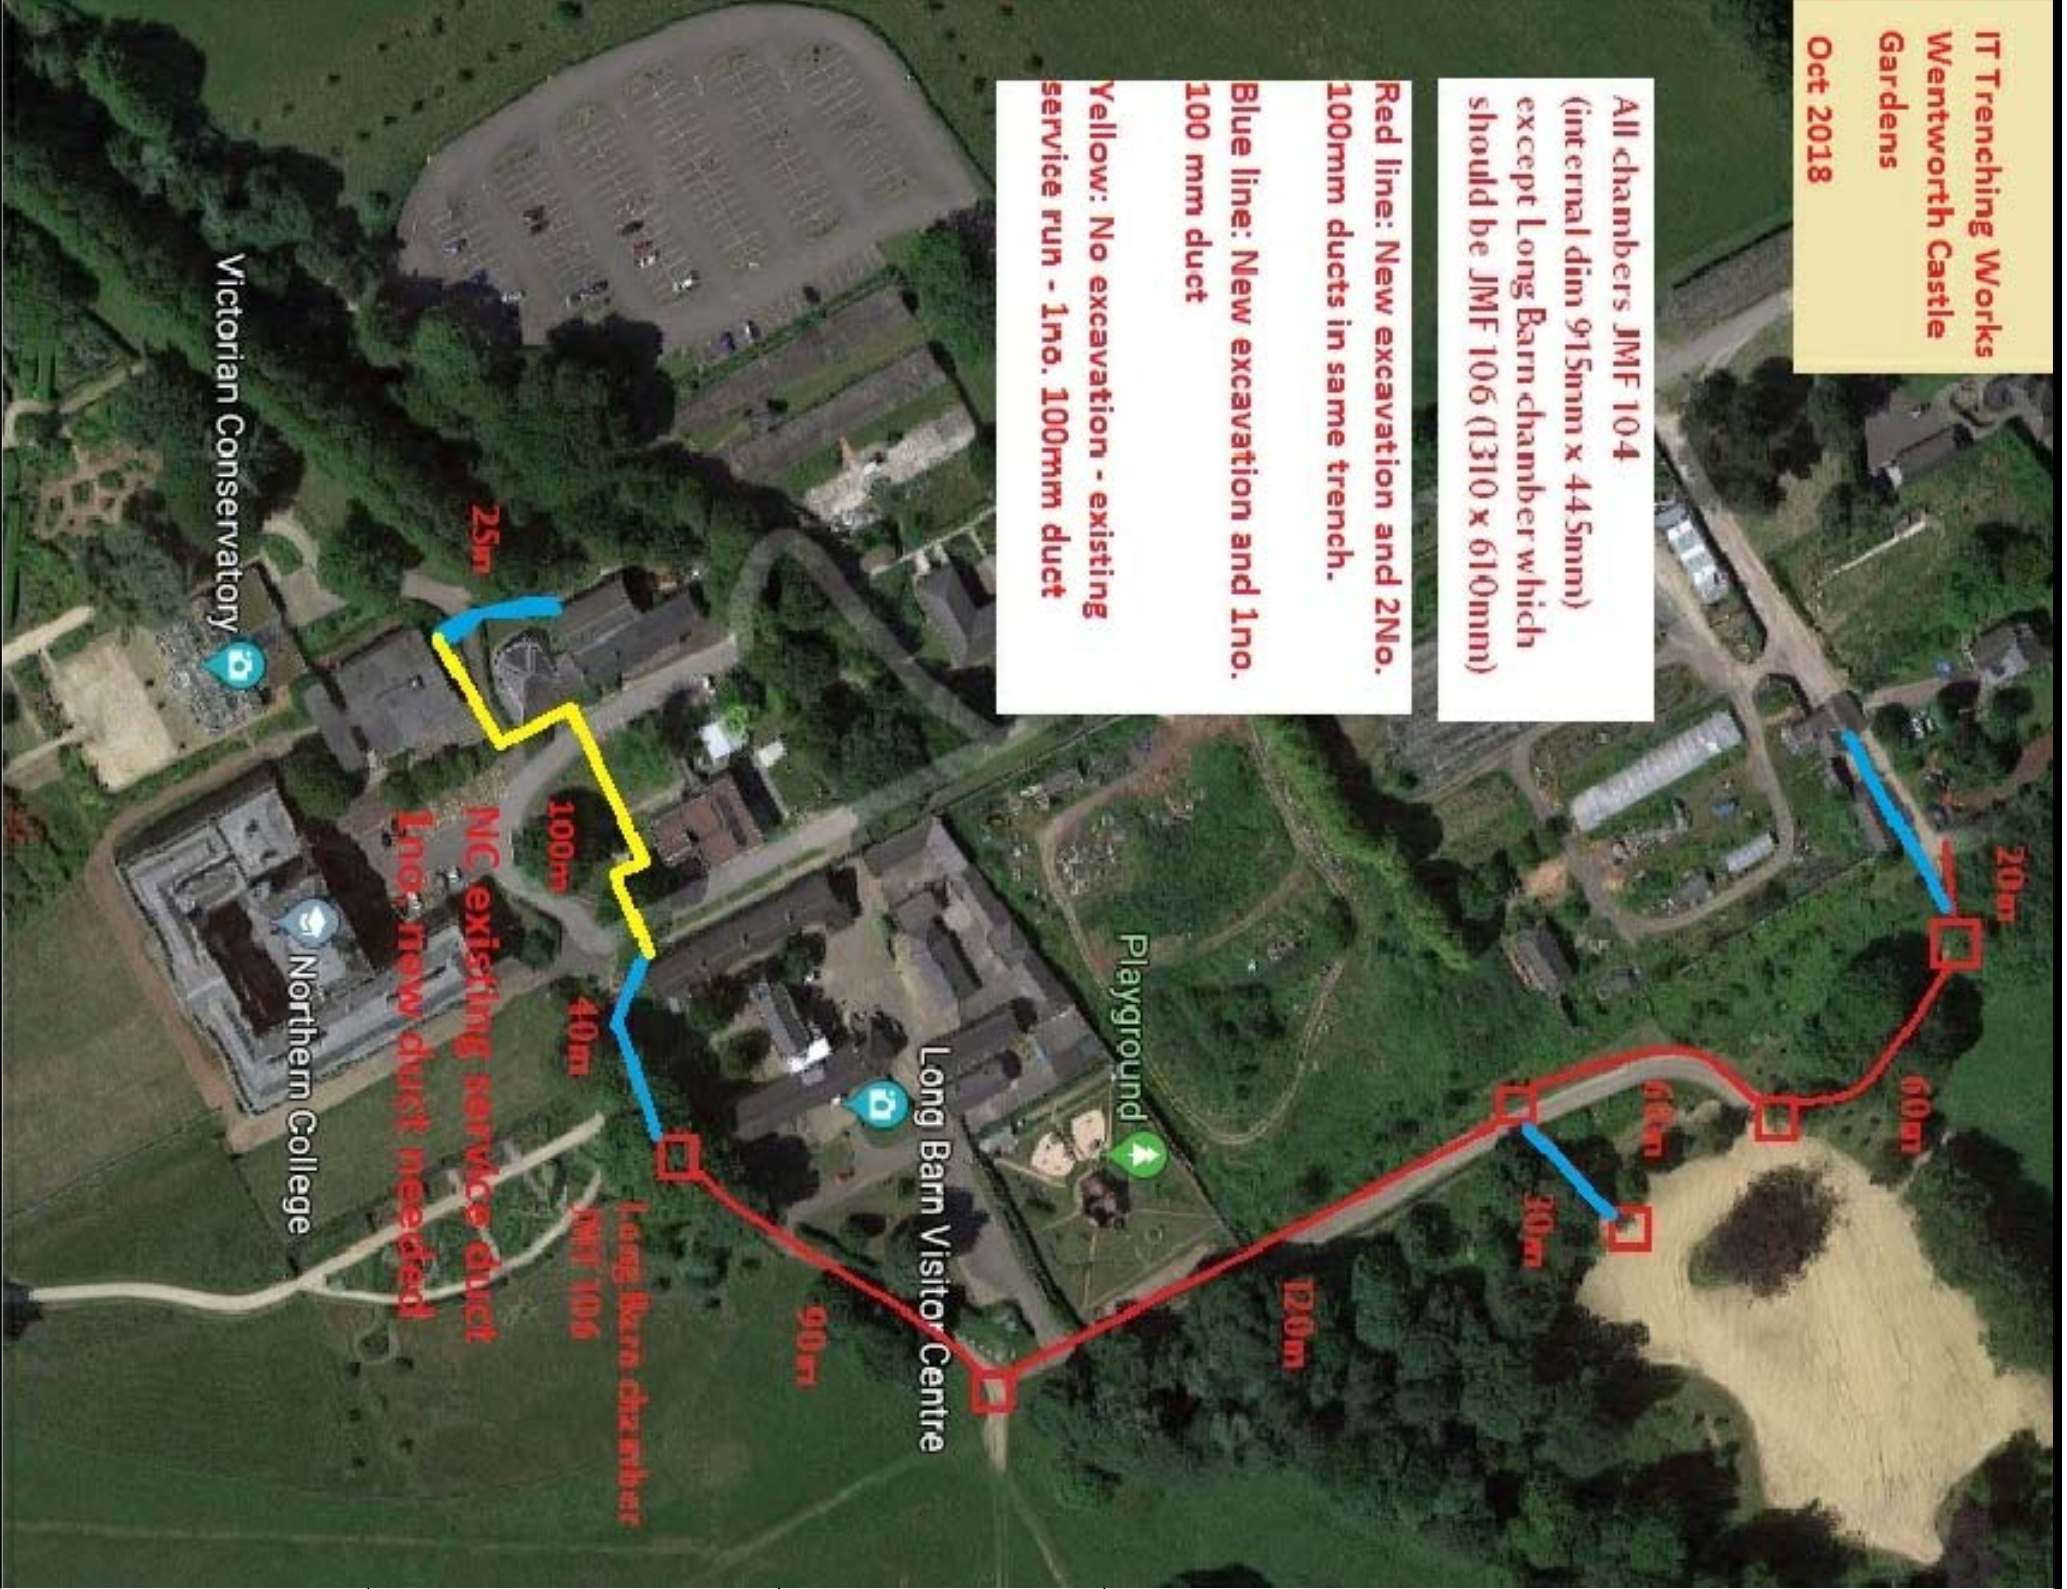


**DO NOT SCALE**


This drawing must not be scaled.  
The Principal Contractor is to verify all dimensions, levels and datum prior to commencement of work.  
Any discrepancies are to be reported immediately to the Building Supervisor.  
Variations and modifications to the work shown on these drawings are not to be carried out without the written permission of the Project Manager.  
This drawing is the property of the National Trust. The information shown is to be treated as confidential and must not be copied, reproduced or disclosed to any third person without the National Trust's written permission.  
Maps are reproduced by permission of Ordnance Survey © Crown Copyright and database right 2017

Excavations for IT infrastructure: contractor to excavate trench to a minimum depth of 450mm and 350mm wide. For heavily trafficked areas the depth should be increased to 600mm. For stony/rocky ground the duct should be laid in a bed of sand or pea gravel to prevent damage during backfill and movement.  
Ducting: Supply and install 100mm H.D.P.E duct as per layout drawing. Duct to have 3.5mm or 5mm wall thickness. The internal wall of the duct must be smooth to prevent snagging.  
Access pits: these will be installed between 75m to 100m along the run and at any point where there is a bend in the route as per drawing.  
The bottom of the access pit will be prepared with type 1 material to form a hard standing base. The pits will then be installed as per manufacturers instructions. Composite covers with steel frames complete this structure. Lids are available to withstand different loads and will be fitted accordingly. Lids should be concrete infill for roadways and recessed for grassed areas.  
Power and data separation: separate ducts installed to prevent interference between power and data. Power must not be above IT in the trench. If the trench is too narrow for side by side then IT must go at the top above power and 60mm apart (B57671-92). Water pipes must always be in the bottom of the trench to prevent any interference.

Trench Depths Section scales: 1:20

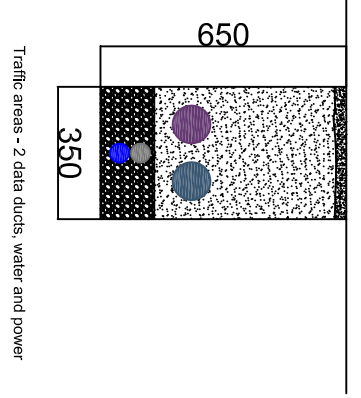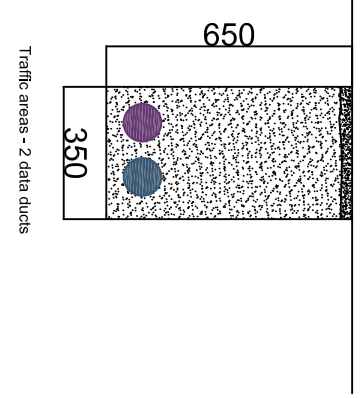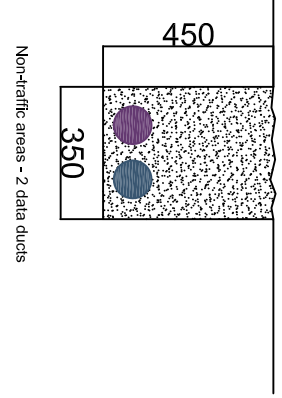

Access Pits Plan scales: 1:20

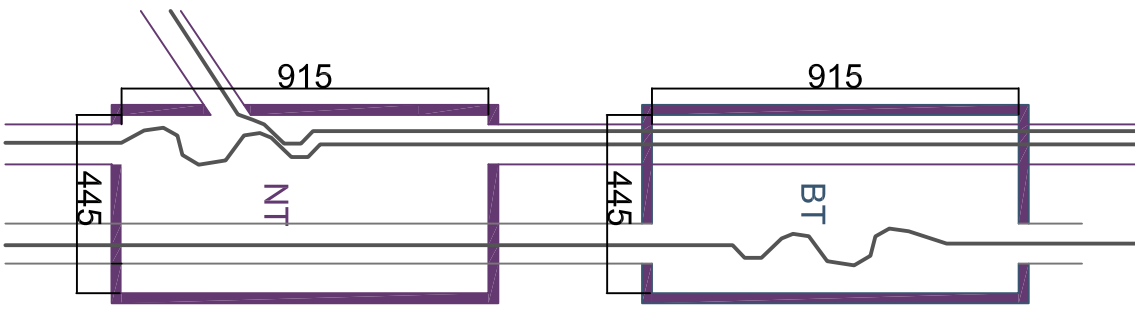

<p><b>NATIONAL TRUST</b> NORTH REGION Aldricham Hub Stamford Estate Office 18 High Street Aldricham Chester WA14 1PH Telephone (0161) 928 0073 Fax (0161) 929 6819 EST/REV/PROPERTY Wentworth Castle Garden</p>		<p><b>Proposed trenching</b></p>	
<p>DRAWING TITLE DRAWN BY SCALE &amp; DATE DRAWING NO</p>	<p>DATE PROPERTY REFERENCE REV</p>	<p>REVISION</p>	<p>DATE</p>
<p>SD NTS</p>	<p>Dec '18</p>		