



FOR USE WITH RIGID PAVEMENT

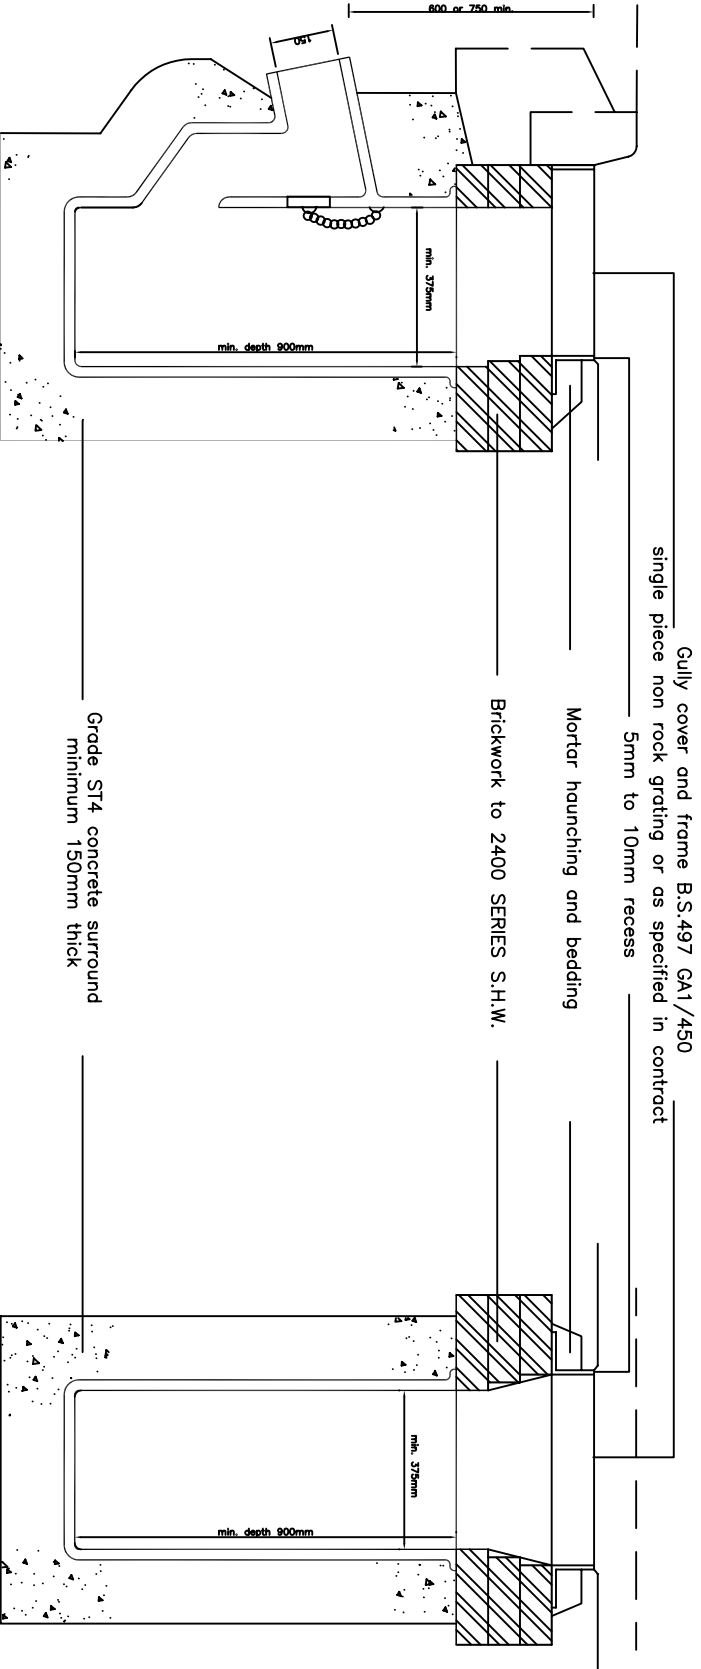

NOTES

1. ALL DIMENSIONS ARE IN MILLIMETRES
2. For details of gully grating and frame see Appendix 5/1
3. The minimum depth from the top of the grating to the top of the gully outlet is to be 750 when the connecting pipe is under a carriageway or a hardshoulder and 600 elsewhere.
4. All precast concrete gullies shall be tropped and comply with the requirements of BS.5911 Pt.2 and S.H.W. Clause 508
5. The grating shall be supplied with a suitable hinge arrangement or anti-theft device to prevent lifting out
6. Mortar to brickwork, haunching and bedding shall be as Table 24/1 Mortar Designation (i)

KEY

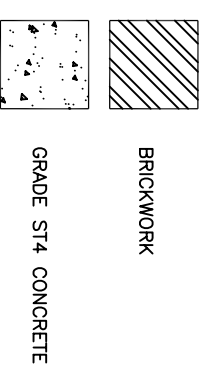

FOR USE WITH FLEXIBLE PAVEMENT



BARNSLEY
Metropolitan Borough Council
Highways & Engineering

GULLIES PERMITTED DESIGN GROUP 1

Scale

N.T.S.

Drawn	Date
JR	OCT 93
Checked	File

D.A. Richardson B.Sc., M.Eng., M.C.I., O.B., M.I.H.T.,
Assistant Director, Highways & Engineering,
Westgate Plaza One, Westgate,
Barnsley S70 2DR.
Tel. (01226) 770770 Fax. (01226) 772222

Drawing No. **BCD/530/D**

© Crown copyright. All rights reserved 100022264 (2006)