


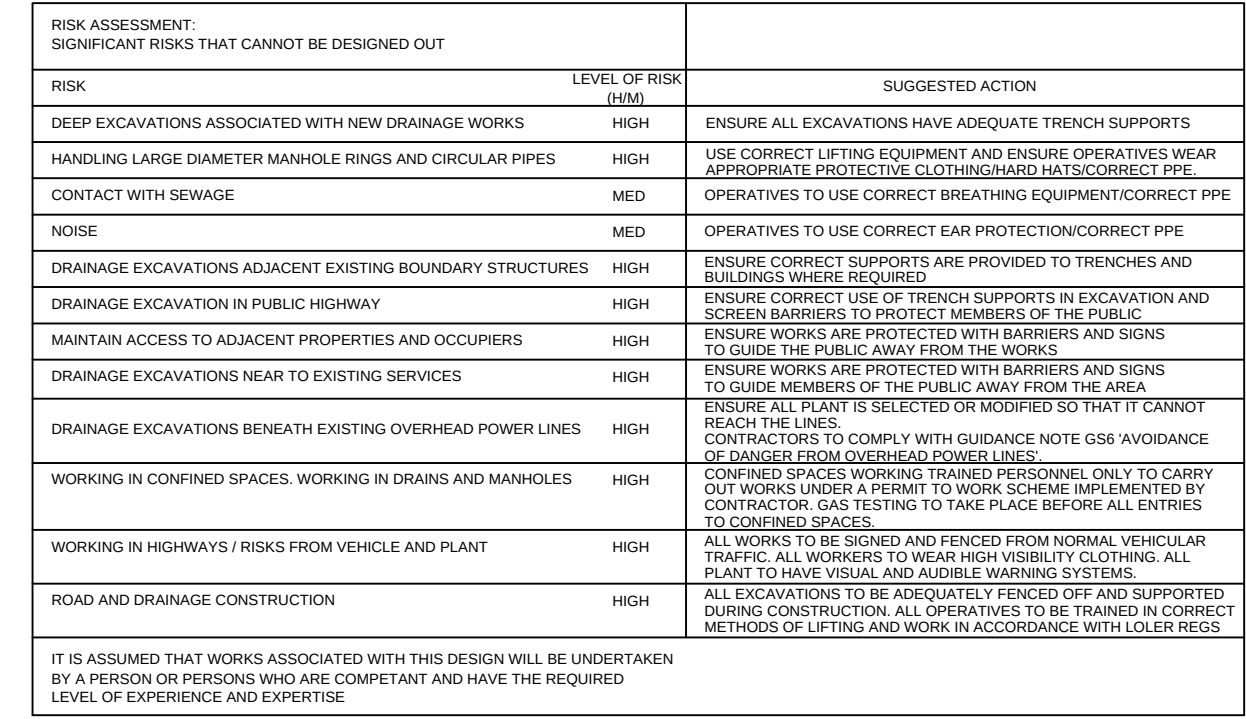

ADOPTABLE SEWERS TO BE LAID IN CLASS 'S' BEDDING (150mm GRANULAR BED & SURROUND). WHERE DEPTH OF COVER TO TOP OF THE SEWER IS LESS THAN 1.2m IN HIGHWAYS AND VERGES (OR LESS THAN 900mm IN NONE VEHICULAR ACCESS AREAS) THEN A CONCRETE SLAB SHOULD BE PROVIDED ABOVE GRANULAR BED & SURROUND.

NOTE:
NO VERTICAL OBSTRUCTIONS TO BE
CONSTRUCTED ABOVE 0.90m EITHER SIDE OF
DRIVEWAYS ADJACENT TO THE 600mm WIDE
HARD MARGINS FOR ADEQUATE VISIBILITY.

B A	Highway gullies and private plot drainage added. Site layout and other details updated.	NJB NJB	21.09.20 14.08.20	PJM PJM
Rev	Amendment	Drawn	Date	Checked

PRELIMINARY DRAWING



sanderson[®]

a s s o c i a t e s

(consulting engineers) ltd

Highways | Traffic | Transportation | Water

T 01924 844080 mail@sandersonassociates.co.uk

F 01924 844081 www.sandersonassociates.co.uk

© Sanderson Associates (Consulting Engineers) Ltd.