

GENERAL:-

FOUNDATIONS:-
Foundations to be constructed at 600x225mm to new cavity walls off good ground with at least 600mm cover subject to depth of existing to be linked to and below all adjacent drainage. All foundations and excavation works to be subject to inspection by LA Building Control Officer including ex foundations in suitable trial holes to former conservatory and main house for review prior to relevant works commencing and agreement of any remedial action deemed necessary..

WALLS BELOW DPC:-
Standard foundation blockwork, solid, with strength 7N/mm². All cavity walls to have GEN 1 designated mix concrete filling up to 150mm below lowest DPC.

DAMP PROOF COURSES:-
Horizontal DPC to all walls. DPC's to external walls to be min 150mm above external ground level. Tray DPC to be installed above all lintels, meter boxes and air bricks with perpendicular weep holes at max 450mm c/c. Tray DPC's to rise min 150mm across cavity. All DPC's to be min 2000 Gauge.

EXTERNAL CAVITY WALLING:-
External leaf in 102.5mm facing brick to match existing in every respect. Internal leaf of 100mm 4.2N/mm² solid lightweight conc block. Generally provide approx 100mm structural cavity with 50mm partial fill Kingspan cavity insulation, to achieve overall U-Value to wall of max 0.28W/m²·c. Where former conservatory walls raised cavity to be filled with mineral fibre and inside of wall to be lined with insulated ply and skim in accordance with chosen mfr's instructions to achieve required o/a u-value to wall. Stainless steel cavity wall safety ties at 750mm horiz c/c, 450mm vert c/c and every block course vertically at reveals within 150mm of reveal. Close cavity around all openings with proprietary insulated combination dpc/closer such as Cavity trays Cav90 or other equal and approved to prevent cold bridging. Cavity to be closed at head of cavity wall. Provide and install all necessary dpc's as specified before.

LINTELS:-
Unless specified otherwise lintels over all openings to be NAYLOR R6 conc lintel with NAYLOR P100 outer lintel, or other equal and approved, BBA certified and suitable for the span and load supported with min 150mm end bearings in accordance with manufacturer's recommendations. Provide tray DPC over as before. Openings with other particular lintel requirements indicated on the drawings.

INTERNAL WALLS:-
Internal walls generally to be non L/B partitions in 75x50 SW studs with head and sole plates and all necessary studs and nogginns with 12.5mm Gyproc Wallboard 10 with skim finish to both sides and full fill mineral fibre insulation to cavity with min 10kg/m³ density. Provide double joists under stud partitions where running parallel to floor joists.

UPPER FLOOR CONSTRUCTION:-
22mm t & g MR chipboard unspaced floor joists as described elsewhere supported off new & existing loadbearing structures as shown. Proprietary joist hangers at joists to trimmer/bearer connections. SW strutting in 1No row at mid-point as spans generally between 2.5 and 4.5m long. Provide multiple joists trimmers as required and where specifically described on plans and sections. Provide lateral restraint to floors using 30 x 5mm galv MS straps turned down walls and fixed across Min 3No joists at 1.5m c/c fully supported on nogginns min 38mm thick x 3/4 depth of joist with solid pack between first joist and wall. Notch top of joist to relieve straps. Provide full perimeter edge support to floor boarding in joists or nogginns.

WINDOWS AND DOORS:-
All new & any replacement windows to be high performance white PVC to match existing in every respect, double glazed with HP DG units incorporating 16mm gas filled cavity & low-E glass to ensure max 1.6 W/m²·C U-Value, fully draft sealed, with opening lights as indicated giving min 1/20th floor area natural ventilation. Trickle vents to be provided to give min 5000mm² to habitable rooms and 2500mm² to all other rooms.

GLAZING:-
All glazing to comply generally with Approved Document K of Building Regs and to BS 5713:1979 and BS EN 1279. Obscure glazing to all bathrooms and WC's. All glazing to critical areas to be Kitemarked safety glass as follows:-
Windows with sill height less than 800mm from internal floor level.
In doors and adjacent side screens to all areas below 1500mm from finished floor level.
All windows and doors to be fully draft sealed.

MECHANICAL VENTILATION:-
Provide the following extract rates:-
Utility - 30L/sec; **Shower Room** - 15Litres/sec; **WC** - 6 litres/second
Mechanical extract to be manually activated generally and, in any windowless accommodation, to be wired thru lighting circuit with min 15 minute overrun in conjunction with 10mm undercut to room door for replacement air.

FIRE SAFETY:-
If not already present provide self contained smoke alarms, interconnected, and all wired on an exclusive mains circuit with battery back-up. Incorporate mains indicator light and manual test button. Smoke alarms to be provided no more than 7.5m away from any doors into habitable rooms. Install heat detectors to any kitchens which are open to the hallway/stair enclosure.

ABOVE GROUND DRAINAGE:-
All sanitary fittings to have pvc wastes of the following sizes:
WC - 100mm dia in black pvc.
Basin - 32mm dia or 40mm if greater than 1.7m from outfall connection.
Sink, Bath & Shower - 40mm dia.
All wastes to have 75mm deep resealing traps.
All fittings to connect to branch drains to connect to SVP as shown on plans and elevations.
Rodding points to be provided to any lengths of drainage which cannot be reached from any other part of the system.
Any branch pipe discharging to a gully to terminate below grate level but above water level.

HEATING AND HOT WATER:-
Existing gas fired central heating system to be adapted extended and improved to suit by a "GAS-SAFE" plumbing contractor.
All primary pipework to be insulated in accordance with current regulations.
Heating system to be controlled by thermostatic rad valves.
All non-room sealed heating appliances to have permanent ventilation to relevant rooms in accordance with manufacturers requirements.
Space heating control system to comply with regulation G3, British Standards and Codes of Practice.
No combustible material to be installed within 40mm of any flue.

INTERNAL LIGHTING/ ELECTRICS:-
New internal lighting to be in accordance with Approved Document L1B and to incorporate in at least 3 in 4 positions high efficacy lighting fittings with lamps giving min luminous efficacy of 40 lumens/circuit-watt.



All new electrical work to be undertaken in accordance with latest edition of "Wiring Regulations" (BS7671) by qualified/certified electrician operating under an approved "competent persons" scheme.

STAIRCASE:-
Purpose made staircase to comply generally with Approved Document K of Building Regs. Refer to plans & sections for specific details regarding number of rises and goings. Max pitch to be 42°. Attic stair - 14no equal rises of approx 165mm with 220mm goings (All subject to site measure prior to manufacture). Handrail height 900mm above pitch line of stair. Guarding to landing to be 900mm high above floor level. Max clear gap in any part of balustrading to be 99mm. Clear headroom to be 2m above pitch line of stairs generally and not less than 1.8m to sides. 600mm clear width to flights. Min 50mm tread to winders.


Conditional Approval requested for the following:-

* Structural calculations for:- Steel beam(s) supporting attic floor structure in accordance with Structural Engr's details.


All details to be submitted to and approved by Building Control Authority Prior to commencing on site with the relevant section of work.

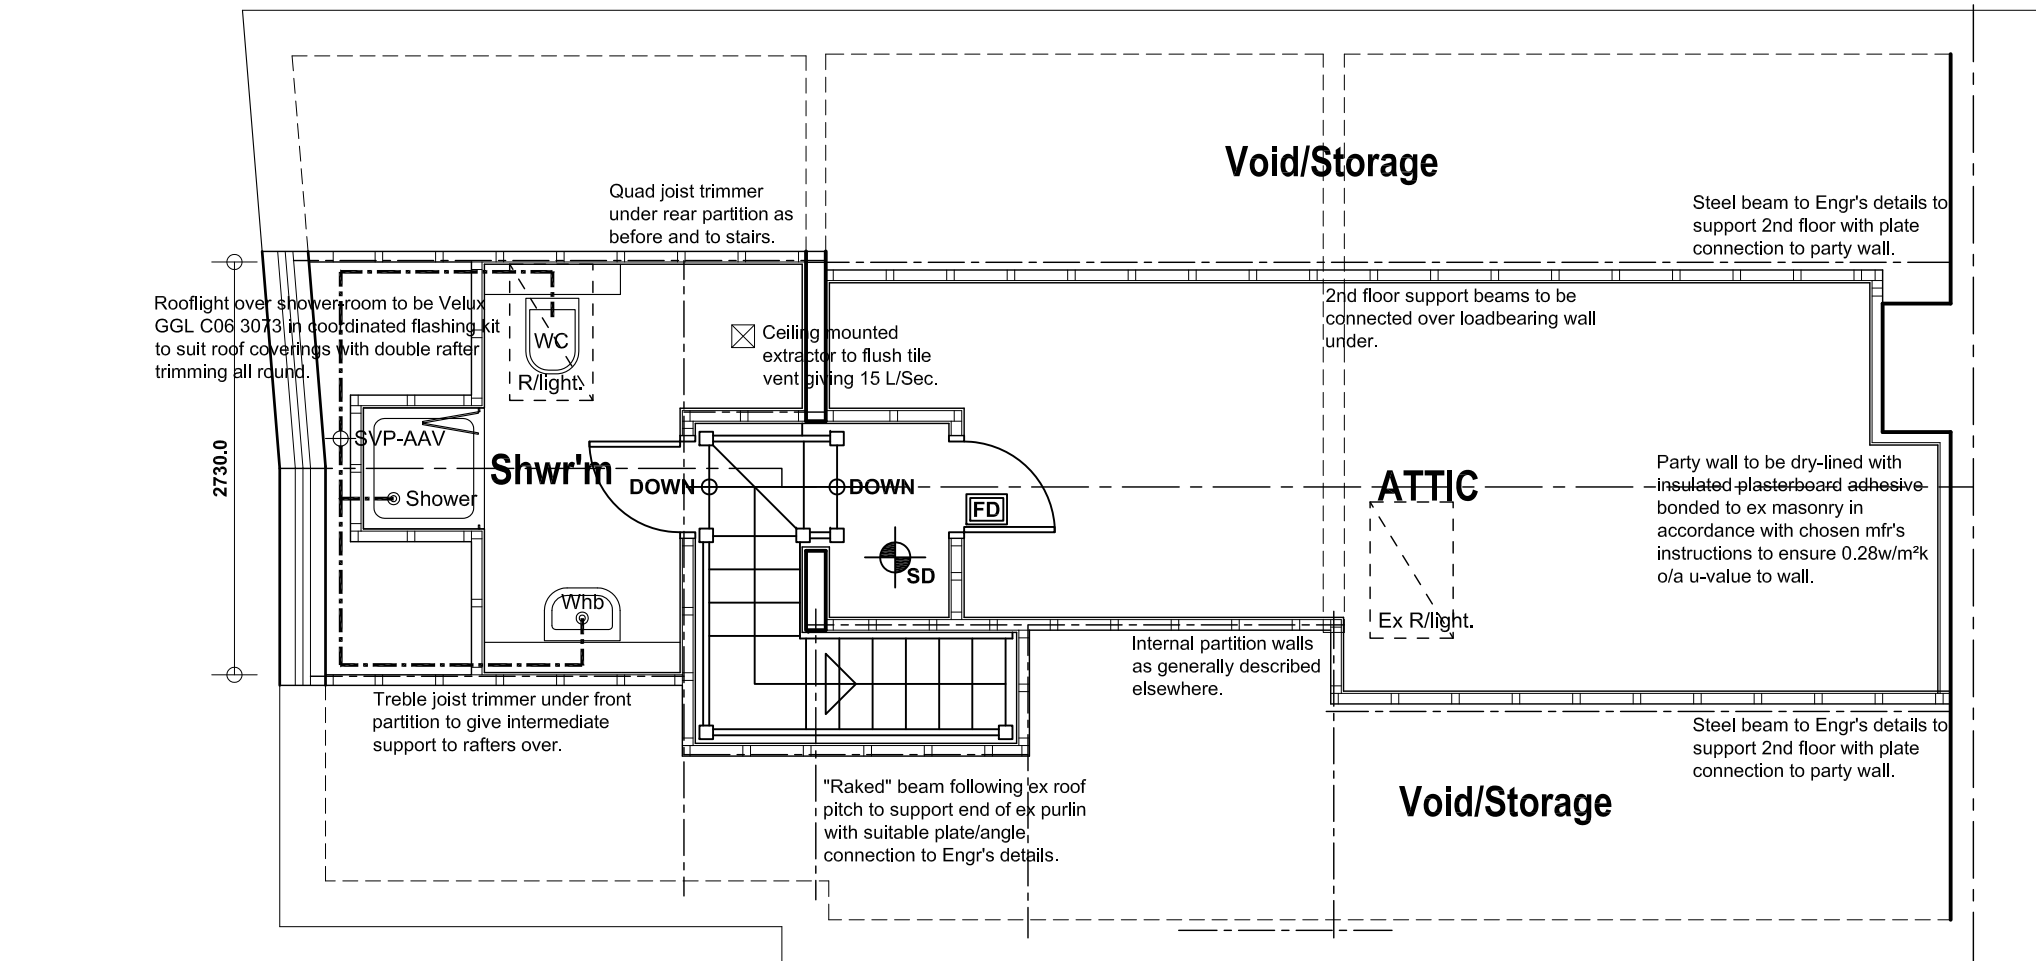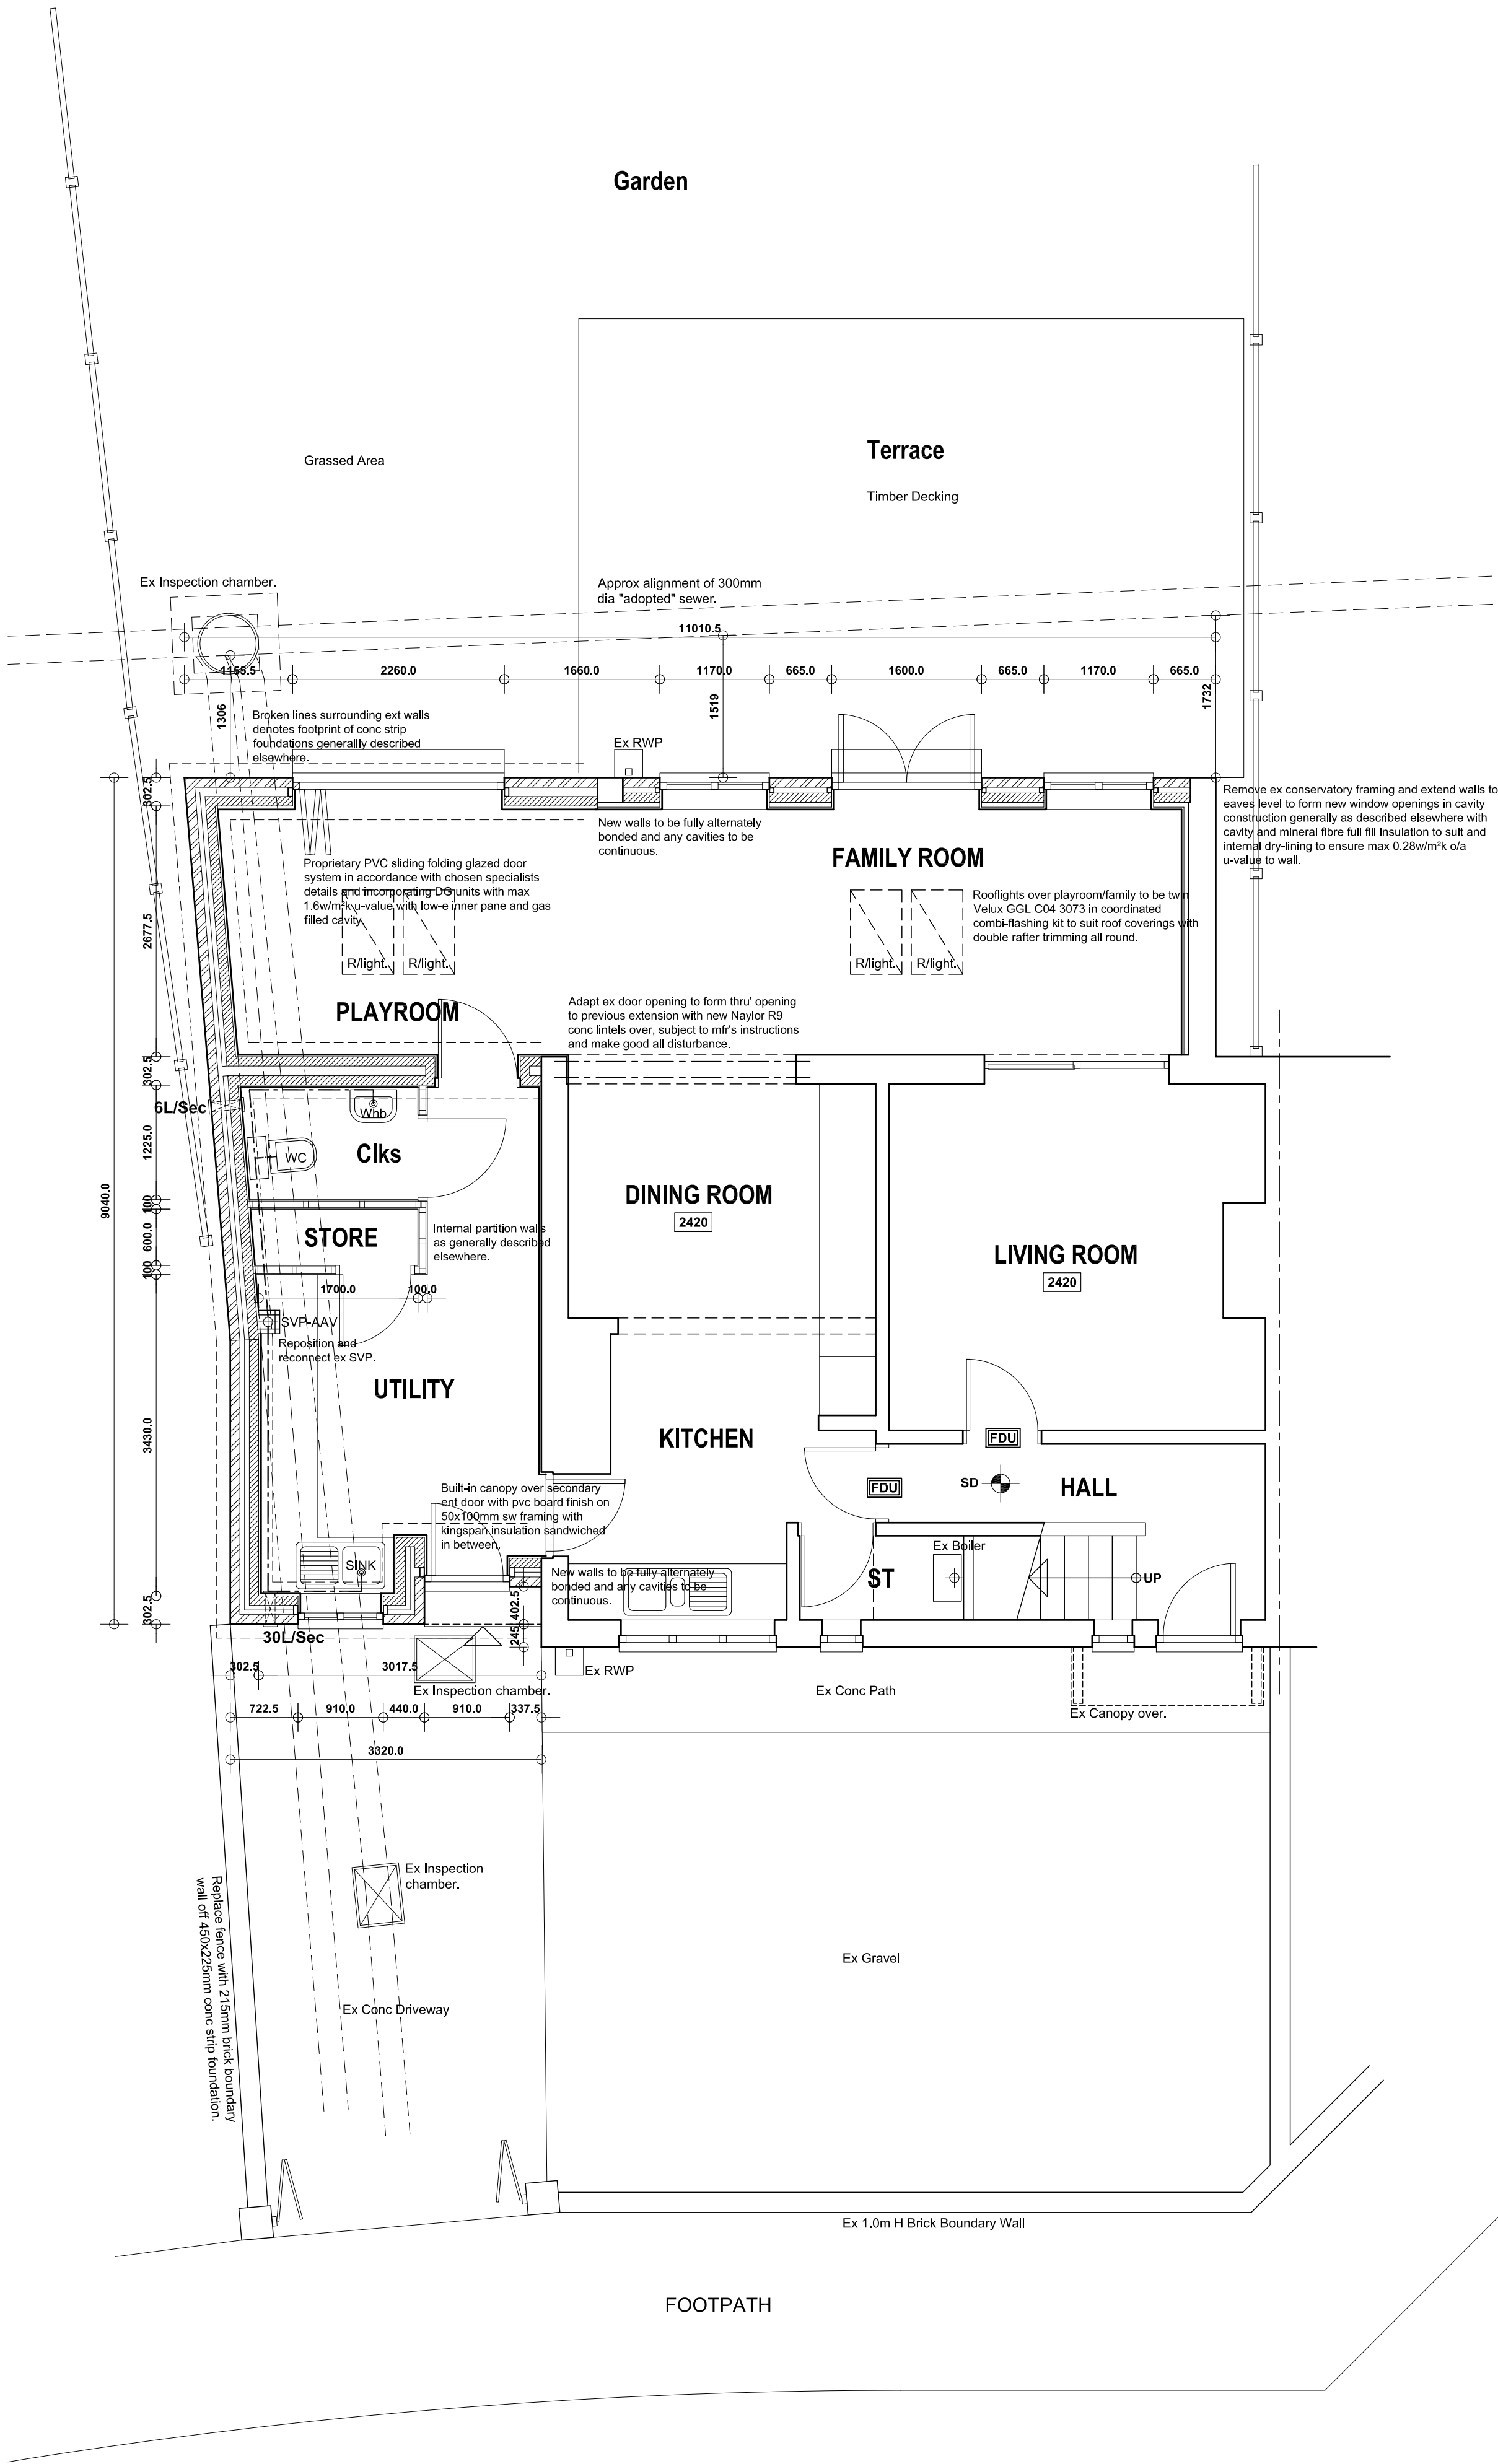

SECOND FLOOR PLAN

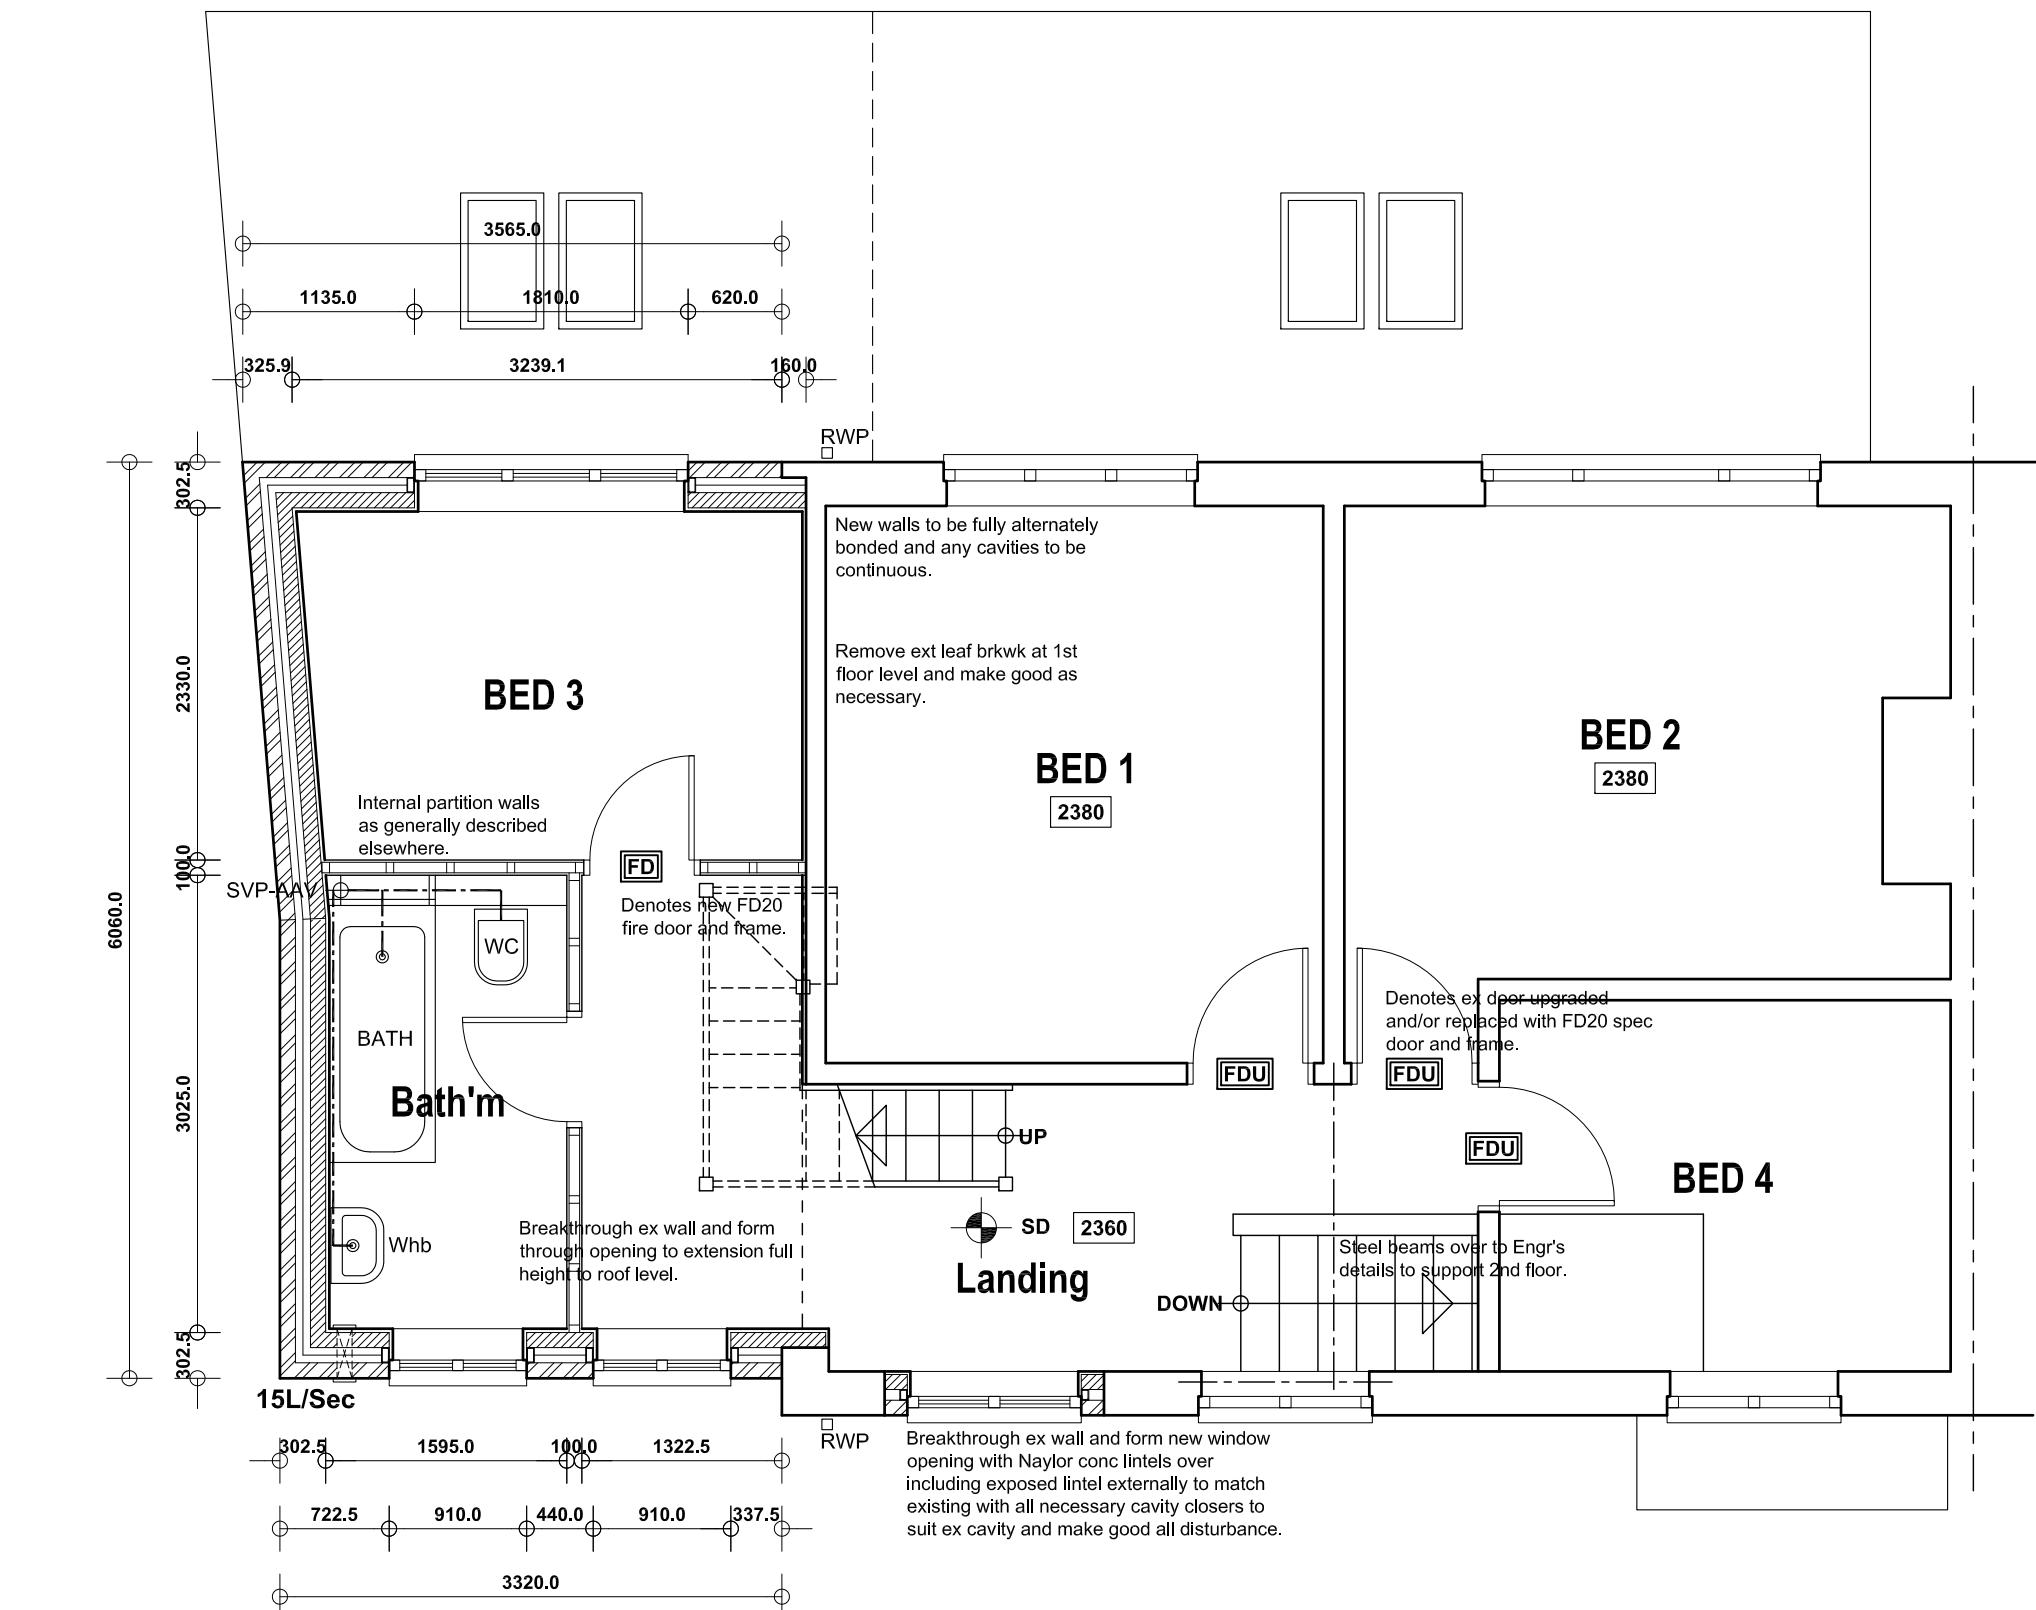

FIRST FLOOR PLAN

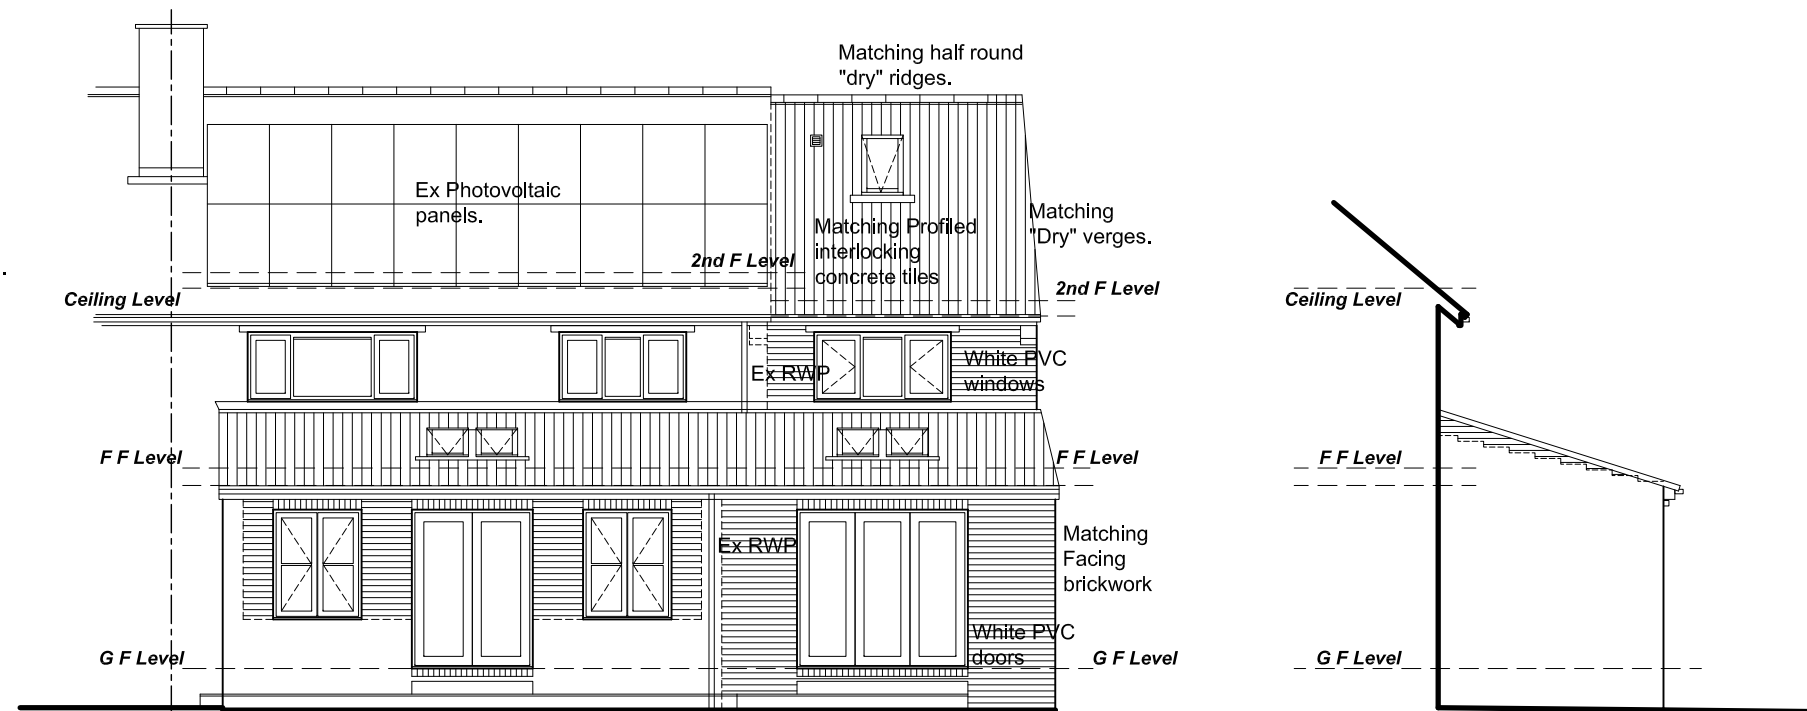

REAR ELEVATION

SIDE ELEVATION R


B 21/07/2015 "Adopted" drains shown and associated rev's.
A 12/05/2015 "Adopted" sewer clarified.

Revision Date Description

PROPOSED ALTERATIONS & EXTENSION,
24 NORFOLK ROAD, GREAT HOUGHTON,
BARNSELY, S72 0DT.

DETAILED PROPOSALS 1
Plans & Rear Elevation.

Mr & Mrs Shelton.

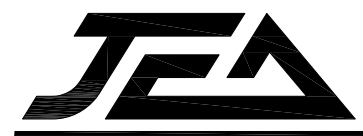

JEA Architectural Ltd
23 Windmill Road, Wombwell,
Barnsley, S73 8PW
Tel: 01226 754507
Email: jea1d@btconnect.com

This drawing and the copyright is the Architectural Company's property and maybe used or reproduced only by agreement. All Dimensions in Millimetres Unless specified otherwise and subject to verification on site.

Scale:1:50 @ A1	Date: FEB 2015
Ref: 201425	Drwg No: 04
0 cm	12 cm
4 cm	16 cm