



- General notes:
- Positions of all equipment, ductwork and fittings are indicative only.
 - Contractors shall confirm the sequence of installation works to ensure safe access is maintained.
 - Attention is drawn to health & safety issues. Liaise with the main contractor to ensure that installation works are programmed to respect H&S rules and relevant coordination.
 - All dimensions / duct sizes are in millimetres unless otherwise stated.
 - This drawing was produced using CAD and should not be amended by hand.
 - All dimensions shown are for reference and should be checked on site prior to commencement of work.

- Specific notes:
- This drawing should be read in conjunction with all architectural, structural and drawings from other services (incl. mechanical, catering, electrical, sprinklers) along with correct documentation and specification for the works.
 - Ensure all method statements, sign offs and approvals are in place before proceeding with any work.
 - All works to be carried out in accordance with the current British Standards, B.S. Codes of practice and building regulations.
 - The HVAC services works shall be carried out in full accordance with the client specification and code, together with any further technical guide and specification.
 - Ductwork shall be installed in accordance with all current industry standard guidelines / regulations.
 - Galvanneal ductwork to be manufactured to BS1444.
 - Ductwork sized in accordance with all current industry standard guidelines / regulations. Duct dimensions shown on drawing are clear internal dimensions (not including flanges and fittings).
 - Access doors required on kitchen extract duct every 1500mm for cleaning and before / after every change of direction & should be accessible at all locations via ceiling access panels or pithead openings etc. Access panels to be provided to meet contractor in any such ceiling where that requirements indicated by HVAC installation contractor.
 - Duct connections with fans and other equipment to be a manufactured canvas connection to prevent duct vibration noise and transmission of vibrations.
 - Volume control dampers shall be provided on all branch legs and diffuser / grille terminals to facilitate commissioning.
 - Supply and secondary fan coil unit ductwork to be fully insulated.
 - Final air intake and exhaust locations are shown indicatively on these drawings. The exact positions shall be agreed with the client, architect and the main contractor and shall be shown accordingly on the working / coordinated drawings.
 - Position of all grilles / air valves shown are in optimum positions for all flow. The grille to be positioned as close as possible to location shown and coordinated with other services and fabric constraints.
 - Fire dampers are to be shown on ductwork penetrating kitchen extract ducts penetrating fire compartment divisions and shall incorporate certified fire dampers to match the fan rating, together with access panels. Reference to be made to architect fire strategy drawing to establish locations. Fire dampers are shown indicatively on these drawings.
 - All transfer grilles and ductwork where fire rated, shall match the fire rating of the wall in which it is installed.
 - Attenuation and anti-vibration measures shall be incorporated on all plant and ductwork supports in full accordance with acoustic consultant specification.
 - Access required to all plant equipment for maintenance and cleaning.
 - Refer to catering specialist layout to determine confirmed canopy sizes and locations.
 - Condensate drain from AC condensers to be cut to the nearest waste connection or to rooftop drain. Condensate drains from the FCU's to be run to the nearest drain (storm), subject to manufacturer and their requirements. Both shall be the equivalent plastic or copper slope.
 - Install all mechanical equipment in accordance with manufacturers guidelines.
 - Catering condensers are not CVL equipment. However, they are indicatively shown on CVL drawings to allow for pre-laid space and access within the HVAC plant area.
 - Locations of all required floor, wall and roof openings shall be co-ordinated with all other trades involved.
 - No other loads (other services or man loading) shall be hung from ductwork supports.

C	14-04-23	AM	Updated duct routes to plant deck.
B	24-03-23	PR	Revised GA and RCP.
A	14-03-23	PR	HVAC updates.

No.	Date	Rev.	By	Revision Description
-----	------	------	----	----------------------

Project:

POPEYES

THE PEEL CENTRE
HARBOROUGH HILL RD.
BARNSELY S71 1BQ

Drawing Title:


HVAC LAYOUT
GROUND FLOOR


Drawing No.:	Rev:
001-1043-01	C
Scale: 1:50 @ A1 1:100 @ A3	
Drawn By: DPH	Date: 07/03/23

chapman
ventilation



15-20 Woodfield Road, Welwyn Garden City
Hertfordshire AL7 1JQ
Tel: 01707 372658 Fax: 01707 325001
E-mail: info@chapmanventilation.co.uk
Web: www.chapmanventilation.co.uk

Copyright of this drawing resides
with Chapman Ventilation Limited



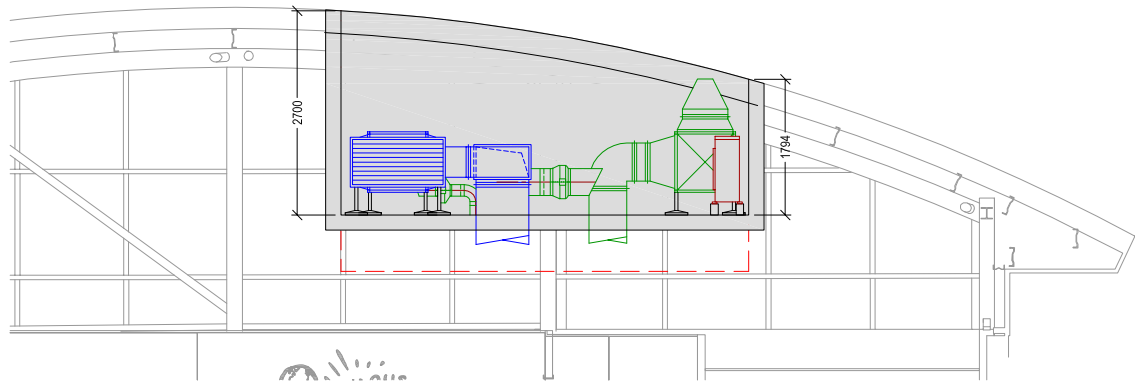

SECTION THROUGH PLANT DECK

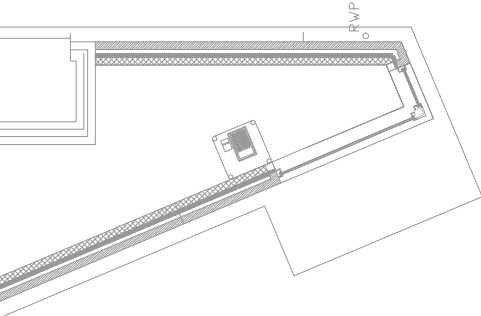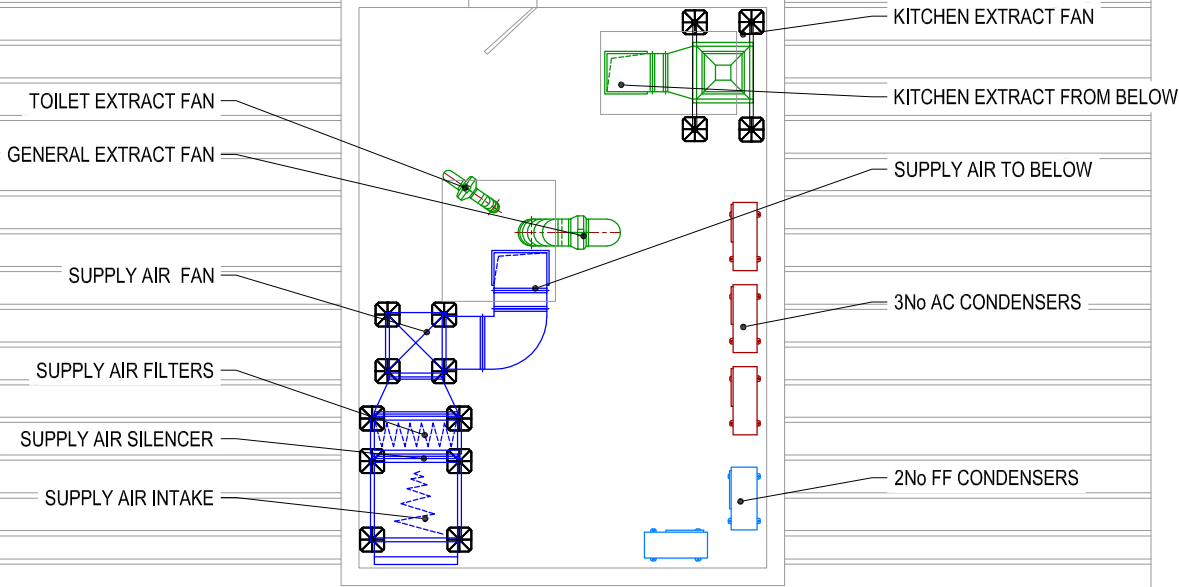

- General notes:
- Positions of all equipment, ductwork and fittings are indicative only.
 - Contractors shall confirm the sequence of installation works to ensure safe access is maintained.
 - Attention is drawn to Health & Safety Issues. Liaise with the main contractor to ensure that installation works are programmed to respect H&S rules and relevant coordination.
 - All dimensions / duct sizes are in millimetres unless otherwise stated.
 - This drawing was produced using CAD and should not be amended by hand.
 - All dimensions shown are for reference and should be checked on site prior to commencement of work.
- Specific notes:
- This drawing should be read in conjunction with all architectural, structural and drawings from other services (incl. mechanical, catering, electrical, sprinklers) along with contract documentation and specification for the works.
 - Ensure all method statements, sign offs and approvals are in place before proceeding with any work.
 - All works to be carried out in accordance with the current British Standards, B.S. Codes of practice and building regulations.
 - The HVAC services works shall be carried out in full accordance with the client specification and code, together with any relevant technical guide and specification.
 - Ductwork shall be installed in accordance with all current industry standard guidelines / regulations.
 - Galvanneal ductwork to be manufactured to DW144.
 - Ductwork sized in accordance with all current industry standard guidelines / regulations. Duct dimensions shown on drawings are clear internal dimensions (not including flanges and fittings).
 - Access doors required on kitchen extract duct every 1500mm for cleaning and before / after every change of direction & should be accessible at all locations via rolling access panels or grilles/collars, etc. Access panels to be provided to main contractor in any duct collars where that requirements indicated by HVAC installation contractor.
 - Duct connections with fans and other equipment to be a manufactured canvas connection to prevent duct thermal noise and transmission of vibrations.
 - Volume control dampers shall be provided on all branch legs and diffuser / grille terminals to facilitate commissioning.
 - Supply and secondary fan coil unit ductwork to be fully insulated.
 - Final air intake and exhaust locations are shown indicatively on these drawings. The exact positions shall be agreed with the client, architect and the main contractor and shall be shown accordingly on the working / coordinated drawings.
 - Position of all grilles / air valves shown are in optimum positions for all flow. The grille to be positioned as close as practicable to location shown and coordinated with other services and fabric constraints.
 - Fire dampers are to be shown on ductwork (including kitchen extract ducts) penetrating fire compartment divisions and shall incorporate certified fire dampers to match the barrier rating, together with access panels. Reference to be made to architect fire strategy drawing to establish locations. Fire dampers are shown indicatively on these drawings.
 - All transfer grilles and ductwork where fire rated, shall match the fire rating of the wall in which it is installed.
 - Attenuation and anti-vibration measures shall be incorporated on all plant and ductwork supports in full accordance with acoustic consultant's specification.
 - Access required to all plant equipment for maintenance and cleaning.
 - Refer to catering specialist layout to determine confirmed canopy sizes and locations.
 - Condensate drain from AC condensers to be run to the nearest waste connection or to rooftop drain. Condensate drains from the FCU's to be run to the nearest drain (storm), subject to manufacturer and their requirements. Both shall be the equivalent plastic or copper slope.
 - Install all mechanical equipment in accordance with manufacturers guidelines.
 - Catering condensers are not CVL equipment. However, they are indicatively shown on CVL drawings to allow for prohibited space and access within the HVAC plant area.
 - Locations of all required floor, wall and roof openings shall be co-ordinated with all other trades involved.
 - No other loads (other services or man loadings) shall be hung from ductwork supports.

A	13-04-23	AM	Updated plant equipment layout.
No.	Date	Rev.	By
			Revision Description

Project:

POPEYES
THE PEEL CENTRE
HARBOROUGH HILL RD.
BARNSELY S71 1BQ

Drawing Title:

HVAC LAYOUT
ROOF PLAN

Drawing No.:	Rev:
001-1043-02	A

Scale: 1:50 @ A1 1:100 @ A3

Drawn By: DPH Date: 07/03/23

chapman
ventilation

15-20 Woodfield Road, Welwyn Garden City
Hertfordshire AL7 1JQ
Tel: 01707 372658 Fax: 01707 325001
E-mail: info@chapmanventilation.co.uk
Web: www.chapmanventilation.co.uk

Copyright of this drawing resides
with Chapman Ventilation Limited

