
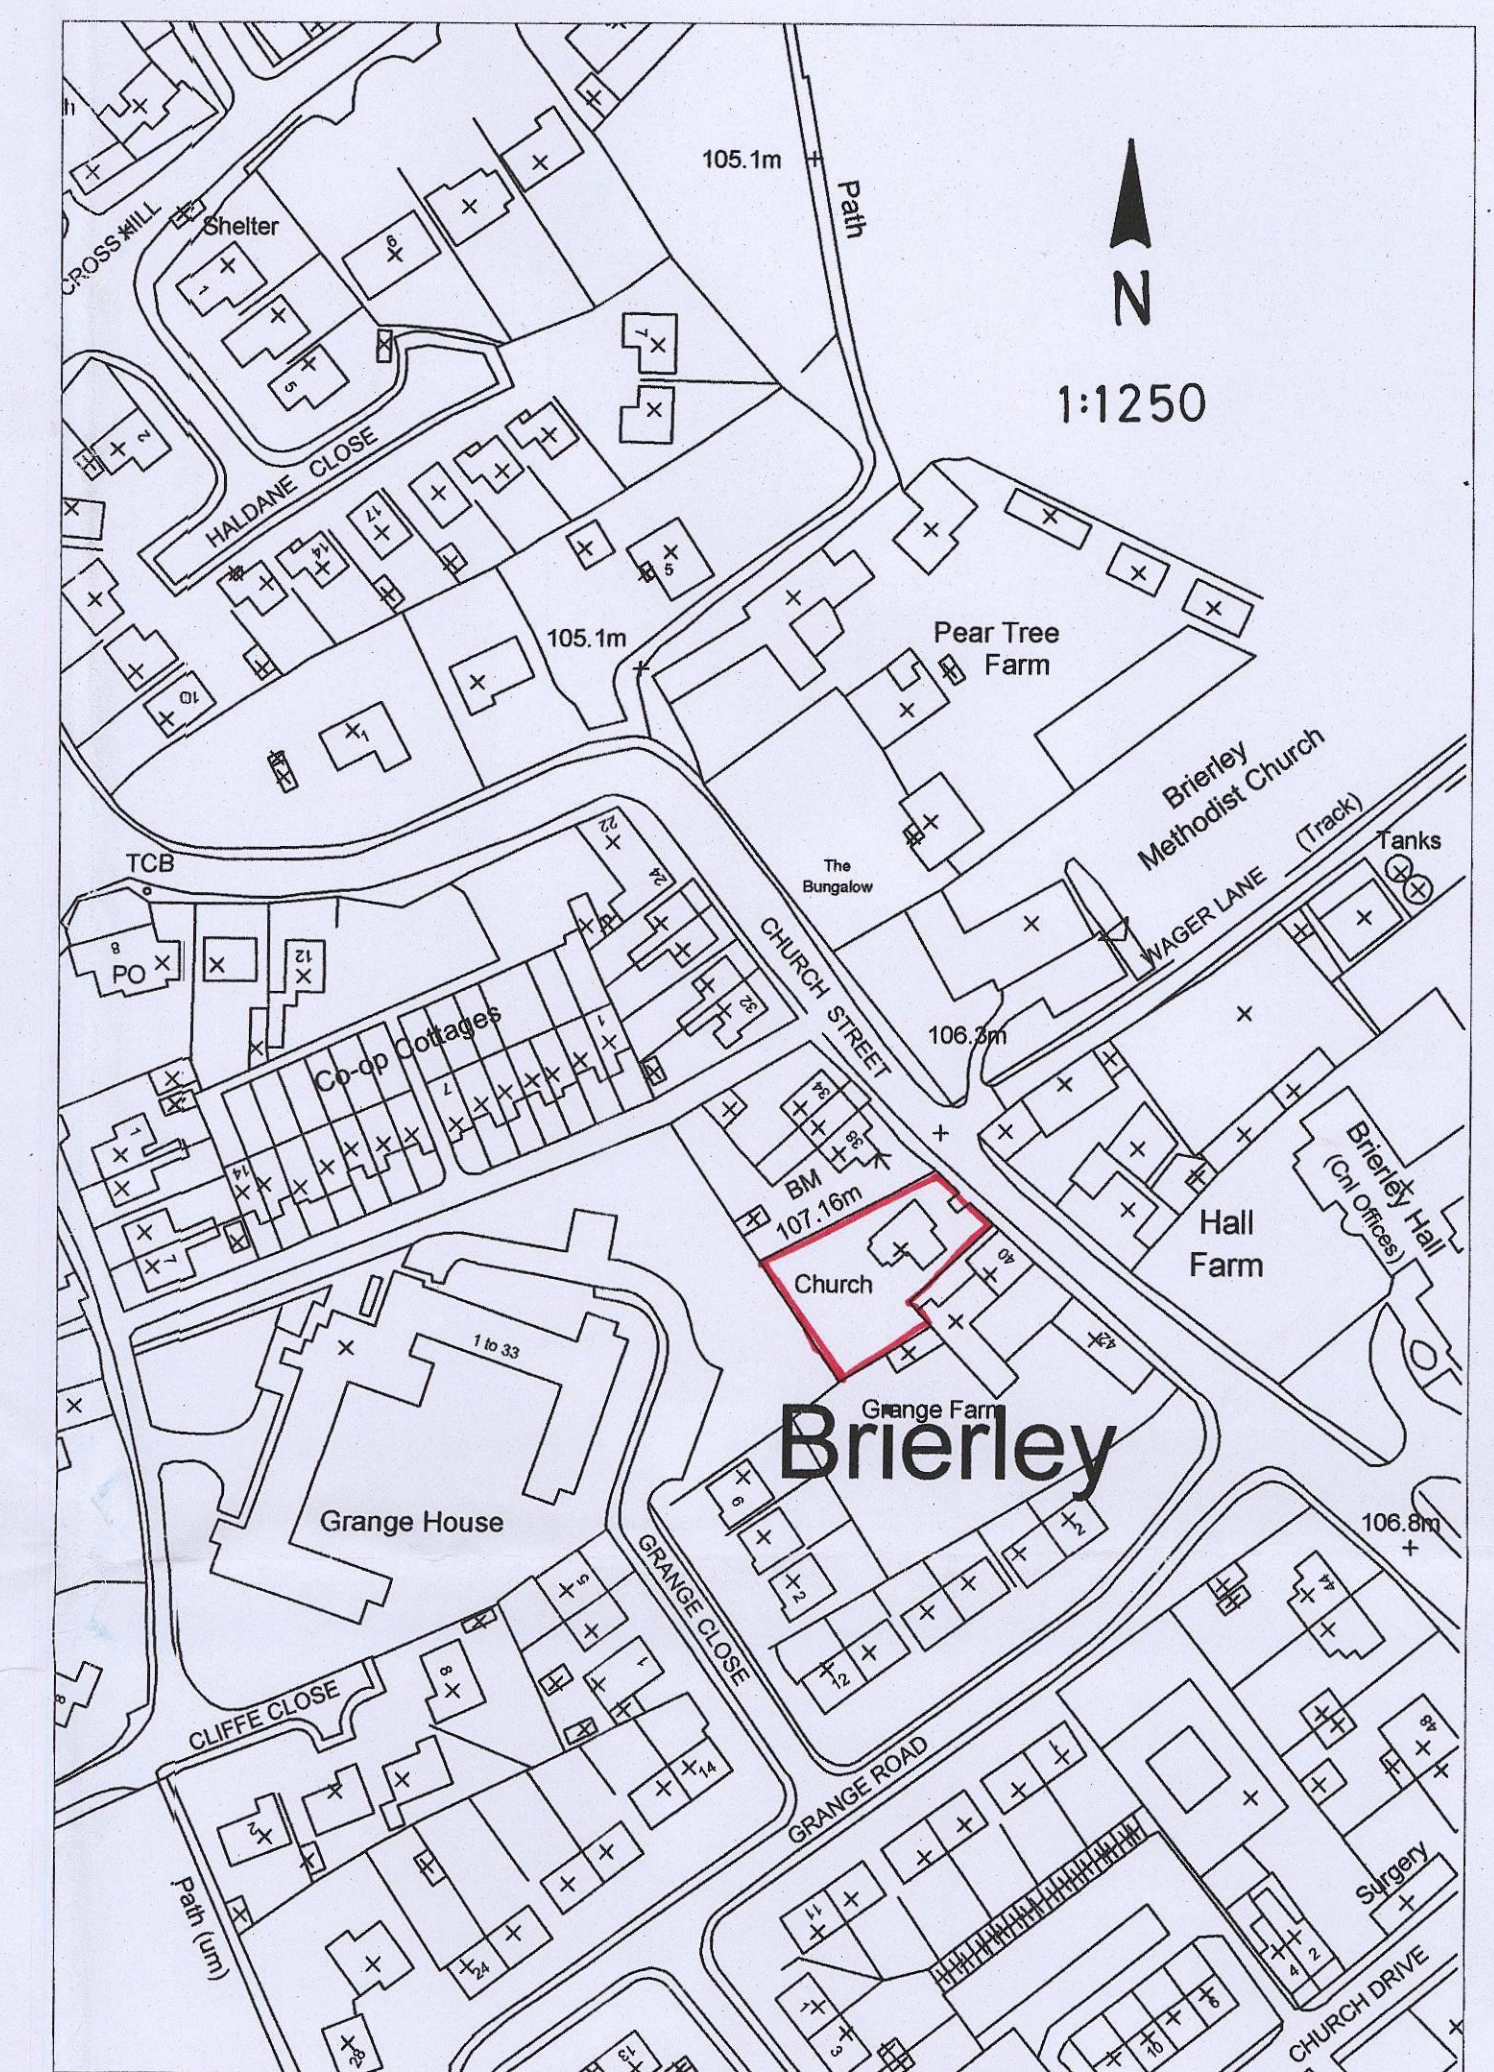
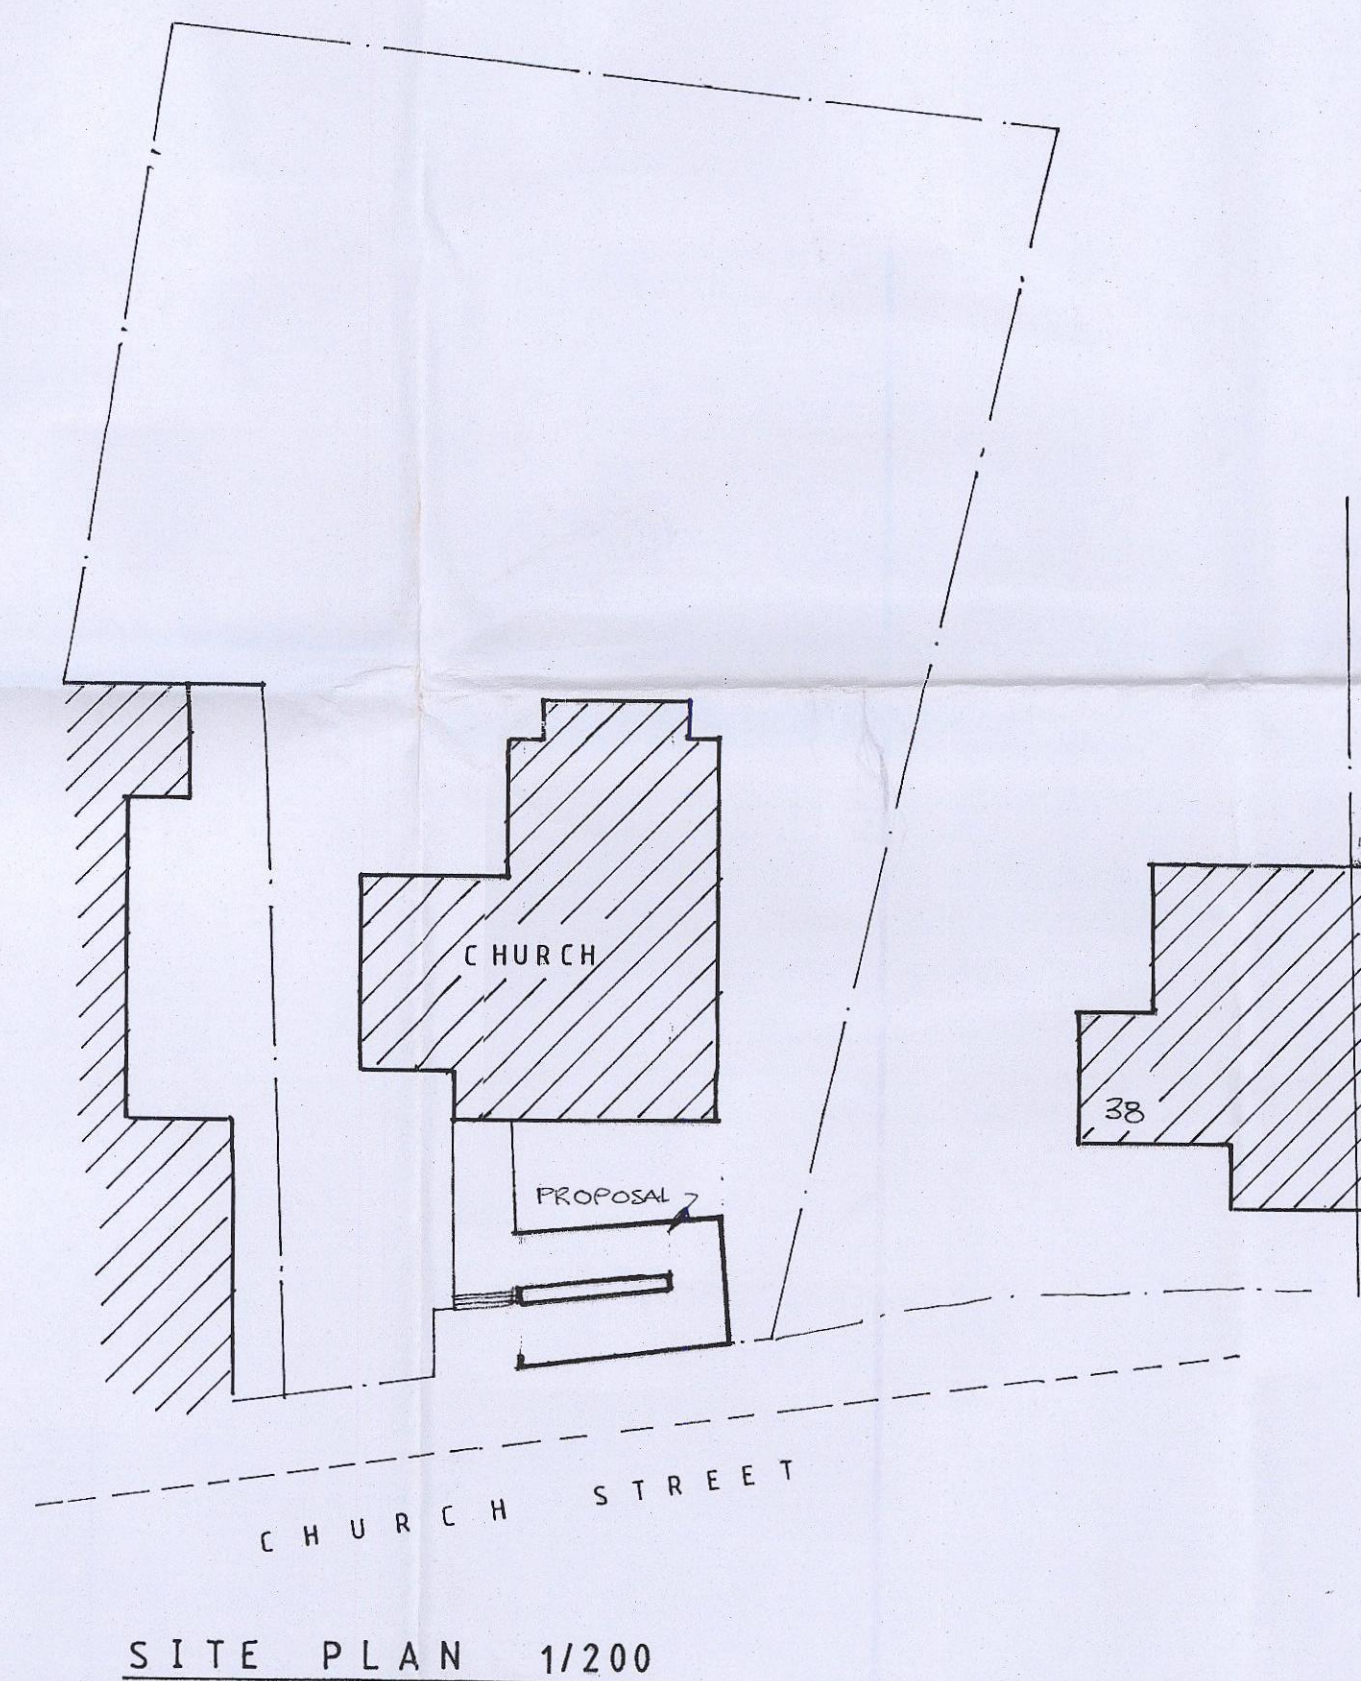
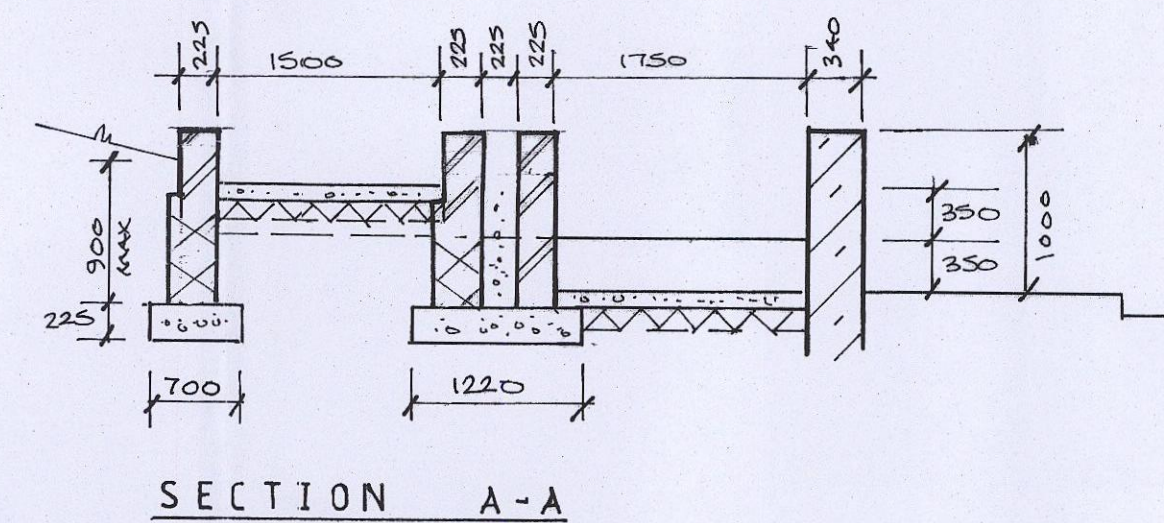
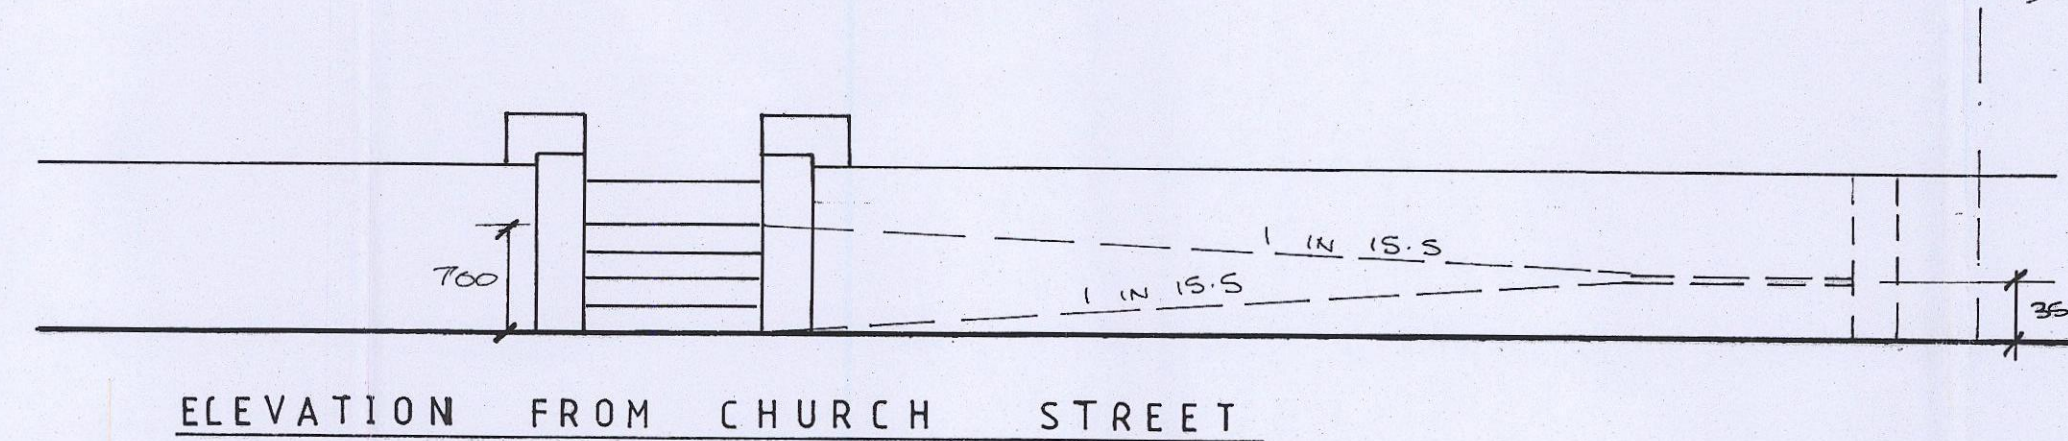
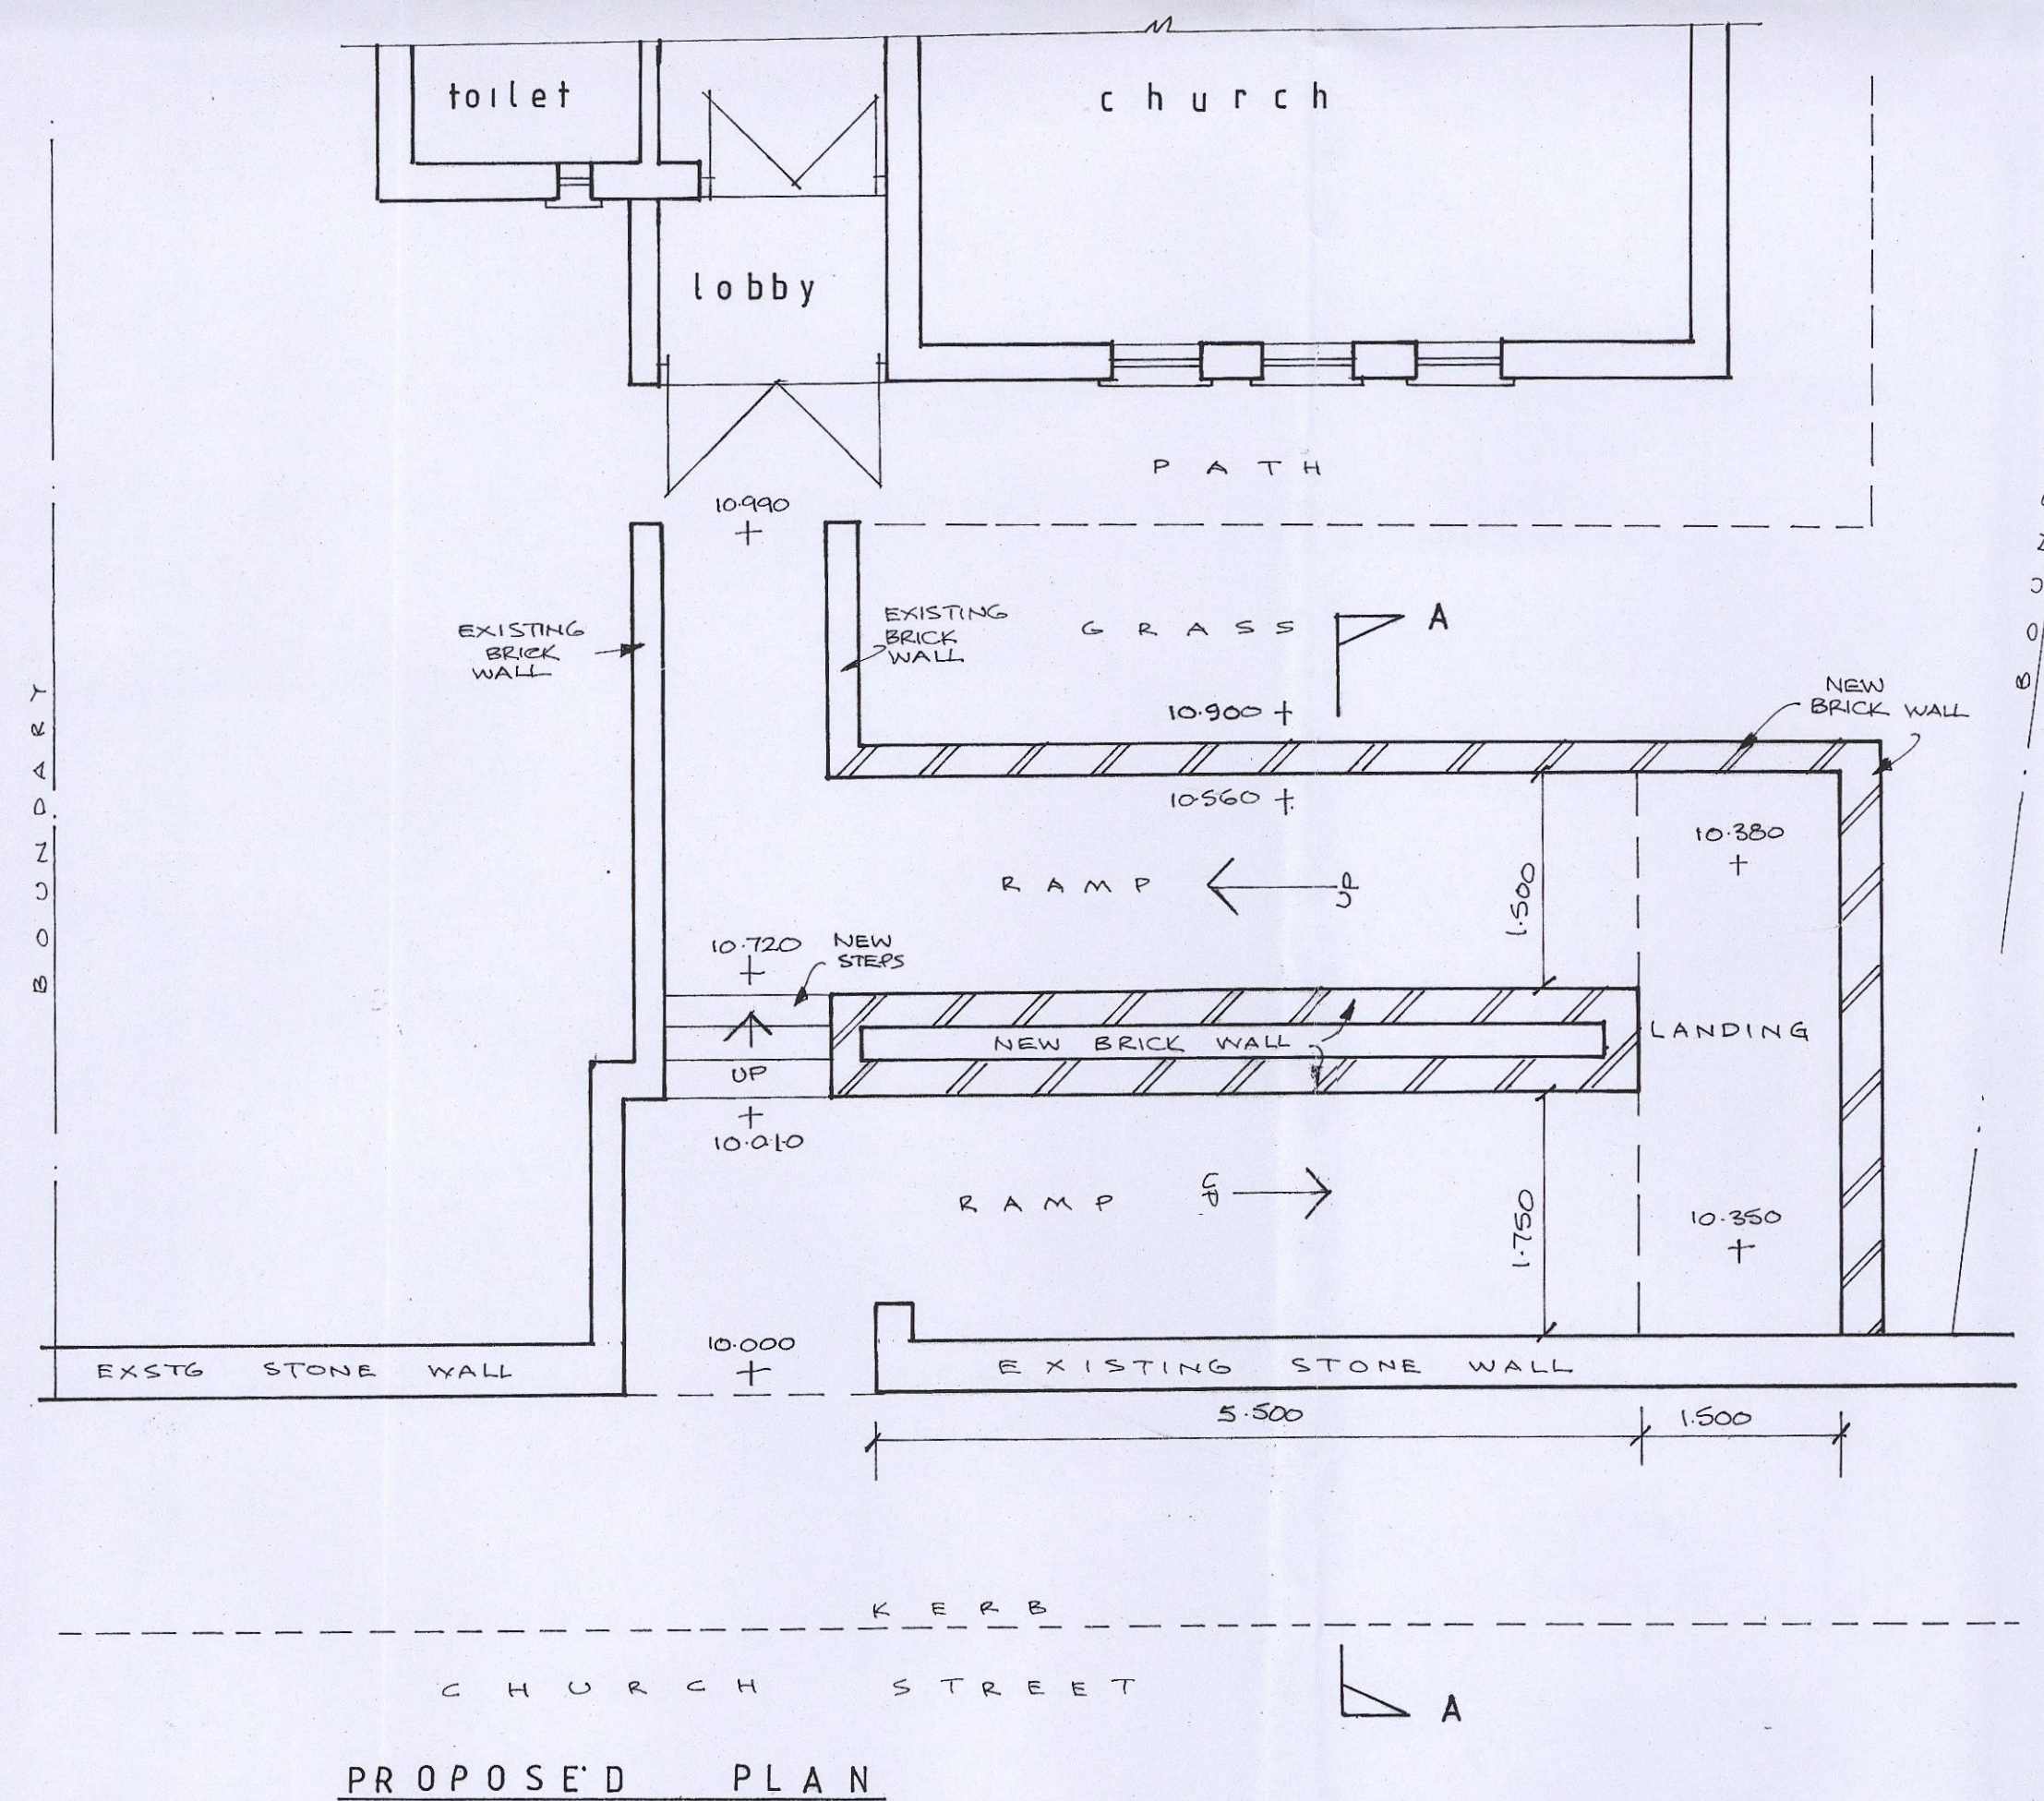


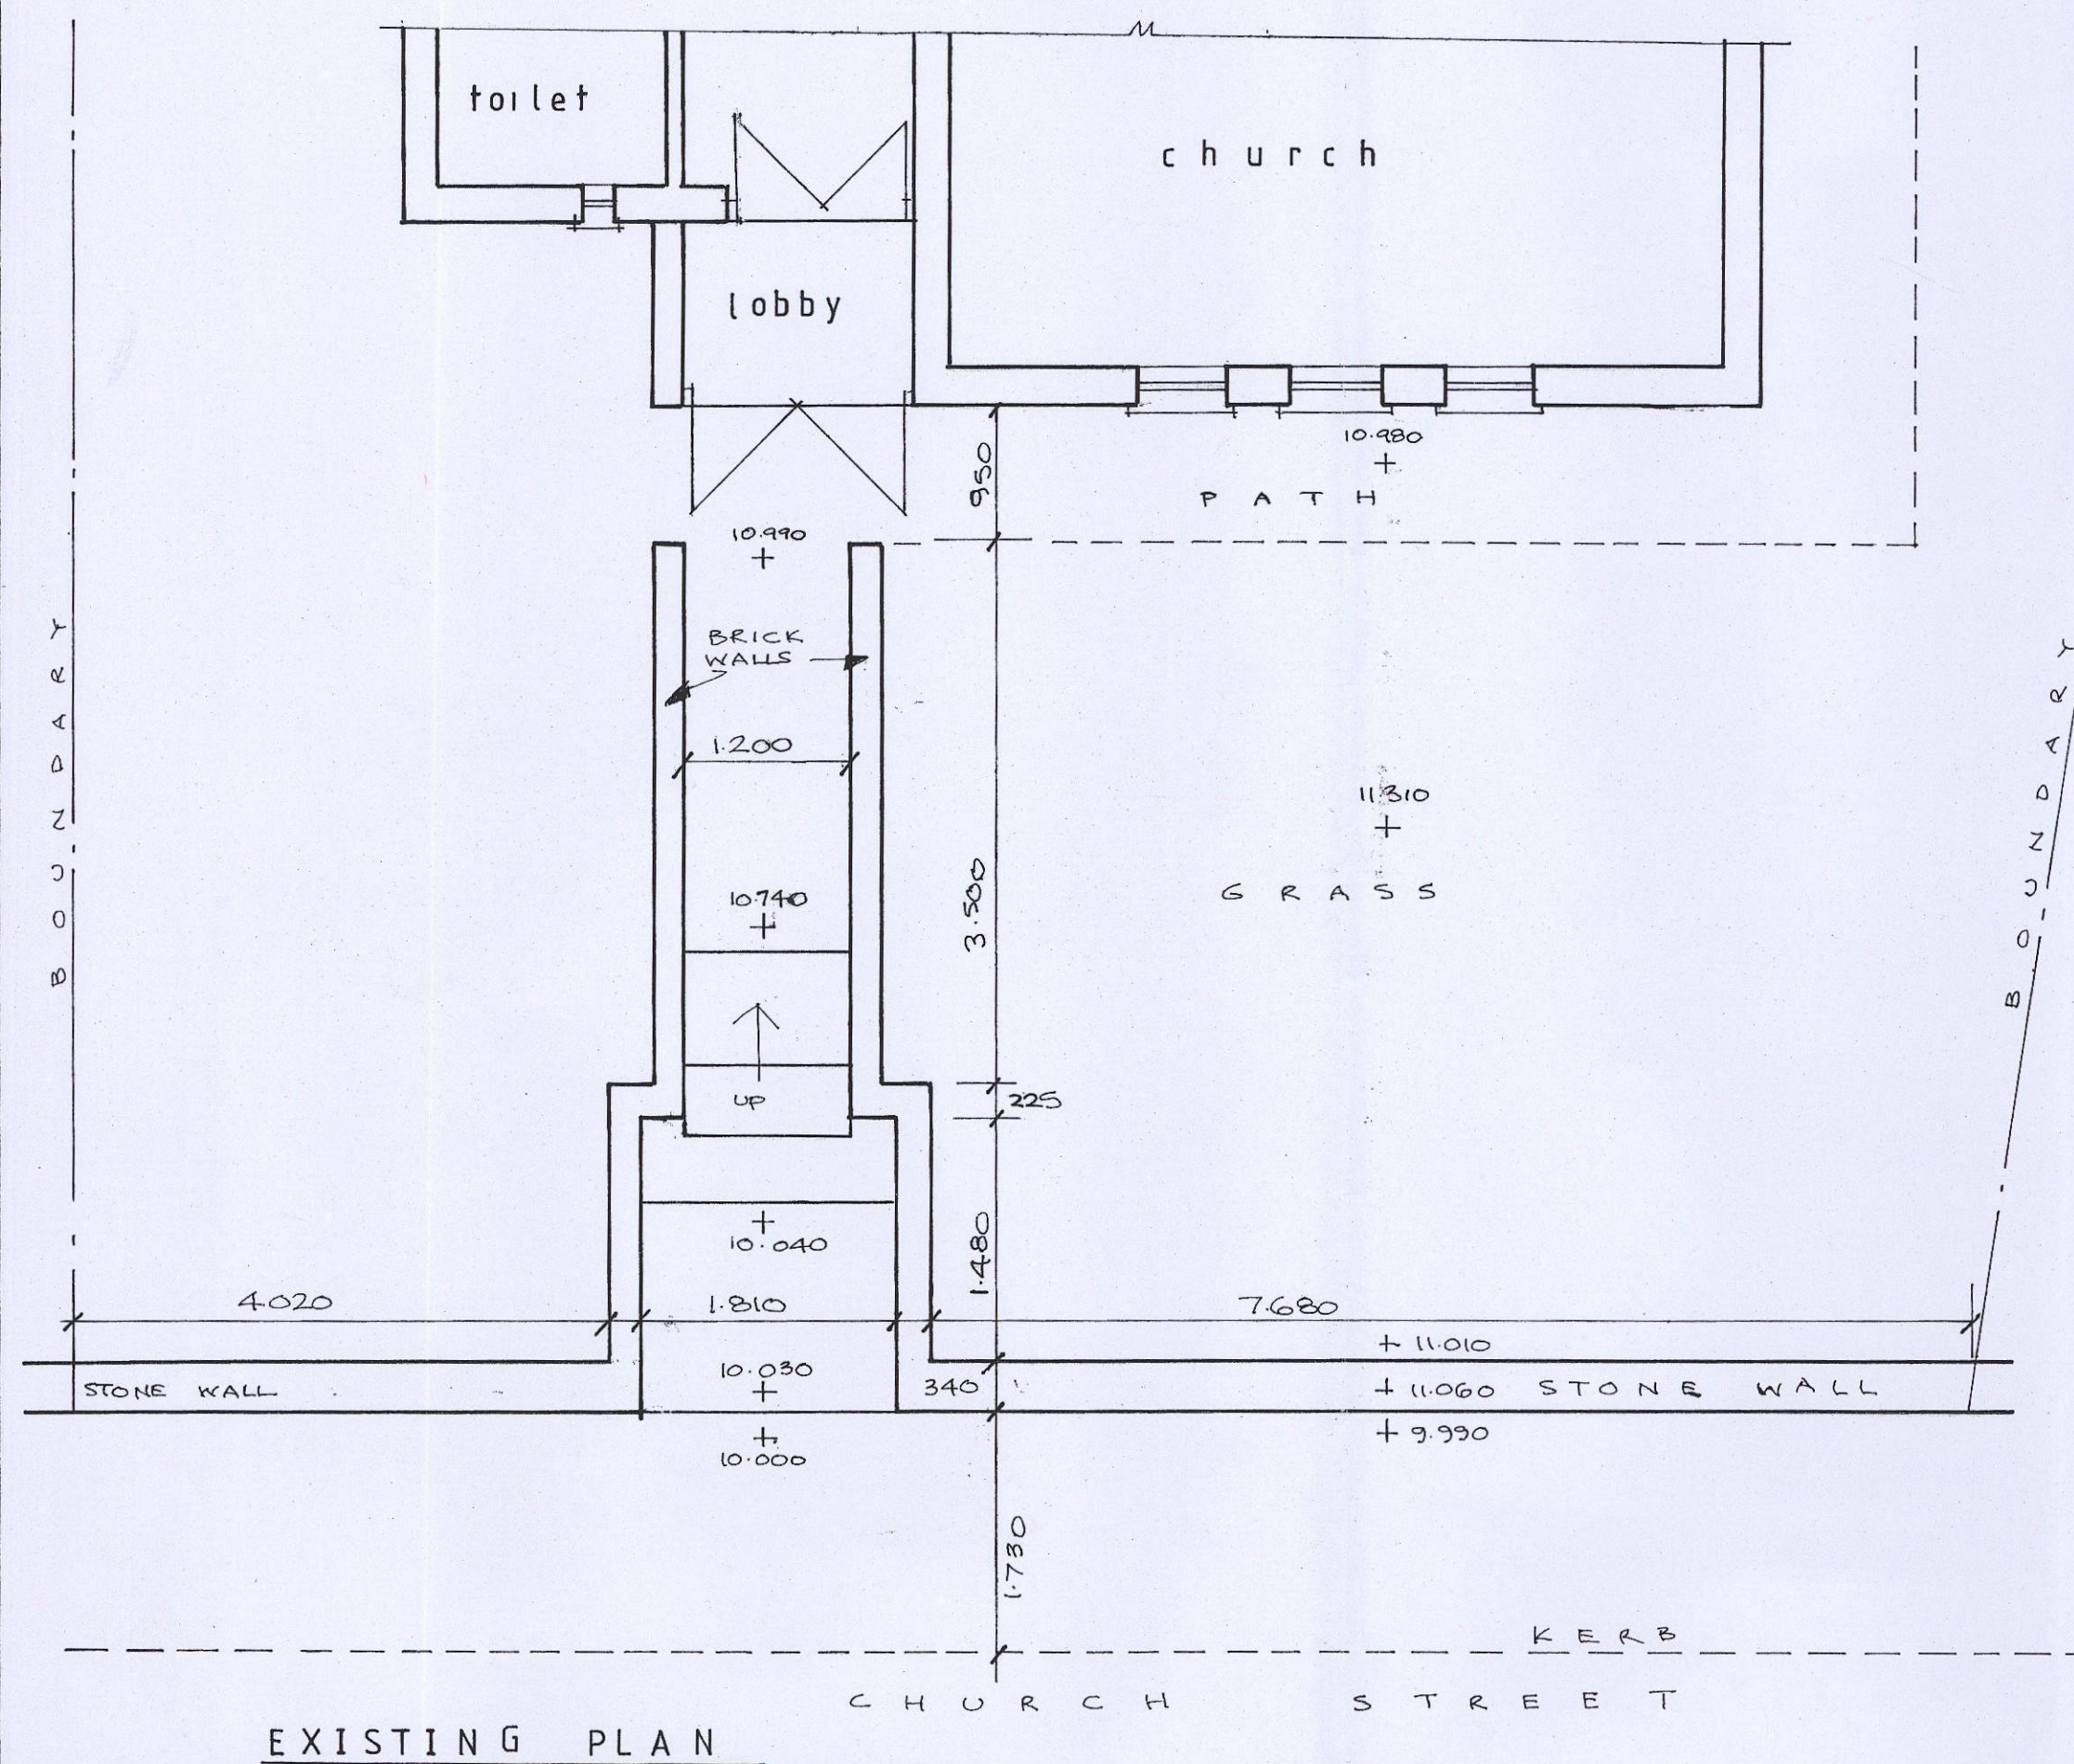

B B B C
 CORPORATE MAIL ROOM
 12 MAR 2015
 Received by:
 ORIGINAL COPY

GENERAL

Existing grassed area to front of church be excavated with existing 340 thick boundary wall in coursed natural sandstone retained; newly exposed side of stone wall made good where necessary and pointed in 1:3 cement/sand mortar

NEW WALLS

NEW WALLS
New retaining walls in 225 thick brickwork in English Bond, brick type and colour to match existing walls with brick rowlock course to top of wall; walls below ramp level in 150 thickness of 3.6 N/mm² standard grade blockwork; walls built off 225 thick concrete foundation with width as shown on Section A-A; walls fully bonded to all adjacent stone and brick walls; maximum 900 height of retained earth to grassed area

RAMPED ACCESS

Minimum 150 thickness of well compacted selected hardcore to bring up to levels; 100 thickness of structural concrete with rough finish to provide non-slip surface, cast iron handrail to be fixed to both sides of steps 1000 above ramp level; gradient of ramp to be maximum 1 in 15.50

STEPS

Existing steps removed and replaced with new steps constructed in brick risers and tactile flagstone treads; 1200 wide steps to have 170 risers and 250 treads; handrail to be fixed to both sides of steps 1000 above pitch line

**PROPOSED DISABLED ACCESS RAMP
at BRIERLEY NATIONAL SPIRITUALIST CHURCH,
CHURCH STREET, BRIERLEY, BARNSELY S72 9HT**

Scale: 1/50th