


Information within this drawing is not necessarily produced to scale. Always use figured dimensions and co-ordinates – if in doubt, ask.

NOTES

1. This drawing is to be read in conjunction with all relevant Miller Homes drawings as well as all relevant engineering drawings for each specific job.

Masonry Retaining Wall Notes:

- Mortar for retaining wall masonry to be group (ii) to BS 5628 and built in English bond.
- Retaining wall to be cast on well rolled crushed stone on well rolled existing bearing material with a minimum bearing capacity of 75kN/m²
- All mesh in retaining wall base to be deformed Type 2, high yield steel to BS 4483.
- Masonry to have a minimum density of at least 1800kg/m³ and be frost resistant and suitable for use below ground/
- Maximum surcharge behind wall to be 5kN/m², i.e garden or domestic driveway loading. For more onerous loading conditions, i.e highway retaining, consult Eastwood & Partners.
- Movement joints to be provided in walls at maximum 6m centres for brick and stone facings.

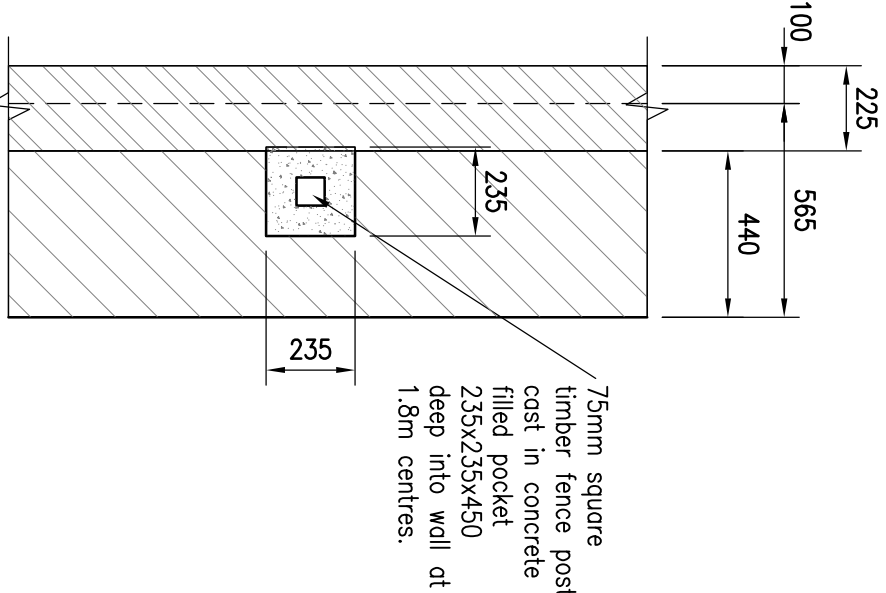

PLAN ON FENCE POST LOCATION POCKET

MASONRY RETAINING WALL


Retaining up to 0.6m.

MASONRY RETAINING WALL


Retaining up to 1.2m.

MASONRY RETAINING WALL


Retaining up to 1.6m.

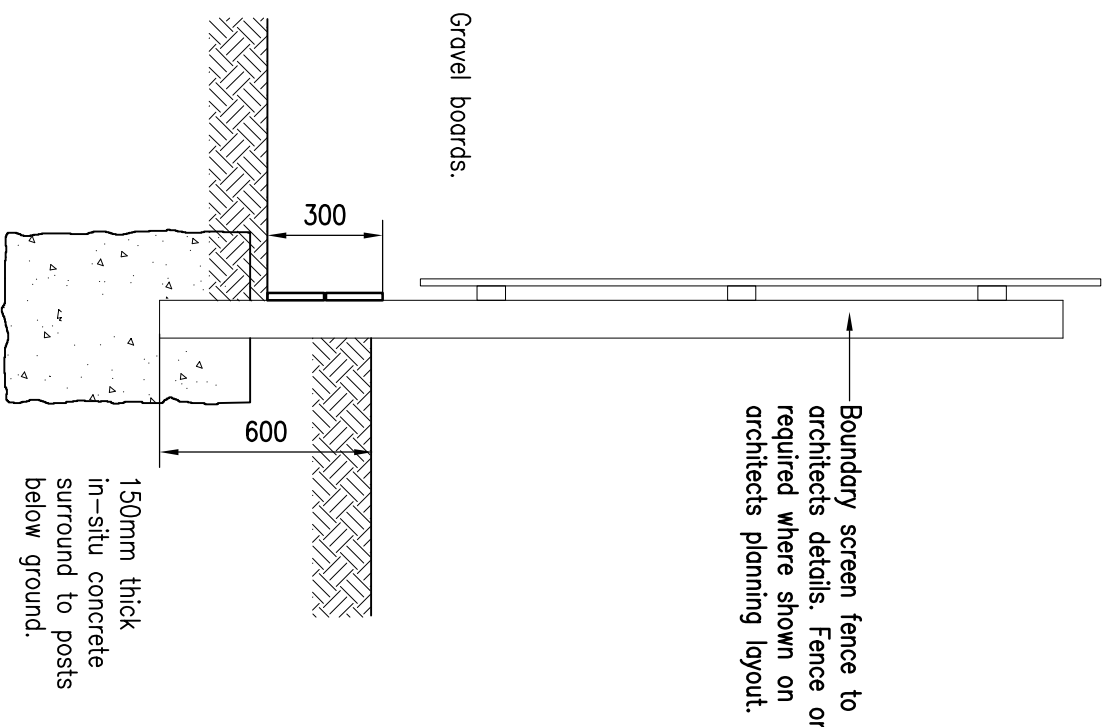

Close Boarded Fence with 300mm High Gravel Board Retainer.

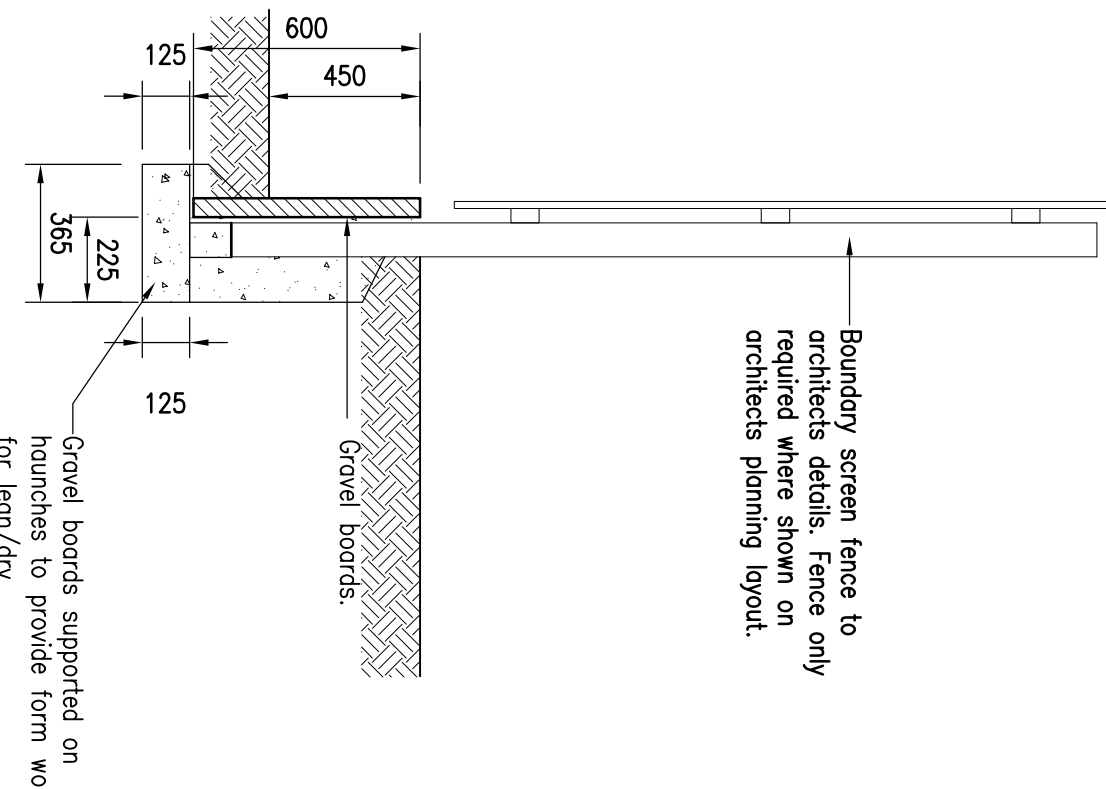

Close Boarded Fence on 450mm Gravel Board Retainer

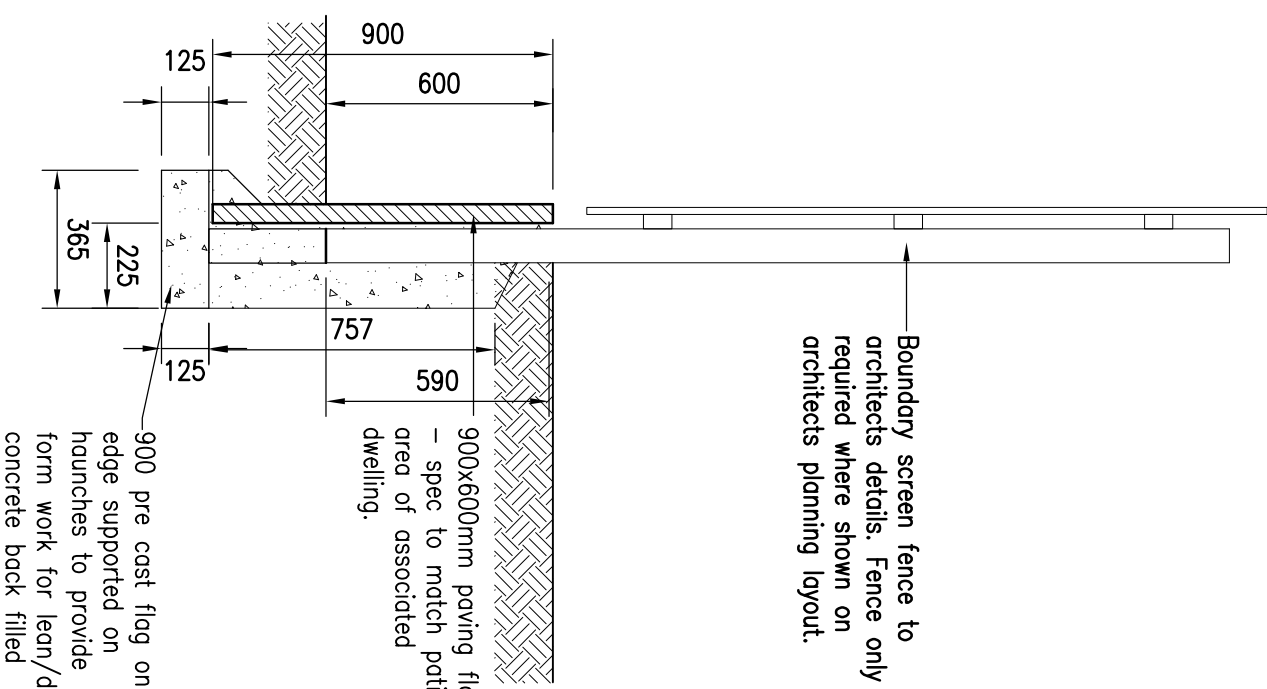

Close Boarded Fence on 600mm High Paving Flag Retaining Wall.

HONEYWELL LANE, BARNSELEY

RETAINING WALL DETAILS

Eastwood & Partners
CONSULTING ENGINEERS
St. Andrew's House
23 Kingfield Road
Sheffield
S11 9AS
Tel 0114 255 4554
Fax 0114 255 4330



mail@eastwoodandpartners.com
www.eastwoodandpartners.com

SCALE WHEN PLOTTED AT A1

DRAWING STATUS

1:20 1:10 CONSTRUCTION

DRAWN	CHECKED	DATE	DRAWING NUMBER	REV
RJ	PR	12.07.16	36903/024	A