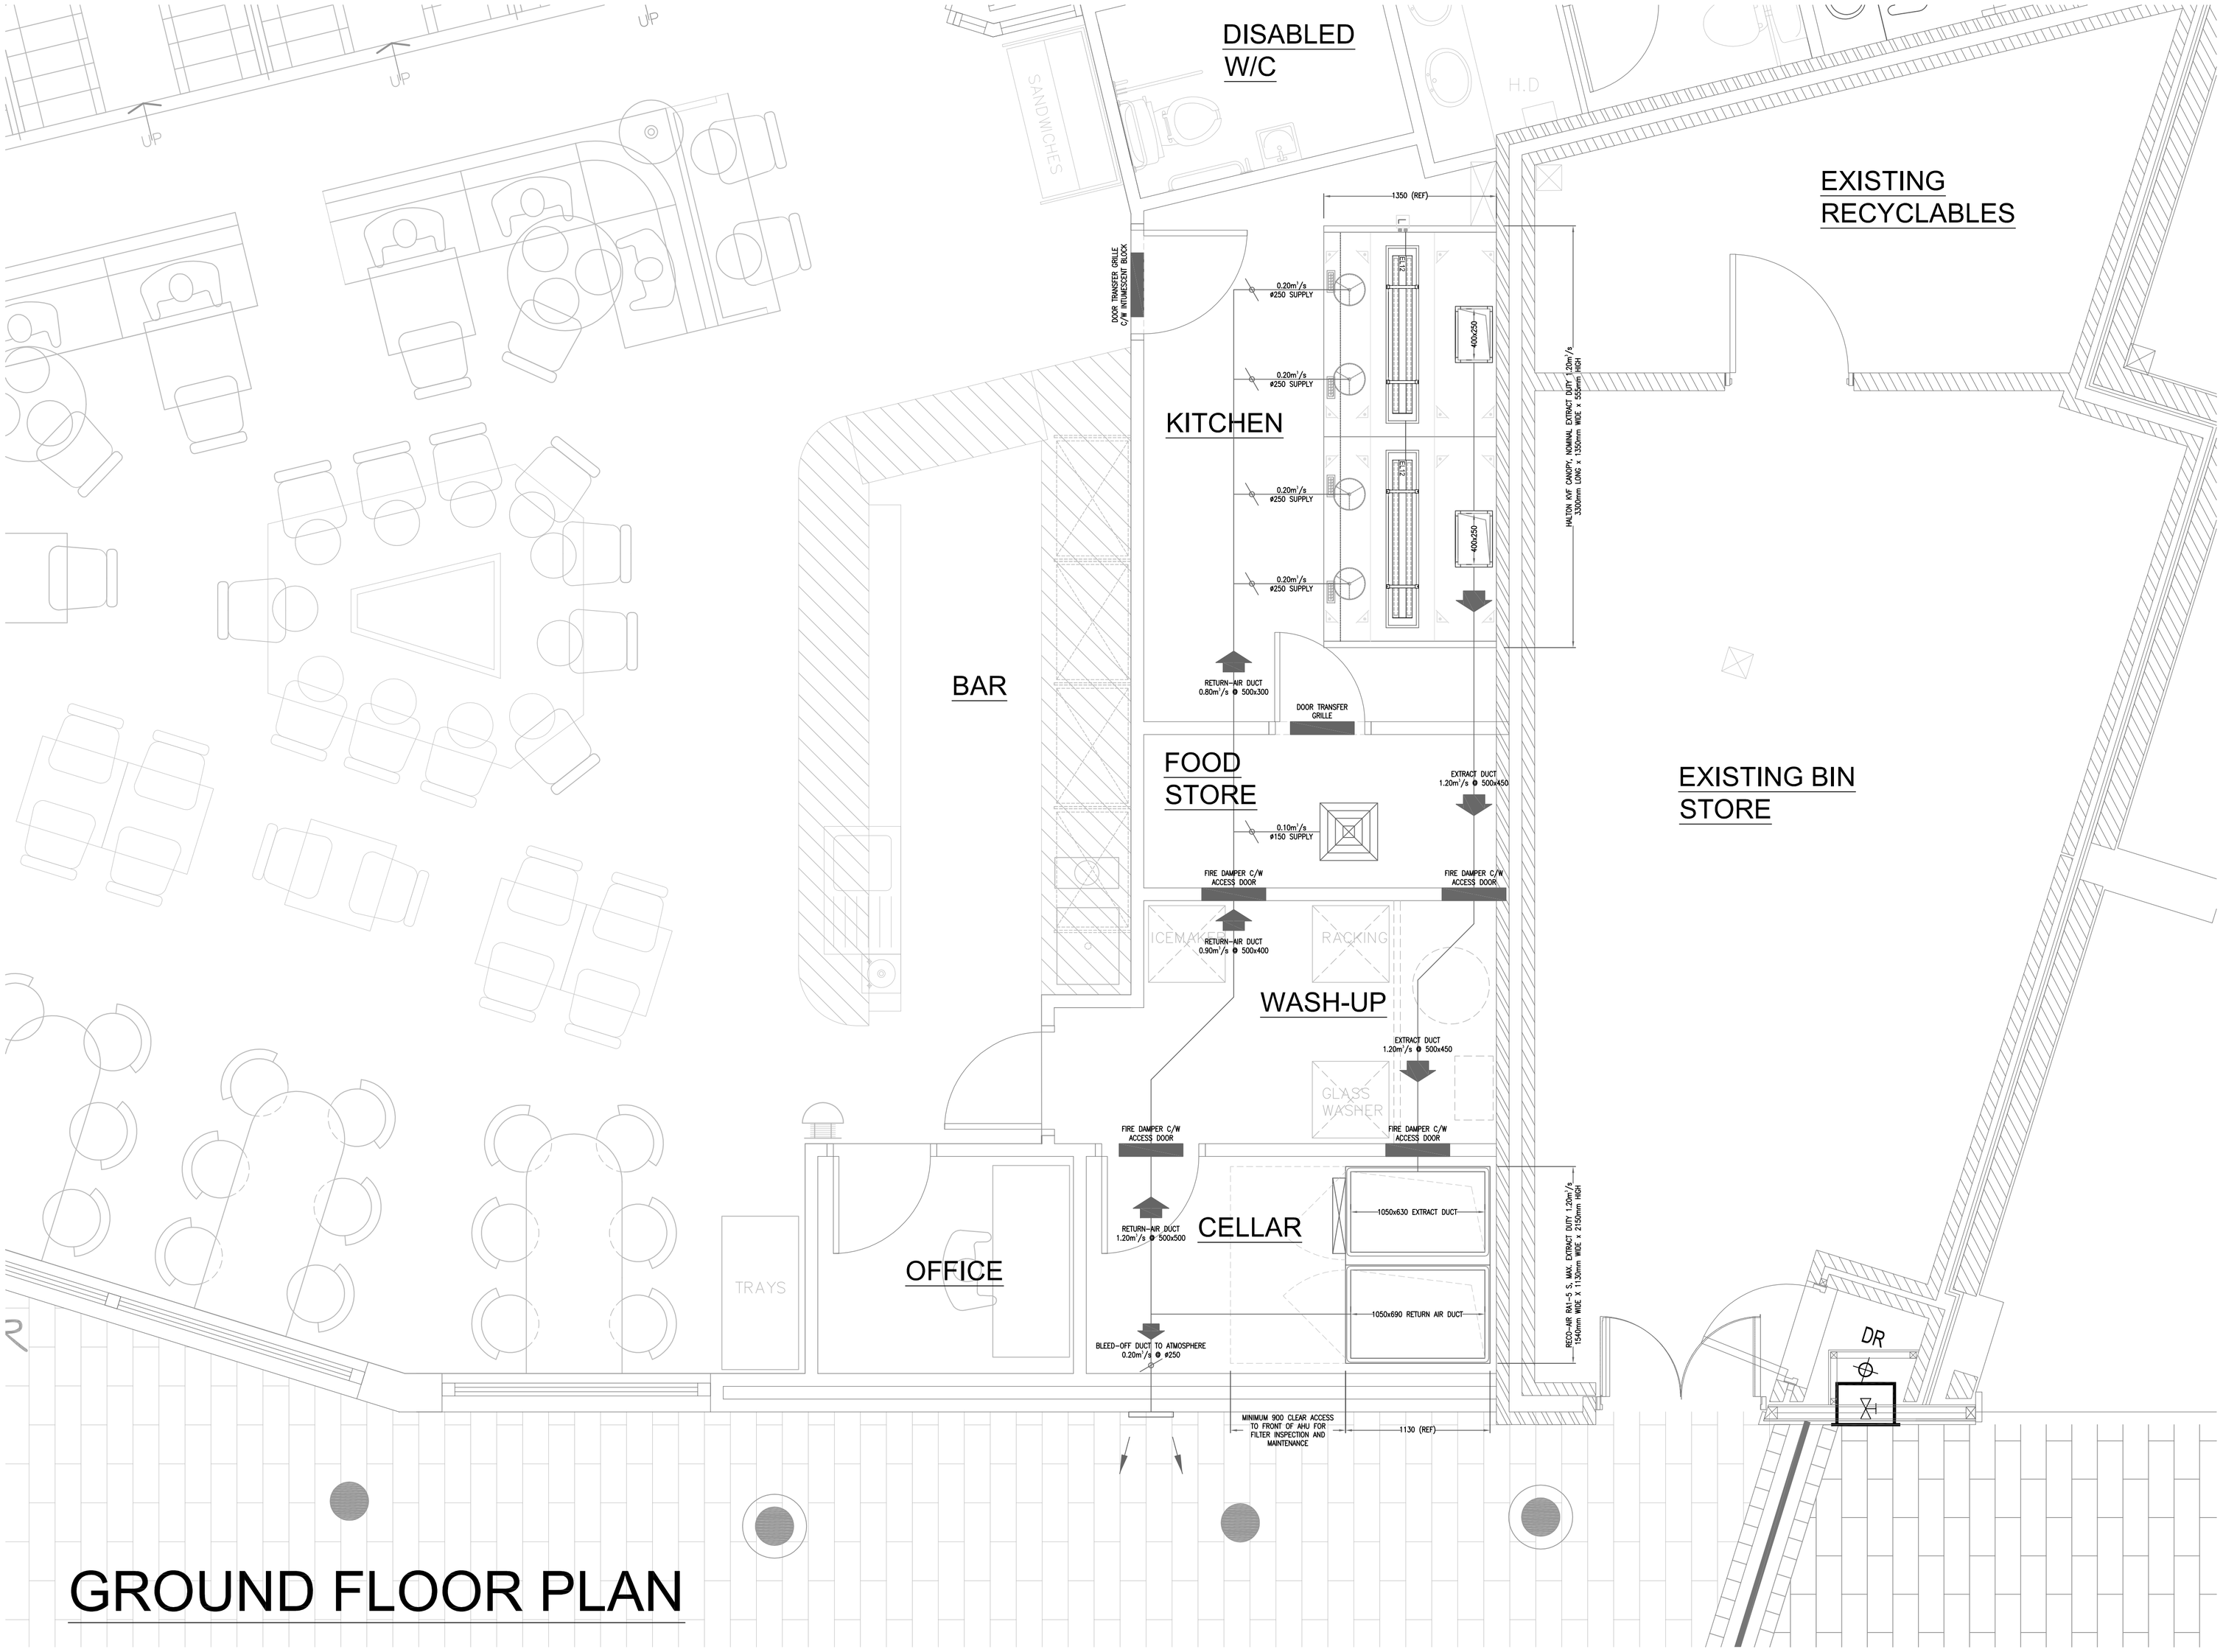


# GROUND FLOOR PLAN

DO NOT SCALE:

ALL DIMENSIONS IN MILLIMETRES

HALTON COMPONENTS FABRICATED FROM 18G (1.2) STAINLESS STEEL GRADE 304 S16 (EN58E) TO BS 1449-PART 4 AND BS 970-PART 4 240S (SILICONE FINISH). ALL WELDED FORMED & FOLDED CONSTRUCTION.

SJ SITE JOINT

PLEASE NOTE:
TO COMPLY WITH BS-6173-2009 MANDATORY INTERLOCKS ARE NOW REQUIRED BETWEEN GAS SUPPLY AND THE MECHANICAL KITCHEN VENTILATION SYSTEM (EXTRACT & MAKE UP AIR).
PLEASE ASCERTAIN WHICH CONTRACTOR IS TO SUPPLY THESE INTERLOCKS

REVISIONS

| | | | |
|---|---|---|---|
| - | - | - | - |

CLIENT:

BROOK LEISURE GROUP Limited

1 FITZWILLIAM STREET,
BARNSLEY,
S70 2RF.
-

PROJECT:

GATEWAY PLAZA
CAFE & TAPAS BAR

FITZWILLIAM STREET,
BARNSLEY,
S70 2RF.
-

DRAWING CONTENT

DETAILS OF PROPOSED KITCHEN VENTILATION SCHEMATIC
-
GROUND FLOOR
PROPOSED KITCHEN PROJECT
-

Status: PRELIMINARY

Halton
11 LAKER ROAD, AIRPORT INDUSTRIAL ESTATE
ROCHESTER, KENT ME1 3QX
Telephone: (01634) 666111
Fax: Projects: (01634) 666444
Fax: Sales: (01634) 666333
www.halton.com/foodservice

This drawing is the copyright of Halton Foodservice Ltd. and must not be copied without permission of Halton Foodservices Ltd.

| TYPE | CHECKED |
|---|---|
| PRELIMINARY DRAWING | MB |

| SCALE: | DATE: | DRAWN: |
|---|---|---|
| 1:25 @ A1 | 04.09.2017 | RJD |

| DRAWING No: | REVISION: |
|---|---|
| 28450-00-01 | - |