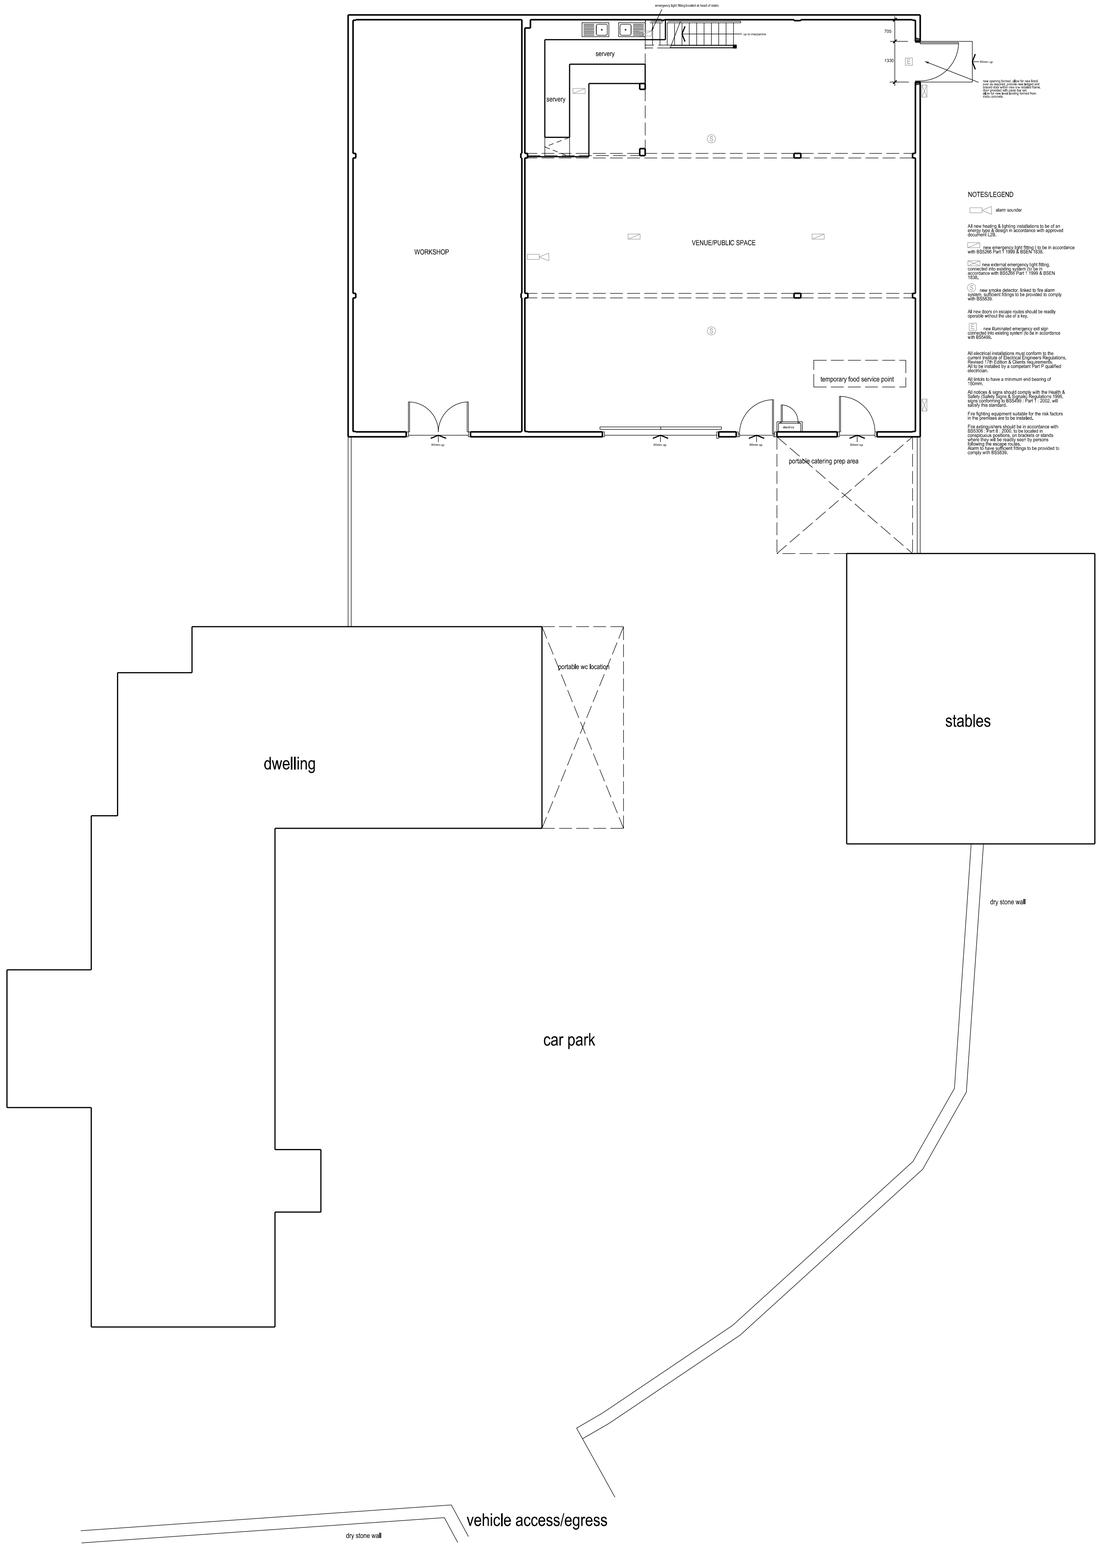

NOTES/LEGEND

alarm sounder

All new heating & lighting installations to be of an energy type & lifestyle in accordance with approved document L2B.

new emergency light fitting c/w be in accordance with BS5266 Part 1 1999 & BSEN 1838.

new external emergency light fitting. c/w be in accordance with BS5266 Part 1 1999 & BSEN 1838.

S new smoke detector, linked to fire alarm c/w equipment fittings to be provided to comply with BS5839.

All new doors on escape routes should be readily openable without the use of a key.

E new illuminated emergency exit sign connected into existing system to be in accordance with BS5499.

All electrical installations mu;st conform to the current Institute of Electrical Engineers Regulations, Revised 17th Edition & Clients requirements, and to be installed by a competent Part P qualified electrician.

All lintels to have a minimum end bearing of 150mm.

All notices & signs should comply with the Health & Safety (Safety Signs & Signals) Regulations 1996, signs to comply with BS5499/ISO 7010 : Part 1 : 2002, will signs this standard.

Fire fighting equipment suitable for the risk factors in the premises are to be installed.

Fire extinguishers should be in accordance with BS5306 : Part 8 : 2000, to be located in prominent positions on escape routes & exits where they will be readily seen by persons following the escape routes.

Smoke detection & alarm fittings to be provided to comply with BS5839.

Copyright. This drawing and design and all the information contained therein is the sole copyright of AP Doughty Design Consultant and reproduction in any form is forbidden unless permission is obtained in writing.

CONTRACTORS PLEASE NOTE

1) Warning, no dimensions to be scaled from this drawing.All contractors to visit the site and be responsible for taking and checking all dimensions relative to this work. The designer must be advised of any discrepancies in writing.

2) This drawing must be read in conjunction with the specification / bill of quantities and related drawings. Any structural work must be carried out to the exact specification and requirements of the clients's appointed structural engineer, and any amendments must have his express prior written authority.

3) All structural work must be inspected at all relevant stages by the structural engineer and the Local Authority's Building Surveyor and comply with their requirements. Any costs and claims for damages, loss of trade, etc. incurred by failing so to do are the sole liability of the contractor.

4) Any discrepancies between drawings and/or drawings and specification, should be reported to the designer prior to any work commencing.

	Date	Revisions	Ini.

AP DOUGHTY
DESIGN CONSULTANT

127 SYCAMORE HOUSE ROAD, SHEFFIELD, S5 0UD
TEL : 0114 2450074, MOBILE 07717 290303
E MAIL apdoughty127@gmail.com

Client
MR & MRS P. LOFTHOUSE

Job Title
RIDDLE PIT FARM,
PENISTONE ROAD,
HOLMFIRTH,
HD9 2TR.

Drawing Title
PROPOSED VENUE FACILITY LOCATIONS

Scale & paper size	Drawn By
1:100 @ A1	APD
Date	**Checked By**
JULY 2019	

Drg.no.	Rev.
PL-RPF-03	