
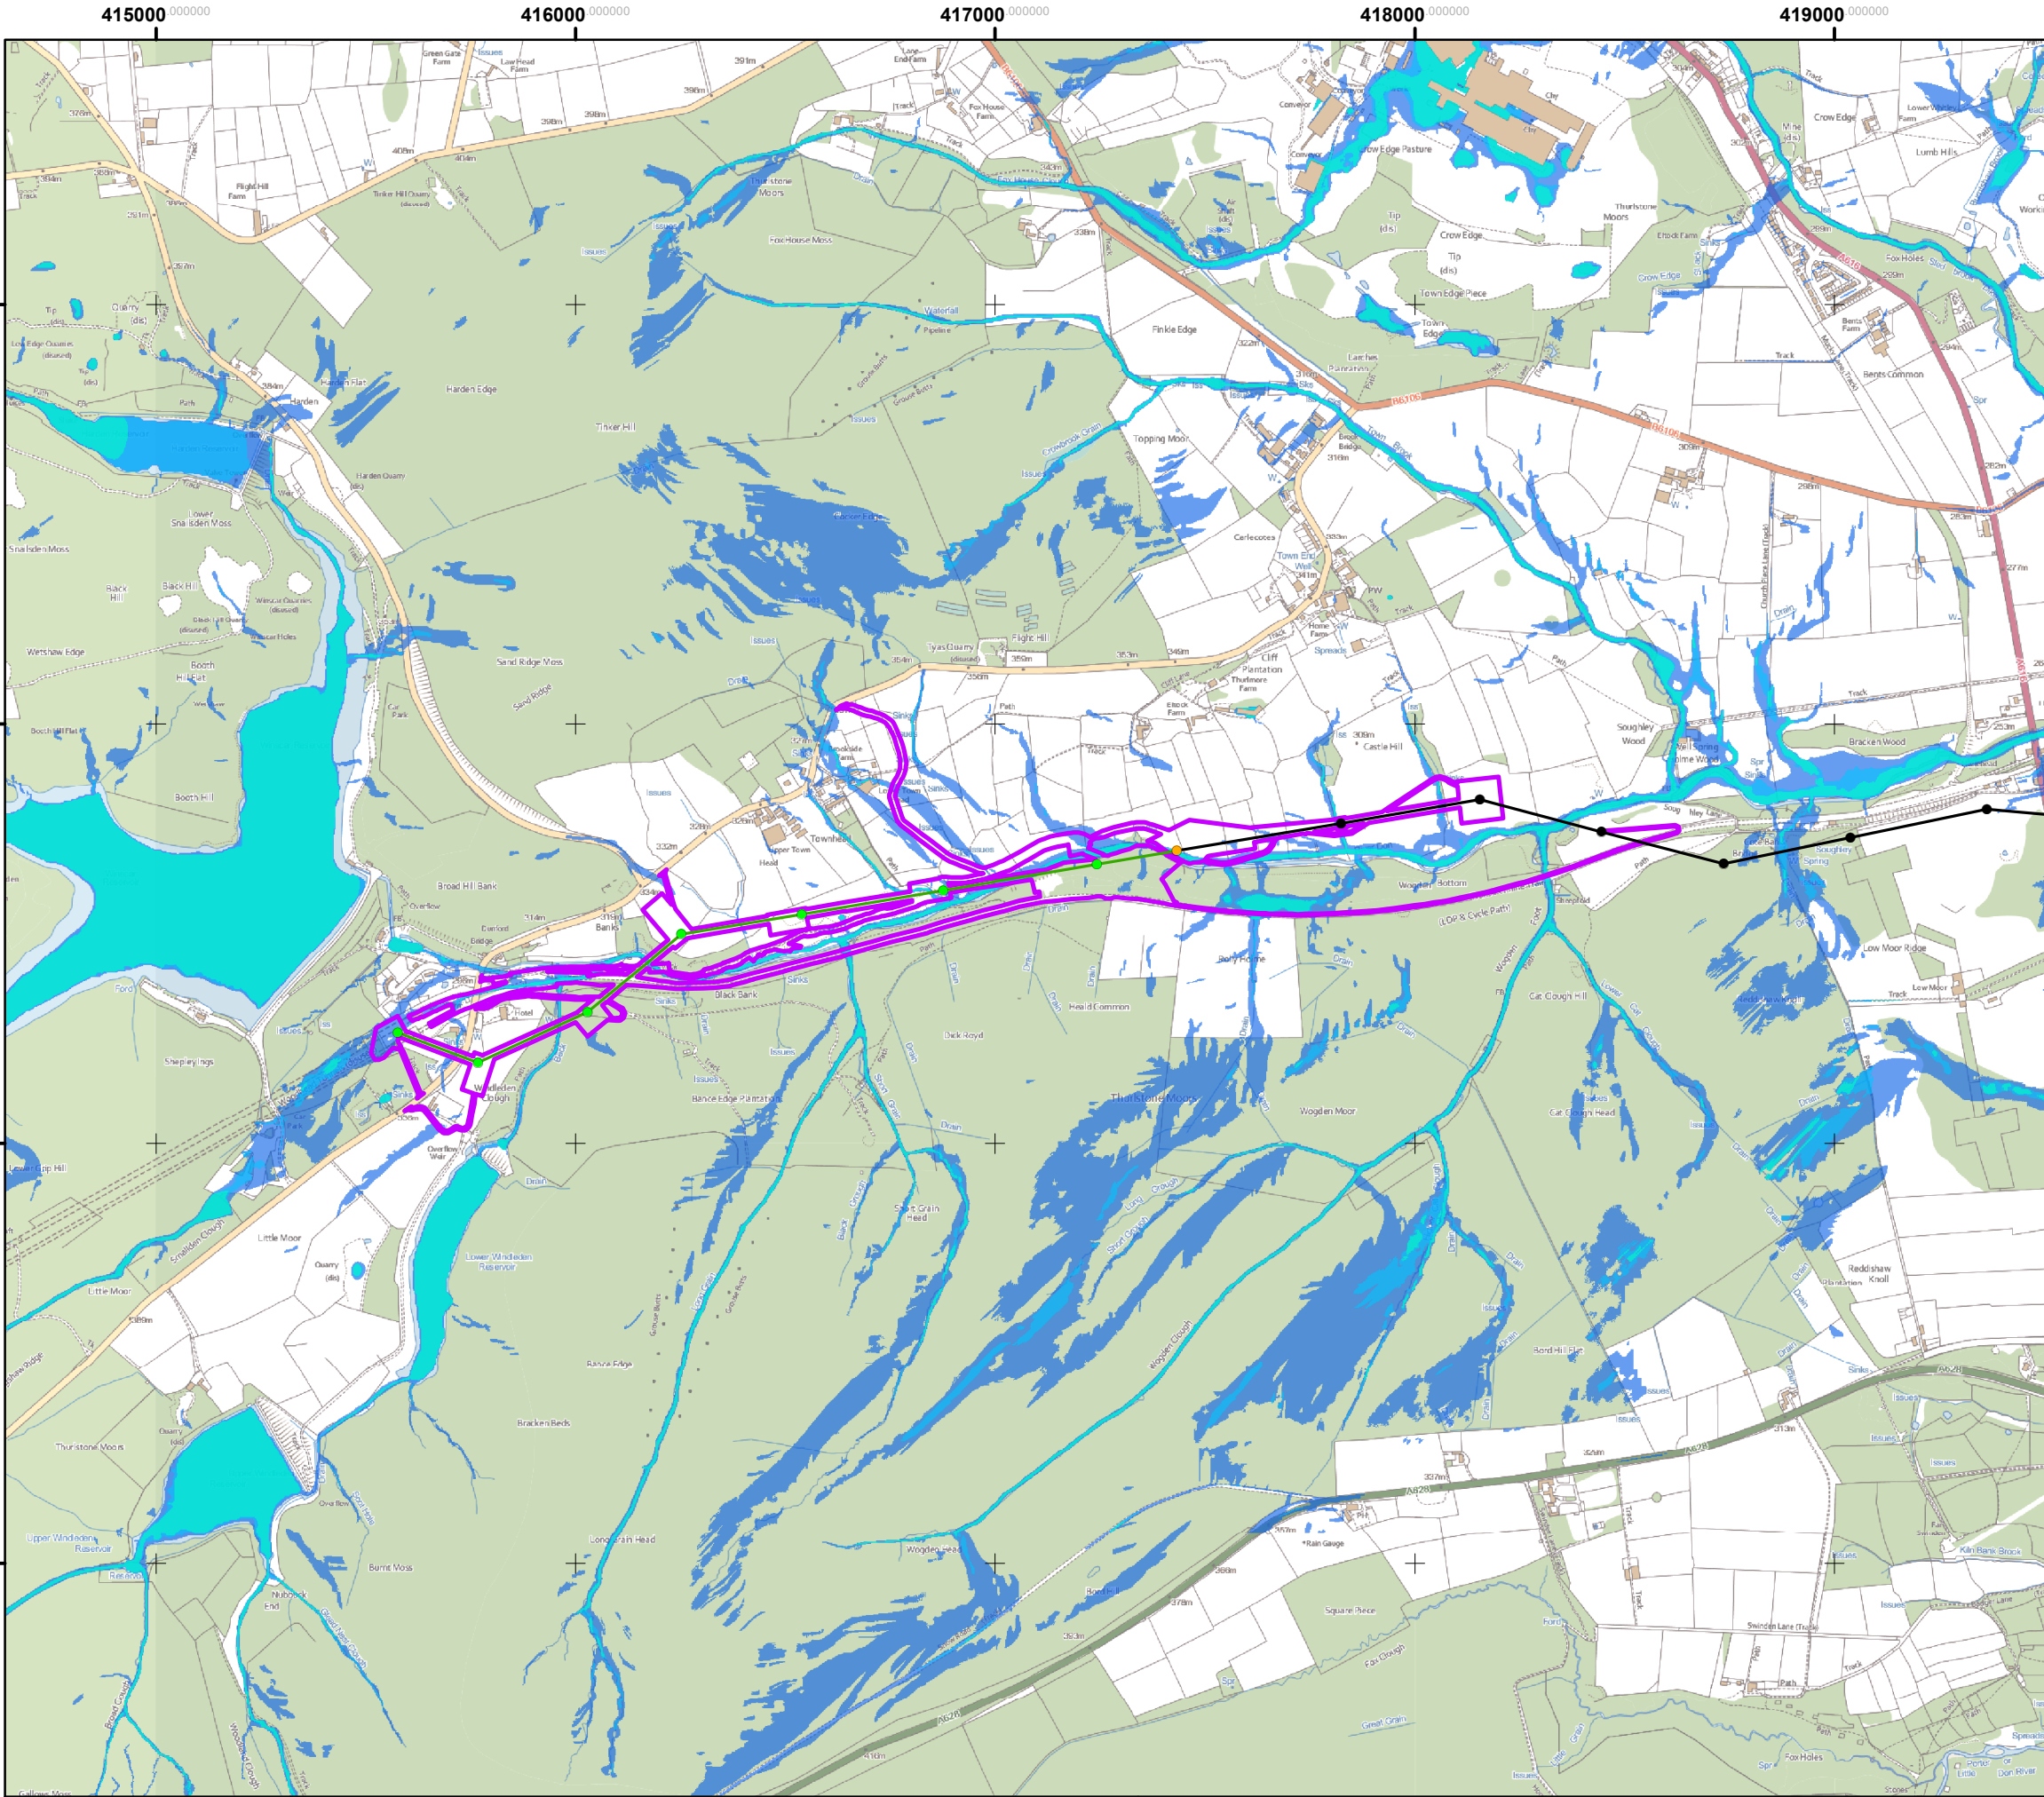


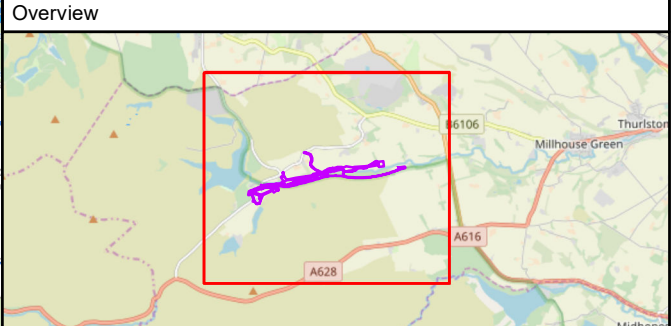

- Site Boundary**
- Existing Infrastructure**
- Existing pylon to remain
 - Existing pylon to be removed
 - Existing pylon to be replaced
 - Existing overhead line to be retained
 - Existing overhead line to be removed
- Risk of Flooding from Surface Water**
- High - chance of flooding of greater than 1 in 30 (3.3%)
 - Medium - chance of flooding of between 1 in 100 (1%) and 1 in 30 (3.3%)
 - Low - chance of flooding between 1 in 1,000 (0.1%) and 1 in 100 (1%)

Source:
Tower and overhead line: National Grid, 2015.
Site Boundary: AECOM, 2015, edited Mott MacDonald May 2019.
Flood Zones:
Contains information provided by the Environment Agency 2016. Copyright © and Database rights Environment Agency 2010. All rights reserved.

Reproduced from Ordnance Survey digital map data © Crown copyright 2015.
All rights reserved. Licence number National Grid Electricity - 100024241
Reproduced from Ordnance Survey digital map data © Crown copyright 2016.
All rights reserved. Licence number 0100031673

004	For information	GS	TN	KL	02/05/19
003	For information	GS	TN	KL	28/03/19
002	For information	GS	LA	KL	18/10/18
Rev	Description	Cre'd	Chk'd	App'd	Date

nationalgrid

Master Scheme No:	Sub-Scheme No:	Site:
Not Provided	Not Provided	Peak District

Scheme Name:
Visual Impact Provision - Peak District (East) Project

Document Title:
Figure 9.7: Environment Agency Risk of Flooding from Surface Water

Created by:	Date:	Checked by:	Date:	Approved by:	Date:
GS	02/05/19	TN	02/05/19	KL	02/05/19
Development Eng:	Document Type:	Scale:	Format:	Sheet(s):	Rev:
-	-	1:16,000	A3	1 of 1	001

National Grid Document Number:
PDD--LAY-012

FEED Document Number:
MMD-362981-C-GIS--XX-0012

