






Front Elevation

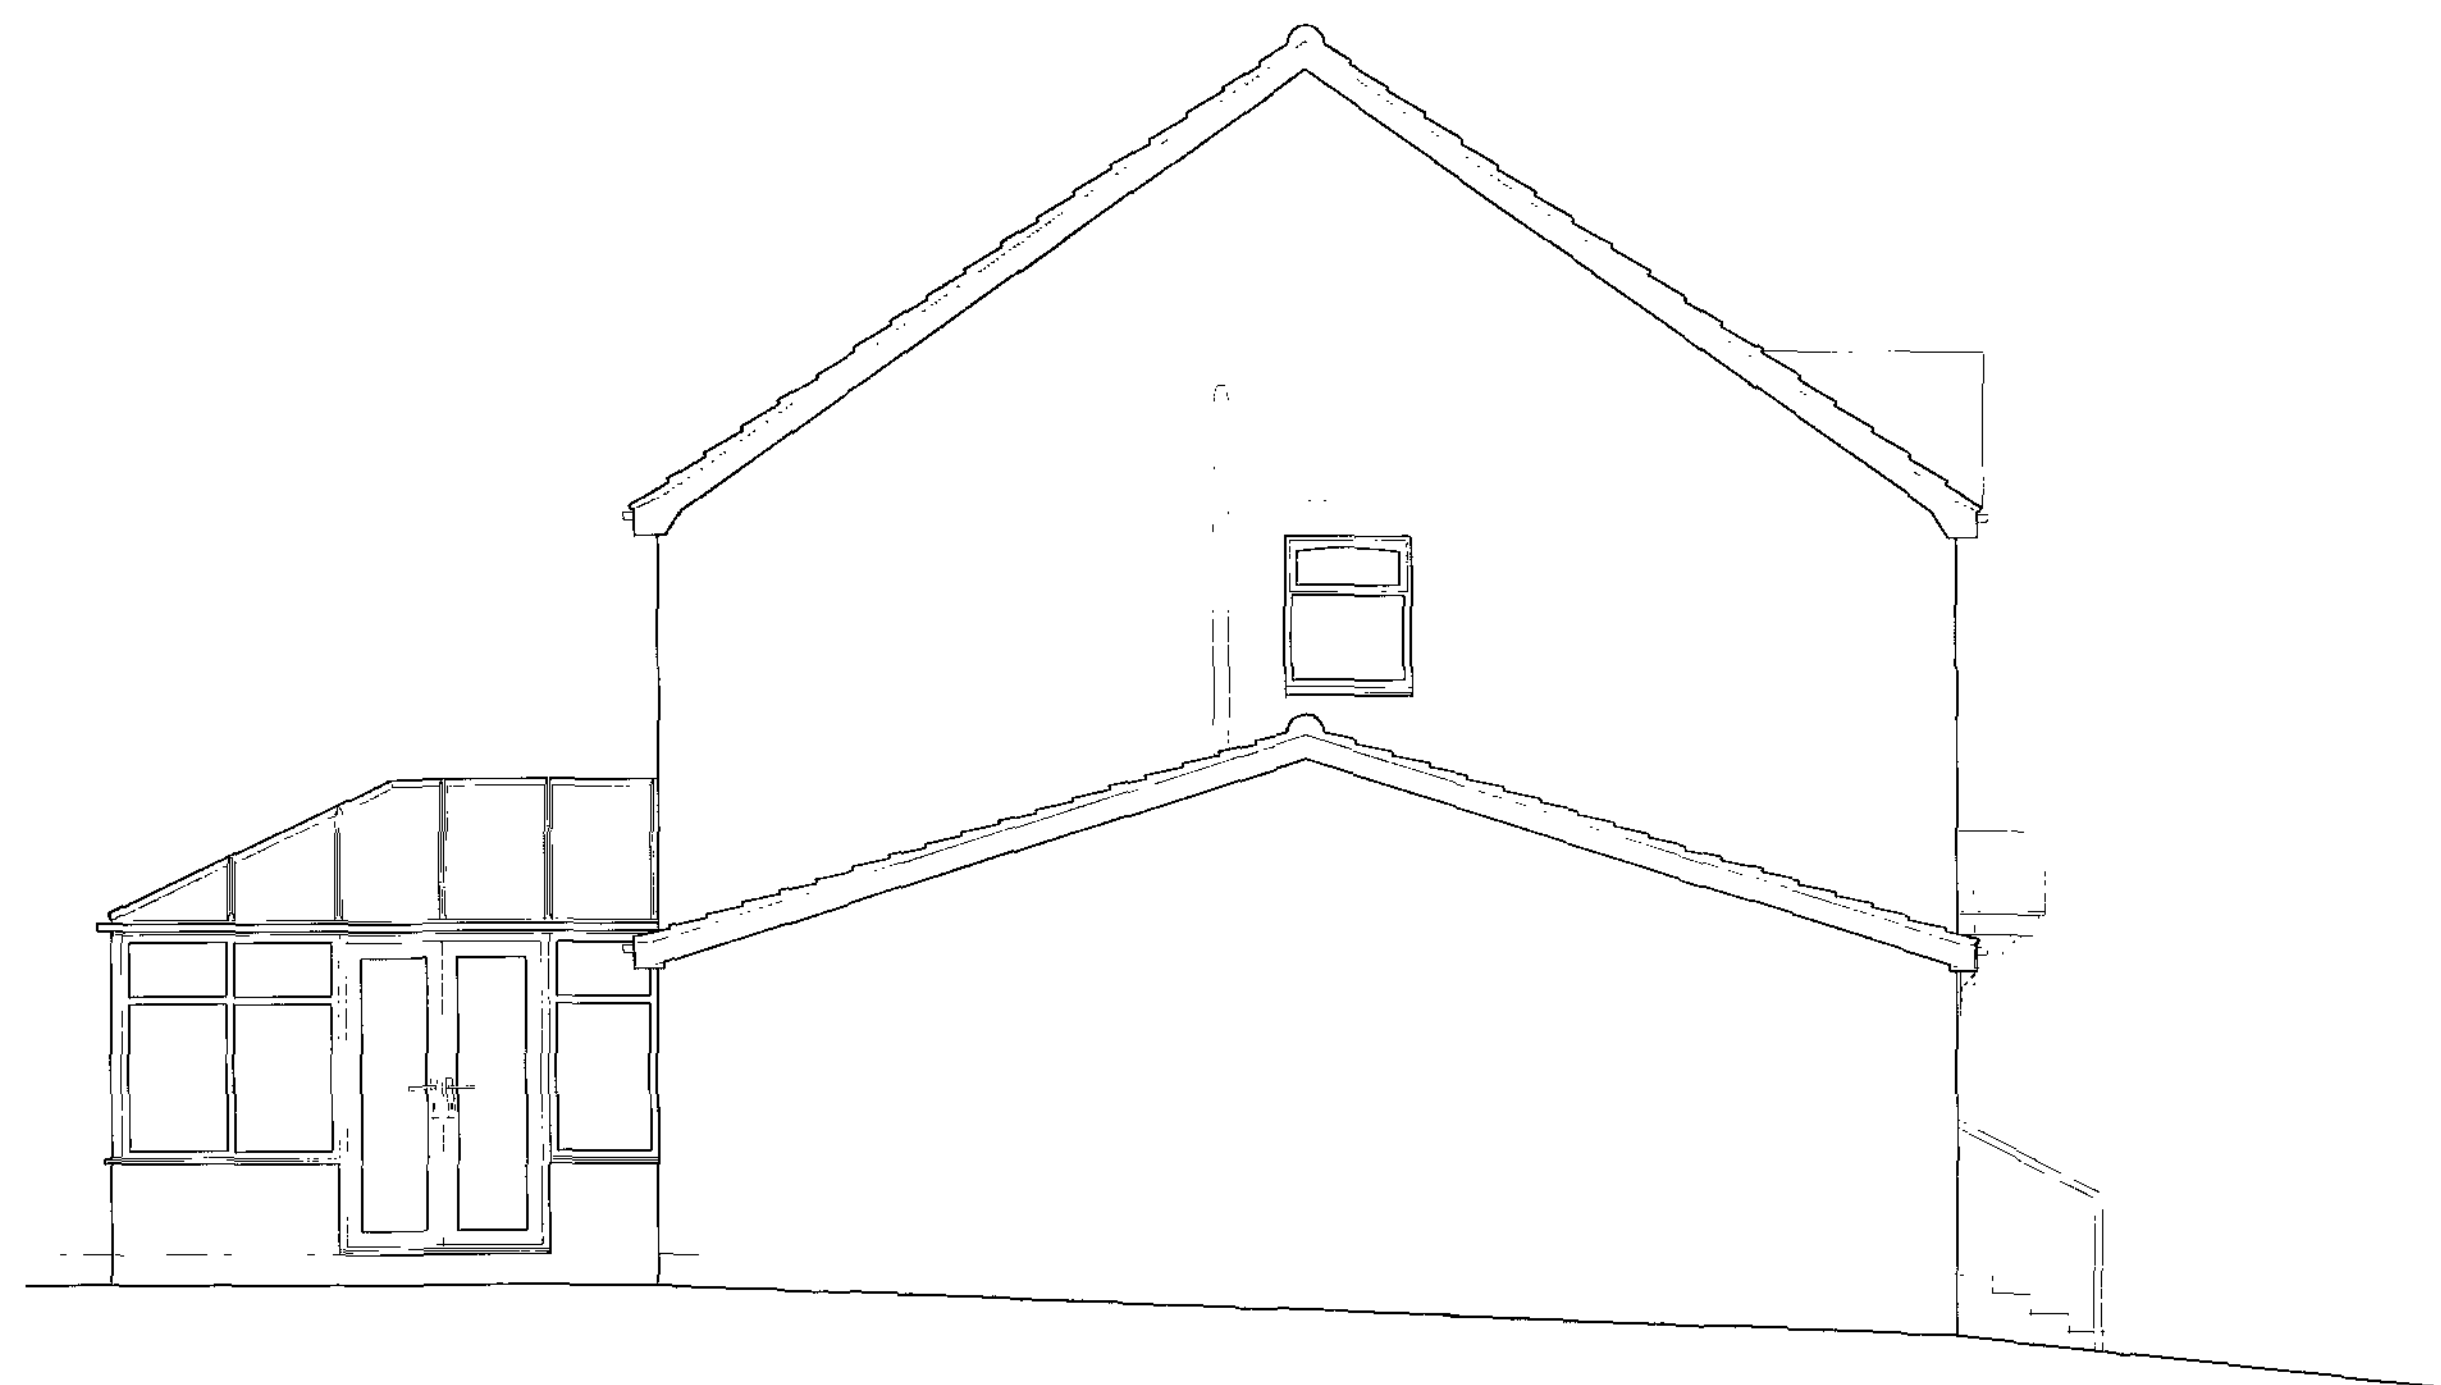


Side Elevation

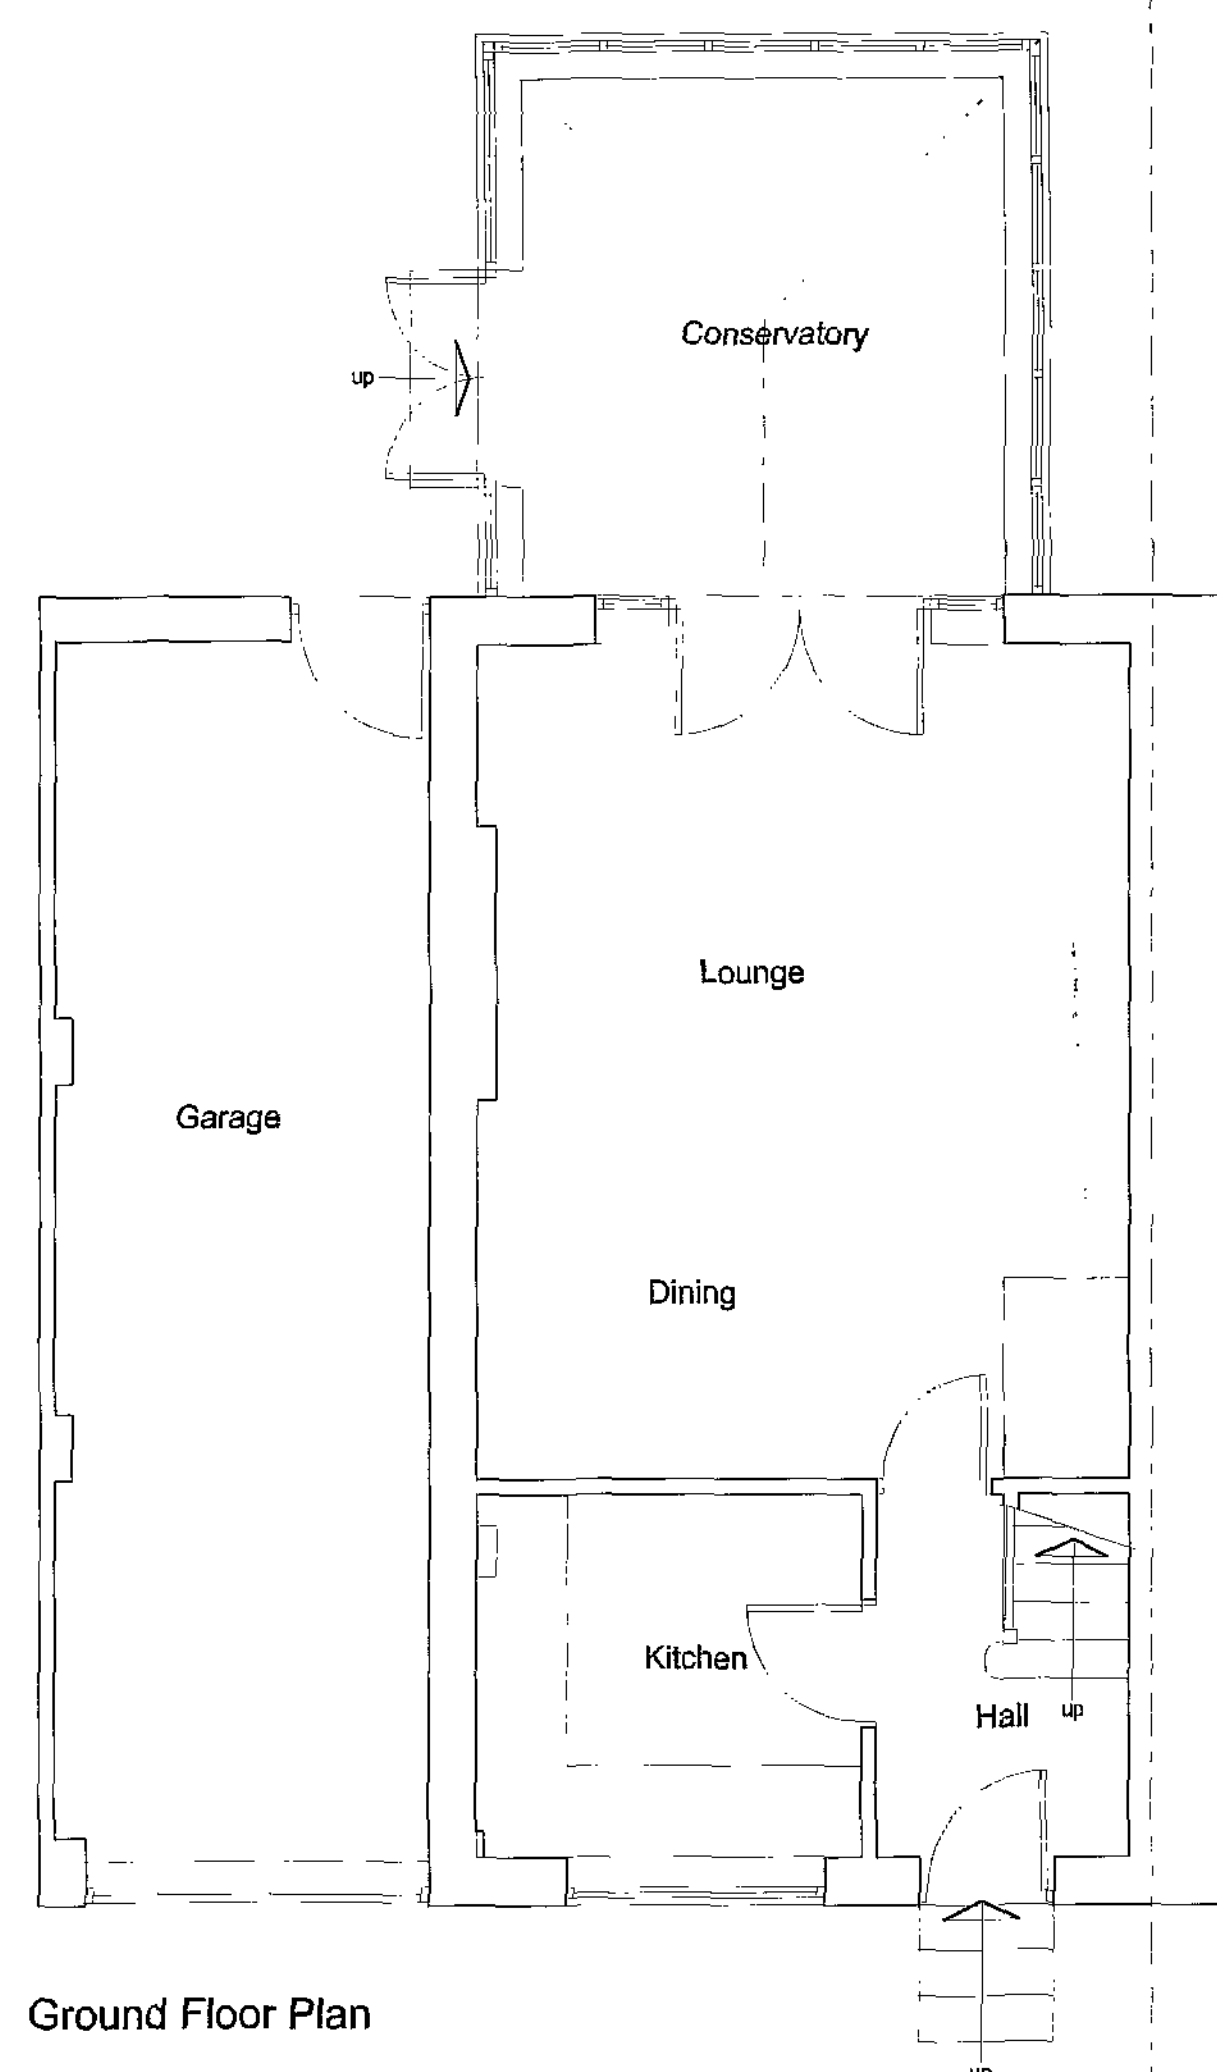

Ground Floor Plan

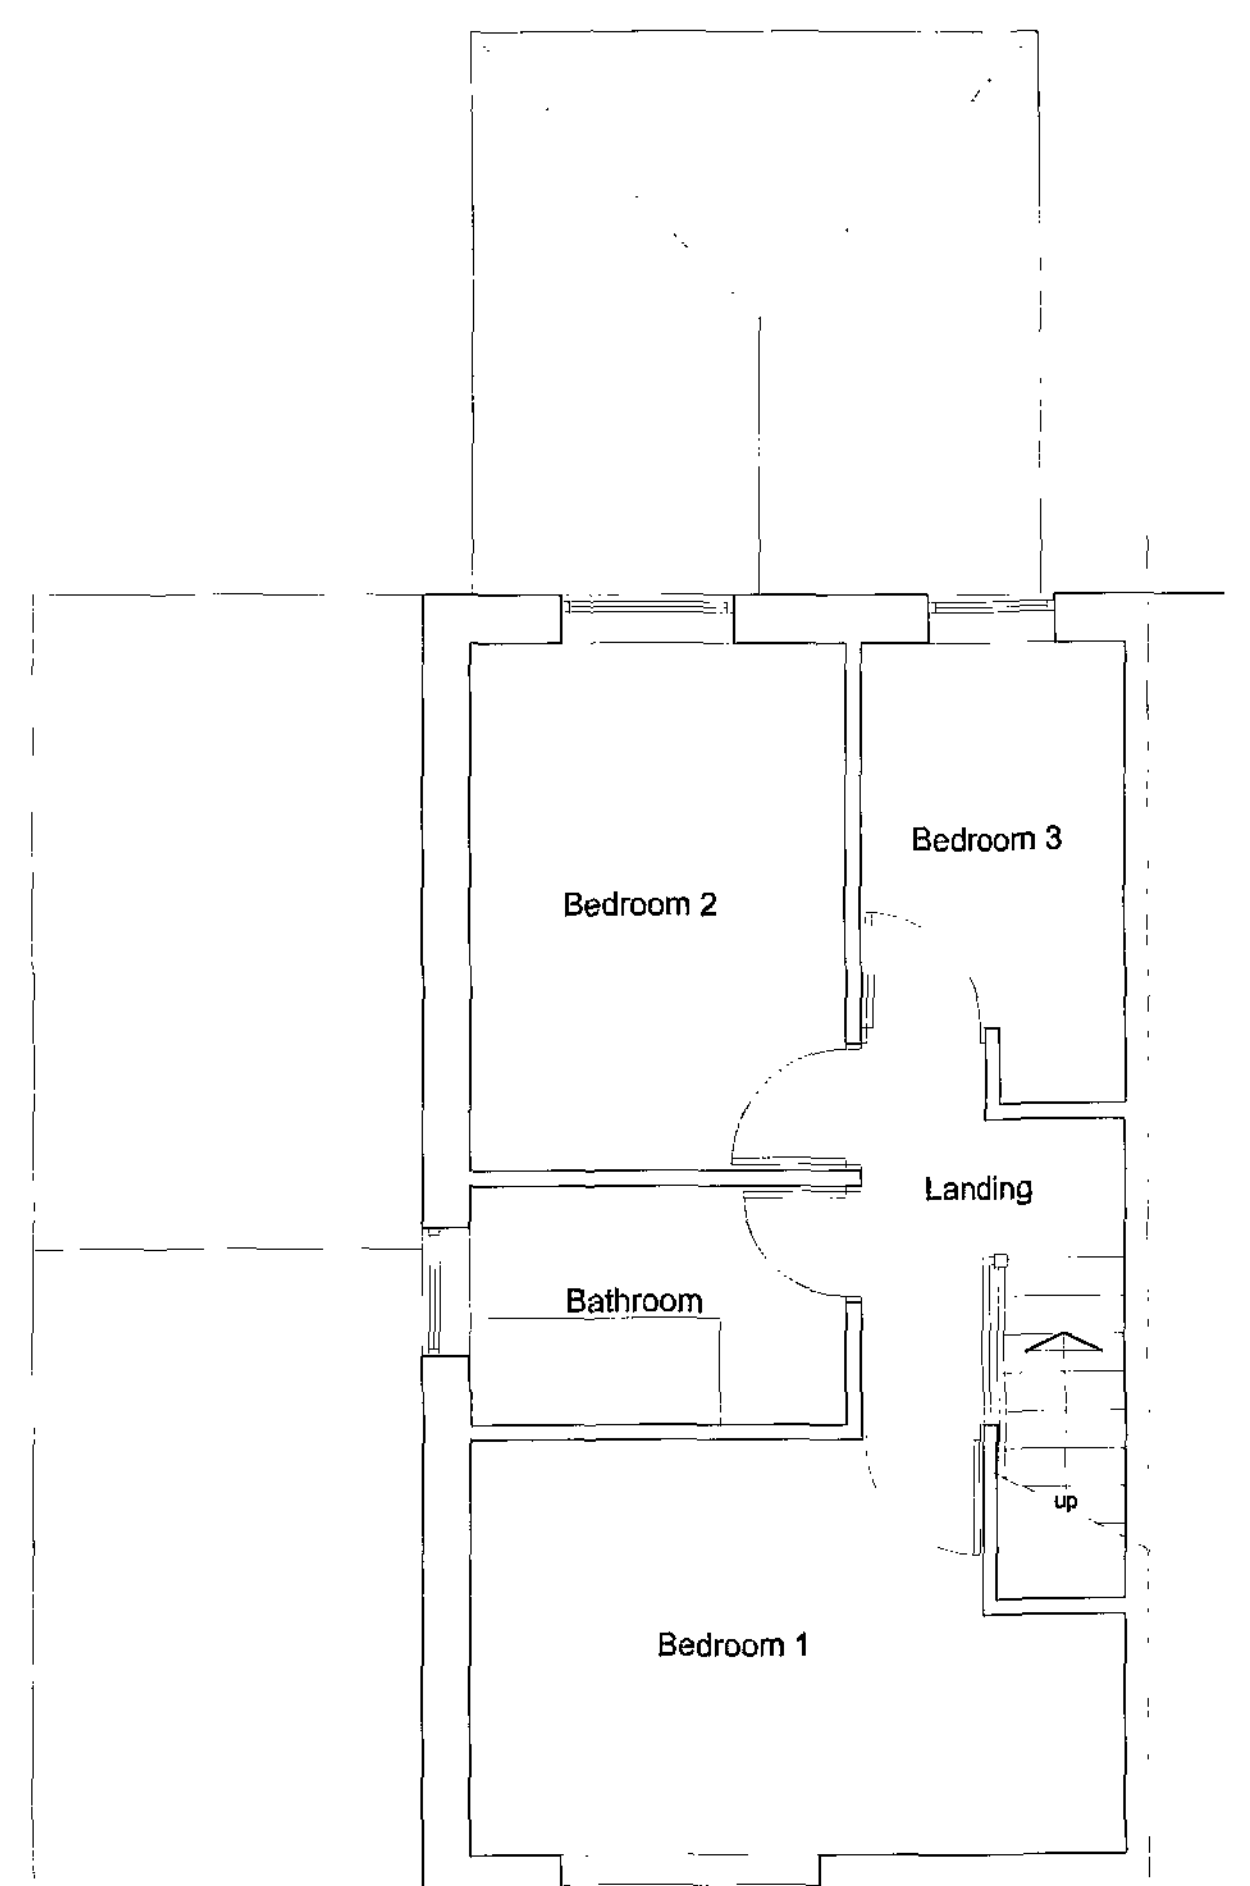

First Floor Plan

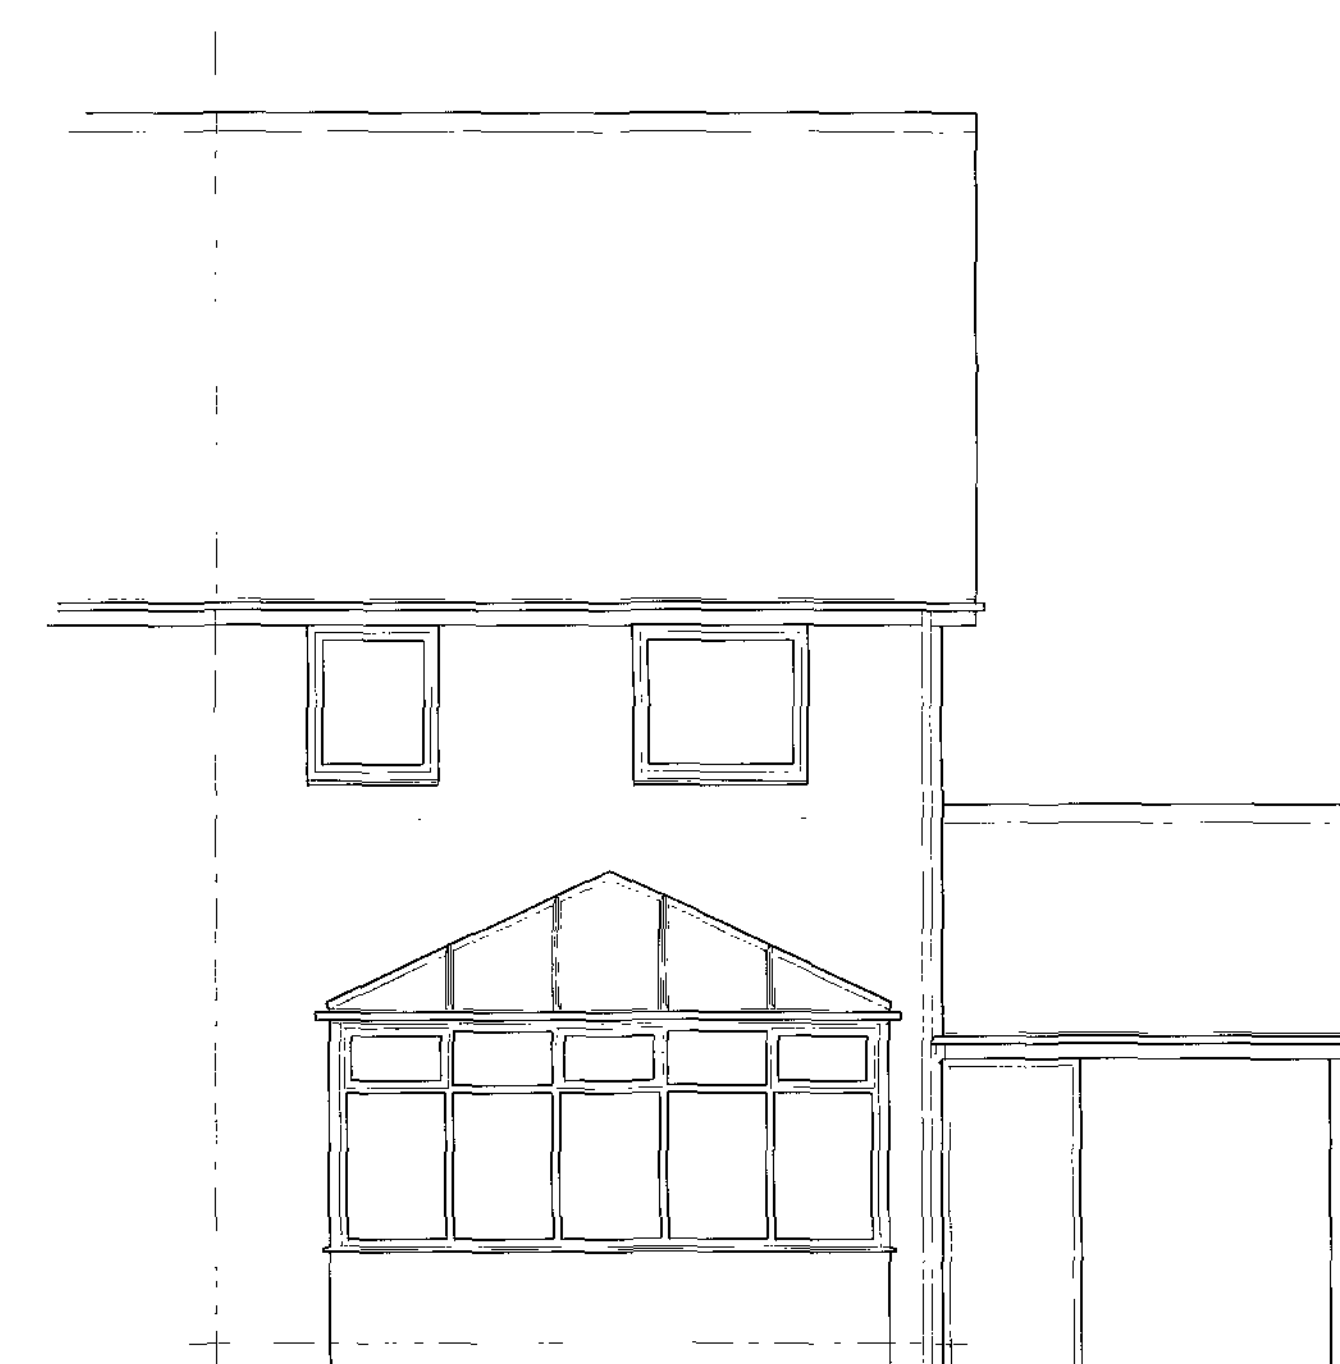

Rear Elevation

Notes:
All dimensions must be checked on site and not scaled from this drawing.

A

Client

Mr & Mrs Wright

Job Title

Proposed Alterations
32 Belle Green Close
Cudworth
Barnsley

Drawing Title

Existing Plans and Elevations

Scale 1:50

Date Mar 2012

Drawn by MJH


Drawing No.

861-01


Rev.




Front Elevation

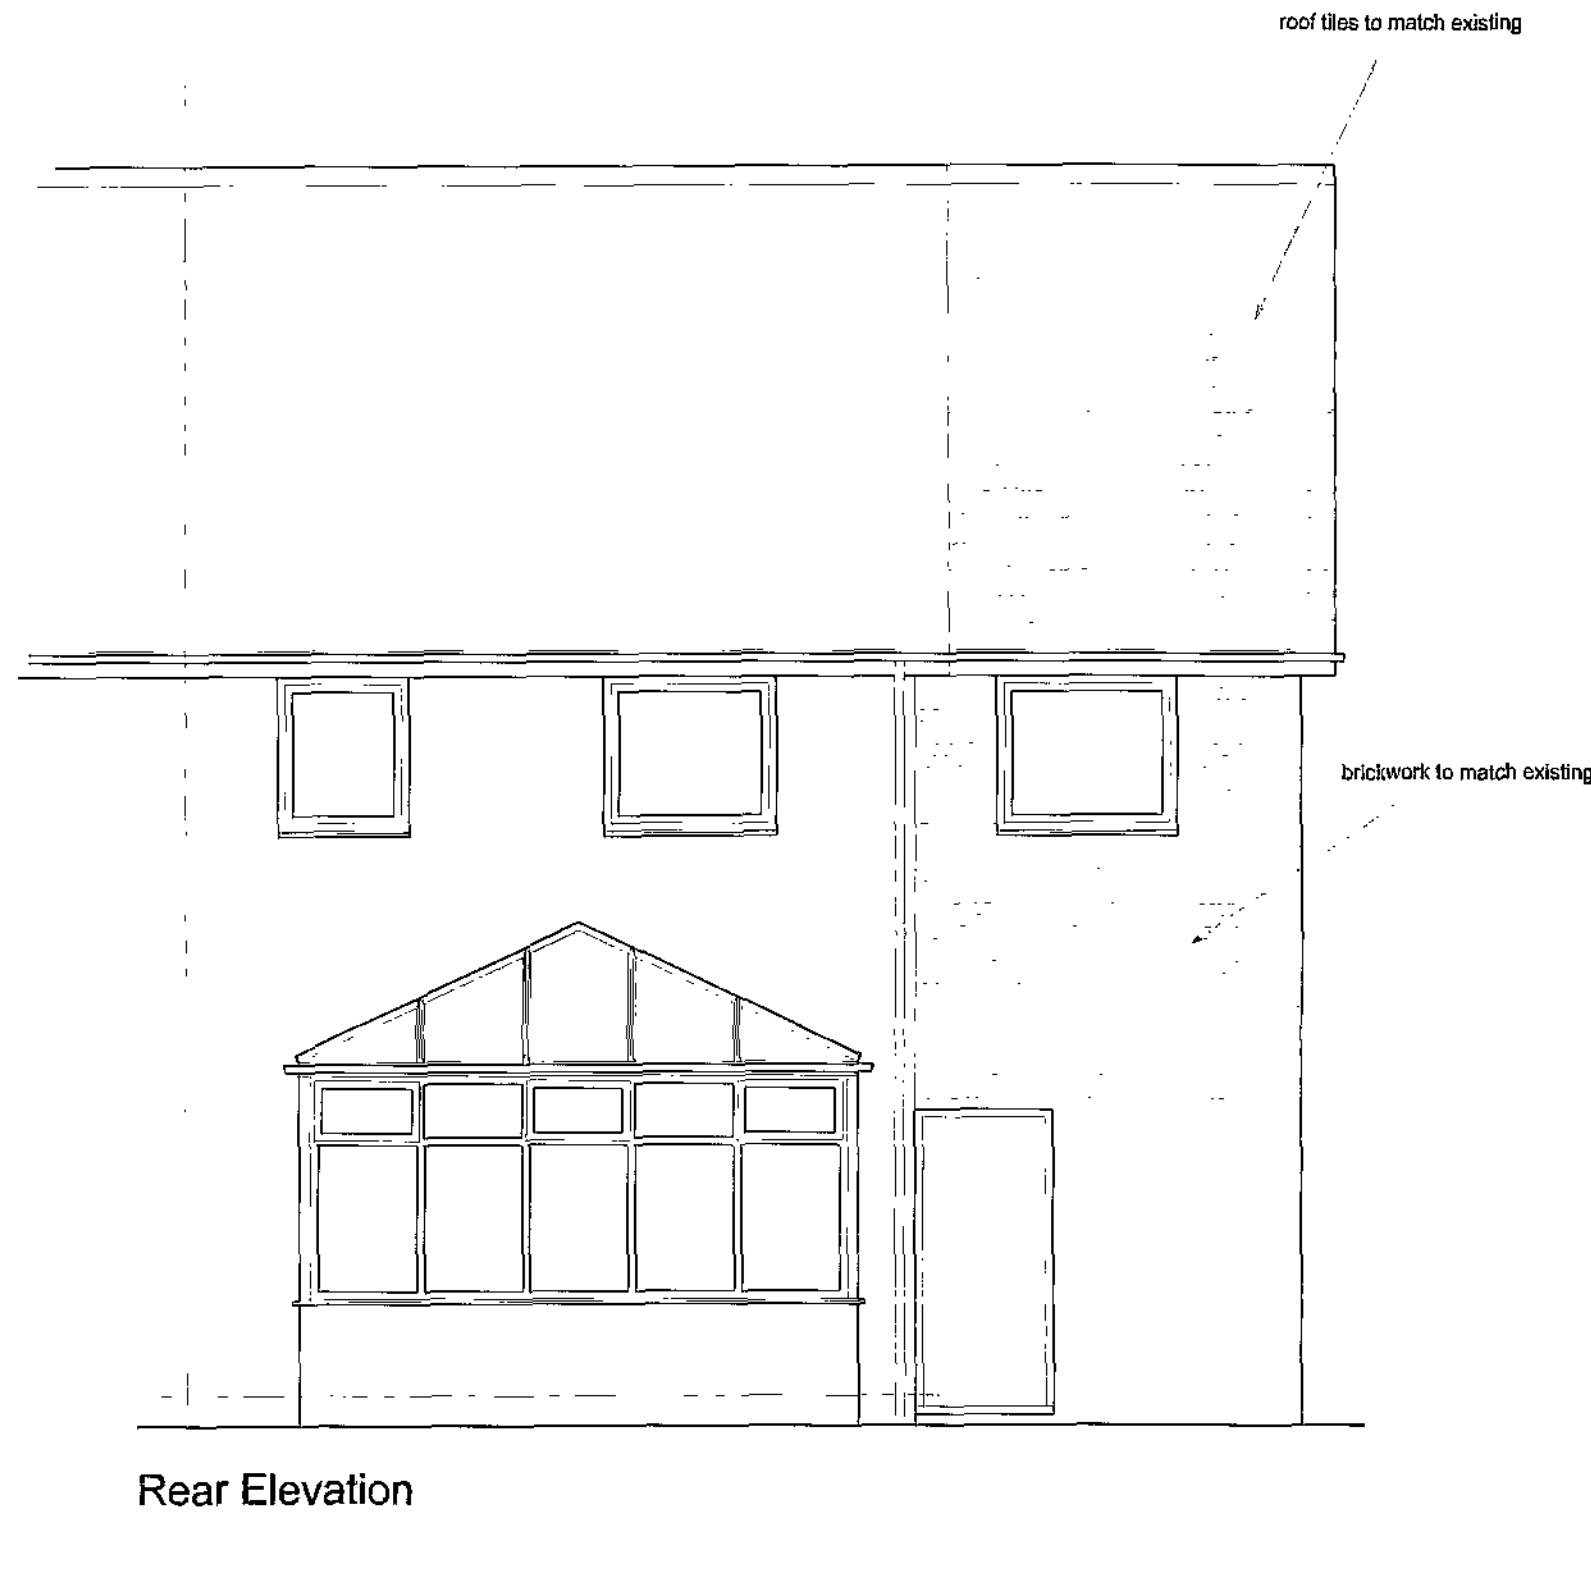


Rear Elevation

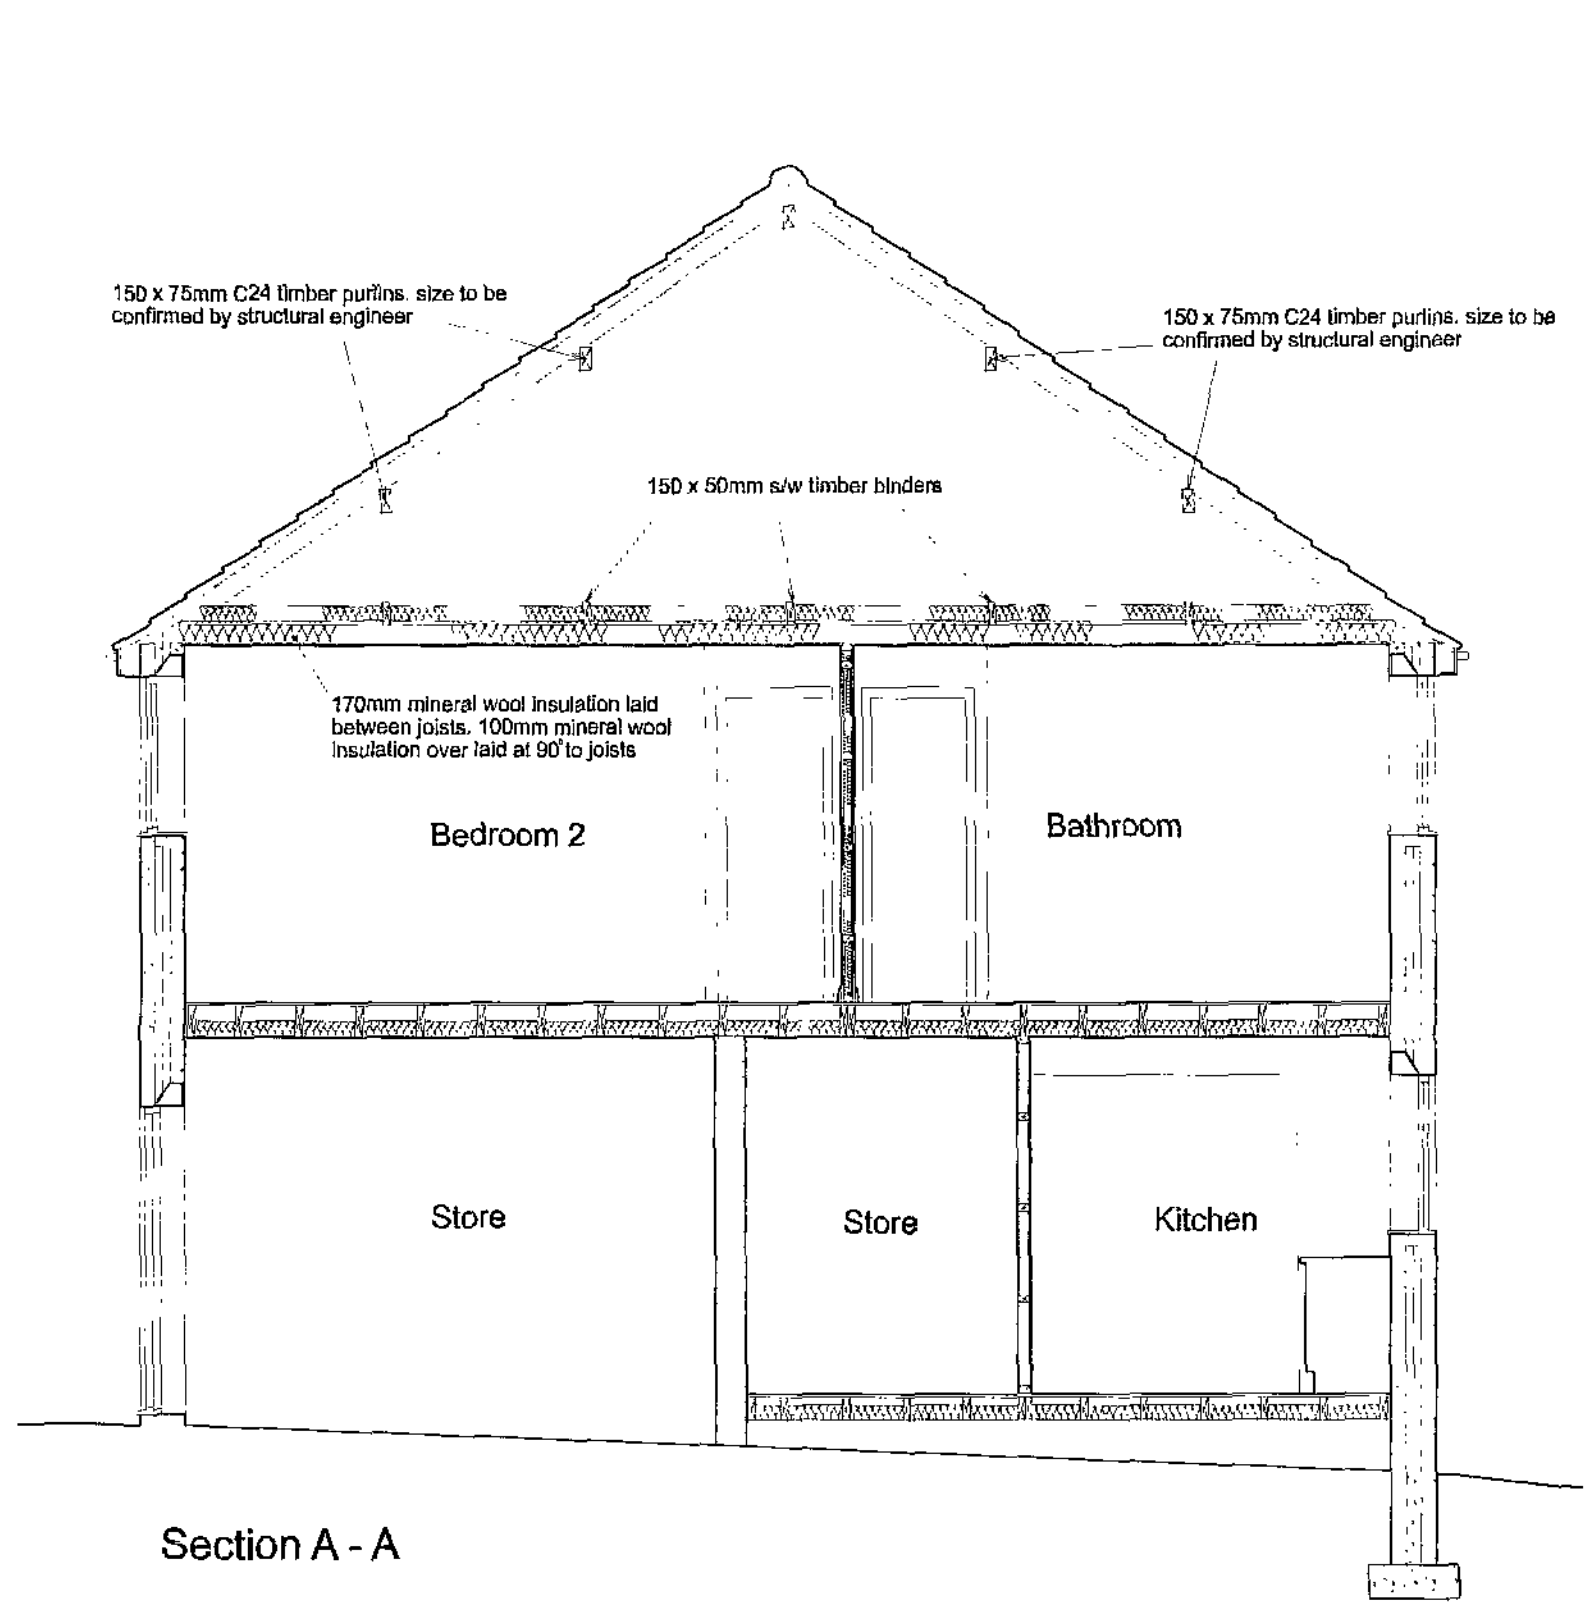


Section A - A

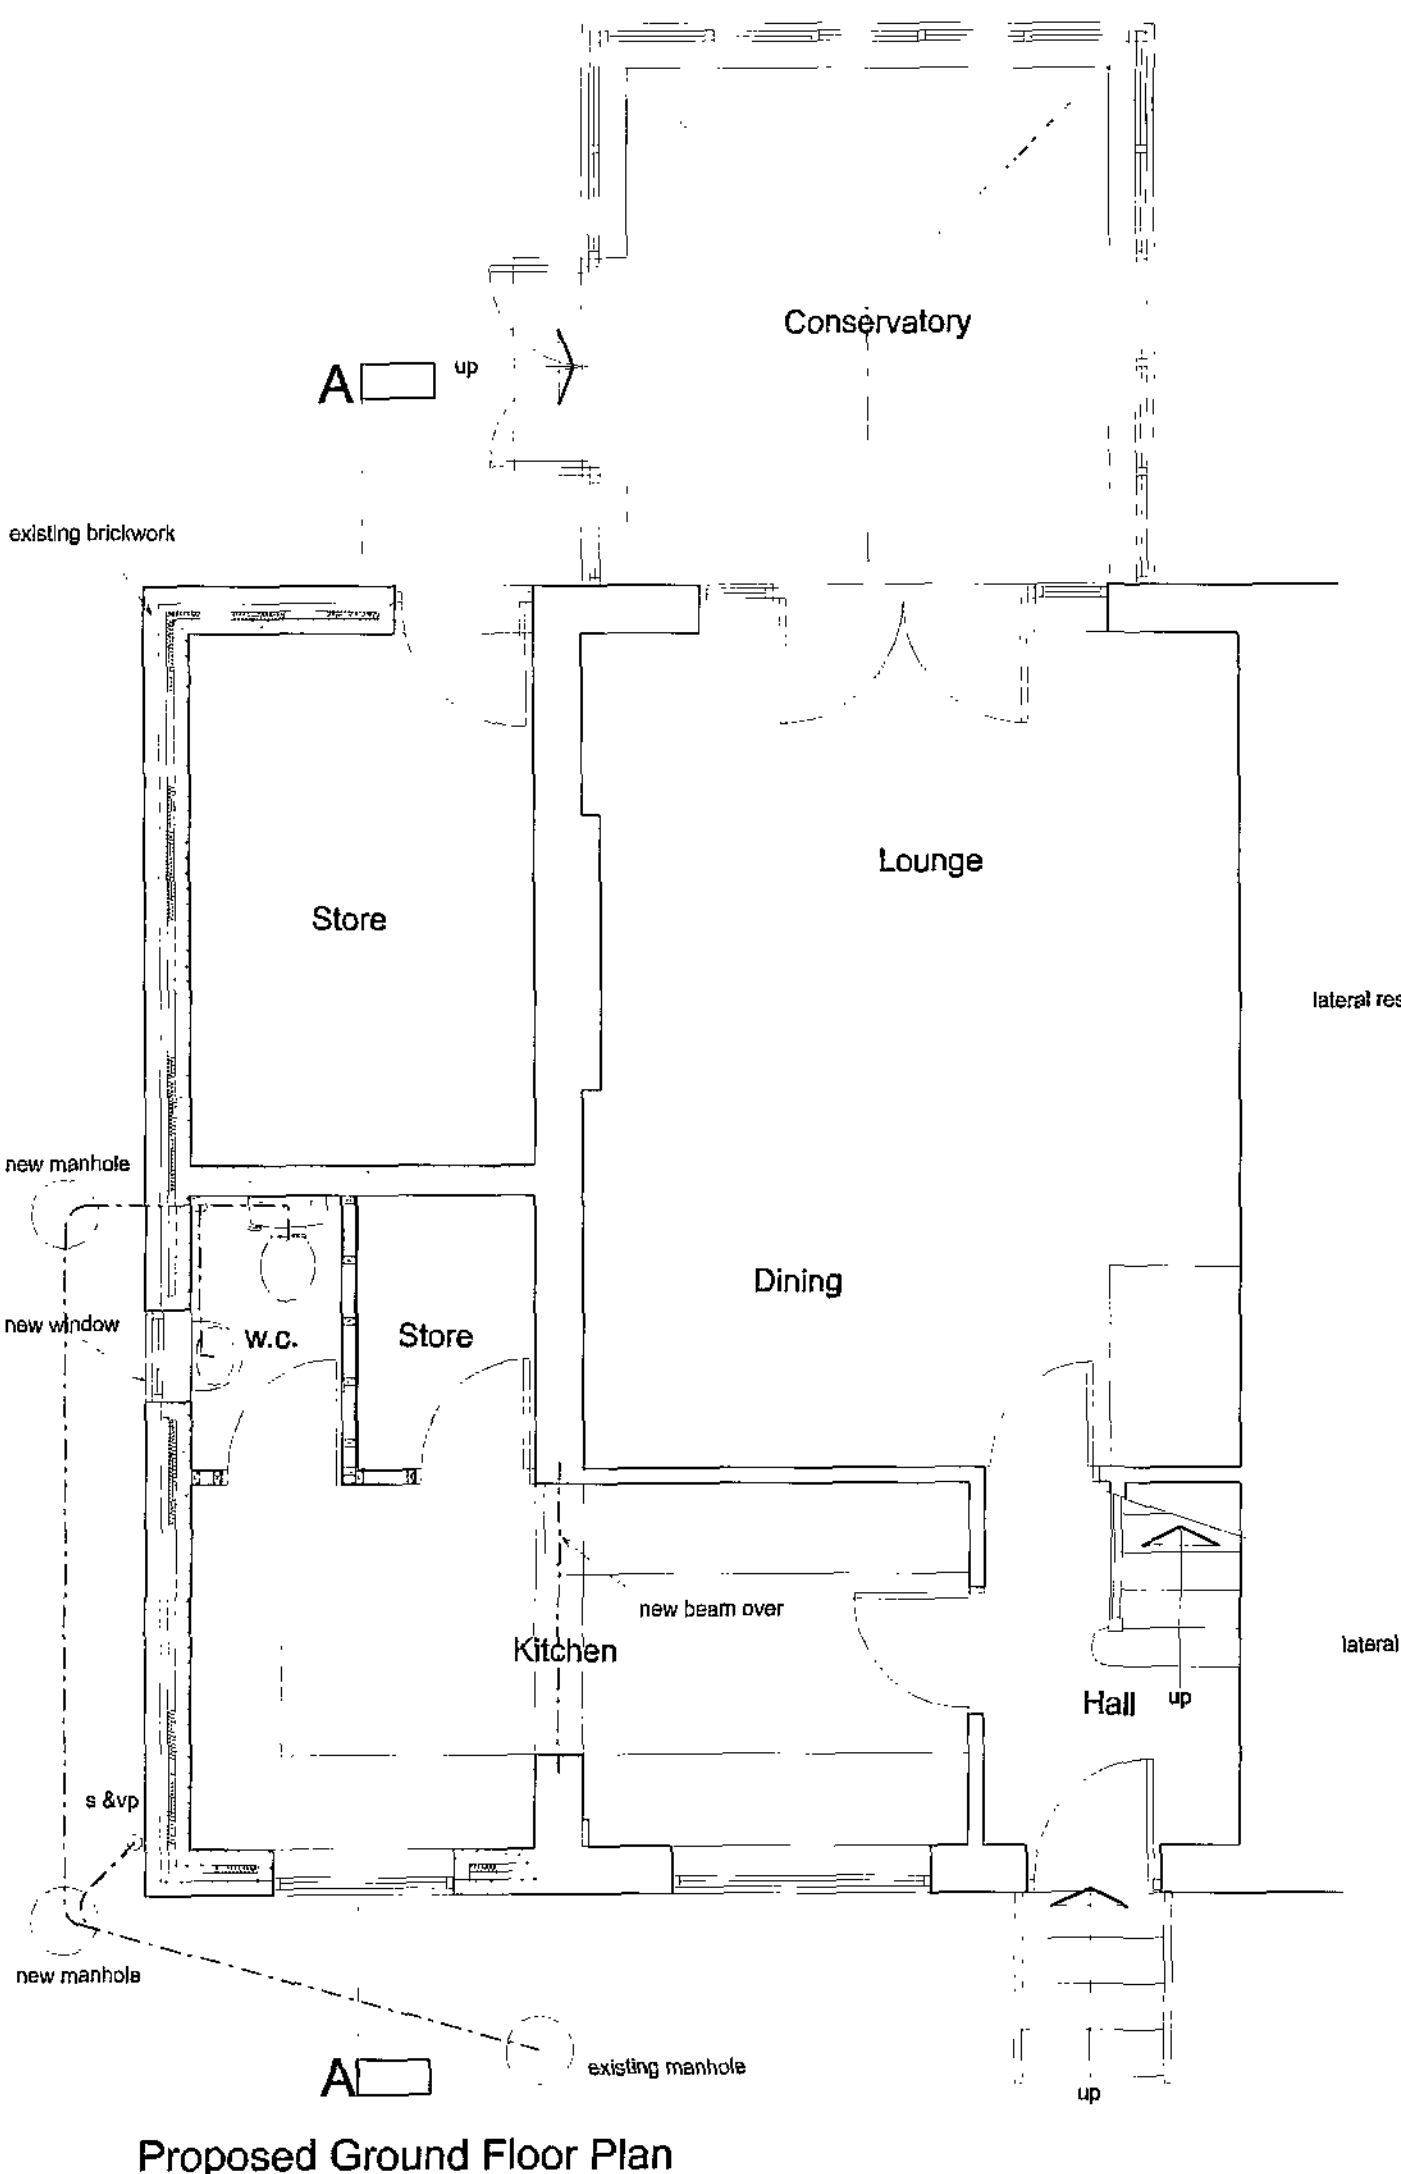

Proposed Ground Floor Plan

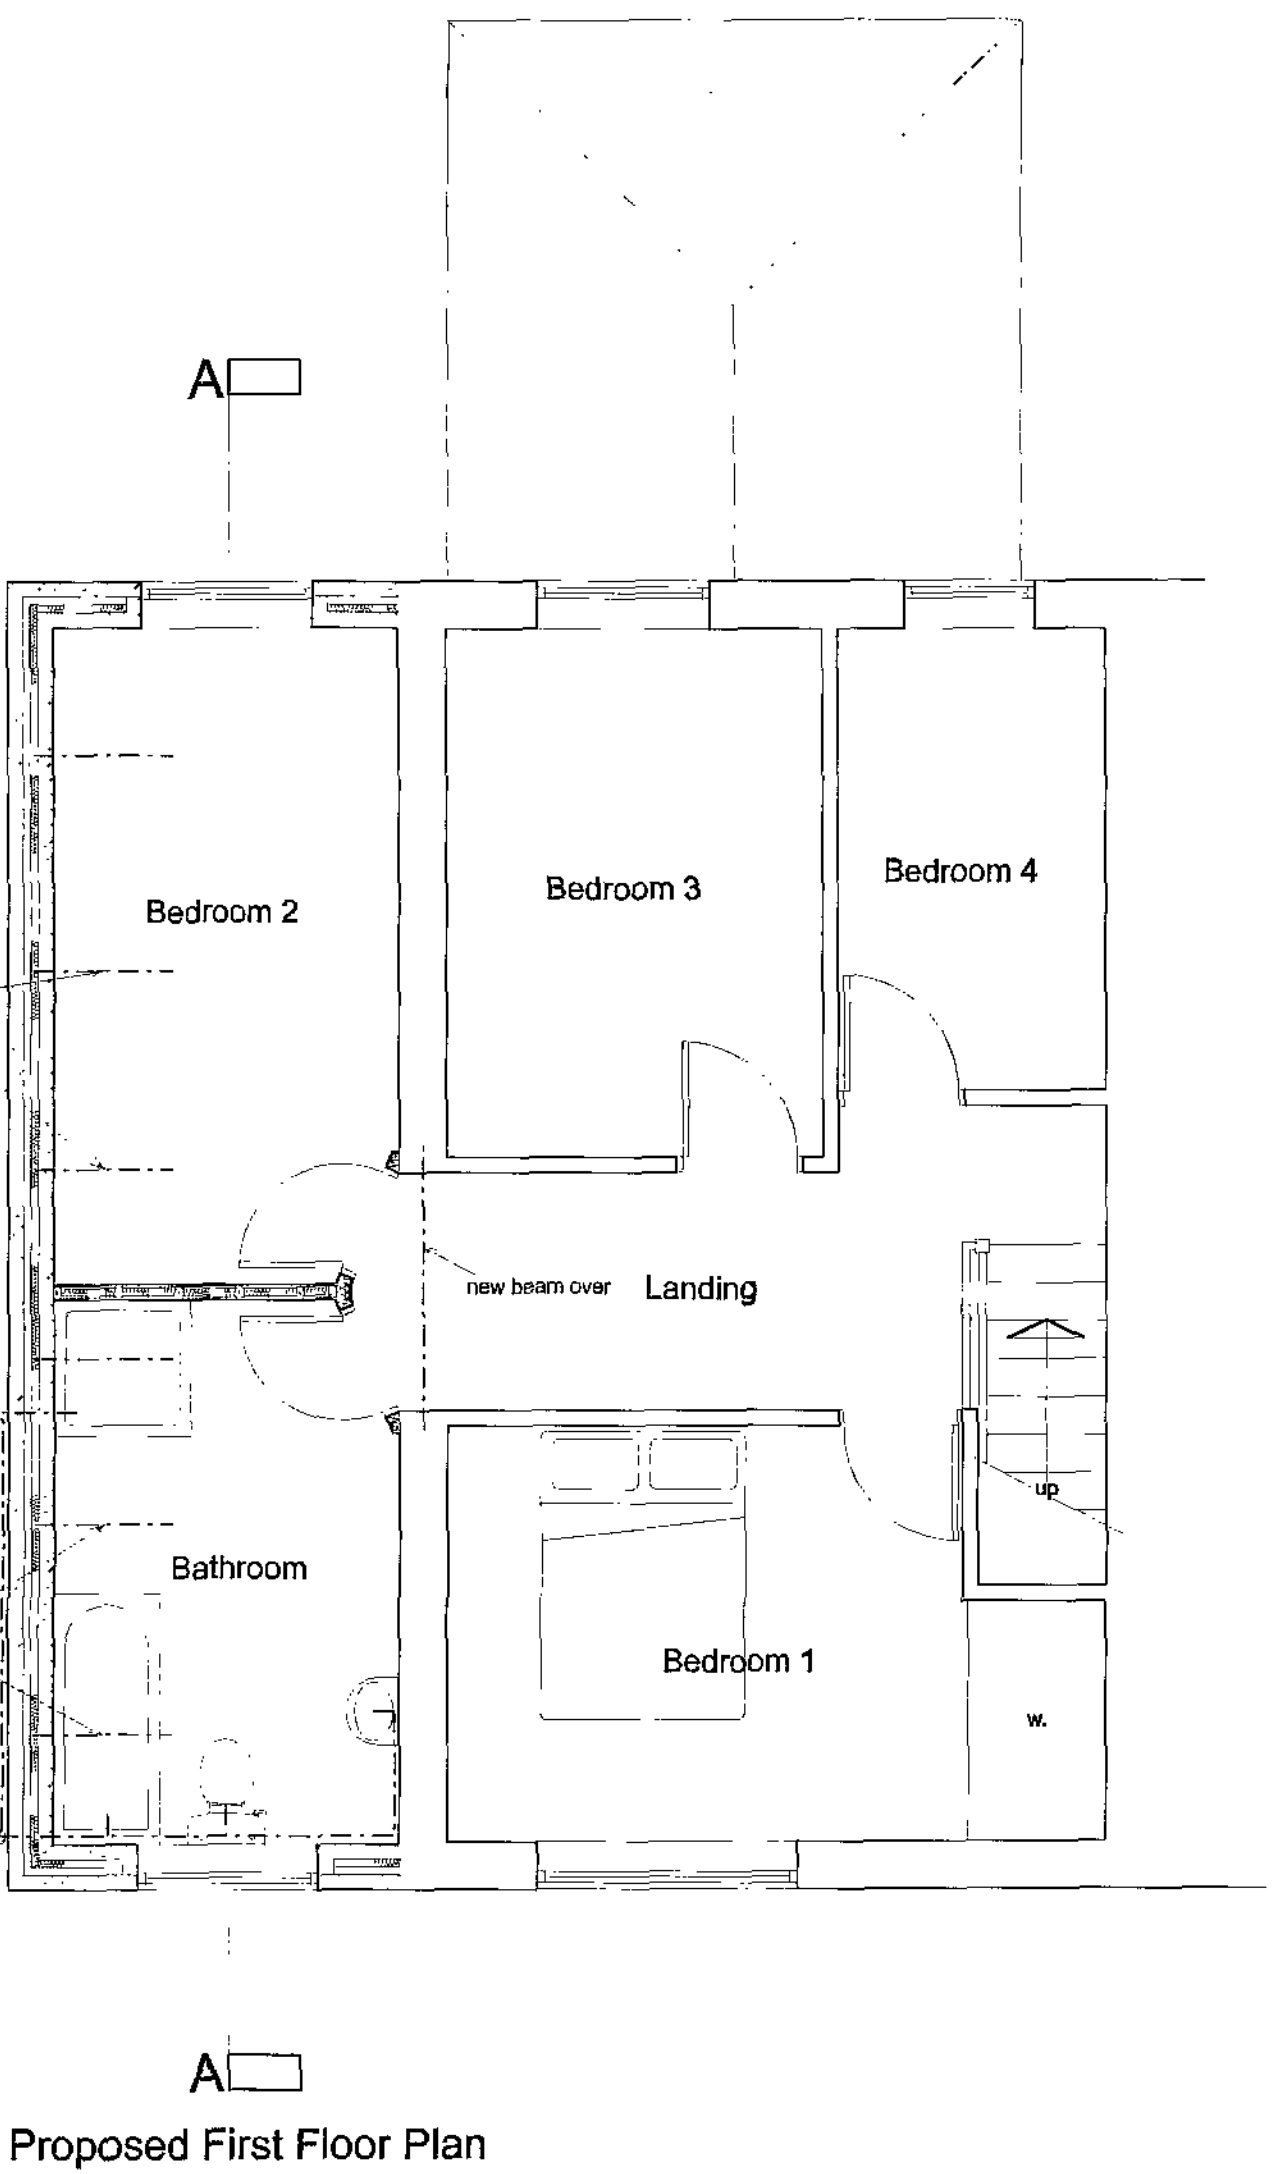

Proposed First Floor Plan

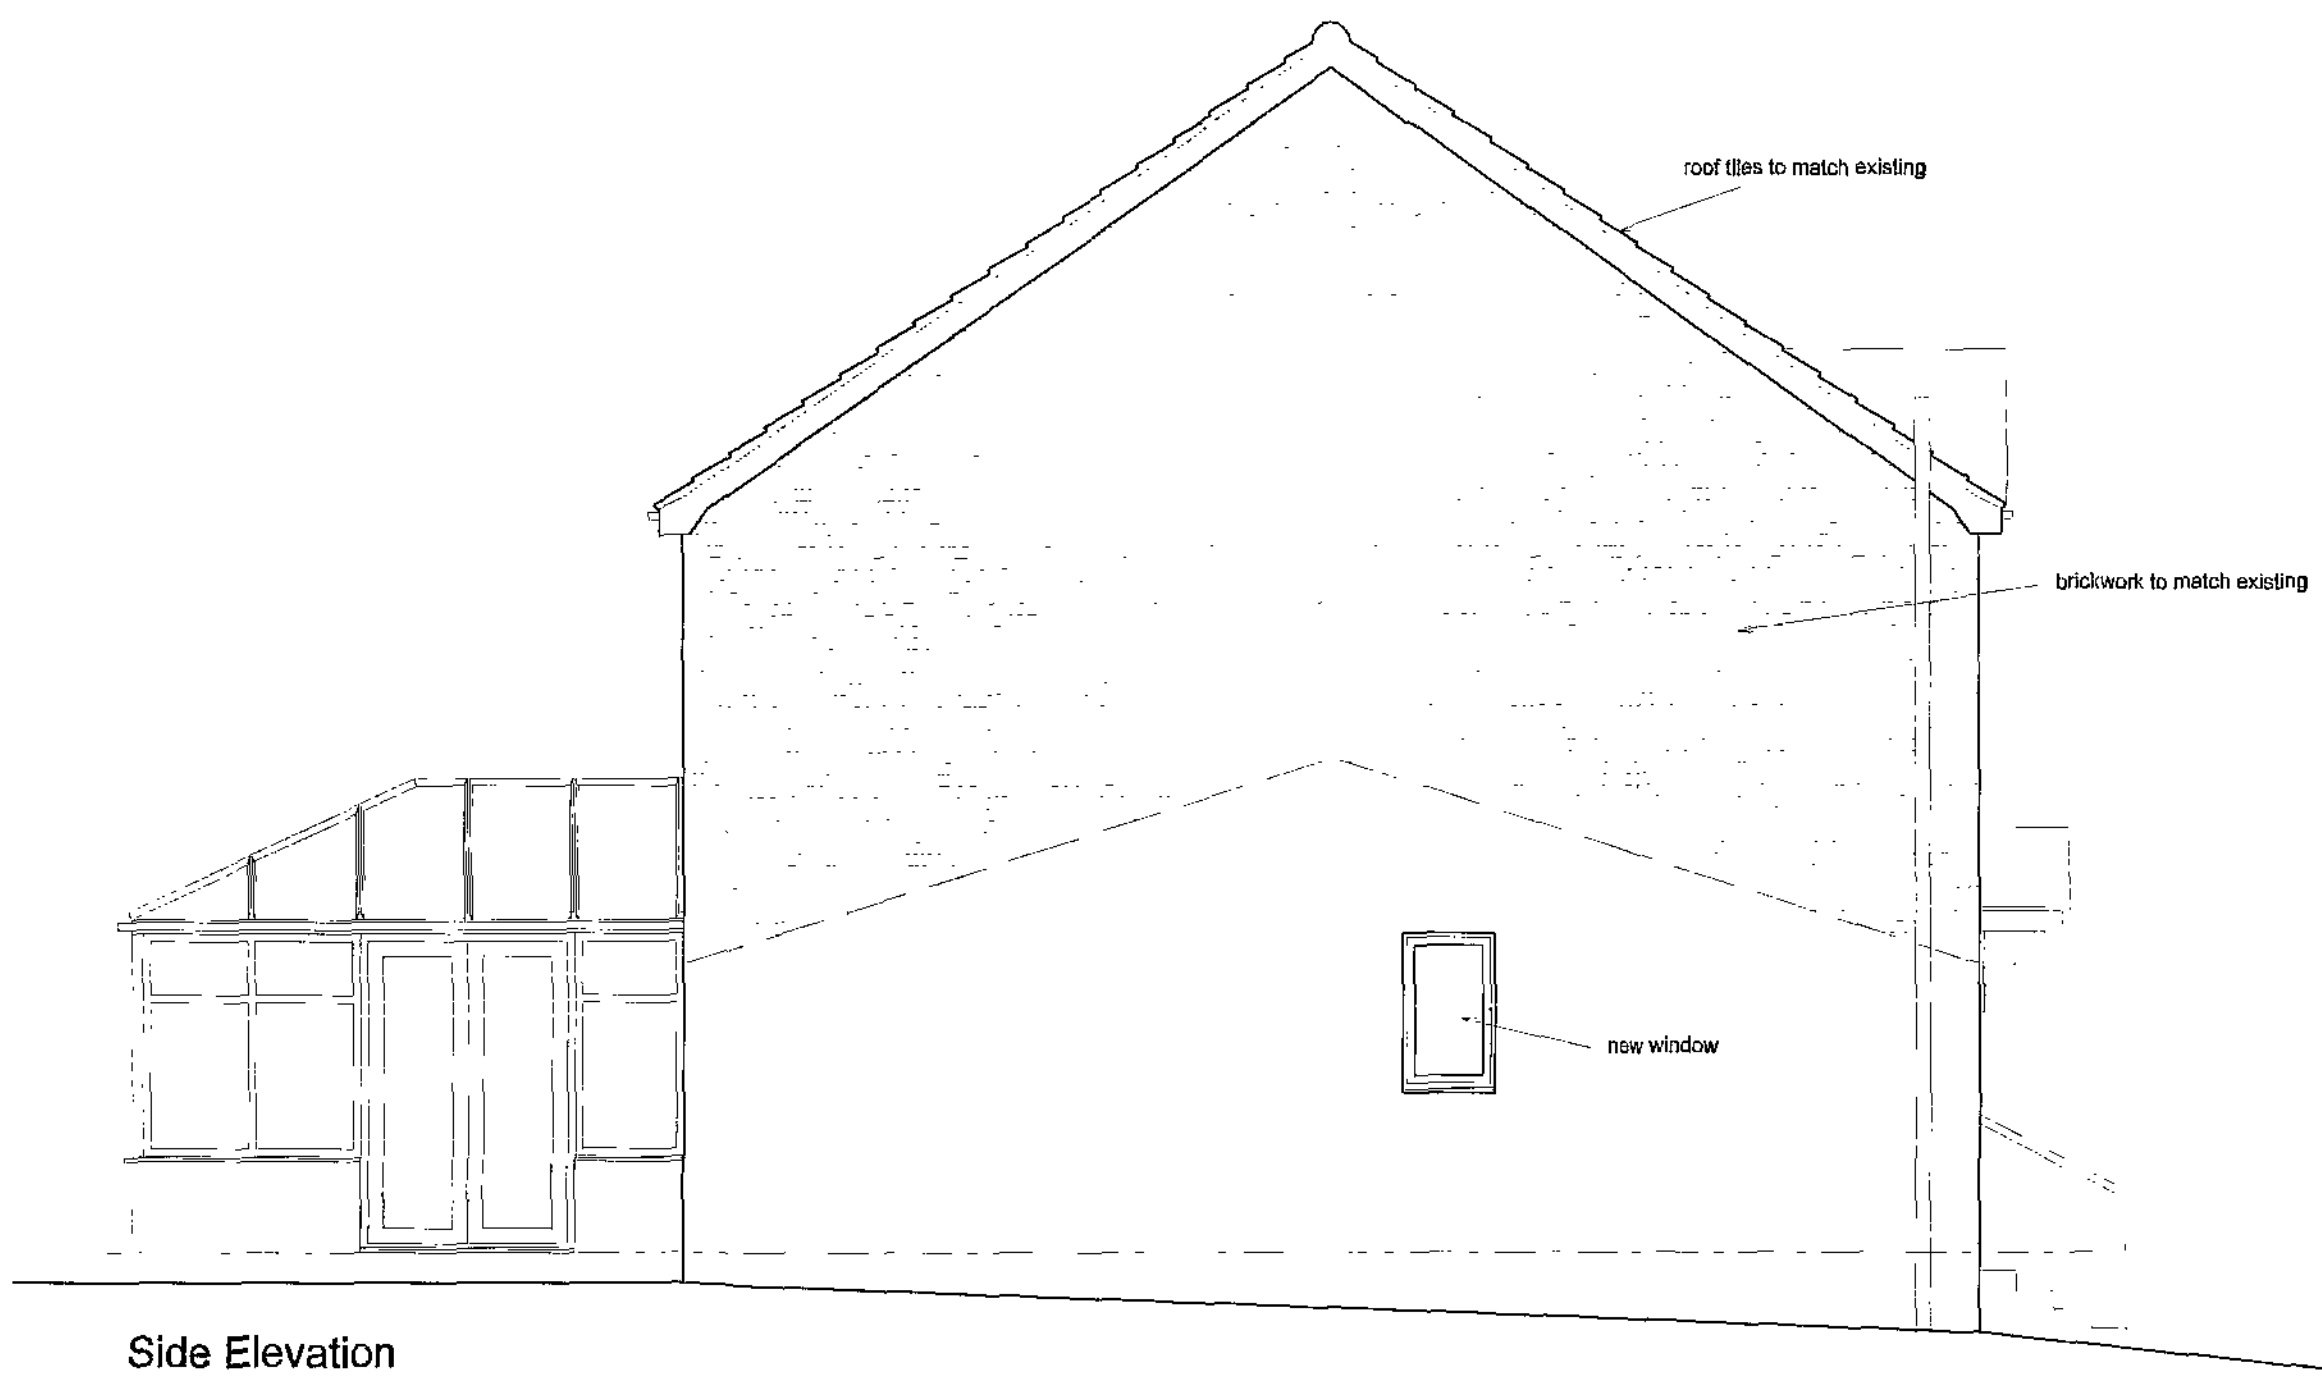

Side Elevation

Lateral restraint straps (min 35x5mm) fixed to blockwork and taken over min. 3No joists at max. 2.0m centres at roof level on gables.
Ventilation to ground floor to be min. 1500 mm² /m run of external wall or 500mm² /m of floor area, whichever is the greater. Ventilation to existing floor to be maintained.

Notes:
All dimensions must be checked on site and not scaled from this drawing.
General:
All work to be carried out strictly in accordance with current Building Regulations and British Standard Codes of Practice. No projections over boundary.
Foundations:
Existing foundations to be checked on site and agreed with Local Building Inspector
External Walls:
100mm thick brickwork to match existing outer leaf to Local Authority Approval, 50mm clear cavity, 50mm thick Celotex double-CA2000 wall insulation, 100mm thick blockwork inner leaf.
Construction to give min. 0.30W/m² K. Stainless steel wall ties to be positioned at 450mm centres vertically and 750mm centres horizontally and at every block course at reveals
D.p.c.s:
D.p.c.s positioned min. 150mm above ground level. D.p.c. weathercheck to all new window and external door openings. D.p.c. cavity tray required over new lintels. Mastic pointing to reveals.
Lintels:
Carnic or equal approved galvanised steel lintels over door and window openings to Manufacturers recommendations.
First Floor:
19mm thick flooring grade chipboard on 200 x 50mm C24 s/w timber joists 9.5mm thick Gyproc moisture resistant board to underside, skim finish. 150mm thick insulation between joists. Solid timber noggins at max. 1800mm cts.
Ventilation:
Background ventilation to habitable room to be min. 8000mm². (trickle ventilators in window heads)
Windows to have opening lights min. 1/20th of floor area.
Glazing:
Glazing within critical locations as defined in Part N of Building Regulations, i.e. within 800mm from floor level or 1500mm in doors to 300mm either side to be laminated or toughened glass to B.S. 6208 and suitably Kite Marked.
Drainage:
New drains to be vitrified clay pipes with approved flexible joints connected to existing system. Drains to be linteled over where passing under walls and surrounded with pea gravel where passing close to building.
Rainwater Goods:
Rainwater goods to match existing.
Ties:
Every third joist to be tied down by stainless steel ties screwed to joists and plugged to wall min. 450mm down.
Roof:
Concrete roof tiles to match existing fixed to 38 x 25mm s/w battens to Manufacturers recommendations on reinforced bitumen felt underlay on 150 x 50mm timber rafters at 450mm centres. 100 x 75mm wallplate fixed to wall at 600mm centres. 25mm soffit ventilation and continuous ridge vent to provide adequate cross ventilation. 100mm Kingspan insulation laid between joists.
150mm thick Kingspan insulation laid over joists.
Min. 50mm clear air space required above insulation.
100x50mm s/w ceiling joists at 450mm centres.
12.5mm plasterboard to underside and skim finish.
All joints to have scrim tape.
General:
Lintels/ beams to have min 150mm end bearing.
New windows to be PVCu double glazed with low-e glass and 12mm air gap to give average u-value of 1.8W/m²K.
Surface water from new extension to go to soakaway.
Wall ties to new external walls to be stainless steel positioned at 450mm centres vertically and 750mm horizontally and at every block course at reveals
All heating to be carried out by Gas Safe registered person.
All electrical work to be carried out by a competent person under Approved Document Part P.
Flyscreen required to soffit ventilation.
New lintels to be insulated, by Carnic or equal approved.
New wall ties to be vertical twist type.
U-value for new wall construction to be 0.3W
Stability calculations to be provided by structural engineer.
Strutting to mid-span of ground floor joists.
D.P.M. to be 1200 gauge Visqueen, to run continuously to outer leaf, lapped and lapped at all joints with a tray provided where passing through wall.
Gutters to be 110mm and downpipes to be 65mm.
Soakaway to be min. 5 metres from any building or highway.
Thermostatic radiator valves and insulated pipework in un-heated spaces required to any new heating.
Thermabate or equal approved insulated cavity closers to new window and door openings.
Calculations for new steel beams to be provided by Structural Engineer and submitted to Local Authority for approval. Beams to be clad with Fireline board to give min. 30min. fire protection.
New beams to be sealed on concrete padstones to Structural Engineers details.
Galvanised steel restraint straps required to wallplate at max. 2.0m centres.
Galvanised steel restraint straps required to first floor joists fixed across 3No joists with noggings between at max. 2.0m centres.
Galvanised steel straps required to gables and strapped over 3No rafters with noggings between.
Electrical work to be carried out by an Electrician registered within a Competent Persons Scheme, or if work is to be inspected by a Building Control Officer in accordance with Part P Electrical Safety.

A	
Client Mr & Mrs Wright	
Job Title Proposed Alterations 32 Belle Green Close Cudworth Barnsley	
Drawing Title Proposed Plans, Elevations and Section A - A	
Scale 1:50	Drawn by MJH
Date Mar 2012	Rev.
Drawing No. 861-02	