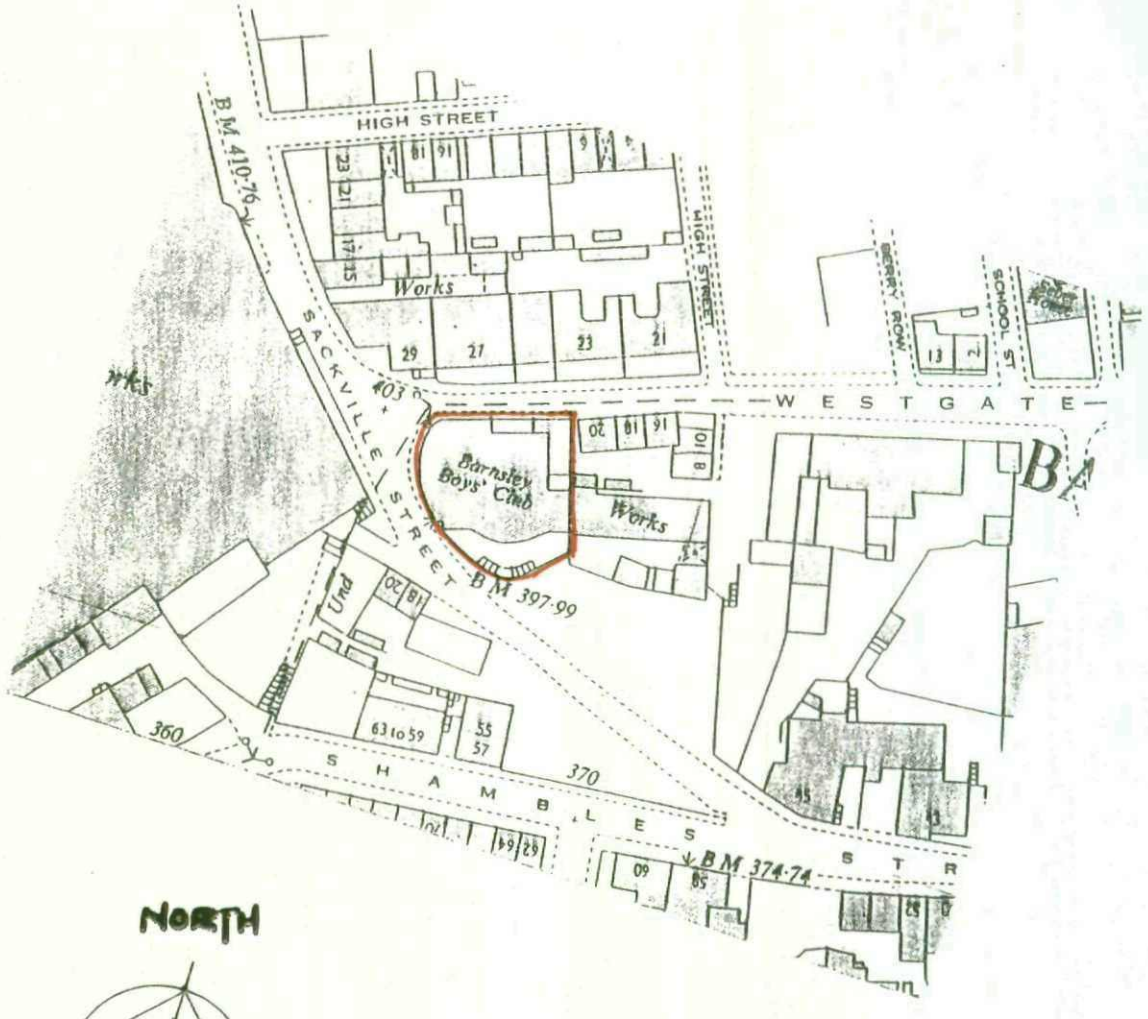


LOCATION PLAN 1:1250

GENERAL NOTES

EMERGENCY LIGHTING
ALL ESCAPE ROUTES + ACCOMMODATION TO HAVE ESCAPE LIGHTING EXCEPT TOILET ACCOMMODATION LESS THAN 8M². ESCAPE LIGHTING INSTALLATION TO COMPLY WITH BS. 5266 EMERGENCY LIGHTING PART 1 : 1988.

MECHANICAL VENTILATION
TOILETS - EXTRACT AT 6 LT./SEC/WC OR 3 AIR CHANGES/HR. WITH OPERATION LINKED TO LIGHT SWITCH OR OCCUPANT SENSOR. BACKGROUND VENTILATION MIN. 4000 MM²/WC WITH AIR BRICK, DUCT THRU WALL + TERMINATE WITH GRILLE.
COMMON SPACES - MECHANICAL VENTILATION TO COMPLY WITH BS 5925 : 1991 OR RELEVANT RECOMMENDATIONS OF CIBSE GUIDE A + GUIDE B.

TIMBER TREATMENT.
ALL NEW TIMBER TO HAVE VAC-VAC PRESERVATIVE TREATMENT.

ELECTRICAL
ALL WIRING TO COMPLY WITH THE LATEST EDITION OF THE IEE. REGULATIONS.

BARNSLEY
Metropolitan Borough Council
17 MAR 2006
APPROVED TOWN PLANNING

: CONC. POST + 6SH FENCE.