Site Investigations

Trial Pit & Borehole Logs

Client	Lloyds Banking Group
Personal Claims Consultant	Ian Fores
Claim Number	100968417
Policy Holder	Cousins
Claim Address	Dodsworth House, Keresforth Road, S75 3ED D
Investigation Date	13th January 2012

	Contractor	SubsNetUK	Subsnet Ref	C3165G1549
	Compiled by	***M Cole***	Date	23/01/2012
	Checked by	***S Cooke***	Date	24/01/2012


Site Investigation
Site Detail

Property:	Dodsworth House, Keresforth Road, S75 3ED
Claim Number:	100968417



Site Investigation
Trial Pit Detail

Property:	Dodsworth House, Keresforth Road	**Borehole Ref:**	TPBH1
Claim Number:	100968417		

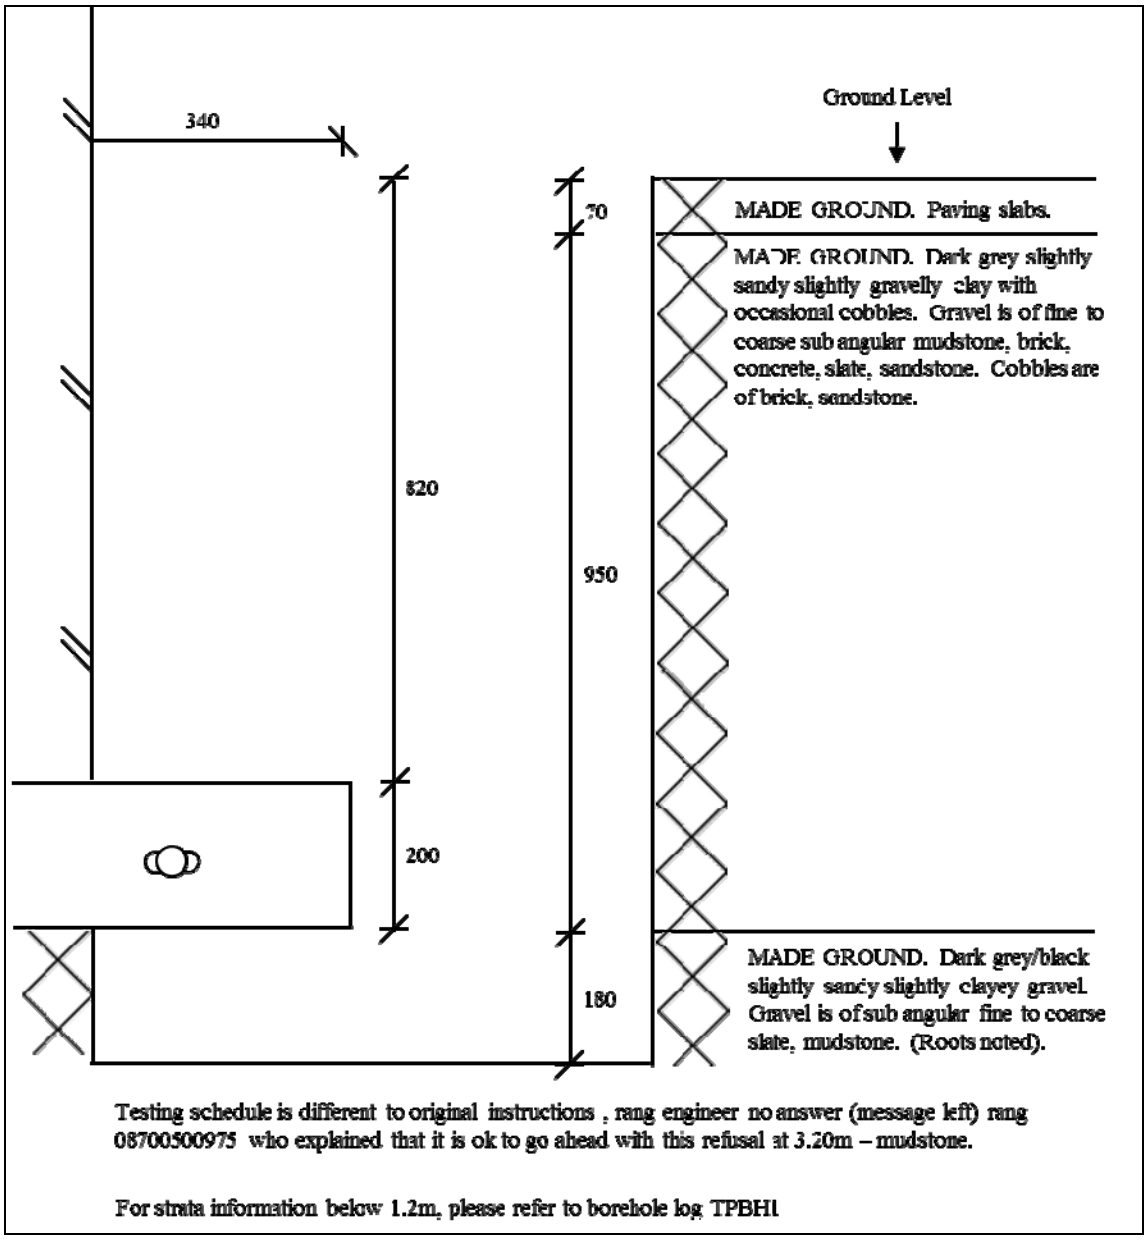

Testing schedule is different to original instructions , rang engineer no answer (message left) rang 08700500975 who explained that it is ok to go ahead with this refusal at 3.20m – mudstone.

For strata information below 1.2m, please refer to borehole log TPBH1

Site Investigation
Borehole Log


Property:	Dodsworth House, Keresforth Road	**Borehole Ref:**	TPBH1
Claim Number:	100968417		

SAMPLES & TESTS			Water	STRATA				Instrument/ Backfill
Depth	Type No	Test Result		Reduced Level	Legend	Depth (Thick-ness)	DESCRIPTION	
						(1.20)	Trial pit. Base of foundation 1.02m.	
1.02	D1					1.20		
						(0.40)	MADE GROUND. Dark grey/black slightly sandy slightly clayey gravel. Gravel is of sub angular fine to coarse slate, mudstone. (Roots noted).	
1.50	D2					1.60		
1.60	HV	130+KPa@1.6m				(1.40)	Stiff grey mottled light brown/orange slightly sandy slightly gravelly CLAY. Gravel is of sub angular fine to coarse mudstone, sandstone.	
2.00	D3	130+KPa@2.0m						
2.50	D4	130+KPa@2.5m				3.00		
3.00	HV	130+KPa@3.0m				(0.20)	Light grey/brown weathered MUDSTONE.	
						3.20		
3.20	D5	130+KPa@3.2m					Mac Probe Readings 7,15,30,42,50/30 at 1m.	

Boring Progress and Water Observations						Chiselling			Water Added		GENERAL REMARKS
Date	Time	Depth	Casing Depth	Casing Dia. mm	Water Dpt	From	To	Hours	From	To	
											Borehole terminated at 3.2m due to refusal - mudstone. Borehole open and dry. Roots at 1.02m-3.0m.

Site Investigation
Trial Pit Detail

Property:	Dodsworth House, Keresforth Road	**Borehole Ref:**	TPBH2
Claim Number:	100968417		

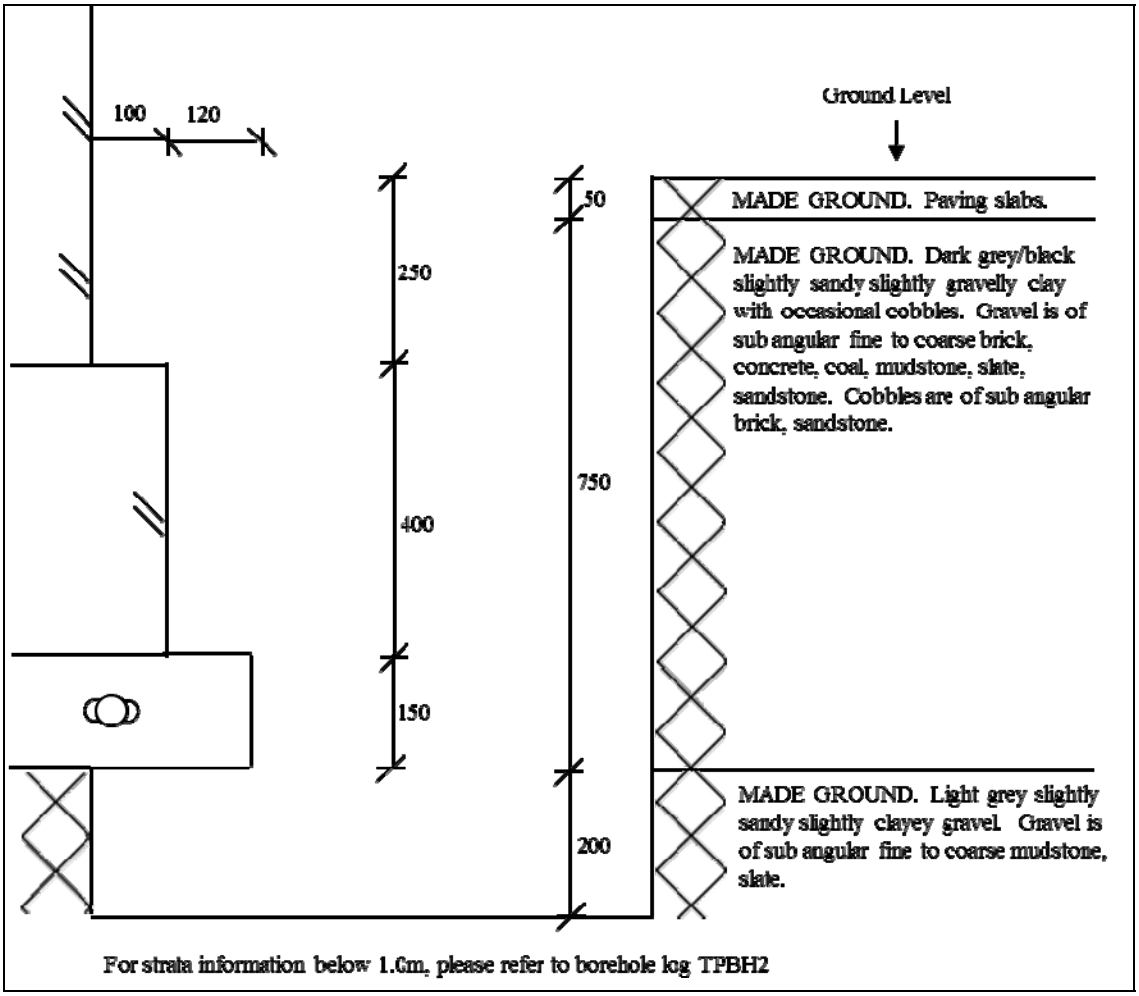

Site Investigation
Borehole Log

Property:	Dodsworth House, Keresforth Road	**Borehole Ref:**	TPBH2
Claim Number:	100968417		

SAMPLES & TESTS			Water	STRATA				Instrument/ Backfill
Depth	Type No	Test Result		Reduced Level	Legend	Depth (Thick-ness)	DESCRIPTION	
						(1.00)	Trial pit. Base of foundation 0.8m.	
0.80	D1					1.00		
						(0.70)	MADE GROUND. Light grey slightly sandy slightly clayey gravel. Gravel is of sub angular fine to coarse mudstone, slate.	
1.50	D2					1.70		
1.70	HV	126KPa@1.7m					Stiff light brown mottled grey slightly gravelly slightly sandy CLAY. Gravel is of sub angular fine to coarse mudstone, sandstone.	
2.00	D3	130+KPa@2.0m				(1.30)		
2.50	D4	130+KPa@2.5m						
						3.00		
3.00	D5	130+KPa@3.0m				(0.40)	Grey/light brown weathered MUDSTONE.	
						3.40		
3.40	D6	130+KPa@3.4m					Mac Probe Readings 9/12,33,50/20 at 1m.	

Boring Progress and Water Observations						Chiselling			Water Added		GENERAL REMARKS
Date	Time	Depth	Casing Depth	Casing Dia. mm	Water Dpt	From	To	Hours	From	To	
											Borehole terminated at 3.4m due to refusal - mudstone. Borehole open and dry. Roots at 0.8-2.0m.