


EXISTING REAR ELEVATION

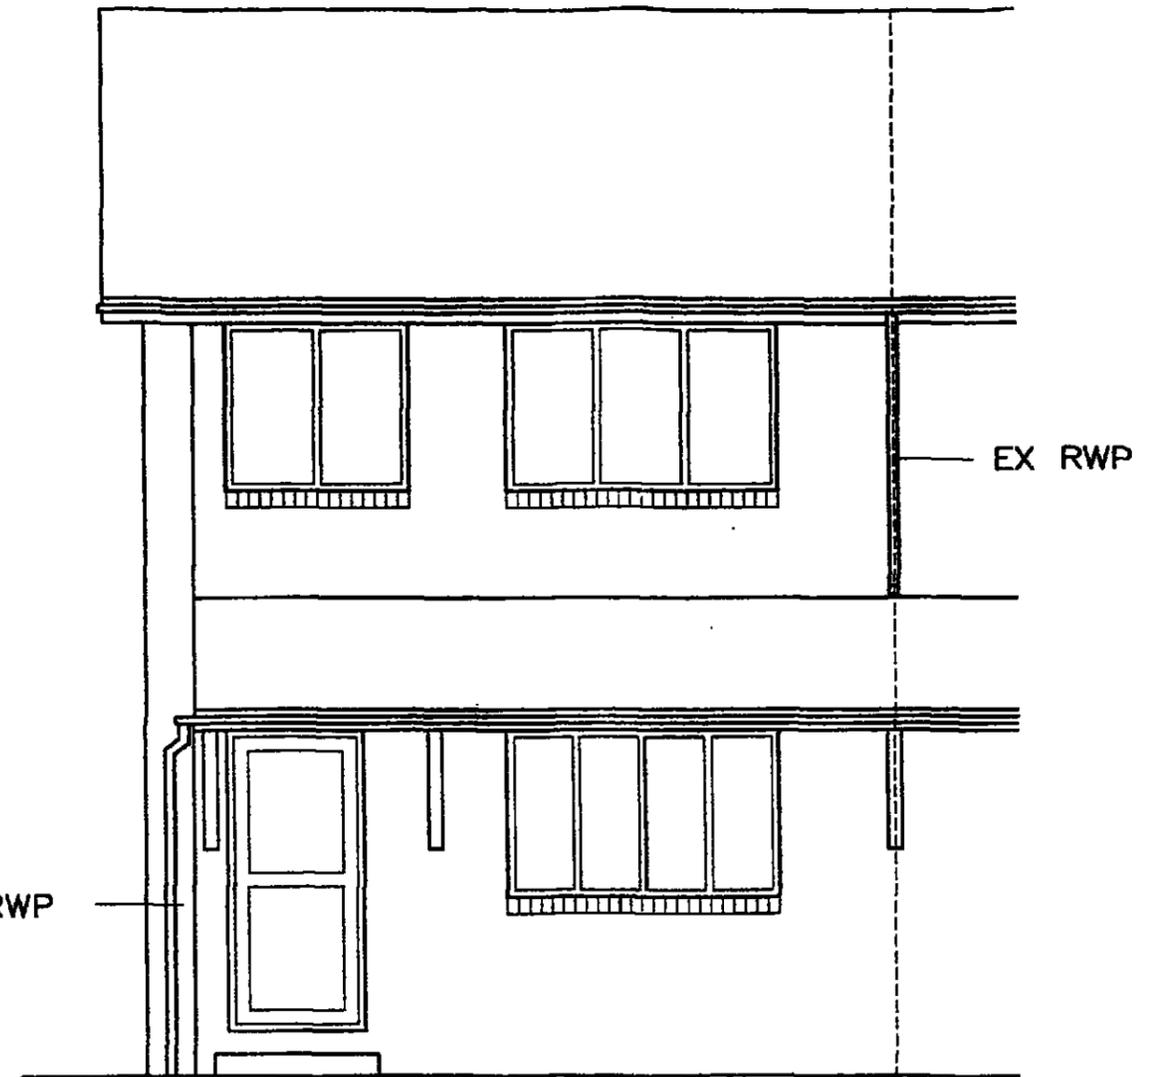


EXISTING FRONT ELEVATION

TO BE READ IN CONJUNCTION WITH
 CONSTRUCTION DETAILS
 NO DIMENSIONS TO BE SCALED OFF
 THIS DRAWING
 ALL DIMENSIONS QUOTED IN
 MILLIMETRES UNLESS STATED OTHERWISE
 ALL DIMENSIONS TO BE CHECKED ON SITE
 BEFORE COMMENCEMENT OF WORK BY BUILDER

PROPOSED EXTENSION PLANS FOR:-
 MR AND MRS EXLEY
 24 TREDIS CLOSE
 MONK BRETTON
 BARNSELY
 S71 2AL

SCALE	DATE	REV
1 : 50	MAY 2012	

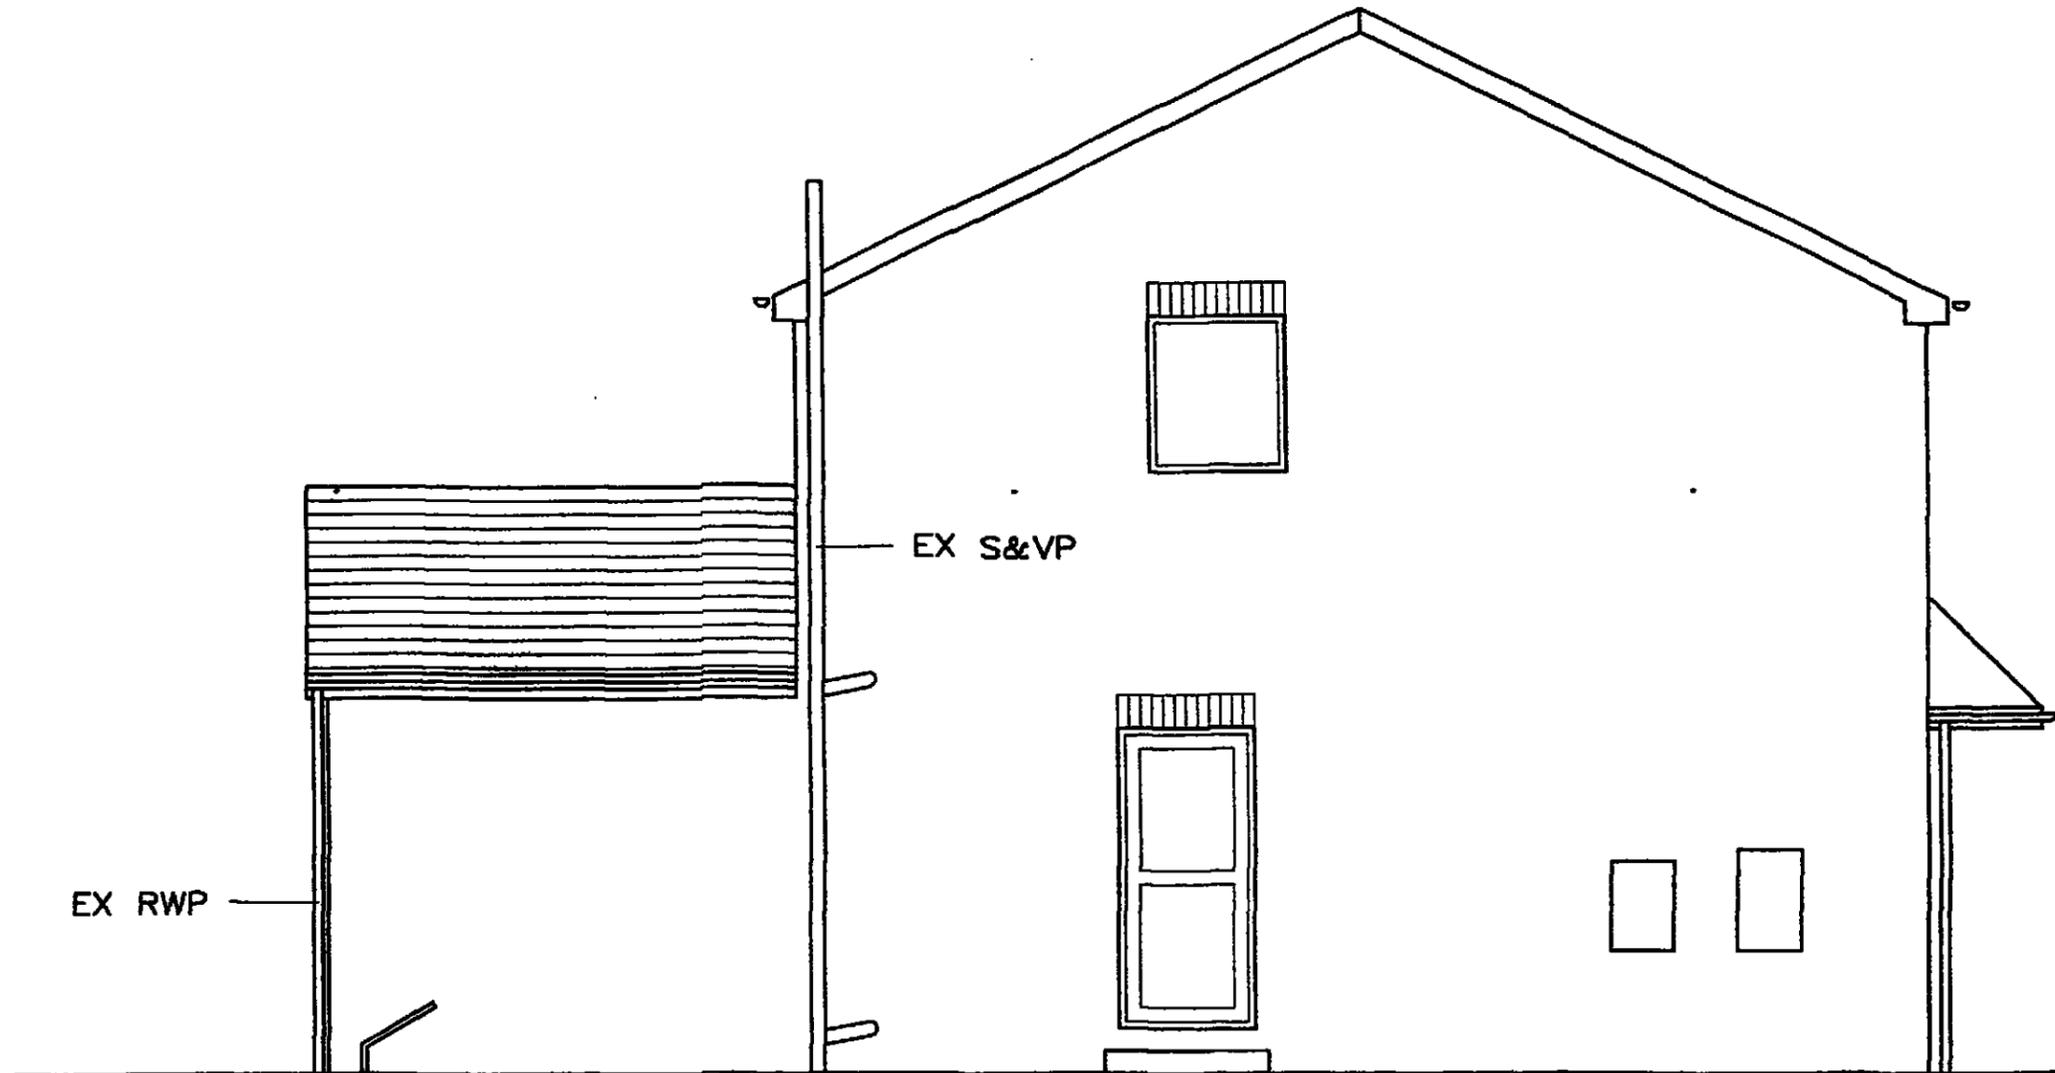

EXISTING SIDE ELEVATION


TO BE READ IN CONJUNCTION WITH
 CONSTRUCTION DETAILS
 NO DIMENSIONS TO BE SCALED OFF
 THIS DRAWING
 ALL DIMENSIONS QUOTED IN
 MILLIMETRES UNLESS STATED OTHERWISE
 ALL DIMENSIONS TO BE CHECKED ON SITE
 BEFORE COMMENCEMENT OF WORK BY BUILDER

PROPOSED EXTENSION PLANS FOR:-
 MR AND MRS EXLEY
 24 TREDIS CLOSE
 MONK BRETTON
 BARNLEY
 S71 2AL

SCALE
 1 : 50

DATE
 MAY 2012


REV

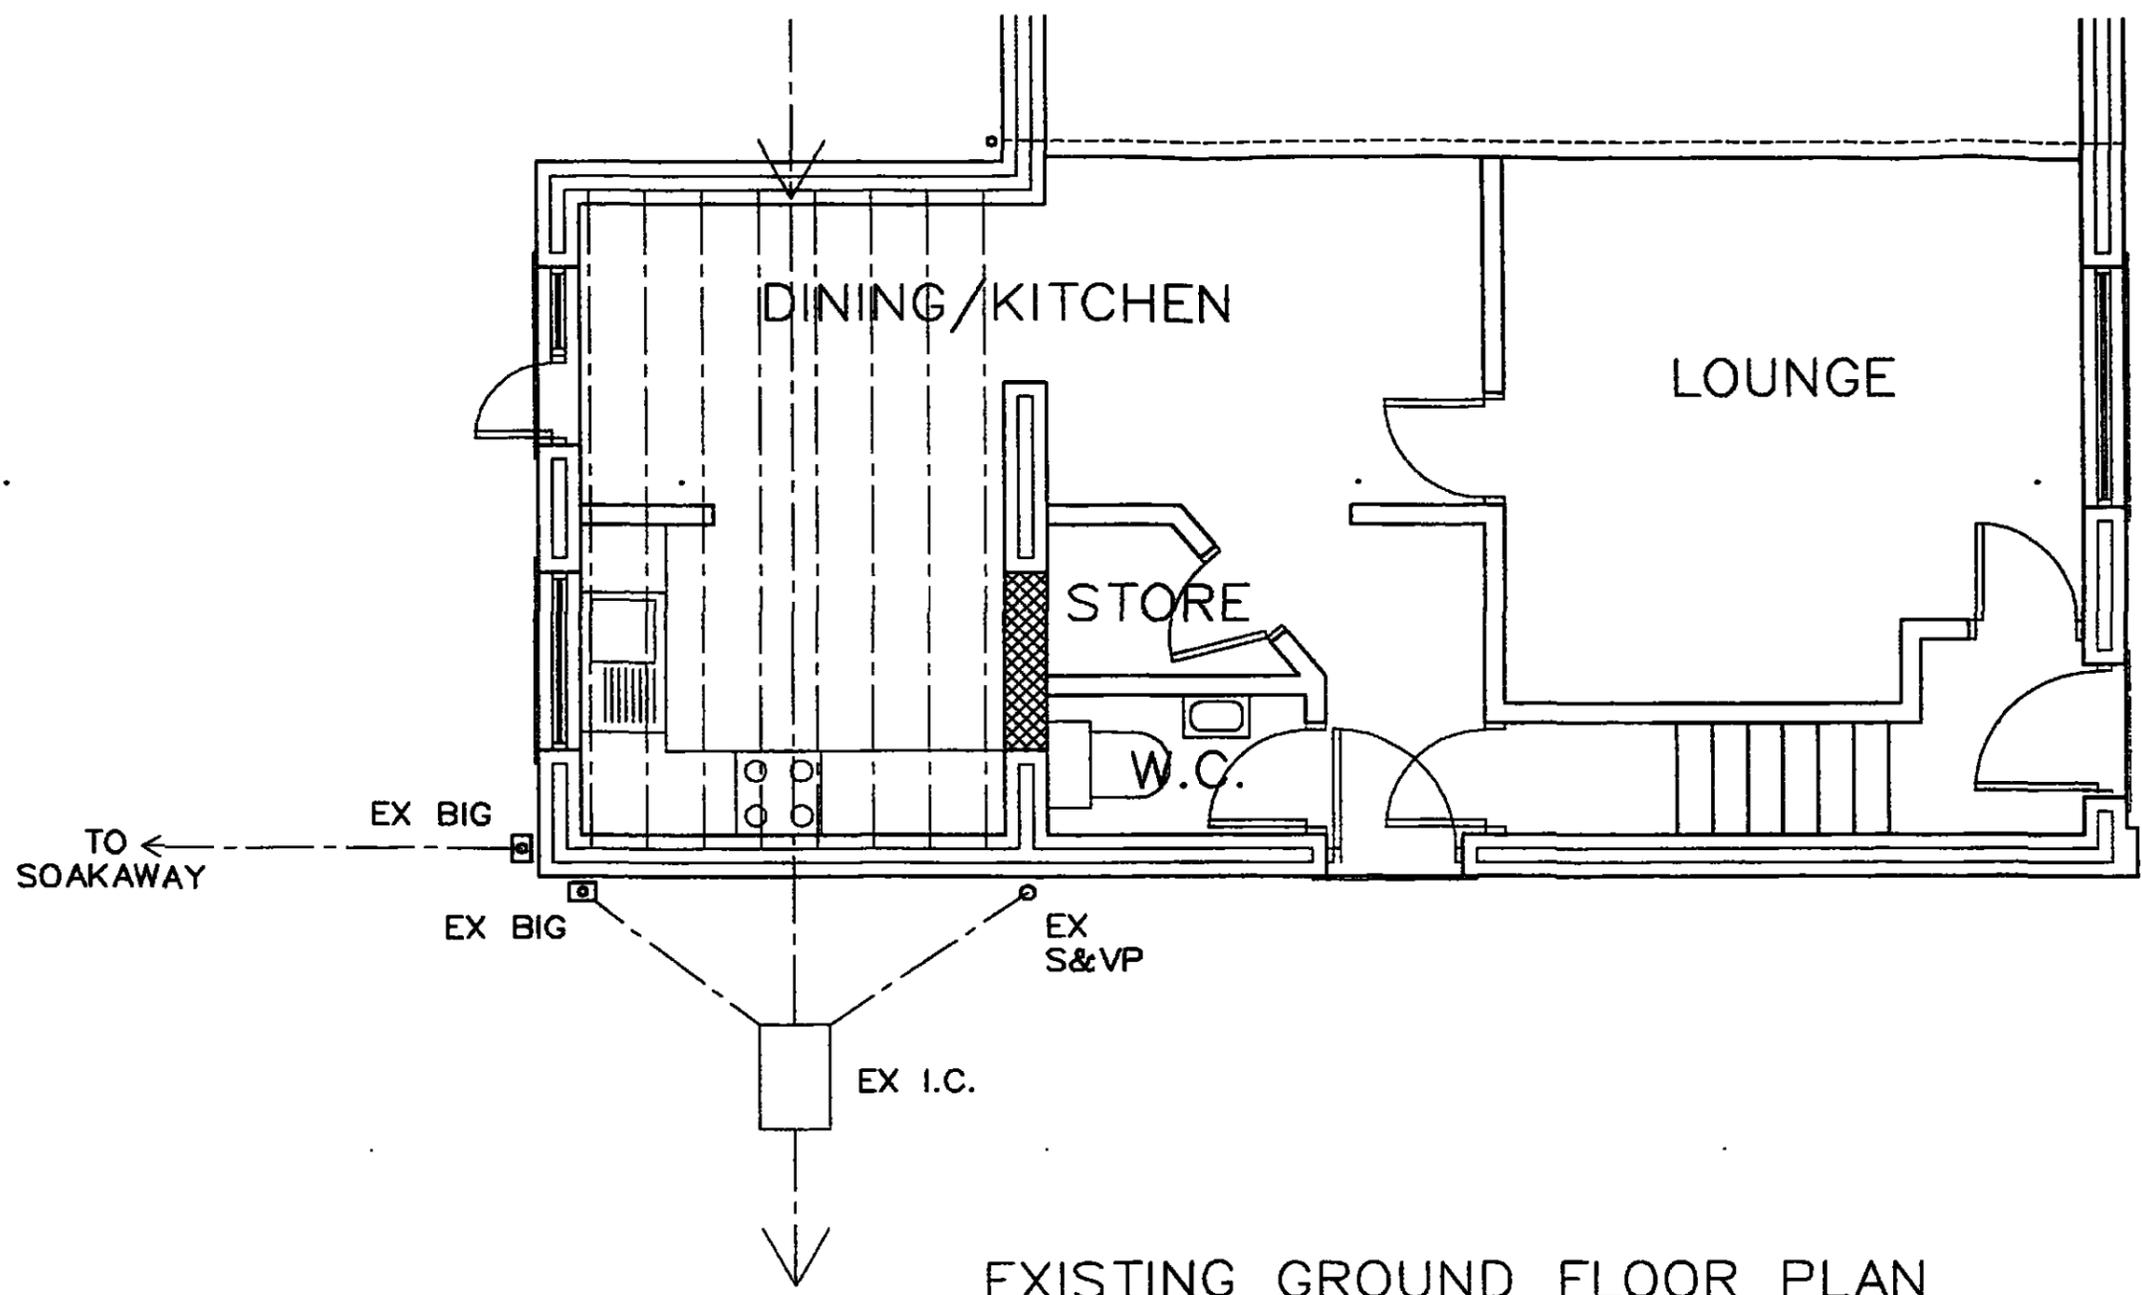

EXISTING GROUND FLOOR PLAN

TO BE READ IN CONJUNCTION WITH
 CONSTRUCTION DETAILS
 NO DIMENSIONS TO BE SCALED OFF
 THIS DRAWING
 ALL DIMENSIONS QUOTED IN
 MILLIMETRES UNLESS STATED OTHERWISE
 ALL DIMENSIONS TO BE CHECKED ON SITE
 BEFORE COMMENCEMENT OF WORK BY BUILDER

PROPOSED EXTENSION PLANS FOR:- MR AND MRS EXLEY 24 TREDIS CLOSE MONK BRETTON BARNSELEY S71 2AL		
SCALE 1 : 50	DATE MAY 2012	REV

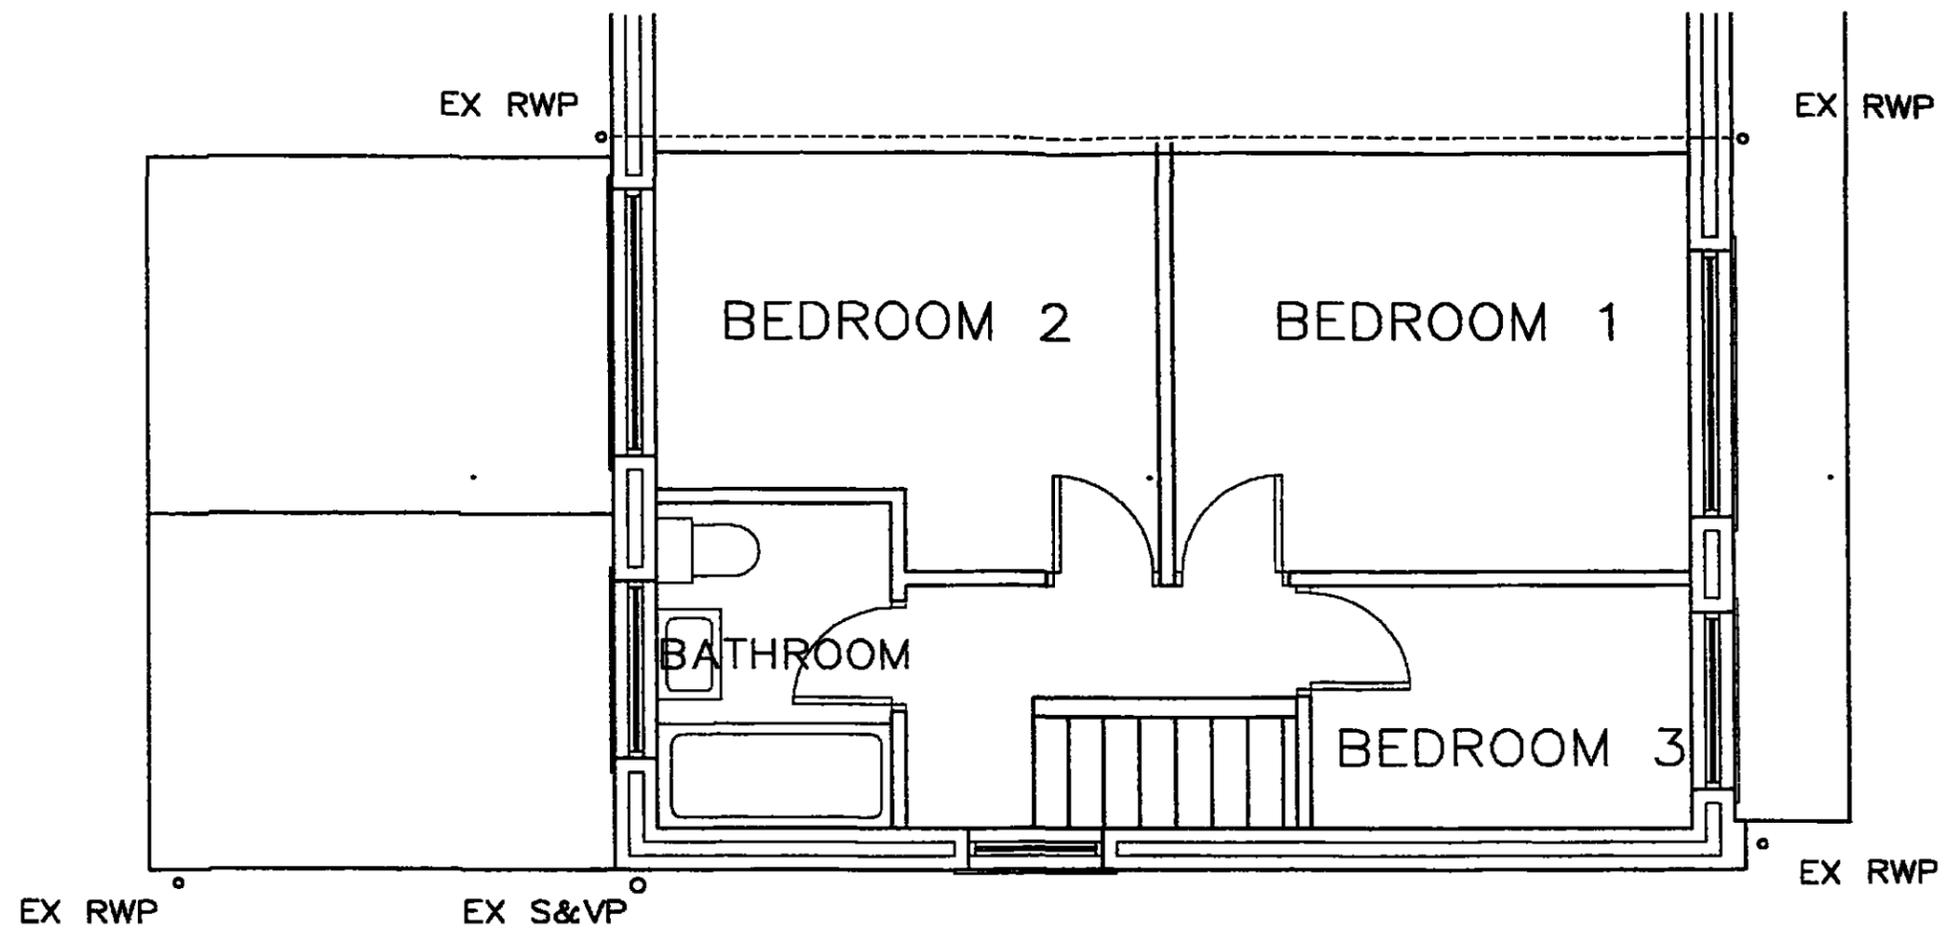

EXISTING FIRST FLOOR PLAN


TO BE READ IN CONJUNCTION WITH
 CONSTRUCTION DETAILS
 NO DIMENSIONS TO BE SCALED OFF
 THIS DRAWING
 ALL DIMENSIONS QUOTED IN
 MILLIMETRES UNLESS STATED OTHERWISE
 ALL DIMENSIONS TO BE CHECKED ON SITE
 BEFORE COMMENCEMENT OF WORK BY BUILDER

PROPOSED EXTENSION PLANS FOR:-
 MR AND MRS EXLEY
 24 TREDIS CLOSE
 MONK BRETTON
 BARNSELY
 S71 2AL

SCALE 1 : 50	DATE MAY 2012	REV
-----------------	------------------	-----

NEW WINDOW DOUBLE GLAZED
UPVC 1300X1200 DEEP
LINTOLLED OVER WITH CATNIC
CN3-1500 LINTOL OR
SIMILAR

NEW OPENING
1500 WIDE X 2500 HIGH
LINTOLLED OVER WITH CATNIC
CN3-1800 LINTOL OR
SIMILAR

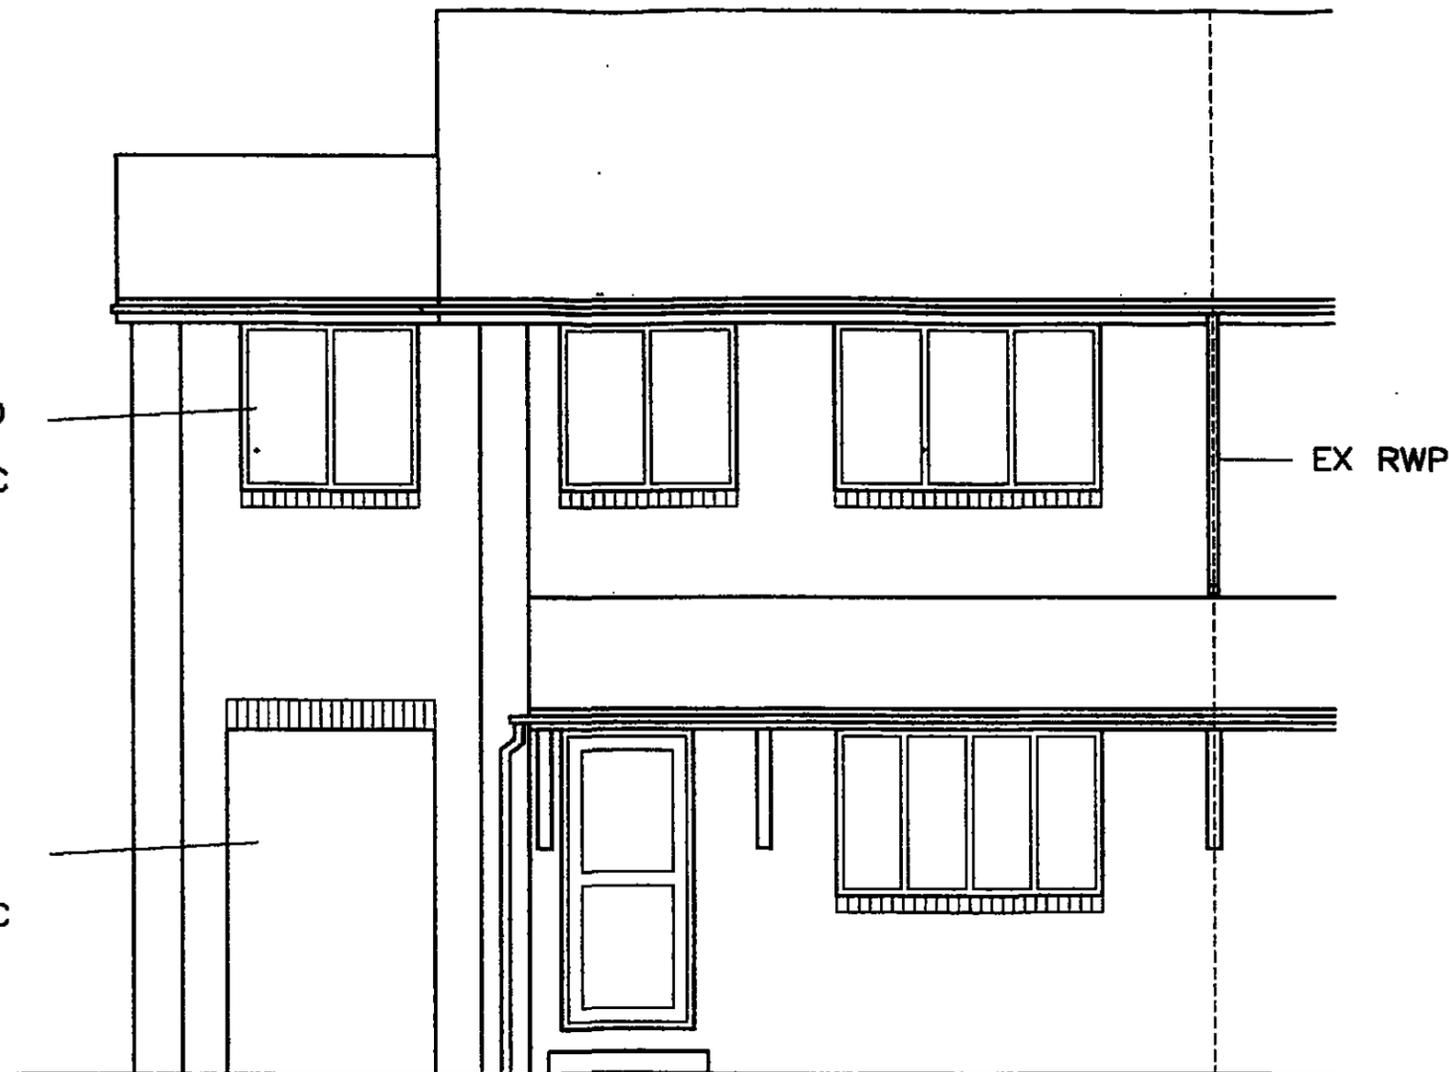

PROPOSED FRONT ELEVATION

TO BE READ IN CONJUNCTION WITH
CONSTRUCTION DETAILS
NO DIMENSIONS TO BE SCALED OFF
THIS DRAWING
ALL DIMENSIONS QUOTED IN
MILLIMETRES UNLESS STATED OTHERWISE
ALL DIMENSIONS TO BE CHECKED ON SITE
BEFORE COMMENCEMENT OF WORK BY BUILDER


PROPOSED EXTENSION PLANS FOR:-
MR AND MRS EXLEY
24 TREDIS CLOSE
MONK BRETTON
BARNSELY
S71 2AL

REVISED - AUGUST 2012

SCALE
1 : 50

DATE
MAY 2012

REV
A

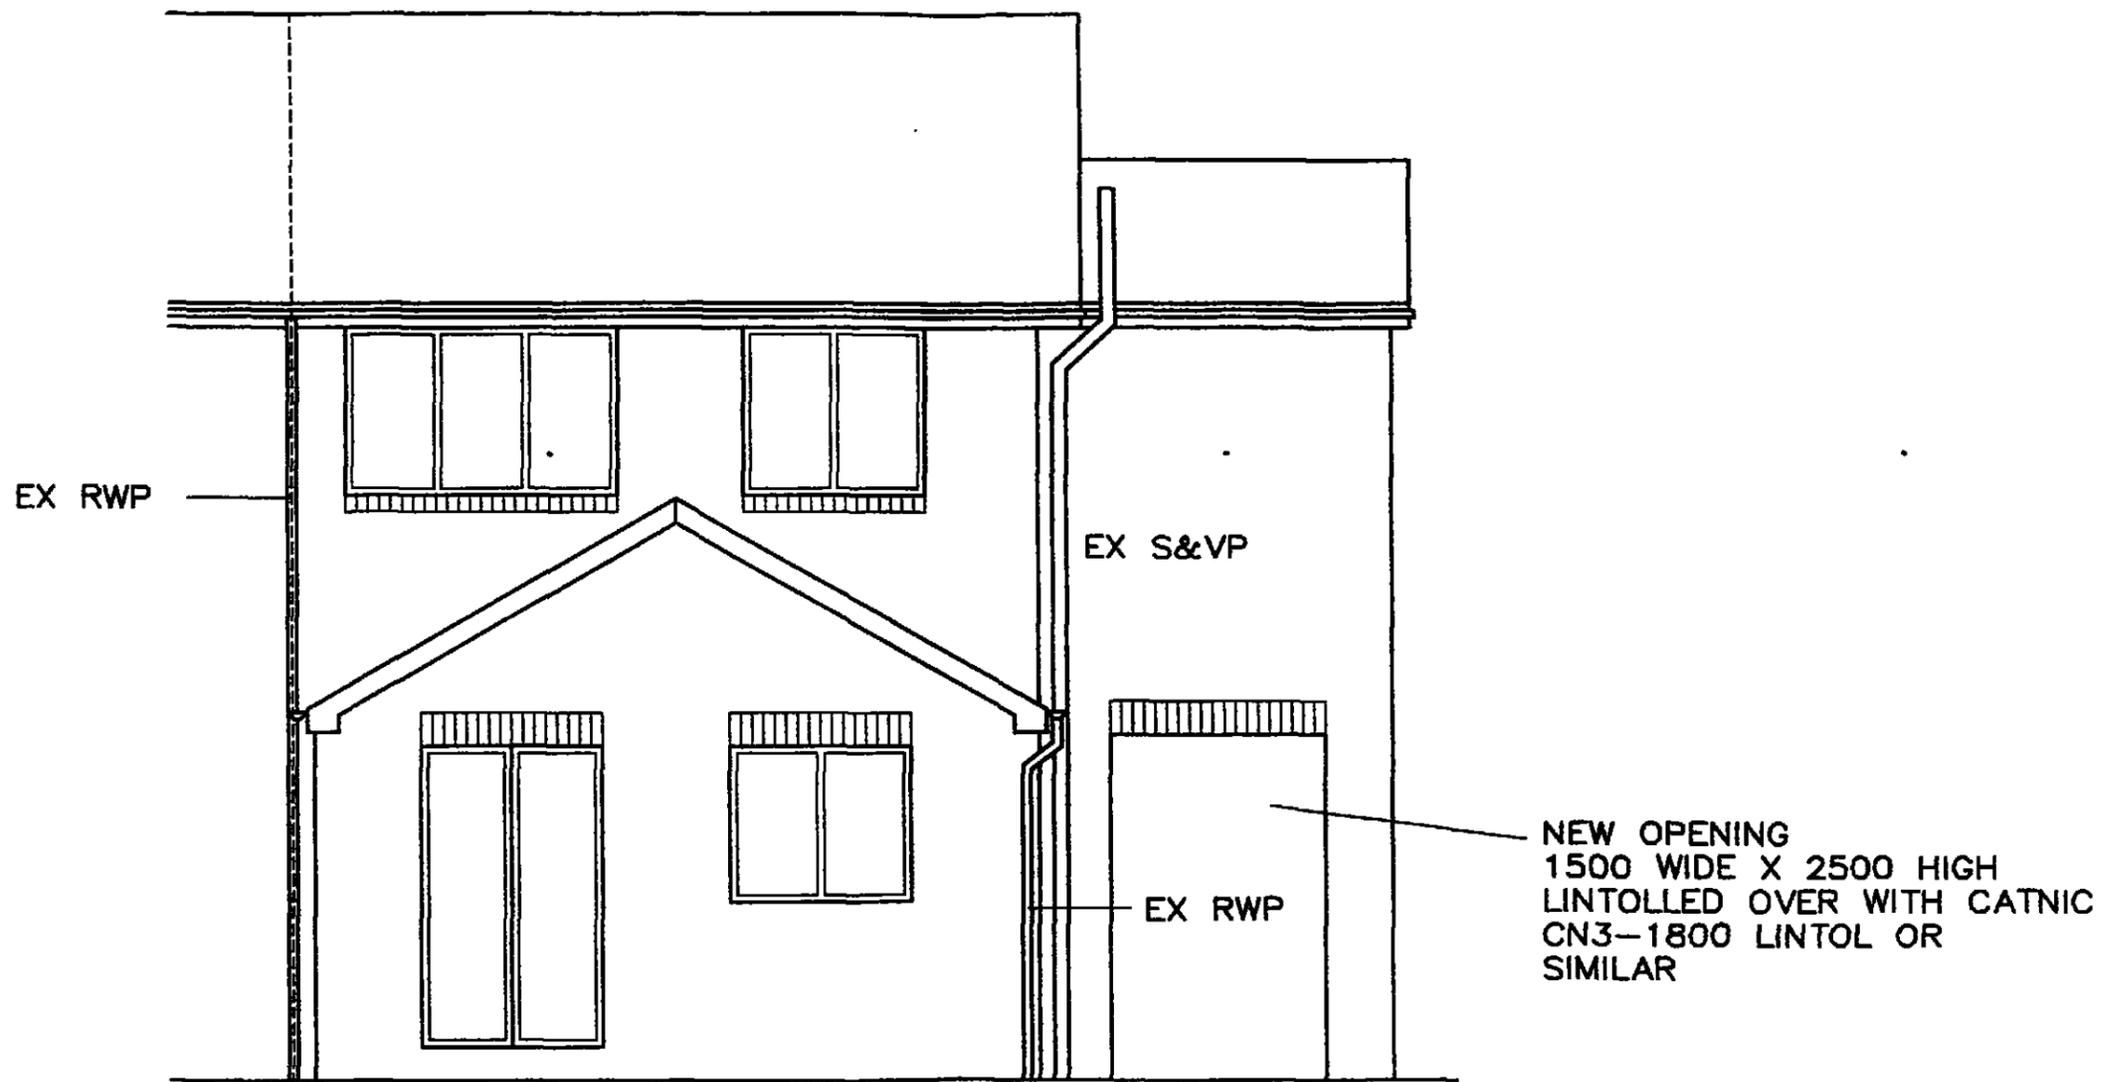

PROPOSED REAR ELEVATION

TO BE READ IN CONJUNCTION WITH
CONSTRUCTION DETAILS
NO DIMENSIONS TO BE SCALED OFF
THIS DRAWING
ALL DIMENSIONS QUOTED IN
MILLIMETRES UNLESS STATED OTHERWISE
ALL DIMENSIONS TO BE CHECKED ON SITE
BEFORE COMMENCEMENT OF WORK BY BUILDER

PROPOSED EXTENSION PLANS FOR:-
MR AND MRS EXLEY
24 TREDIS CLOSE
MONK BRETTON
BARNSELEY
S71 2AL

REVISED - AUGUST 2012

SCALE


1 : 50

DATE

MAY 2012

REV

A

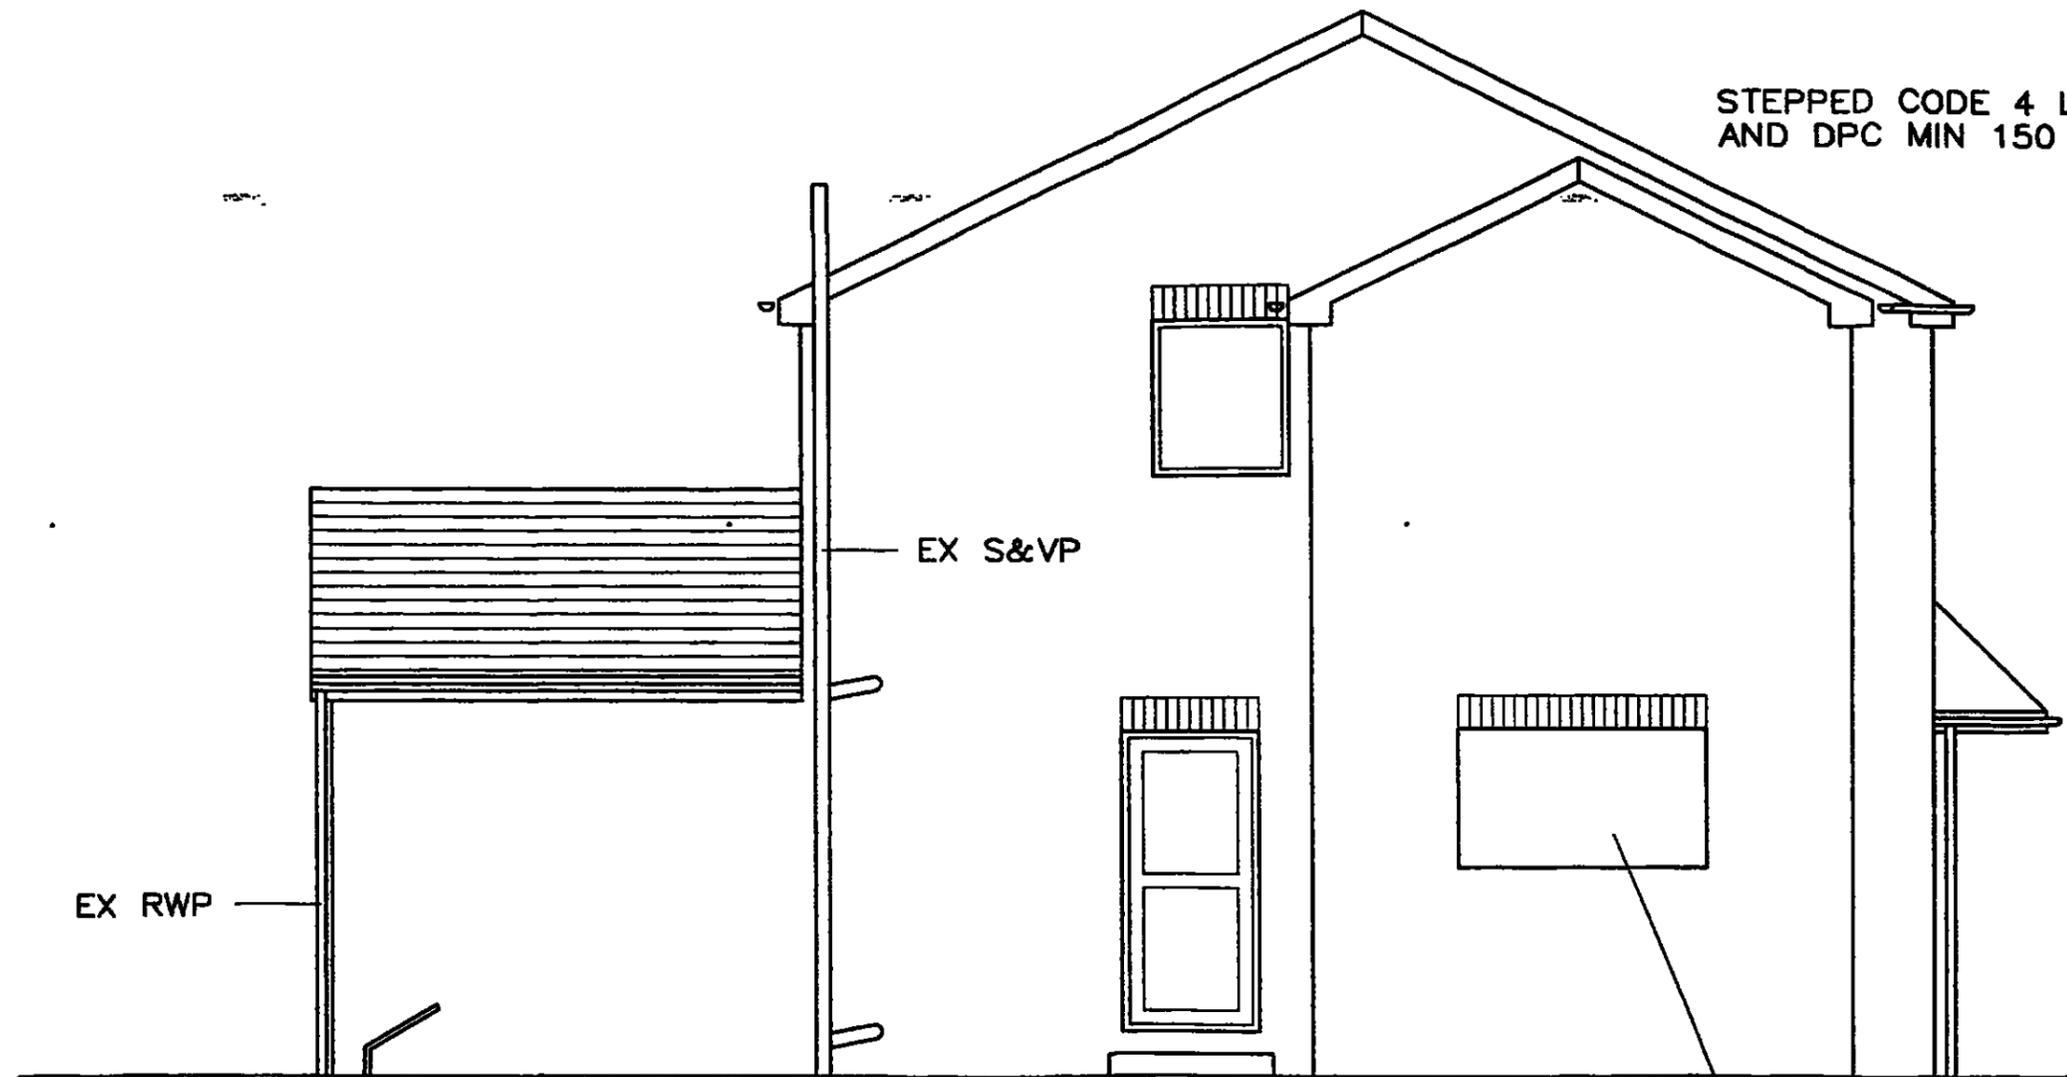

STEPPED CODE 4 LEAD FLASHING
AND DPC MIN 150 UPSTAND

EX S&VP


EX RWP

NEW OPENING
1800 WIDE X 1000 HIGH
LINTOLLED OVER WITH CATNIC
CN3-2100 LINTOL OR
SIMILAR

PROPOSED SIDE ELEVATION

TO BE READ IN CONJUNCTION WITH
CONSTRUCTION DETAILS
NO DIMENSIONS TO BE SCALED OFF
THIS DRAWING
ALL DIMENSIONS QUOTED IN
MILLIMETRES UNLESS STATED OTHERWISE
ALL DIMENSIONS TO BE CHECKED ON SITE
BEFORE COMMENCEMENT OF WORK BY BUILDER

PROPOSED EXTENSION PLANS FOR:- MR AND MRS EXLEY 24 TREDIS CLOSE MONK BRETTON BARNSELY S71 2AL		
REVISED - AUGUST 2012		
SCALE 1 : 50	DATE MAY 2012	REV A

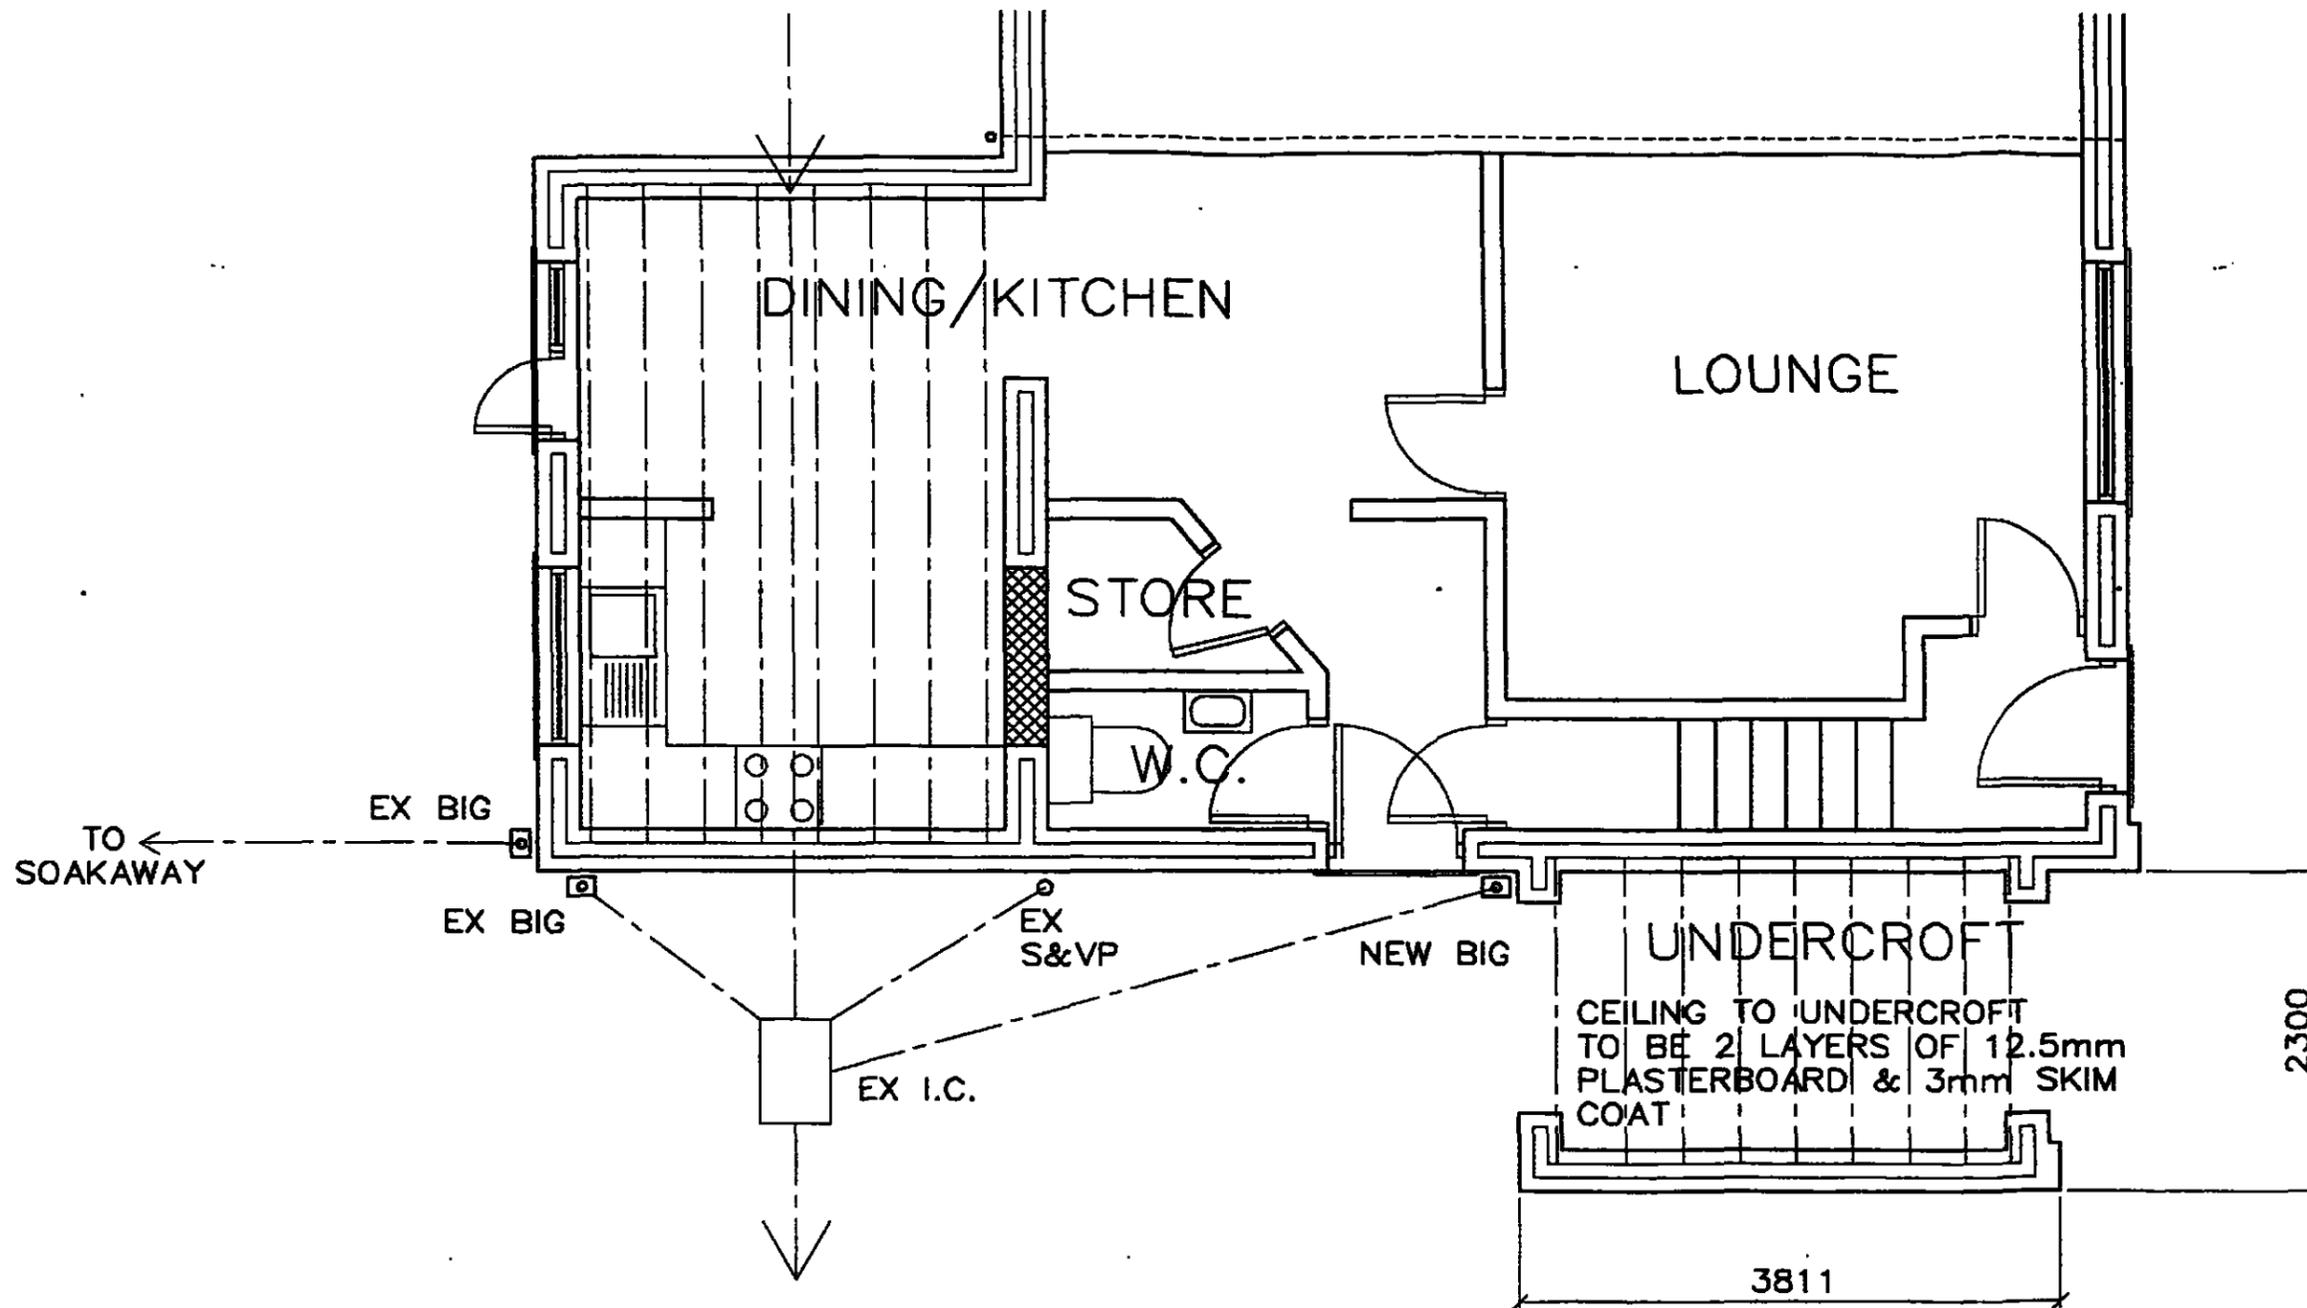

PROPOSED GROUND FLOOR PLAN

TO BE READ IN CONJUNCTION WITH
CONSTRUCTION DETAILS
NO DIMENSIONS TO BE SCALED OFF
THIS DRAWING
ALL DIMENSIONS QUOTED IN
MILLIMETRES UNLESS STATED OTHERWISE
ALL DIMENSIONS TO BE CHECKED ON SITE
BEFORE COMMENCEMENT OF WORK BY BUILDER


PROPOSED EXTENSION PLANS FOR:-
MR AND MRS EXLEY
24 TREDIS CLOSE
MONK BRETTON
BARNSELY
S71 2AL

REVISED - AUGUST 2012

SCALE
1 : 50

DATE
MAY 2012

REV
A

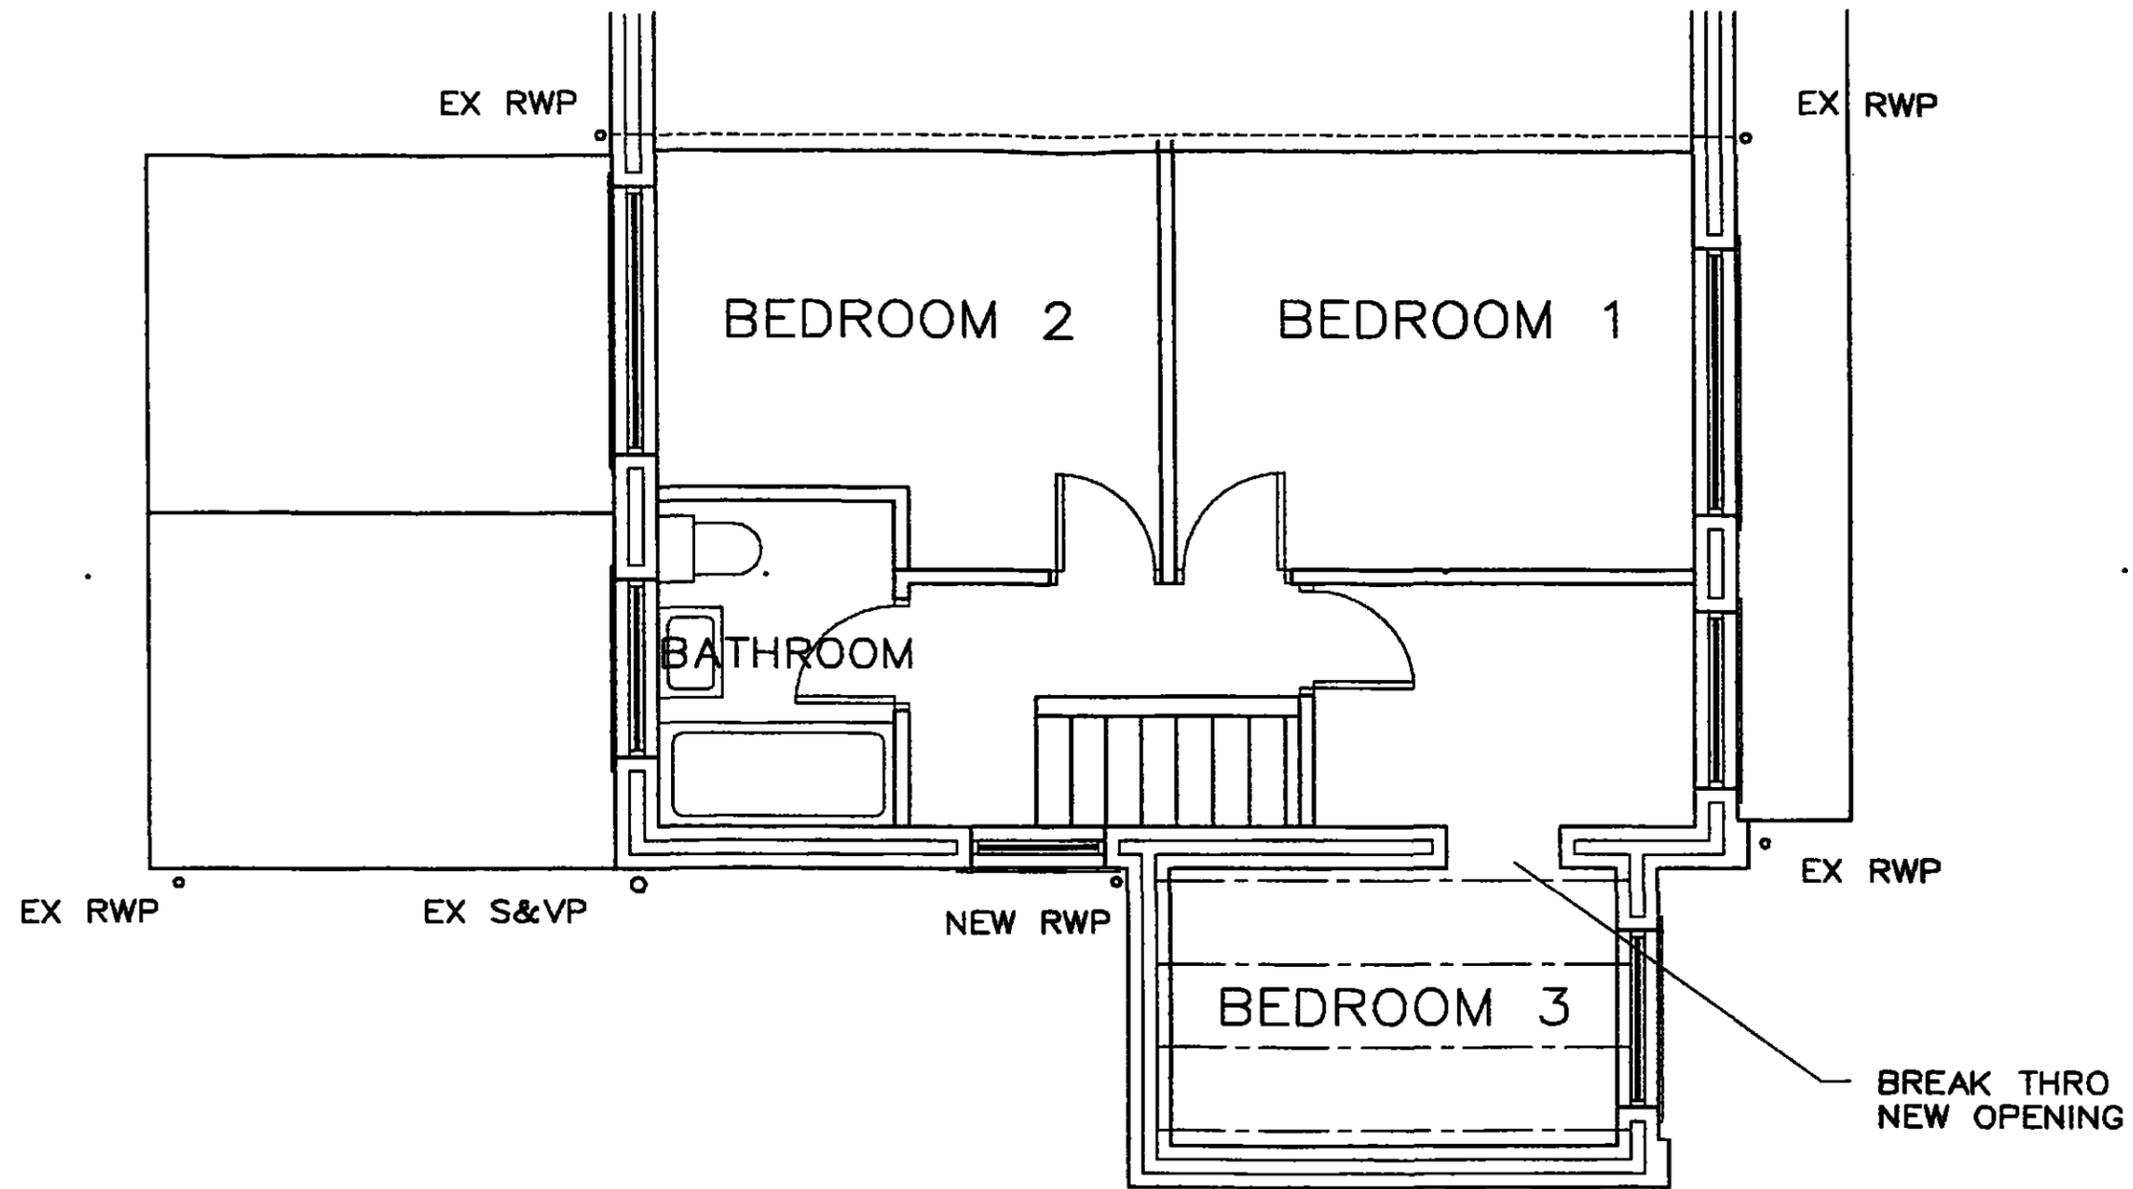

PROPOSED FIRST FLOOR PLAN


TO BE READ IN CONJUNCTION WITH
CONSTRUCTION DETAILS
NO DIMENSIONS TO BE SCALED OFF
THIS DRAWING
ALL DIMENSIONS QUOTED IN
MILLIMETRES UNLESS STATED OTHERWISE
ALL DIMENSIONS TO BE CHECKED ON SITE
BEFORE COMMENCEMENT OF WORK BY BUILDER

PROPOSED EXTENSION PLANS FOR:-
MR AND MRS EXLEY
24 TREDIS CLOSE
MONK BRETTON
BARNLEY
S71 2AL

REVISED - AUGUST 2012

SCALE 1 : 50	DATE MAY 2012	REV A
-----------------	------------------	----------

ROOF CONSTRUCTION IS SUGGESTED DESIGN ONLY. MANUFACTURERS FINAL DESIGN, DETAILS AND CALCULATIONS TO BE SUPPLIED UPON RECEIPT BY CLIENT/BUILDER

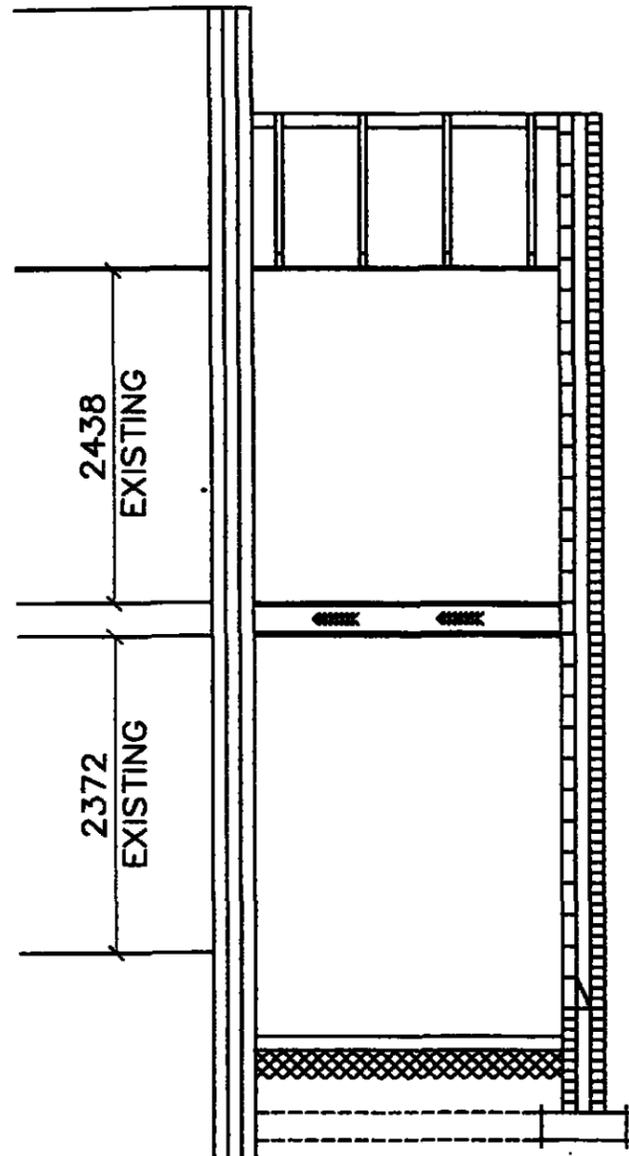

250 THICK MINERAL FIBRE INSULATION QUILT


INSULATION ABOVE UNDERCROFT TO BE 100mm THICK MINERAL WOOL AND 50mm THICK INSULATION BOARDING TO GIVE BOTH THERMAL & SOUND RESISTANCE

U/CROFT FLOOR FROM 100 THICK CONCRETE ON WELL COMPACTED HARDCORE

U/CROFT FLOOR TO BE 100 MINIMUM BELOW LEVEL OF OTHER FLOORS

PROPOSED SECTION THRO

GUTTERS, FALL PIPES AND FASCIAS TO MATCH EXISTING

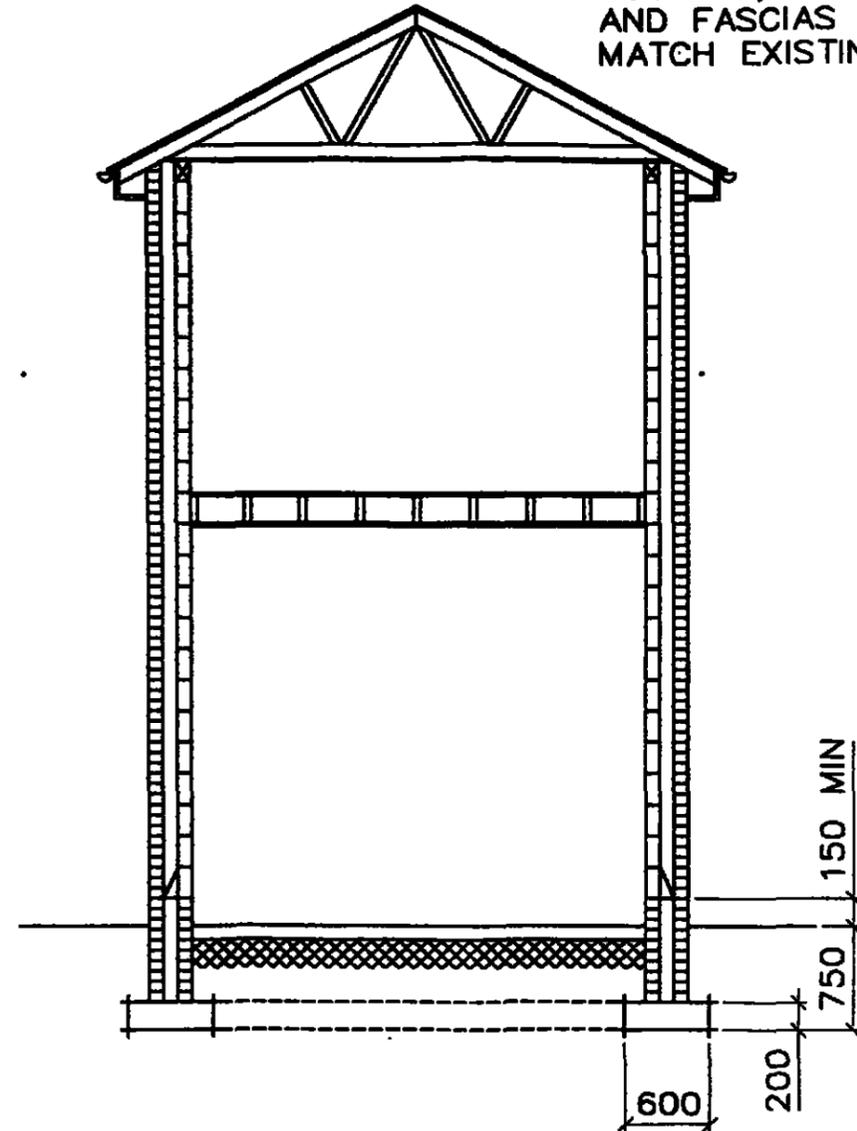

PROPOSED SECTION THRO


TO BE READ IN CONJUNCTION WITH CONSTRUCTION DETAILS
NO DIMENSIONS TO BE SCALED OFF THIS DRAWING
ALL DIMENSIONS QUOTED IN MILLIMETRES UNLESS STATED OTHERWISE
ALL DIMENSIONS TO BE CHECKED ON SITE BEFORE COMMENCEMENT OF WORK BY BUILDER

PROPOSED EXTENSION PLANS FOR:-
MR AND MRS EXLEY
24 TREDIS CLOSE
MONK BRETTON
BARNSELY
S71 2AL

REVISED - AUGUST 2012

SCALE 1 : 50	DATE MAY 2012	REV A
-----------------	------------------	----------

NORTH

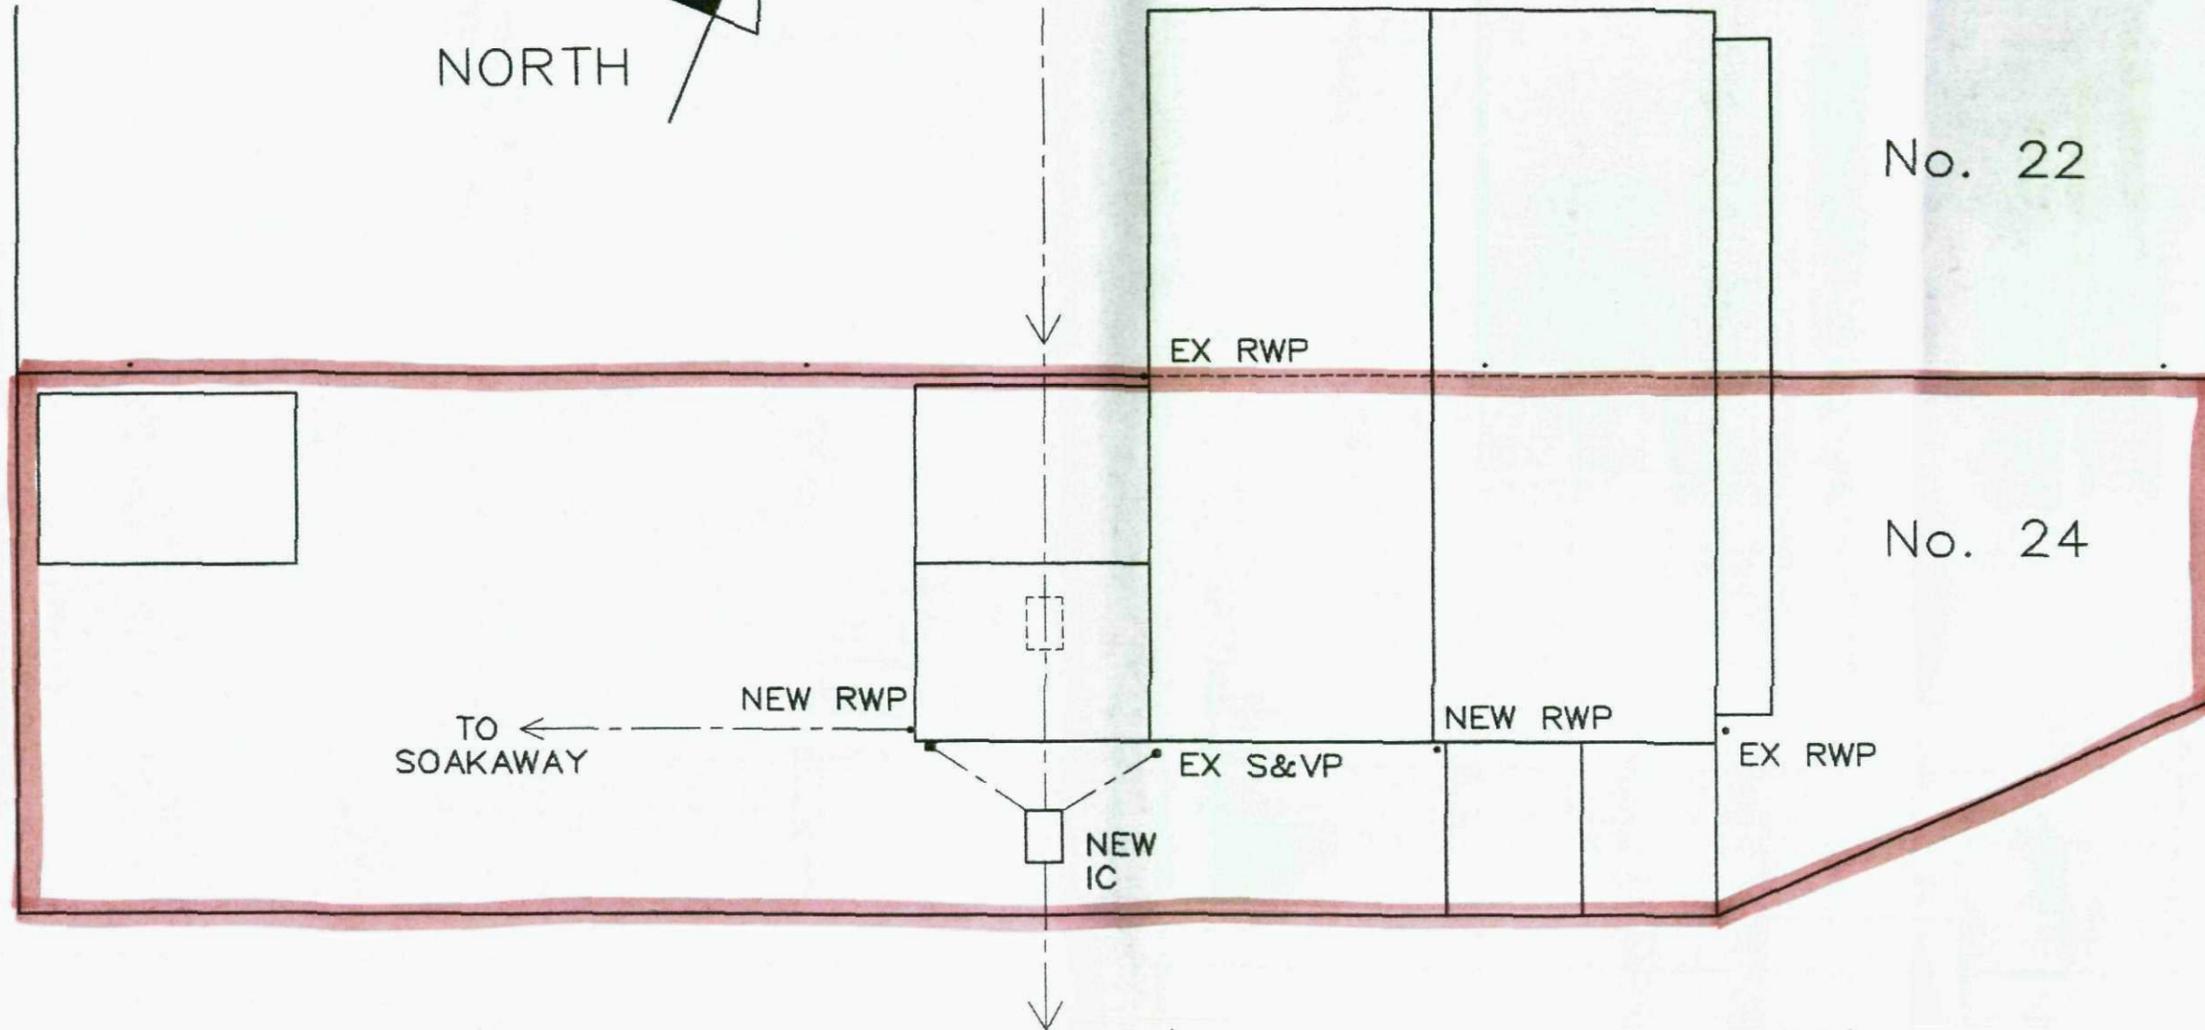

SITE PLAN
SCALE 1:100

TO BE READ IN CONJUNCTION WITH
CONSTRUCTION DETAILS
NO DIMENSIONS TO BE SCALED OFF
THIS DRAWING
ALL DIMENSIONS QUOTED IN
MILLIMETRES UNLESS STATED OTHERWISE
ALL DIMENSIONS TO BE CHECKED ON SITE
BEFORE COMMENCEMENT OF WORK BY BUILDER

PROPOSED EXTENSION PLANS FOR:-
MR AND MRS EXLEY
24 TREDIS CLOSE
MONK BRETTON
BARNSELY
S71 2AL

REVISED - AUGUST 2012

SCALE
1 : 100

DATE
MAY 2012

REV
A

NORTH



BURTON ROAD

NEWBRIDGE GROVE

TREDIS CLOSE

NEWLYN DRIVE


BODMIN COURT

TRURO COURT

SENNEN CROFT.

LANYON WAY

HELSTON COURT



ROCHE CLOSE

LADDOCK CLOSE

FALMOUTH CLOSE

LOCATION PLAN
SCALE 1:1250

TO BE READ IN CONJUNCTION WITH
CONSTRUCTION DETAILS
NO DIMENSIONS TO BE SCALED OFF
THIS DRAWING
ALL DIMENSIONS QUOTED IN
MILLIMETRES UNLESS STATED OTHERWISE
ALL DIMENSIONS TO BE CHECKED ON SITE
BEFORE COMMENCEMENT OF WORK BY BUILDER

PROPOSED EXTENSION PLANS FOR:- MR AND MRS EXLEY 24 TREDIS CLOSE MONK BRETTON BARNSELY S71 2AL		
SCALE 1 : 1250	DATE MAY 2012	REV

THIS DRAWING FOR PLANNING APPROVAL AND BUILDING REGULATIONS APPROVAL ONLY
CONSTRUCTION NOTES

GENERAL
ALL WORK TO COMPLY WITH CURRENT BUILDING REGS N.H.B.C. TECHNICAL REQUIREMENTS & WITH THE CURRENT RELEVANT BRITISH STANDARDS, AGREEMENT CERTIFICATES ETC AS APPROPRIATE

CONTRACTOR TO VISIT THE PROPERTY (BY APPOINTMENT) AND AQUAINT HIMSELF WITH SCOPE & NATURE OF THE WORKS, ACCESS ETC.

MAKE ALLOWANCE FOR ALL SUPPORTS, PROPS, NEEDLES DOWN TO LOWEST LEVEL DURING INSERTION OF ANY LINTOLS, RSJ'S ETC. AND ALLOW SUFFICIENT TIME FOR ANY NEW SUPPORT WALLS OR MAKING GOOD TO ACHIEVE STRENGTH BEFORE REMOVAL OF TEMPORARY SUPPORTS.

WHERE NEW OPENINGS MADE OR NEW WALLS INCLUDED, ALLOW FOR MAKING GOOD WITH ARCHITRAVES & SKIRTINGS TO MATCH.
MINIMUM HEADROOM UNDER ANY BEAMS OR TRIMMERS TO BE 2 METRES.

FOUNDATIONS

TO SUIT SITE CONDITIONS, NORMALLY 600X200 THICK CONCRETE UNDER EXTERNAL WALLS & 450X150 THICK CONCRETE UNDER LOADBEARING SINGLE SKIN SPINE WALLS. ALL CONCRETE TO COMPLY WITH APPROVED DOCUMENT 'A' PART 'E' OF THE BUILDING REGULATIONS.

FIRST FLOOR

TO BE 22mm THICK FLOORING GRADE T&G CHIPBOARD (V313) TO BS 5669 ON 200X50 JOISTS AT 400mm CENTRES. CEILING TO BE 12.5mm PLASTERBOARD & SKIM HERRINGBONE STRUTTING REQUIRED AT MIDSPAN TIMBER TO BE SC3/4 GRADE.

PARTITION WALLS

TO BE 100mm STUD PARTITIONS COMPRISING OF 3mm PLASTER SKIM COAT ON 12mm PLASTERBOARD ON 75X50 TIMBER STUDS AT 600 CENTRES WITH 75X50 HEAD AND SOLE PLATES
SOUND INSULATION TO BE PROVIDED TO PARTITION WALLS

FLASHINGS

TO BE BS 117 MILLED LEAD SHEET (4 LBS) IN POSITIONS INDICATED.

MODS TO EXISTING HEATING SYSTEM TO BE CARRIED OUT BY A REGISTERED INSTALLER AND MUST BE TO PART J OF THE BUILDING REGULATIONS.

EXTERNAL WALLS

CAVITY WALL CONSTRUCTION TO BE EXTERNAL LEAF OF HALF BRICK THICK COMMONS TO GROUND LEVEL WITH FACING BRICKS TO MATCH EXISTING.
80mm CAVITY FILLED WITH 80mm "ROCKWOOL" CAVITY BATTS, CAVITY TO BE FILLED WITH LEAN MIX CONCRETE TO 225 BELOW D.P.C. INNER LEAF TO BE HALF BRICK THICK COMMONS TO DPC LEVEL WITH 100 THERMALITE BLOCKS ABOVE. BUILD IN 225mm LONG STAINLESS STEEL TIES AT 750mm HORIZ. CENTRES, 450mm VERTICAL CENTRES & EVERY BLOCK COURSE AT REVEALS. INSULATED CAVITY CLOSERS TO BE PROVIDED TO ALL OPENINGS, ALL CAVITIES TO BE SEALED AT EAVES, CILLS & VERGES, DPC'S TO BE PROVIDED TO HEADS, JAMBS & CILLS OF ALL WINDOW & DOOR OPENINGS. CAVITY TRAYS REQUIRED ABOVE ALL OPENINGS WITH 150mm UPSTAND & WEEPHOLES. VERTICAL DPM TO METER CABINETS.

LINTOLS - TO BE GALVANISED PRESSED STEEL, BRITISH STANDARD OR AGREEMENT CERTIFIED TO BE APPROPRIATE FOR SPANS & LOADS SUPPORTED WITH SUITABLE BEARINGS. INTERNAL SPINE WALLS TO BE FORMED INTERNAL LINTOLS OR BOX BEAMS AS INDICATED.

STRUCTURAL STEELWORK - AS DESIGNED BY CONSULTANT ENGINEER IN POSITIONS INDICATED ON DRAWING. ALL STEELWORK ENCASED TO GIVE 1 HOUR FIRE RESISTANCE

ROOF

ROOF TILES TO MATCH EXISTING ON 38 X 25 TILE BATTENS ON ROOFING FELT TO BS 747 ON PREFABRICATED TRUSSED RAFTERS TO CP112 PART 3, 1973 AT 400 CENTRES MAXIMUM. 26.5 DEGREE PITCH SPIKED TO 75X50 WALL PLATE STRAPPED TO BLOCKWORK AT 2000 CENTRES. BRACINGS & BINDERS TO ROOF TO CONFORM WITH BS 5268 PART 3. 200 X 25 & 175 X 25 SOFTWOOD FASCIA. EX 150 X 19 SOFFIT ON 100 X 25 SOFTWOOD BEARERS. 100 X 12 SOFTWOOD TILT FILLET EAVES VENTILATOR BY AIRFLOW AIRBRICKS LTD. COMPLETE WITH FLYSCREEN TO GIVE EQUIVALENT TO 10mm CONTINUOUS AIR SPACE, 150 X 25 BARGEBOARD FIXED TO 100 X 50 GABLE LADDER BEAM FILLED OVER CAVITY WALLS. 50mm VENTILATED AIR SPACE WITH KINGSPAN THERMAPITCH TP10 ZERO ODP BETWEEN RAFTERS AND KINGSPAN THERMAWALL TW56 ZERO ODP UNDER RAFTERS

ALL ELECTRICAL WORK REQUIRED TO MEET THE REQUIREMENTS OF PART P (ELECTRICAL SAFETY) MUST BE DESIGNED, INSTALLED, INSPECTED AND TESTED BY A PERSON COMPETENT TO DO SO. PRIOR TO COMPLETION OF THE WORK THE DISTRICT SURVEYOR IS TO BE PROVIDED WITH EVIDENCE TO DEMONSTRATE THAT EITHER:-
A) THE ELECTRICAL WORK HAS BEEN CARRIED OUT BY A PERSON WHO IS A MEMBER OF A RELEVANT "COMPETENT PERSON SCHEME"; OR
B) THE REQUIREMENTS OF PART P HAVE BEEN COMPLIED WITH AND THAT AN APPROPRIATE BS7671 ELECTRICAL INSTALLATION CERTIFICATE HAS BEEN ISSUED BY A PERSON COMPETENT TO DO SO. (NOTE THAT ADDITIONAL BUILDING REGULATION CHARGES AND INSPECTIONS WILL APPLY IN THIS CASE.)

RAINWATER PIPES AND GUTTERS
RAINWATER PIPES TO BE 63 INTERNAL DIA. PVC TO REG H3 DISCHARGING INTO GULLEY. GUTTERS TO BE 100 DIA. LAID TO FALLS AND FIXED IN ACCORDANCE WITH MANUFACTURERS INSTRUCTIONS

PLUMBING

SOIL & VENT PIPE TO BE 100mm DIA. P.V.C. VENT PIPES TO BE 75mm DIA. BOTH TO FITTED WITH CAGE & TERMINATED A MIN. OF 900mm ABOVE ANY WINDOW OPENING. WASTE PIPES TO BE TO B.S. 659, TABLE 3 COMPRESSION FITTINGS; BATH, SHOWER & SINK WASTES TO BE 40mm DIA. LAVATORY BASIN WASTE PIPES TO BE 32mm DIA. ALL WASTES TO BE FITTED WITH 75mm DEEP SEAL TRAPS AND LAID TO FALLS OF 1 IN 24 MIN. NO CONNECTION WITHIN 200mm WHERE BELOW W.C. CONN.

ANCHOR TIES

FIRST FLOOR - TO BE BUILT INTO EXTERNAL WALLS AT 1800mm CENTRES OVER 3 No. JOISTS WHERE PARALLEL TO WALL ROOF - TO BE BUILT INTO EXTERNAL GABLE WALLS AT 1800mm CENTRES OVER 3 No. RAFTERS AND CEILING MEMBERS OF ROOF TRUSSES. ALL ANCHOR TIES TO BE MILD STEEL 30mm WIDE x 5mm THICK. NOGGINS, PACKINGS 1/2 MEMBER DEPTH PROVIDED.

INTERNAL FINISHES

TO INTERNAL LEAF OF CAVITY WALL AND INTERNAL BLOCK WALLS TO BE 25mm DRY LINING OF 3mm PLASTER SKIM COAT ON 9.5mm PLASTERBOARD WITH TAPED JOINTS ON PLASTER DABS.

DRAINAGE

ALL DRAINS FOR FOUL AND SURFACE WATER TO COMPLY WITH B.S. 65 & 540:1986 WITH FLEXIBLE JOINTS. DRAIN TRENCHES WITHIN 1000mm OF FOUNDATIONS TO BE FILLED TO UNDERSIDE OF FOUNDATIONS WITH CONCRETE. DRAINS PASSING UNDER BUILDINGS TO BE SURROUNDED WITH GRANULAR FILL AND JOINTS LEFT FLEXIBLE. MANHOLES TO BE PRECAST CONCRETE RING TYPE OR CLASS 'B' ENGINEERING BRICKS 225mm THICK ON 100mm CONCRETE FOUNDATIONS. DRAINS PASSING THROUGH WALLS TO HAVE PRECAST CONCRETE LINTOL OVER & 50mm SPACE OR ROCKER PIPES.

WINDOWS AND DOORS

TO BE TO OWNERS REQUIREMENTS AND TO THE SATISFACTION OF LOCAL AUTHORITY PLANNING OFFICER AND TO MEET CURRENT REGS I.E. DOUBLE GLAZED WITH PILKINTON K OR SIMILAR LOW E GLASS WITH 16mm AIR GAP. OPENING LIGHTS TO BE 1/20TH FLOOR AREA WITH 8000mm TRICKLE VENT ALL WINDOWS TO HAVE MEANS OF ESCAPE MIN. 750X450mm WIDE AND 1100 MAX. ABOVE FLOOR LEVELS. ALL GLAZING IN CRITICAL AREAS WITHIN 800mm OF FLOOR LEVEL TO BE SAFETY GLASS TO BS 6206 AND STAMPED ACCORDINGLY. ALL WINDOWS TO ACHIEVE MIN U VALUE OF 1.8 N/M2.

TO BE READ IN CONJUNCTION WITH CONSTRUCTION DETAILS
NO DIMENSIONS TO BE SCALED OFF THIS DRAWING
ALL DIMENSIONS QUOTED IN MILLIMETRES UNLESS STATED OTHERWISE
ALL DIMENSIONS TO BE CHECKED ON SITE BEFORE COMMENCEMENT OF WORK BY BUILDER

PROPOSED EXTENSION PLANS FOR:-
MR AND MRS EXLEY
24 TREDIS CLOSE
MONK BRETTON
BARNSELEY
S71 2AL

SCALE	DATE	REV
NOT APPLICABLE	MAY 2012	