


GENERAL NOTES

1. This drawing to be read in conjunction with all relevant documents.
2. Do not scale from this drawing.
3. Drawing to be read in conjunction with the provided specification.
4. All work to be carried out in accordance with the latest Building Regulations.
5. Provide DPC to all new window and door openings.
6. New windows to be 1/10 floor area. Minimum operatives to be 1/20 floor area.
7. All new windows to be upvc double glazed sealed units with Pilkington 'K' glass and incorporating 8000mm trickle vent.
8. All dimensions to be checked on site.
9. All dimensions in millimetres.
10. All structural timber to be tanalized.
11. Lead flashing to BS code No.4 to be provided.
12. Provide 50mm x 3mm galvanised mild steel strips to new roof and floor at 1.2m centres.
13. New brickwork to be tied to existing via wall starters or screw/fistul ties at 225mm vertical spacing.
14. Provide 75mm steel trops to all walls.
15. Wall ties to be provided in accordance with BS5628.
16. Roof purling to be provided in accordance with BS5268 Part 3:1985.
17. Provide minimum 150mm bearing to all lintels and beams. Posts/rods to be of concrete and at least 150mm deep.
18. All new brickwork and roof tiles to match existing.
19. All new drains to be 100mm dia. Where possible new rainwater pipes to empty directly into gullies. Provide rodding access at changes of direction.
20. 10000 sq. mm free ventilation for patio doors.
21. Provide 125mm plasterboard and skim surround to all beams.
22. Provide insulation at all cavity closures.
23. To client specification all electrical works to be carried out in accordance with Part P (see specification).
24. The building contractor and client are responsible for health and safety while construction is taking place on this site and this drawing is not to be used for health and safety purposes.
25. For rear extension foundation details see Specification Appendix 4.
26. Rear extension not to extend more than 3m from original rear face.
27. (Ungrazed safety grazing to be provided at areas where grazing occurs less than 800mm above floor level or external ground levels also where grazing occurs less than 1500mm above floor level or external ground level within 300mm of any internal or external door).
28. Provide coritic or similar prefabricated steel lintels to BS 5977. Part II to all openings. All lintels to be insulated. Bad on mortar with a minimum bearing of not less than 150mm. Ensure internal surface covered with a minimum of 15mm of plaster. Provide cavity trays/ops over all lintels if required with stop ends and weep holes at 900mm centres with a minimum of two per cavity tray.
29. All electrical works must be undertaken by a person competent to so.
30. For above ground drainage see specification page 12.
31. Floor construction to be 50mm deep sand/cement screed. Finished tide floor covering on 100m deep mass concrete oversite slab.
32. 100mm thick mass concrete oversite slab 20V/m/m2 on Varsquene damp proof membrane, taken up and laid onto horizontal blunorous DPC on 50mm Celex Wk/R G4500 insulation with a thermal conductivity of 0.025 W/m.k on 150mm well compacted hardcore from sulphate and blended with sand. 25mm metal poly/styrene edge insulation to be provided around edge of ground floor slab.


EXISTING REAR ELEVATION

1:50

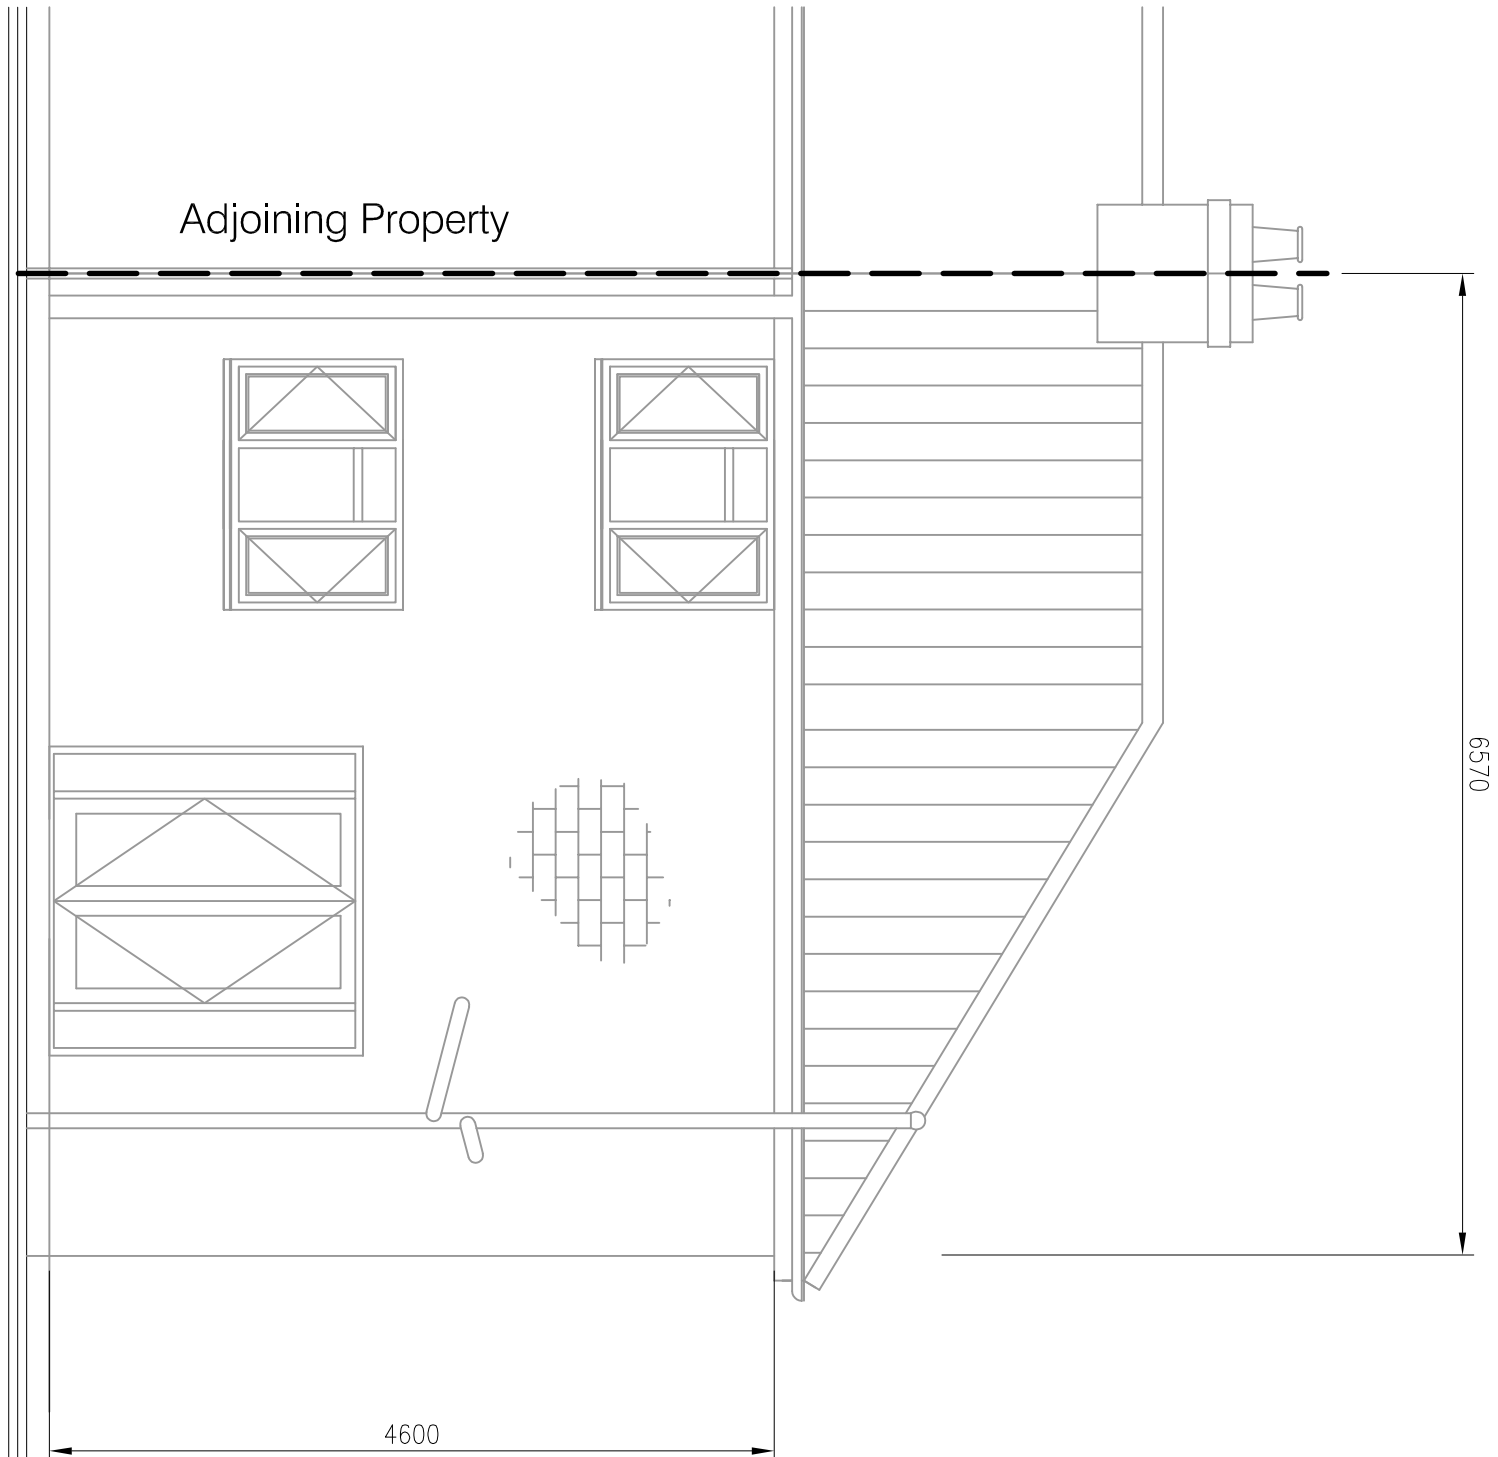


EXISTING SIDE ELEVATION

1:50

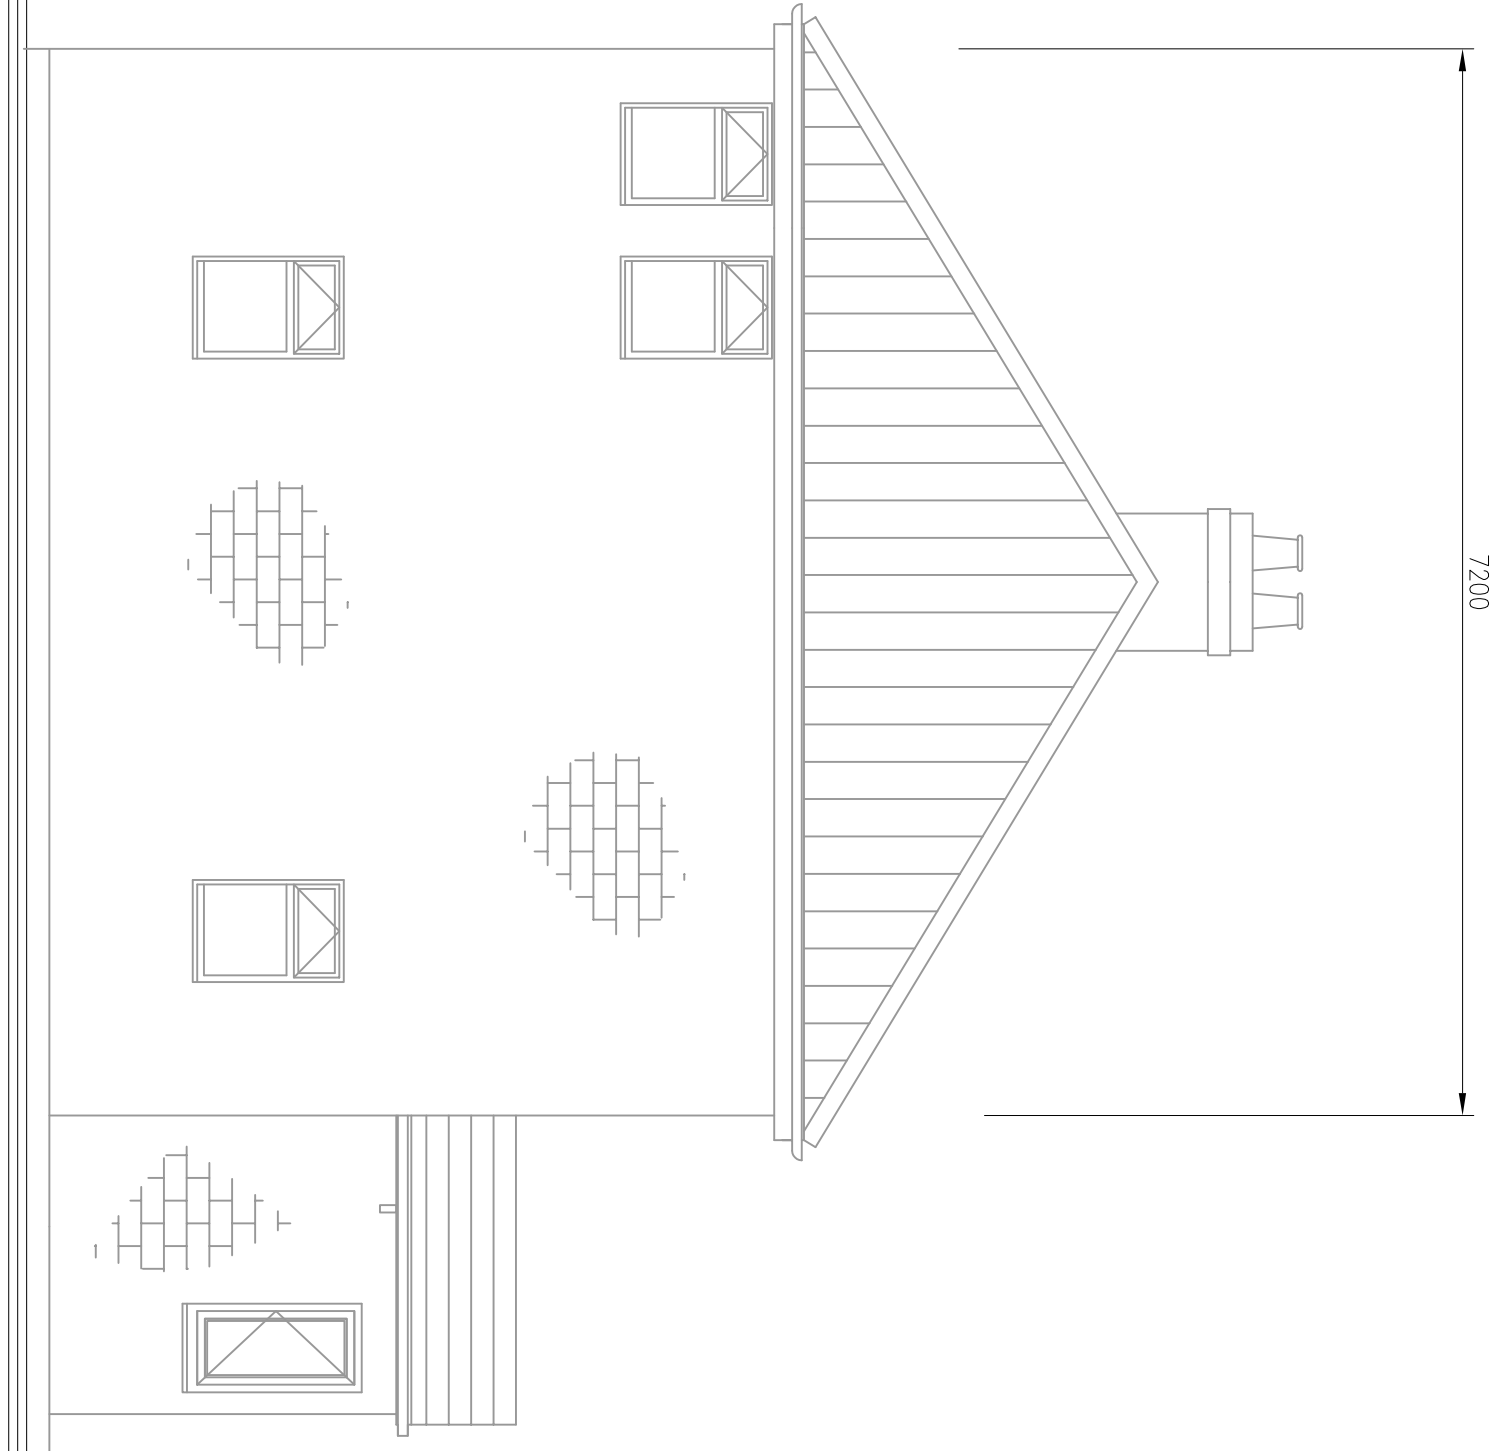


EXISTING FRONT ELEVATION

1:50

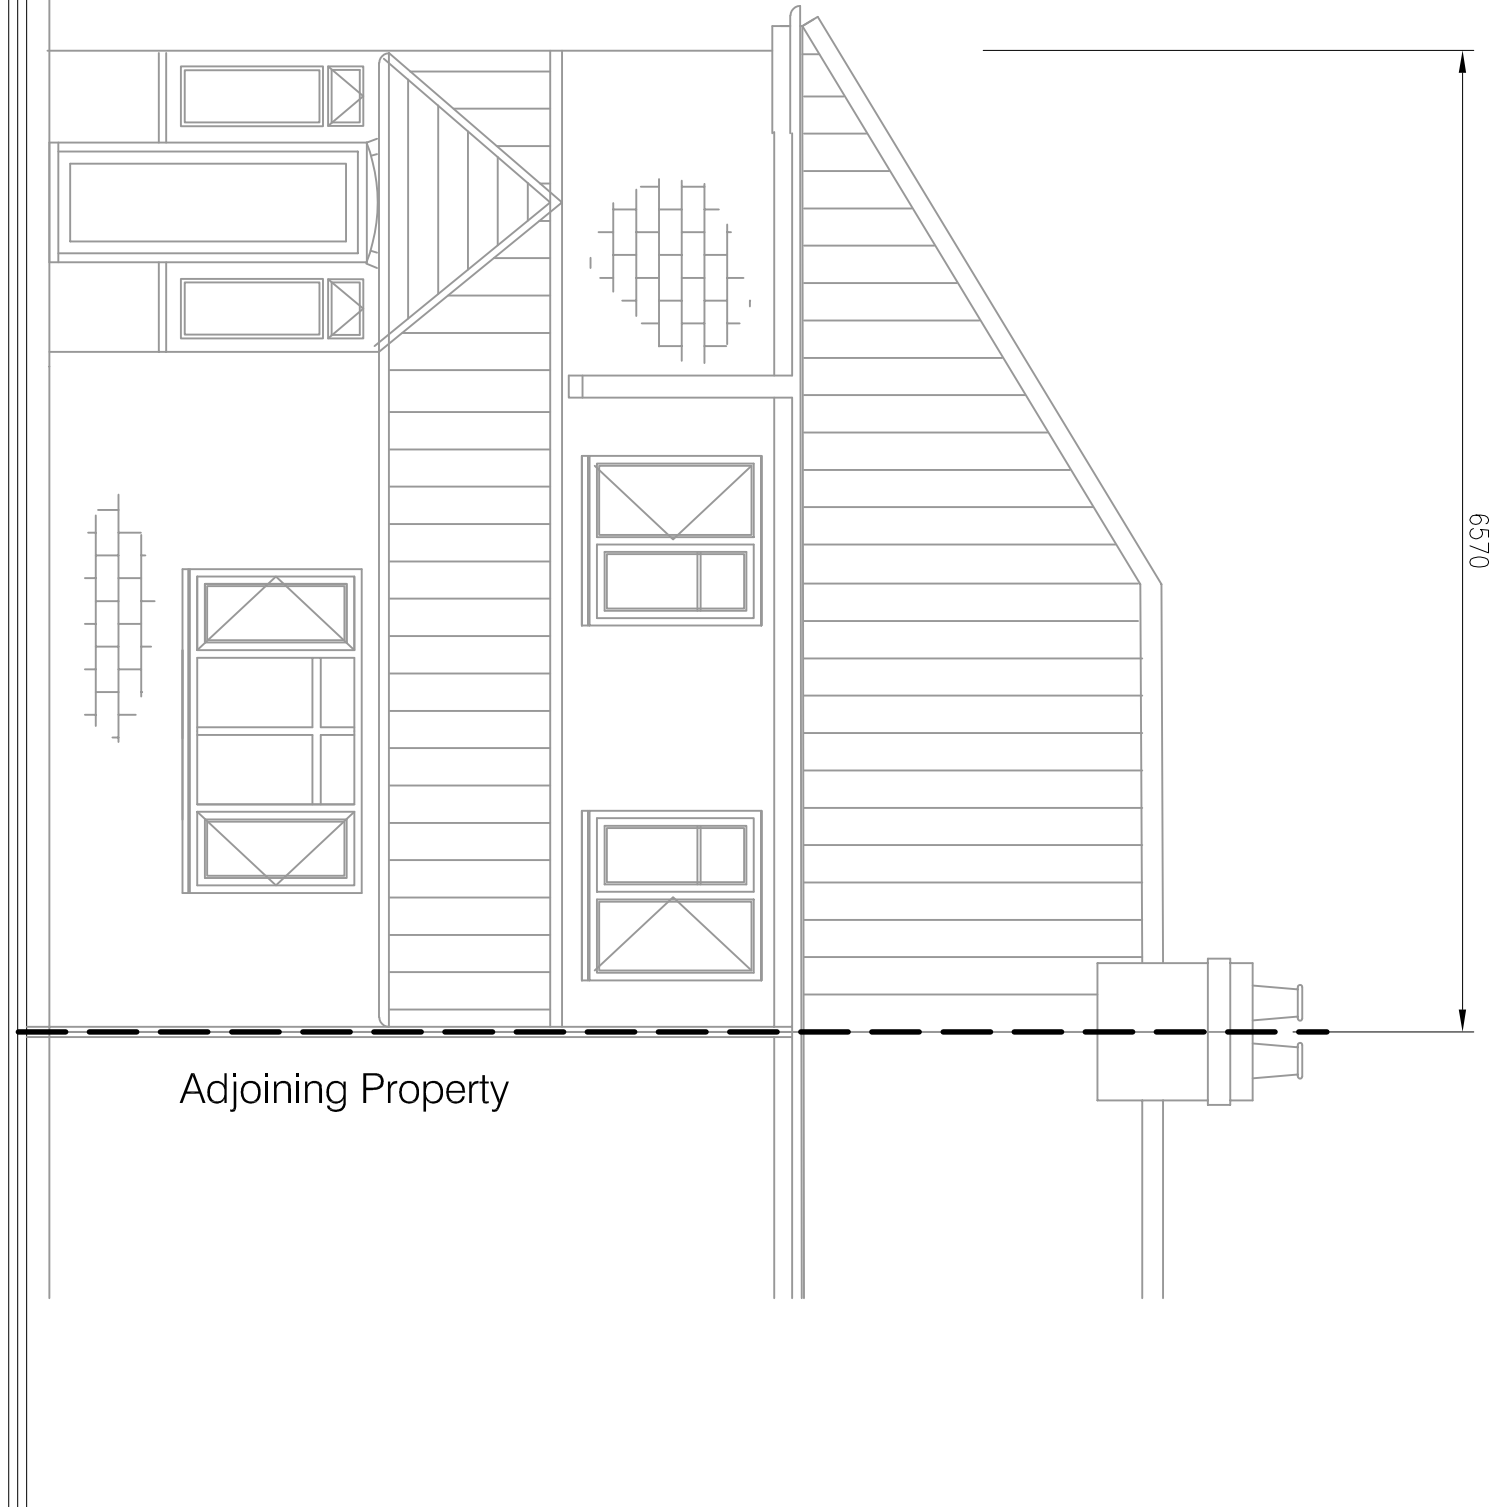


PROPOSED REAR ELEVATION

1:50

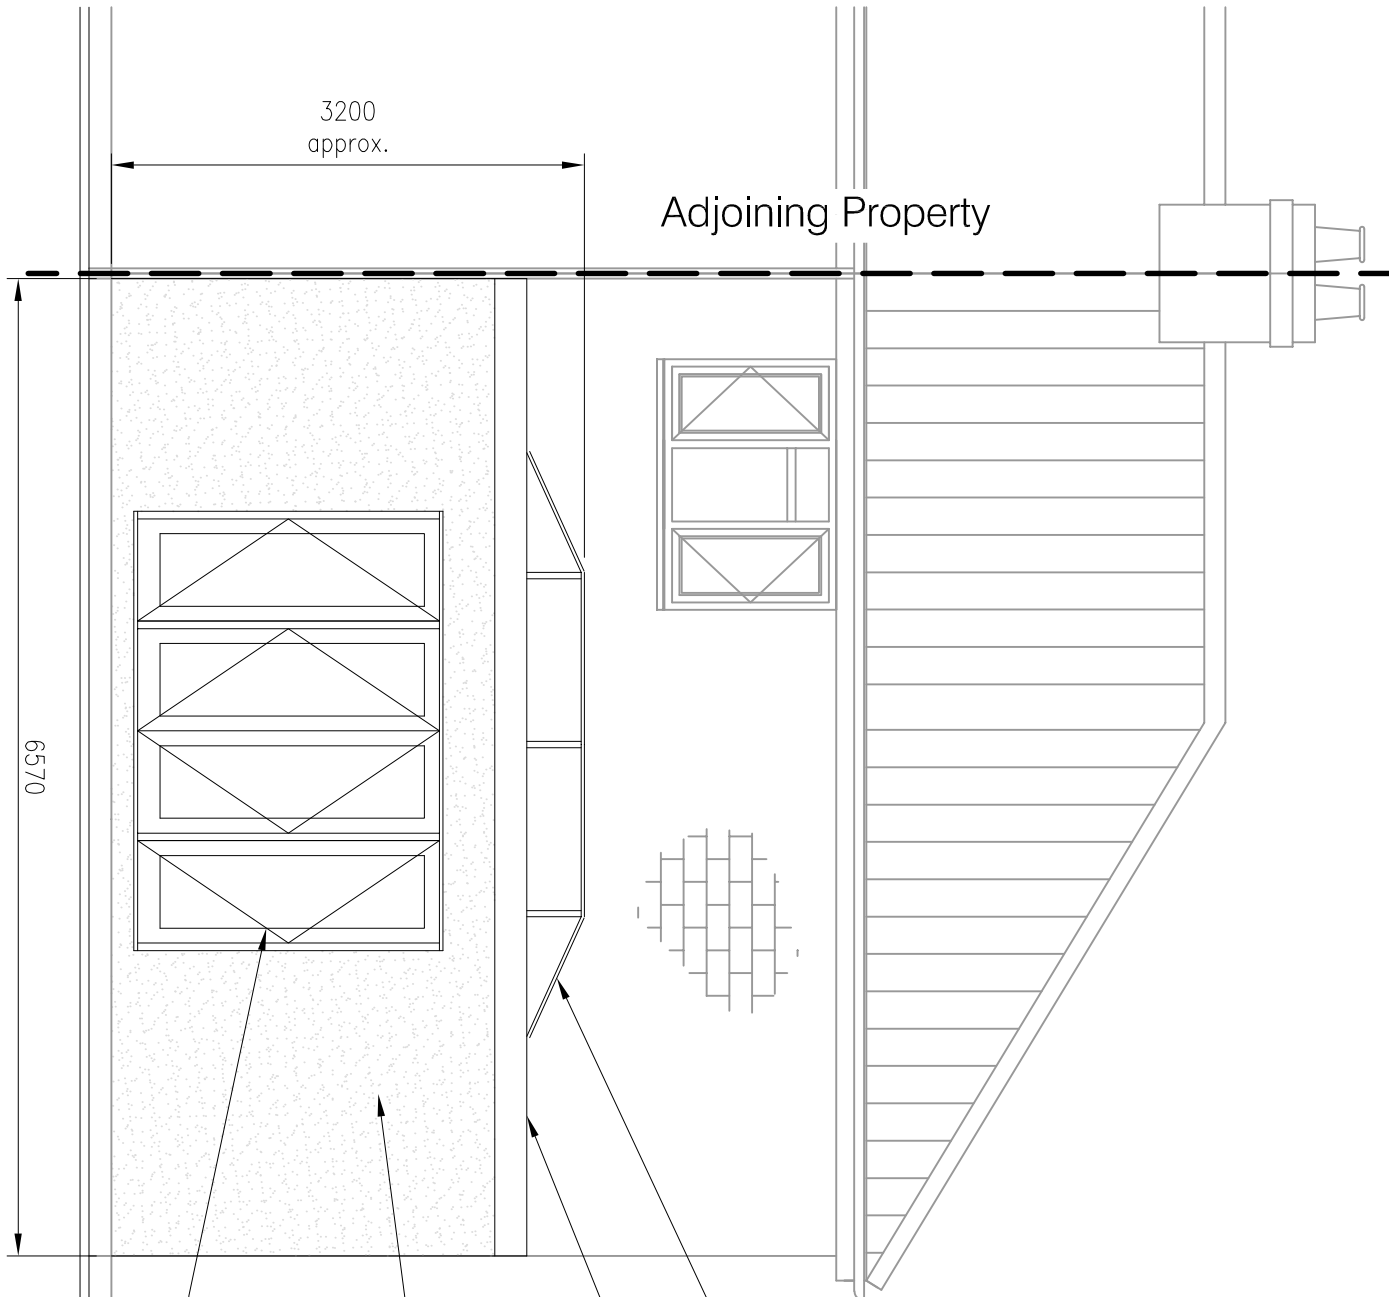


PROPOSED SIDE ELEVATION

1:50

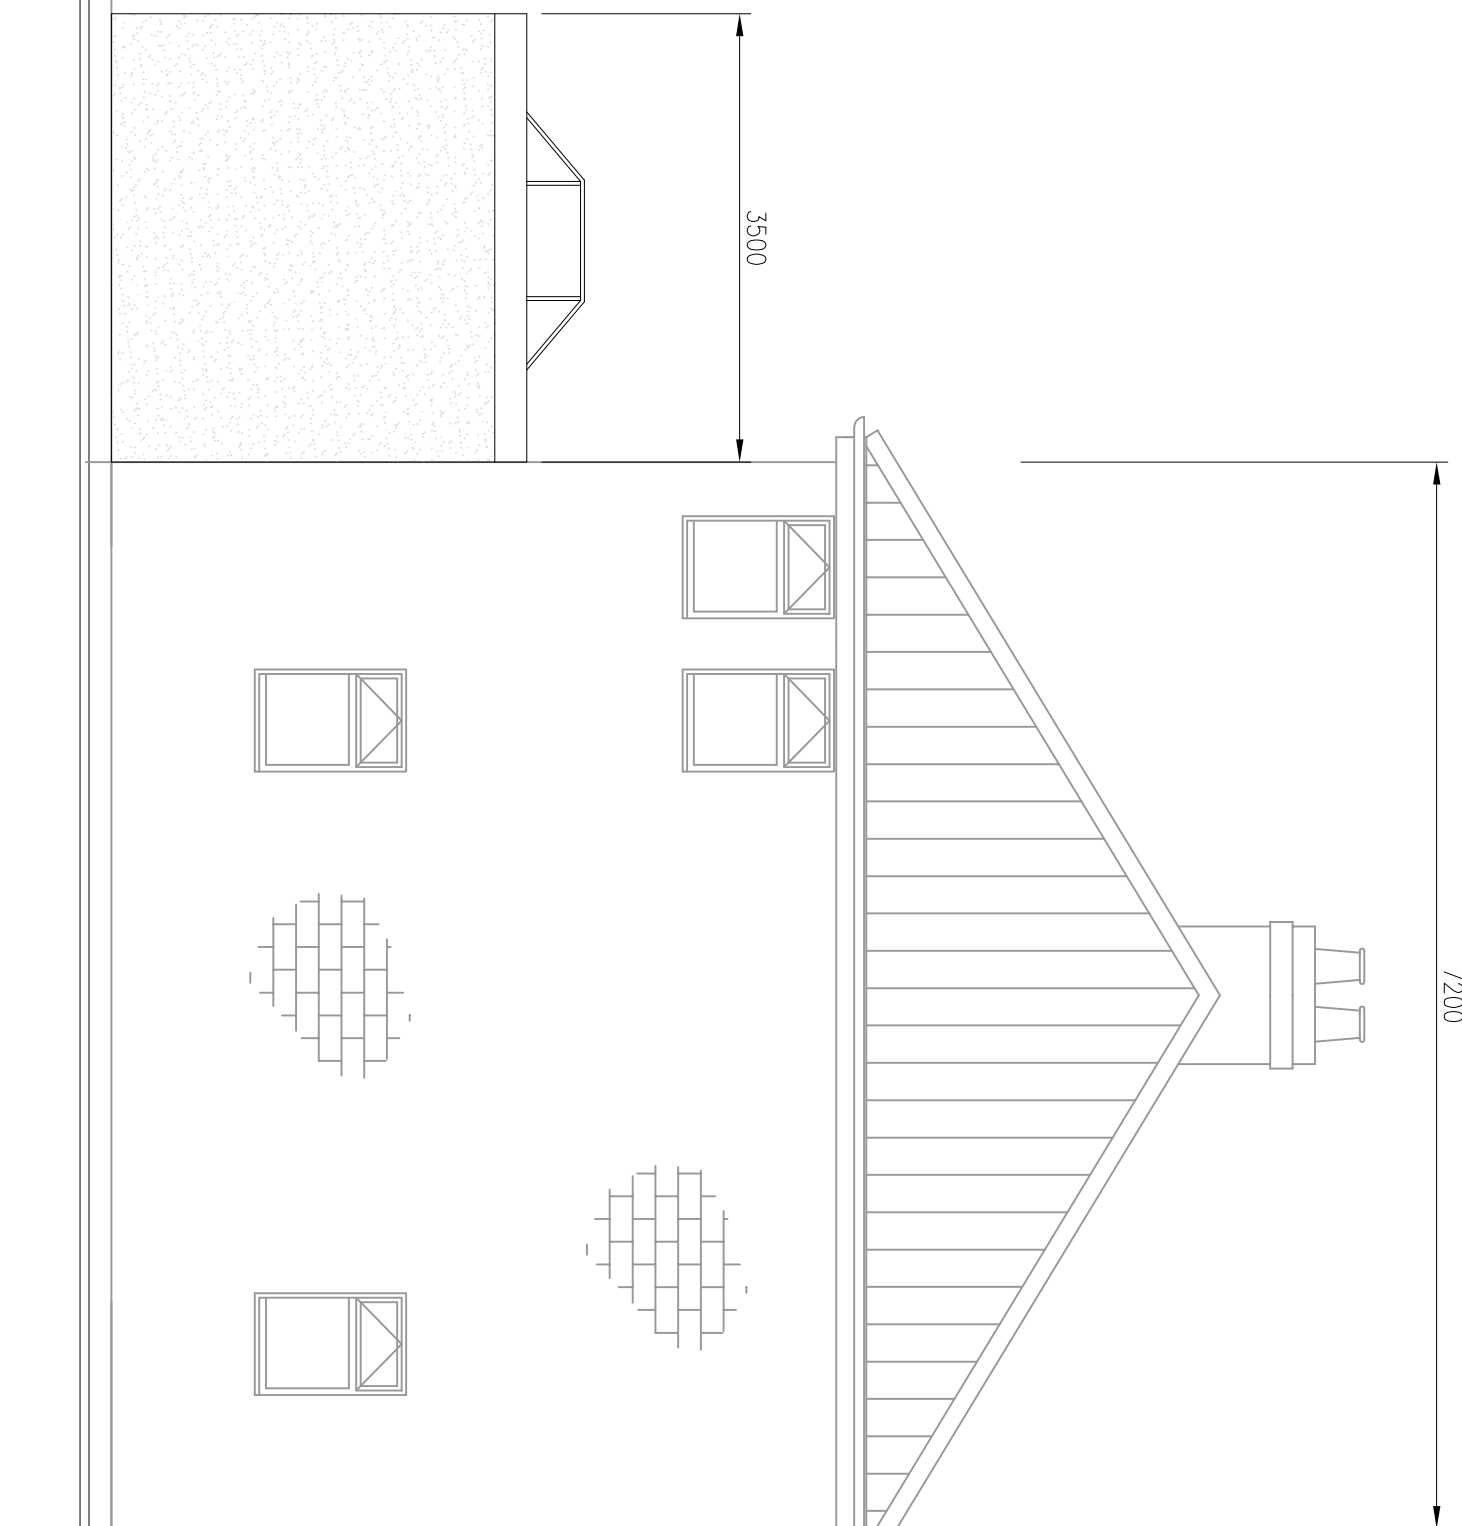

PROPOSED FRONT ELEVATION

1:50

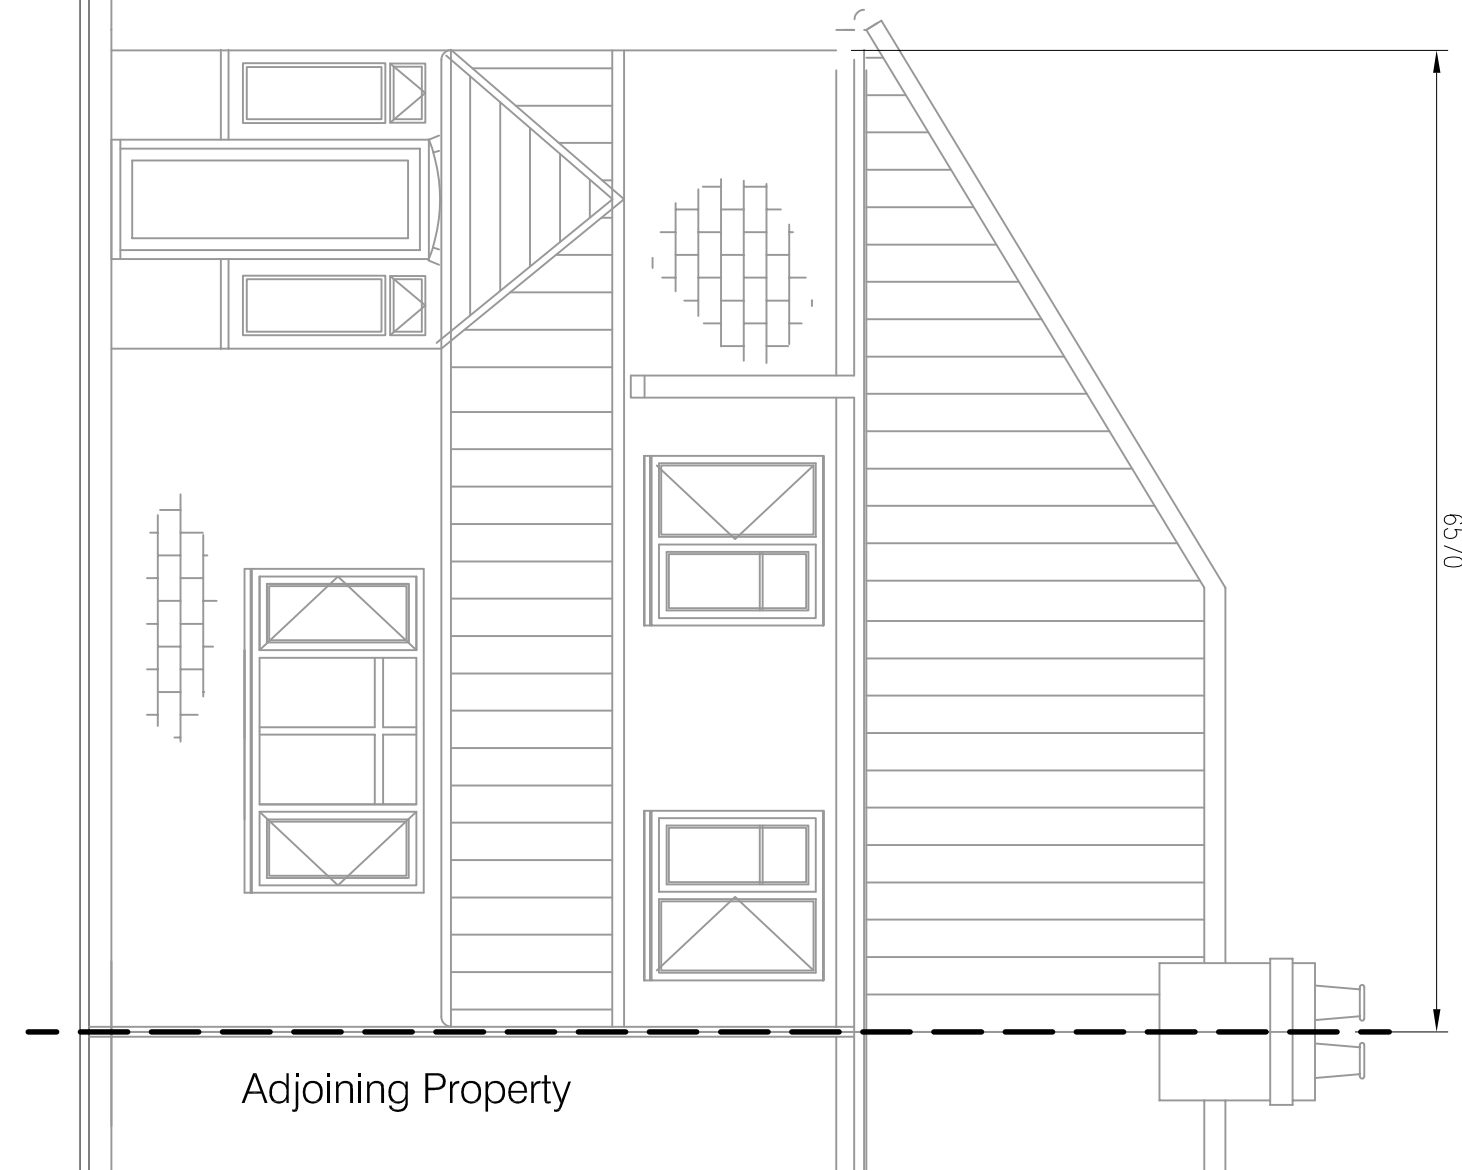

A	FOR PLANNING APPROVAL	AB	IS	AB	12.12.22
REV	DESCRIPTION	DRN	CHK	APP	DATE



APB DETAILING LTD

MR IAN SHIRT

101 NEVILLE AVE,
KENDRAY, BARNSLEY
S70 3HS

Drawing Title				
EXTENSION PLANNING PROPOSALS				
EXISTING AND PROPOSED				
ELEVATIONS				
	Name	Date	Scale	Revision
Drawn	APB	11/12/21	1:50	
	Title No.	Iron Shirt 101 Neelie Arching		
	Drawing Status	COMMENT		
Drawing No.	AB/10109/002			Revision A